



September, 1990
Supersedes Descriptive Bulletin 41-160,
pages 1-4, dated February, 1989
Mailed to: E, D, C/41-100A

Device Number: 46

Types COQ and POQ Negative Sequence Current Relays



COQ



POQ

Generator Protection Against Unbalanced Fault Currents

The COQ relay is designed to protect turbine or engine driven generators from damage due to thermal heating caused by negative sequence currents which flow during unbalanced faults on the power on the power system. These negative sequence currents, in turn, induce 120-hertz rotor currents which tend to flow in the surface of the rotor's solid forging, and in the non-magnetic wedges and retaining rings. The I²R loss caused by these induced currents can raise the machine temperature sufficiently to cause metal flow and resultant machine damage.

Its burden is sufficiently low to permit the use of existing current transformers. Potential transformers are not required.

Sensitive Instantaneous Detection of Unbalanced Currents on 3-Phase Systems

The POQ high-speed relay provides sensitive detection of unbalances or unbalanced faults in three-phase power systems. It is commonly used to detect unbalances on feeder or distribution circuits, or to detect

single phasing in generator or motor circuits.

Type POQ's sensitive polar unit is energized by the output of a negative sequence current filter. It will pickup on 0.5 ampere of negative sequence current and will withstand 5 amperes of positive sequence current continuously. It can detect phase failure on motor circuits having a maximum to minimum load variation as great as 5 to 1. The minimum single phased load current that can be detected is 1.0 ampere.

Since the POQ will operate for external faults, a timing relay such as type TD-5 should be used to effect coordination between the primary line relays and the POQ.

Type COQ Characteristics

Overcurrent Unit

The COQ negative sequence relay is available with the following negative sequence current taps: 3, 3.25, 3.5, 3.8, 4.2, 4.6, 5.0

These tap values represent the current transformer secondary amperes which correspond to one per unit generator current. At these values of negative sequence current, the moving contact will leave the time dial stop and reach the stationary contacts in a time as determined by the time dial setting and as shown by Figure 3. For example, with a time dial setting of 4 the relay will close its contacts in 30 seconds with the above tap currents applied to the relay.

As shown by the curves in Figure 4, the relay's characteristic is defined by a generator characteristic $I^2T = K$. The relay characteristic is such that it coincides with the generator characteristic at 1 per unit negative sequence current, but at higher values of negative sequence current the relay characteristic is substantially parallel and slightly less than the generator characteristic. In this manner, a suitable margin of safety is obtained between the two characteristics.

Figure 5 provides a means of selecting a time dial setting that will restrict unbalanced fault duration to the desired limit.

Figure 6 demonstrates the use of a tap setting lower than the full load current of the machine to accommodate I^2T limits of 7 and

10 while still providing wide contact spacing. For this figure, a tap setting of 3 is used with a machine full load current of 4 amperes.

Typical time-current curves of the relay are shown in Figure 3. Minimum pickup is approximately 0.6 of the tap value current.

Trip Circuit Data

Main contacts on the COQ induction disc unit will close 30 amperes at 250 volts d-c and will carry this current for sufficient time to trip a circuit breaker.

Type POQ

The POQ relay provides sensitive instantaneous detection of unbalanced currents in a three-phase power system. It is operated by negative sequence current, and has a high speed polar unit which can be used to initiate tripping, or to sound an alarm.

Common applications include its use to detect unbalanced loads on feeder circuits, or to avoid thermal damage to motors as caused by single-phasing.

Operation

The polar unit of the POQ is energized by the rectified output of a saturating transformer which is energized by the filter output. When the relay is energized by tap value negative sequence current, the polar unit contact closes to energize an auxiliary contactor switch (CS-1) coil which is connected across battery voltage. Operating time of the CS-1 switch is $\frac{3}{4}$ of a cycle, at the end of which time the trip circuit will be completed if the polar unit contact remains closed. Inclusion of the CS-1 switch, adds a desirable shock-proof feature to the relay.

Characteristics

The following negative sequence current taps are available on the Type POQ relay.

.5 .6 .8 .1 1.5 2.0 2.5


These taps represent the negative sequence current that will operate the relay. At these values of negative sequence current, the polar unit will close its contacts to pickup the time delay switch.

Operating Time

POQ operating time is 1 to 2 cycles (60 hertz base).

Construction – COQ and POQ in FT-21 Case

- ① **Filter Reactor** — The negative sequence current filter consists of a three-winding mutual reactor and a wire resistor assembly with adjustable sliders. It is factory-adjusted so that its output is proportional to the negative sequence current input.
- ② **Tap Block** — Taps provided on the tap block allow selection of the minimum negative sequence current input to the filter which will just cause the relay contacts to close (pickup is approx. 0.6 of tap value for the COQ).
- ③ **Time Dial (COQ Only)** — Positioning of the time dial at its various numbered settings determines the setting of the relay for the permissible $(I_2)^2t$ thermal characteristic of the protected machine.
- ④ **Stationary Contact** — *COQ* Made of silver. Has sufficient wipe to assure positive contact action. *POQ* The right hand contact of the POQ polar unit (see "P" in figure 0) is wired into the relay trip circuit. The lefthand stationary contact serves as a backstop for the moving contact assembly.
- ⑤ **Moving Contact** — *COQ* Clamped to an insulated section of the COQ's induction disc shaft. Current passes through a spiral spring to the moving contact. *POQ* The contacts of the polar unit are connected in series with an auxiliary contactor switch (CS-1) to avoid the possibility of undesired tripping due to vibration or accidental shock.
- ⑥ **Indicating Contactor Switch** — When energized, the ICS causes an operation indicator target to drop into visible position – indicating that the relay has operated.

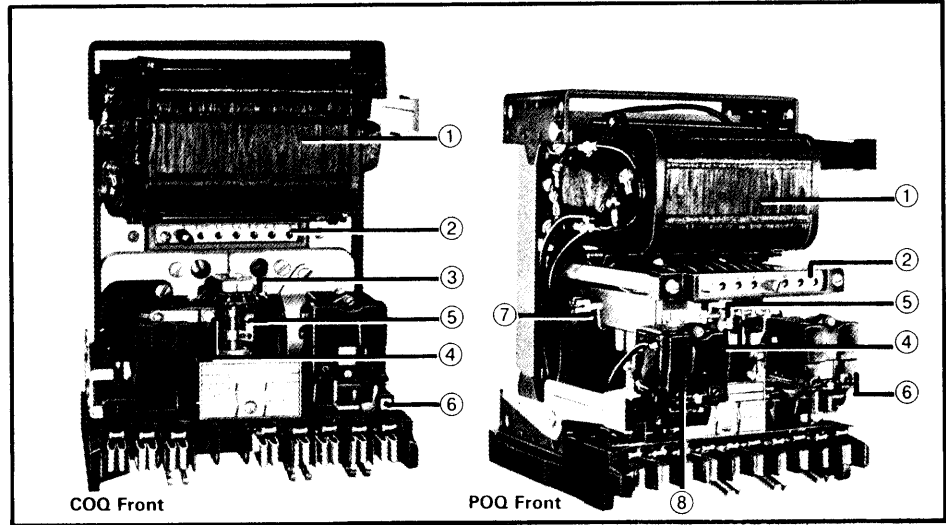

Resetting is manual, by means of a pushrod external to the case.

ICS Unit Burden and Rating

ICS Tap:	Coils Rating in Amps		Resistance in Ohms
Amps	Cont.	1 Second	
0.2	0.4	11.5	6.5
2.0	3.2	88.0	0.15

- ⑦ **Magnetic Shunt Screws (POQ Only)** — Sensitivity of the polar unit assembly is adjusted by means of two screw assemblies; one on each side of the unit's magnetic frame. Drawing out of the

left shunt increases the amount of current required to close the polar unit contact. Drawing out of the right hand shunt decreases the minimum trip current. Both shunts are held firmly in position by a spring-type clamp.

- ⑧ **Auxiliary Contactor Switch (CS-1) POQ only (not shown on photo)** — Energized by the closing of the polar unit contact. Prevents accidental closing of the relay contacts due to jarring of the relay panel. Operates in about 3/4 of a cycle. Has a coil resistance of about 170 ohms. The assembly does not include an operation indicator target.

ANSI Standards and Limitations

This material is reproduced from the "American Standard Requirements for Salient Pole Synchronous Generators and Condensers," C50.12-1965 and "American Standard Requirements for Cylindrical Rotor Synchronous Generators," C50.13-1965, copies of which may be purchased from the American National Standards Institute, 1430 Broadway, New York, N. Y. 10018.

C50.12

6. Short-Circuit Requirements

A machine shall be capable of withstanding, without injury, a 30-second, three-phase short circuit at its terminals when operating at rated kva and power factor, at 5 percent over-voltage, with fixed excitation. ② The machine shall also be capable of withstanding, without injury, any other short circuit at its terminals of a 30-second duration or less, provided the machine phase currents under fault conditions are such that the negative phase sequence current (I_2), expressed in terms of per unit stator current, at rated kva, and the duration of the fault in seconds (t), are limited to values which give an integrated product (I_2^2t) equal to or less than the values shown below, and provided also the maximum phase current is limited, by external means to a value which does not exceed the maximum phase current obtained from the three-phase fault.

Type of Synchronous Machine	Permissible I_2^2t ②
Salient pole generator	40
Synchronous condenser	30

② Machines subjected to faults between these limits and 200% of these limits may suffer varying degrees of damage: for faults in excess of 200% of these limits serious damage should be expected.

C50.13

6. Requirements for Abnormal Conditions

6.1 Armature Winding Short-Term Thermal Requirements

The generator armature shall be capable of operating a 130 percent of rated armature current for at least one minute, starting from stabilized temperatures at rated conditions.

Note 1: The permissible armature at currents times up to 120 seconds, based upon the same increment of heat storage as defined in 6.1, will be:

Time (seconds)	10	30	60	120
Armature current (percent)	226	154	130	116

Note 2: It is recognized that armature temperatures will exceed rated load values under these conditions and, therefore, the machine construction is based upon the assumption that the number of such operations at armature currents to the limits of Note 1 will occur not more than two times per year.

6.2 Field Winding Short-Time Thermal Requirements

The generator field winding shall be capable of operating at a field voltage of 125 percent of rated-load field voltage for at least one minute starting from stabilized temperatures at rated conditions.

Note 1: The permissible field voltages at times up to 120 seconds, based upon the same increment of heat storage as defined in 6.2, will be:

Time (seconds)	10	30	60	120
Field voltage (percent)	208	146	125	112

Note 2: It is recognized that field winding temperatures under these conditions will exceed rated-load values and, therefore, the machine construction is based upon the assumption that the number of such operations at field voltages to the limits of Note 1 will occur not more than two times per year.

6.3 Rotor Short-Time Thermal Requirements for Unbalanced Faults

The generator rotor shall be capable of withstanding, without injury, the effects of unbalanced short circuits at the armature terminals for times up to 120 seconds, based upon a constant rate of heat being generated and negligible heat dissipation, provided the integrated product (I_2^2T) of generator negative phase-sequence current (I_2) and time (T) does not exceed the values listed below. Negative-phase-sequence current shall be expressed in per unit stator current at rated kva and time shall be expressed in seconds.

Type of Cylindrical Rotor Synchronous Generator	Permissible I_2^2T ①
Conventionally-cooled	30
Conductor-cooled	10

① Generators subjected to faults between these limits and 200 percent of these limits may suffer varying degrees of damage; for faults in excess of 200 percent of these limits, serious damage may be expected.

6.4 Mechanical Requirements for Short Circuit

The generator shall be capable of withstanding, without mechanical injury, any type of short circuit at its terminals for times not exceeding short-time thermal requirements, when operating at rated kva and power factor and five percent over-voltage, provided the maximum phase current is limited by external means to a value which does not exceed the maximum phase current obtained from the three-phase fault.

Characteristics

27-D-5544

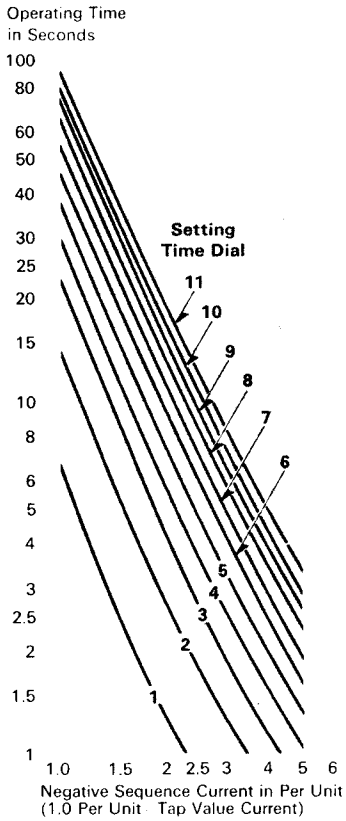


Fig. 3 Operating Time-current Curve

27-D-5543

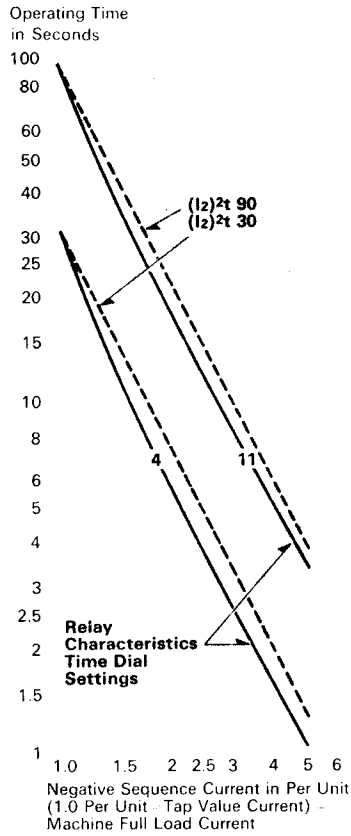


Fig. 4 Comparison of COQ relay $(I_2)^2t$ factor from 30 to 90.

27-D-5609

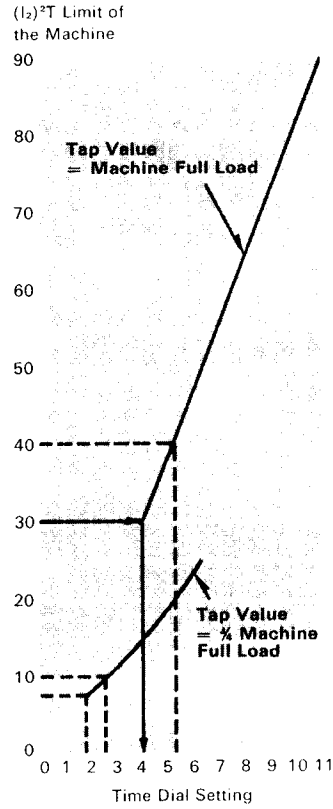


Fig. 5 Time Dial Setting Versus Permissible Constant of Generator

670B901

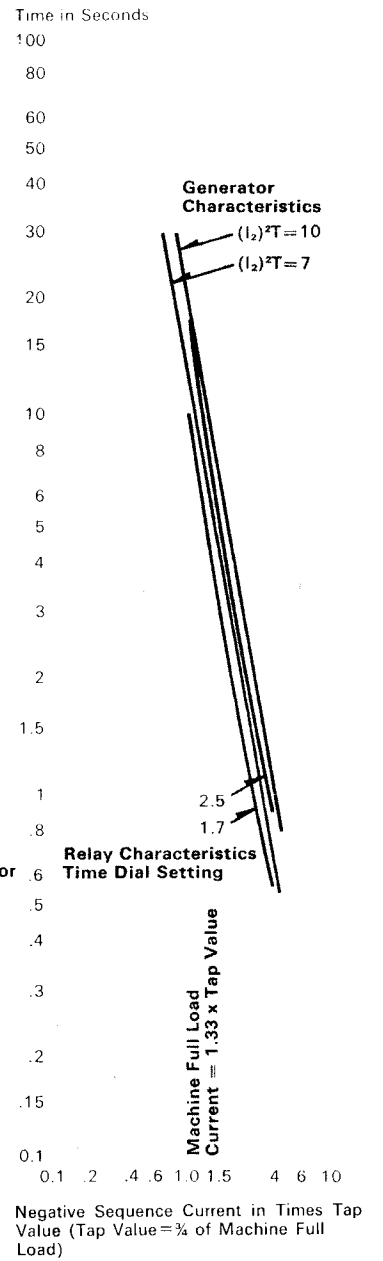


Fig. 6 Comparison of COQ relay and generator characteristics-Time versus Negative Sequence Current, for an $(I_2)^2T$ Factor from 7 to 10.

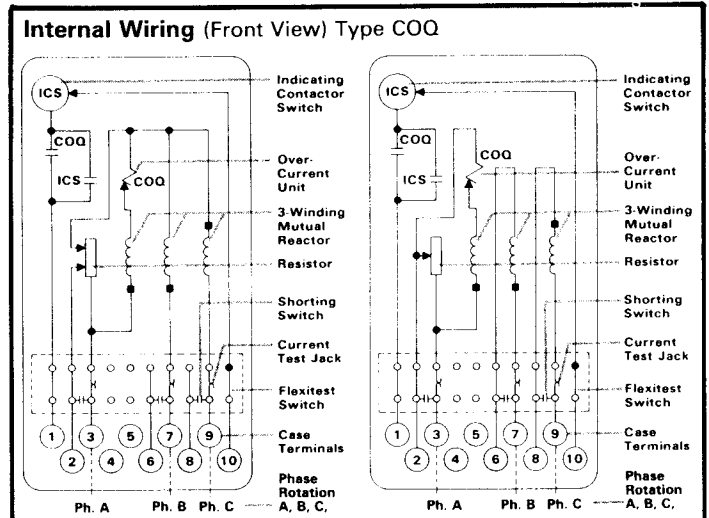


Figure 6: Neutral Connection of Three Phases Formed Within The Relay 182A973
Figure 7: Neutral Connection of Three Phases External to The Relay 183A484

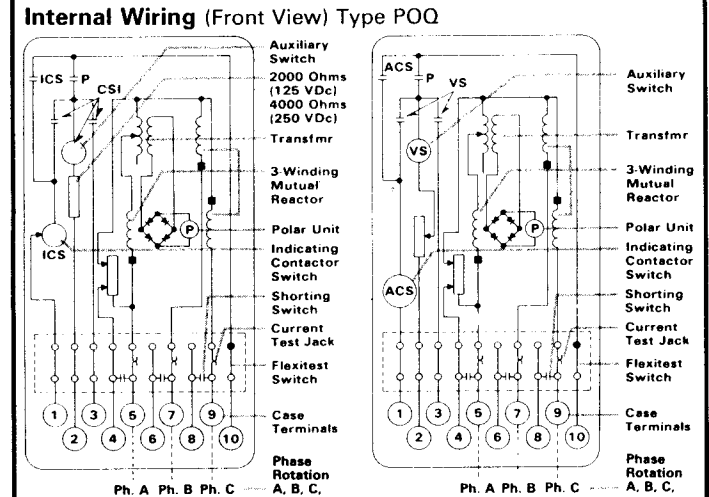


Figure 8: 183A794
Figure 9: Type POQ for Ac Controlled Trip Circuit 184A870

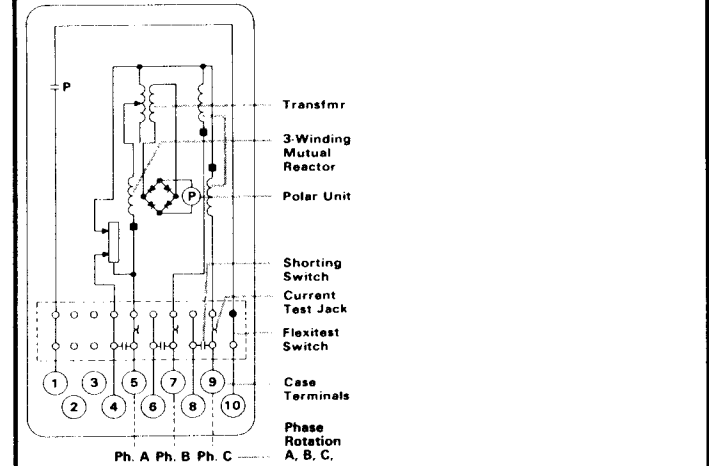


Figure 10: Type POQ Without ICS and Auxiliary Switch 187A264

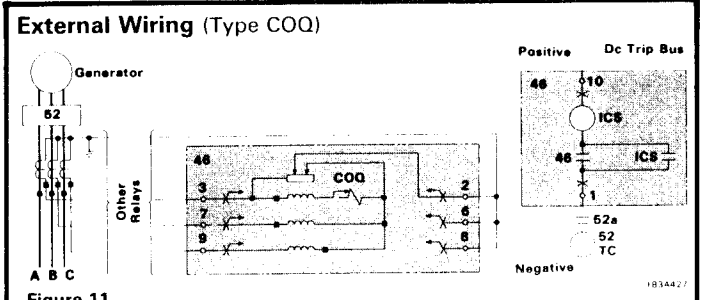


Figure 11: 183A427

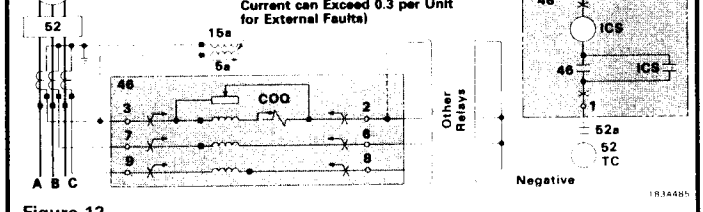


Figure 12: 183A485

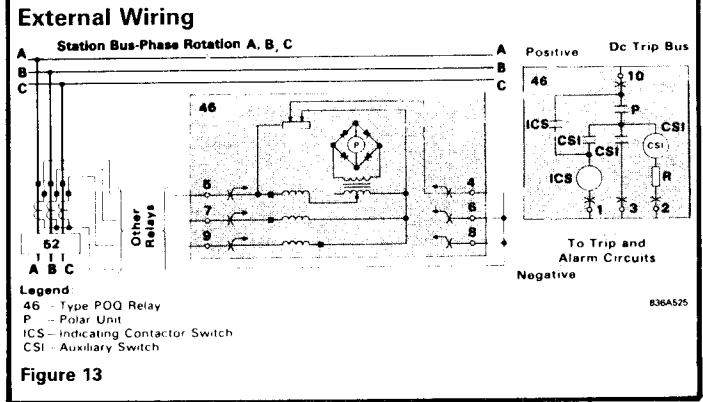


Figure 13: 836A525

Further Information

- List Prices: PL 41-020
- Technical Data: TD 41-025
- Instructions:
 - Type COQ, IL 41-161
 - Type POQ, IL 41-162.2
- Renewal Parts: RPD 41-918
- Flexitest Case Dimensions: DB 41-076
- Contactor Switches: DB 41-081
- Other Protective Relays:
 - Application Selector Guide, TD 41-016

Printed in U.S.A.



December, 1990
Supersedes TD 41-020, Types COQ and POQ
on page 36, dated November, 1987
Mailed to: E, D, C/41-100A

Types COQ and POQ Negative Sequence Current Relays

Overcurrent, Negative Sequence, Three Phase (Device Number: 46)

Type and Contacts	Application	Neutral Location	Indicating Contactor Switch ^③	Time Unit Current Range: Amps Ac	Circuit Control Volts: Dc	Relay Data Internal Schematic	Style Number	Case Size
COQ ^① With self-contained filter	Generator Protection	At relay	0.2/2.0 amp dc	3-5	...	182A973	3499A08A09 ^⑥	FT-21
		Remote from relay ^②		3-5	...	183A484	3499A08A11 ^⑥	
Spst-cc								
POQ With self-contained filter	Phase Protection	...	0.2/2.0 amp dc	0.2-1.0	24-48 125-250	183A794	774B289A11 774B289A09	
				0.5-2.5	24-48 125-250		774B289A12 774B289A10	
Spst-cc								

⑥ Denotes item available from stock.

① 50 Hertz relays and auxiliaries can be supplied at same price. Order "Similar to Style Number, except 50 Hertz".

② Use one style number 7881A01G03 (15/5 Amps) auxiliary current transformer when zero sequence current in relay can exceed 0.3 per unit. Refer to Instrument Transformer Dept., Raleigh, NC, for transformer pricing and shipment.

③ ICS: Indicating Contactor Switch (dc current operated) having seal-in contacts and indicating target which are actuated when the ICS coil is energized at or above pickup current setting. Suitable for dc control voltages up to and including 250 volts dc. Two current ranges available:
(1) 0.2/2.0 amps dc, with tapped coil.
(2) 1.0 amp dc, without taps.

Rating of ICS unit used in specific types of relays is shown in price tables. All other ratings must be negotiated.

When ac current is necessary in a control trip circuit, the ICS unit can be replaced by an ACS unit.

The ACS unit may be supplied in place of an ICS unit at no additional cost. Specify system voltage rating on order.