



**GE Power Management**

# **G60 Generator Management Relay**

## **UR Series Instruction Manual**

**G60 Revision: 2.9X**

Manual P/N: 1601-0110-B3 (GEK-106228B)

Copyright © 2002 GE Power Management



830702AY.CDR

### **GE Power Management**

215 Anderson Avenue, Markham, Ontario  
Canada L6E 1B3

Tel: (905) 294-6222 Fax: (905) 294-8512

Internet: <http://www.GEindustrial.com/pm>



Manufactured under an  
ISO9000 Registered system.





## **ADDENDUM**

This Addendum contains information that relates to the G60 Generator Management relay, version 2.9X. This addendum lists a number of information items that appear in the instruction manual GEK-106228B (1601-0110-B3) but are not included in the current G60 operations.

The following functions/items are not yet available with the current version of the G60 relay:

- Signal Sources SRC 5 to SRC 6

**NOTE:**

- The UCA2 specifications are not yet finalized. There will be changes to the object models described in Appendix C: UCA/MMS.

**GE Power Management**

215 Anderson Avenue, Markham, Ontario

Canada L6E 1B3

Tel: (905) 294-6222 Fax: (905) 294-8512

Internet: <http://www.GEindustrial.com/pm>



## TABLE OF CONTENTS

### 1. GETTING STARTED

#### 1.1 IMPORTANT PROCEDURES

1.1.1	CAUTIONS AND WARNINGS .....	1-1
1.1.2	INSPECTION CHECKLIST .....	1-1

#### 1.2 UR OVERVIEW

1.2.1	INTRODUCTION TO THE UR RELAY .....	1-2
1.2.2	UR HARDWARE ARCHITECTURE .....	1-3
1.2.3	UR SOFTWARE ARCHITECTURE .....	1-4
1.2.4	IMPORTANT UR CONCEPTS .....	1-4

#### 1.3 URPC SOFTWARE

1.3.1	PC REQUIREMENTS .....	1-5
1.3.2	SOFTWARE INSTALLATION .....	1-5
1.3.3	CONNECTING URPC® WITH THE G60 .....	1-6

#### 1.4 UR HARDWARE

1.4.1	MOUNTING AND WIRING .....	1-8
1.4.2	COMMUNICATIONS .....	1-8
1.4.3	FACEPLATE DISPLAY .....	1-8

#### 1.5 USING THE RELAY

1.5.1	FACEPLATE KEYPAD .....	1-9
1.5.2	MENU NAVIGATION .....	1-9
1.5.3	MENU HIERARCHY .....	1-9
1.5.4	RELAY ACTIVATION .....	1-10
1.5.5	BATTERY TAB .....	1-10
1.5.6	RELAY PASSWORDS .....	1-10
1.5.7	FLEXLOGIC™ CUSTOMIZATION .....	1-10
1.5.8	COMMISSIONING .....	1-10

### 2. PRODUCT DESCRIPTION

#### 2.1 INTRODUCTION

2.1.1	OVERVIEW .....	2-1
2.1.2	ORDERING .....	2-3

#### 2.2 TECHNICAL SPECIFICATIONS

2.2.1	PROTECTION ELEMENTS .....	2-5
2.2.2	USER-PROGRAMMABLE ELEMENTS .....	2-8
2.2.3	MONITORING .....	2-8
2.2.4	METERING .....	2-9
2.2.5	INPUTS .....	2-9
2.2.6	POWER SUPPLY .....	2-10
2.2.7	OUTPUTS .....	2-10
2.2.8	COMMUNICATIONS .....	2-10
2.2.9	ENVIRONMENTAL .....	2-10
2.2.10	TYPE TESTS .....	2-11
2.2.11	PRODUCTION TESTS .....	2-11
2.2.12	APPROVALS .....	2-11
2.2.13	MAINTENANCE .....	2-11

### 3. HARDWARE

#### 3.1 DESCRIPTION

3.1.1	PANEL CUTOUT .....	3-1
3.1.2	MODULE WITHDRAWAL / INSERTION .....	3-4
3.1.3	REAR TERMINAL LAYOUT .....	3-5

#### 3.2 WIRING

3.2.1	TYPICAL WIRING DIAGRAM .....	3-6
3.2.2	DIELECTRIC STRENGTH .....	3-7
3.2.3	CONTROL POWER .....	3-7
3.2.4	CT/VT MODULES .....	3-8
3.2.5	CONTACT INPUTS/OUTPUTS .....	3-10
3.2.6	TRANSDUCER INPUTS/OUTPUTS .....	3-16
3.2.7	RS232 FACEPLATE PROGRAM PORT .....	3-17
3.2.8	CPU COMMUNICATION PORTS .....	3-17
3.2.9	IRIG-B .....	3-19

## 4. HUMAN INTERFACES

### 4.1 URPC® SOFTWARE INTERFACE

4.1.1	GRAPHICAL USER INTERFACE .....	4-1
4.1.2	CREATING A SITE LIST .....	4-1
4.1.3	URPC® SOFTWARE OVERVIEW .....	4-1
4.1.4	URPC® SOFTWARE MAIN WINDOW .....	4-3

### 4.2 FACEPLATE INTERFACE

4.2.1	FACEPLATE .....	4-4
4.2.2	LED INDICATORS .....	4-5
4.2.3	CUSTOM LABELING OF LEDS .....	4-7
4.2.4	CUSTOMIZING THE DISPLAY MODULE .....	4-7
4.2.5	DISPLAY .....	4-8
4.2.6	KEYPAD .....	4-8
4.2.7	MENUS .....	4-9
4.2.8	CHANGING SETTINGS .....	4-10

## 5. SETTINGS

### 5.1 OVERVIEW

5.1.1	SETTINGS MAIN MENU .....	5-1
5.1.2	INTRODUCTION TO ELEMENTS .....	5-3
5.1.3	INTRODUCTION TO AC SOURCES .....	5-4

### 5.2 PRODUCT SETUP

5.2.1	PASSWORD SECURITY .....	5-7
5.2.2	DISPLAY PROPERTIES .....	5-8
5.2.3	COMMUNICATIONS .....	5-8
5.2.4	MODBUS® USER MAP .....	5-15
5.2.5	REAL TIME CLOCK .....	5-15
5.2.6	OSCILLOGRAPHY .....	5-16
5.2.7	DATA LOGGER .....	5-18
5.2.8	USER-PROGRAMMABLE LEDS .....	5-19
5.2.9	FLEX STATE PARAMETERS .....	5-20
5.2.10	USER-DEFINABLE DISPLAYS .....	5-20
5.2.11	INSTALLATION .....	5-22

### 5.3 SYSTEM SETUP

5.3.1	AC INPUTS .....	5-23
5.3.2	POWER SYSTEM .....	5-24
5.3.3	SIGNAL SOURCES .....	5-25
5.3.4	FLEXCURVES™ .....	5-27

### 5.4 FLEXLOGIC™

5.4.1	INTRODUCTION TO FLEXLOGIC™ .....	5-28
5.4.2	FLEXLOGIC™ RULES .....	5-35
5.4.3	FLEXLOGIC™ EVALUATION .....	5-35
5.4.4	FLEXLOGIC™ PROCEDURE EXAMPLE .....	5-35
5.4.5	FLEXLOGIC™ EQUATION EDITOR .....	5-40
5.4.6	FLEXLOGIC™ TIMERS .....	5-40
5.4.7	FLEXELEMENTS™ .....	5-41

### 5.5 GROUPED ELEMENTS

5.5.1	OVERVIEW .....	5-45
5.5.2	SETTING GROUP .....	5-45
5.5.3	POWER SWING DETECT .....	5-46
5.5.4	STATOR DIFFERENTIAL .....	5-52
5.5.5	CURRENT ELEMENTS .....	5-55
5.5.6	INVERSE TIME OVERCURRENT CURVE CHARACTERISTICS .....	5-56
5.5.7	PHASE CURRENT .....	5-61
5.5.8	NEUTRAL CURRENT .....	5-67
5.5.9	GROUND CURRENT .....	5-74
5.5.10	GENERATOR UNBALANCE .....	5-76
5.5.11	VOLTAGE ELEMENTS .....	5-78
5.5.12	PHASE VOLTAGE .....	5-79
5.5.13	NEUTRAL VOLTAGE .....	5-81
5.5.14	NEGATIVE SEQUENCE VOLTAGE .....	5-82
5.5.15	AUXILIARY VOLTAGE .....	5-83
5.5.16	VOLTS PER HERTZ .....	5-85

## TABLE OF CONTENTS

5.5.17	LOSS OF EXCITATION .....	5-88
5.5.18	ACCIDENTAL ENERGIZATION .....	5-90
5.5.19	SENSITIVE DIRECTIONAL POWER .....	5-92
5.5.20	STATOR GROUND .....	5-95
5.5.21	100% STATOR GROUND .....	5-96
5.5.22	THIRD HARMONIC NEUTRAL UNDERVOLTAGE .....	5-98
<b>5.6 CONTROL ELEMENTS</b>		
5.6.1	OVERVIEW .....	5-100
5.6.2	SETTING GROUPS .....	5-100
5.6.3	UNDERFREQUENCY .....	5-101
5.6.4	OVERFREQUENCY .....	5-102
5.6.5	SYNCHROCHECK .....	5-103
5.6.6	DIGITAL ELEMENTS .....	5-107
5.6.7	DIGITAL COUNTERS .....	5-110
5.6.8	MONITORING ELEMENTS .....	5-112
<b>5.7 INPUTS / OUTPUTS</b>		
5.7.1	CONTACT INPUTS .....	5-113
5.7.2	VIRTUAL INPUTS .....	5-115
5.7.3	UCA SBO TIMER .....	5-116
5.7.4	CONTACT OUTPUTS .....	5-116
5.7.5	VIRTUAL OUTPUTS .....	5-117
5.7.6	REMOTE DEVICES .....	5-117
5.7.7	REMOTE INPUTS .....	5-118
5.7.8	REMOTE OUTPUTS: DNA BIT PAIRS .....	5-119
5.7.9	REMOTE OUTPUTS: UserSt BIT PAIRS .....	5-120
5.7.10	RESETTING .....	5-120
<b>5.8 TRANSDUCER I/O</b>		
5.8.1	DCMA INPUTS .....	5-121
5.8.2	RTD INPUTS .....	5-122
<b>5.9 TESTING</b>		
5.9.1	TEST MODE .....	5-123
5.9.2	FORCE CONTACT INPUTS .....	5-123
5.9.3	FORCE CONTACT OUTPUTS .....	5-123

## 6. ACTUAL VALUES

<b>6.1 OVERVIEW</b>		
6.1.1	ACTUAL VALUES MAIN MENU .....	6-1
<b>6.2 STATUS</b>		
6.2.1	CONTACT INPUTS .....	6-3
6.2.2	VIRTUAL INPUTS .....	6-3
6.2.3	REMOTE INPUTS .....	6-3
6.2.4	CONTACT OUTPUTS .....	6-4
6.2.5	VIRTUAL OUTPUTS .....	6-4
6.2.6	REMOTE DEVICES STATUS .....	6-4
6.2.7	REMOTE DEVICES STATISTICS .....	6-5
6.2.8	DIGITAL COUNTERS .....	6-5
6.2.9	FLEX STATES .....	6-5
6.2.10	ETHERNET .....	6-5
<b>6.3 METERING</b>		
6.3.1	METERING CONVENTIONS .....	6-6
6.3.2	STATOR DIFFERENTIAL .....	6-9
6.3.3	SOURCES .....	6-9
6.3.4	SYNCHROCHECK .....	6-12
6.3.5	TRACKING FREQUENCY .....	6-12
6.3.6	FLEXELEMENTS™ .....	6-13
6.3.7	SENSITIVE DIRECTIONAL POWER .....	6-13
6.3.8	STATOR GROUND .....	6-14
6.3.9	VOLTS PER HERTZ .....	6-14
6.3.10	TRANSDUCER I/O .....	6-14
<b>6.4 RECORDS</b>		
6.4.1	EVENT RECORDS .....	6-15
6.4.2	OSCILLOGRAPHY .....	6-15

## TABLE OF CONTENTS

6.4.3	DATA LOGGER .....	6-15
-------	-------------------	------

### 6.5 PRODUCT INFORMATION

6.5.1	MODEL INFORMATION .....	6-16
6.5.2	FIRMWARE REVISIONS .....	6-16

## 7. COMMANDS AND TARGETS

### 7.1 COMMANDS

7.1.1	COMMANDS MENU .....	7-1
7.1.2	VIRTUAL INPUTS .....	7-1
7.1.3	CLEAR RECORDS .....	7-2
7.1.4	SET DATE AND TIME .....	7-2
7.1.5	RELAY MAINTENANCE .....	7-2

### 7.2 TARGETS

7.2.1	TARGETS MENU .....	7-3
7.2.2	RELAY SELF-TESTS .....	7-3

## 8. COMMISSIONING

### 8.1 PRODUCT SETUP

8.1.1	SETTINGS .....	8-1
-------	----------------	-----

### 8.2 SYSTEM SETUP

8.2.1	SETTINGS .....	8-8
8.2.2	FLEXCURVE A .....	8-9
8.2.3	FLEXCURVE B .....	8-10

### 8.3 FLEXLOGIC™

8.3.1	SETTINGS .....	8-11
-------	----------------	------

### 8.4 GROUPED ELEMENTS

8.4.1	SETTINGS .....	8-21
-------	----------------	------

### 8.5 CONTROL ELEMENTS

8.5.1	SETTINGS .....	8-25
-------	----------------	------

### 8.6 INPUTS / OUTPUTS

8.6.1	CONTACT INPUTS .....	8-30
8.6.2	VIRTUAL INPUTS .....	8-31
8.6.3	SBO TIMER .....	8-31
8.6.4	CONTACT OUTPUTS .....	8-32
8.6.5	VIRTUAL OUTPUTS .....	8-33
8.6.6	REMOTE DEVICES .....	8-34
8.6.7	REMOTE INPUTS .....	8-35
8.6.8	REMOTE OUTPUTS .....	8-36
8.6.9	RESETTING .....	8-36

### 8.7 TRANSDUCER I/O

8.7.1	DCMA INPUTS .....	8-37
8.7.2	RTD INPUTS .....	8-38

### 8.8 TESTING

8.8.1	FORCE CONTACT INPUTS/OUTPUTS .....	8-39
-------	------------------------------------	------

## A. FLEXANALOG PARAMETERS

### A.1 FLEXANALOG PARAMETERS

A.1.1	PARAMETER LIST .....	A-1
-------	----------------------	-----

## B. MODBUS® RTU PROTOCOL

### B.1 OVERVIEW

B.1.1	INTRODUCTION .....	B-1
B.1.2	PHYSICAL LAYER .....	B-1
B.1.3	DATA LINK LAYER .....	B-1
B.1.4	CRC-16 ALGORITHM .....	B-3



## TABLE OF CONTENTS

### B.2 FUNCTION CODES

B.2.1	SUPPORTED FUNCTION CODES .....	B-4
B.2.2	03H/04H: READ ACTUAL VALUES OR SETTINGS .....	B-4
B.2.3	05H: EXECUTE OPERATION .....	B-5
B.2.4	06H: STORE SINGLE SETTING .....	B-5
B.2.5	10H: STORE MULTIPLE SETTINGS.....	B-6
B.2.6	EXCEPTION RESPONSES .....	B-6

### B.3 FILE TRANSFERS

B.3.1	OBTAINING UR FILES USING MODBUS® PROTOCOL.....	B-7
B.3.2	MODBUS® PASSWORD OPERATION .....	B-8

### B.4 MEMORY MAPPING

B.4.1	MODBUS® MEMORY MAP .....	B-9
B.4.2	MODBUS® MEMORY MAP DATA FORMATS .....	B-41

---

## C. UCA/MMS

### C.1 UCA/MMS OVERVIEW

C.1.1	UCA.....	C-1
C.1.2	MMS.....	C-1
C.1.3	UCA REPORTING .....	C-6

---

## D. IEC 60870-5-104

### D.1 IEC 60870-5-104 PROTOCOL

D.1.1	INTEROPERABILITY DOCUMENT .....	D-1
D.1.2	POINT LIST.....	D-10

---

## E. DNP

### E.1 DNP DEVICE PROFILE

E.1.1	DNP V3.00 DEVICE PROFILE .....	E-1
-------	--------------------------------	-----

### E.2 DNP IMPLEMENTATION TABLE

E.2.1	IMPLEMENTATION TABLE .....	E-4
-------	----------------------------	-----

### E.3 DNP POINT LISTS

E.3.1	BINARY INPUT POINTS.....	E-8
E.3.2	BINARY OUTPUT AND CONTROL RELAY OUTPUT .....	E-13
E.3.3	COUNTERS .....	E-14
E.3.4	ANALOG INPUTS .....	E-15

---

## F. MISCELLANEOUS

### F.1 CHANGE NOTES

F.1.1	REVISION HISTORY .....	F-1
F.1.2	CHANGES IN G60 MANUAL .....	F-1

### F.2 FIGURES AND TABLES

F.2.1	LIST OF FIGURES.....	F-2
F.2.2	LIST OF TABLES.....	F-3

### F.3 ABBREVIATIONS

F.3.1	STANDARD ABBREVIATIONS .....	F-5
-------	------------------------------	-----

### F.4 WARRANTY

F.4.1	GE POWER MANAGEMENT WARRANTY .....	F-7
-------	------------------------------------	-----

---

## INDEX



Please read this chapter to help guide you through the initial setup of your new relay.

### 1.1.1 CAUTIONS AND WARNINGS



WARNING



CAUTION

Before attempting to install or use the relay, it is imperative that all **WARNINGS** and **CAUTIONS** in this manual are reviewed to help prevent personal injury, equipment damage, and/or downtime.

### 1.1.2 INSPECTION CHECKLIST

- Open the relay packaging and inspect the unit for physical damage.
- Check that the battery tab is intact on the power supply module (for more details, see the section BATTERY TAB in this chapter).
- View the rear name-plate and verify that the correct model has been ordered.

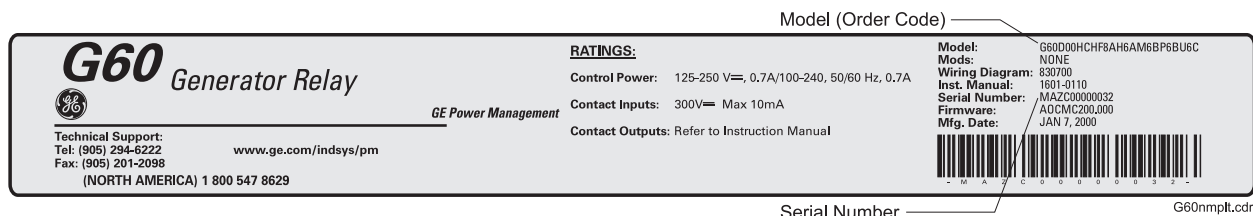


Figure 1-1: REAR NAME-PLATE (EXAMPLE)

- Ensure that the following items are included:
  - Instruction Manual
  - Products CD (includes URPC software and manuals in PDF format)
  - mounting screws
  - registration card (attached as the last page of the manual)
- Fill out the registration form and mail it back to GE Power Management (include the serial number located on the rear nameplate).
- For product information, instruction manual updates, and the latest software updates, please visit the GE Power Management Home Page.



NOTE

If there is any noticeable physical damage, or any of the contents listed are missing, please contact GE Power Management immediately.

#### GE POWER MANAGEMENT CONTACT INFORMATION AND CALL CENTER FOR PRODUCT SUPPORT:

GE Power Management  
215 Anderson Avenue  
Markham, Ontario  
Canada L6E 1B3

**TELEPHONE:** (905) 294-6222, 1-800-547-8629 (North America only)  
**FAX:** (905) 201-2098  
**E-MAIL:** info.pm@indsys.ge.com  
**HOME PAGE:** http://www.GEindustrial.com/pm

### 1.2.1 INTRODUCTION TO THE UR RELAY

Historically, substation protection, control, and metering functions were performed with electromechanical equipment. This first generation of equipment was gradually replaced by analog electronic equipment, most of which emulated the single-function approach of their electromechanical precursors. Both of these technologies required expensive cabling and auxiliary equipment to produce functioning systems.

Recently, digital electronic equipment has begun to provide protection, control, and metering functions. Initially, this equipment was either single function or had very limited multi-function capability, and did not significantly reduce the cabling and auxiliary equipment required. However, recent digital relays have become quite multi-functional, reducing cabling and auxiliaries significantly. These devices also transfer data to central control facilities and Human Machine Interfaces using electronic communications. The functions performed by these products have become so broad that many users now prefer the term IED (Intelligent Electronic Device).

It is obvious to station designers that the amount of cabling and auxiliary equipment installed in stations can be even further reduced, to 20% to 70% of the levels common in 1990, to achieve large cost reductions. This requires placing even more functions within the IEDs.

Users of power equipment are also interested in reducing cost by improving power quality and personnel productivity, and as always, in increasing system reliability and efficiency. These objectives are realized through software which is used to perform functions at both the station and supervisory levels. The use of these systems is growing rapidly.

High speed communications are required to meet the data transfer rates required by modern automatic control and monitoring systems. In the near future, very high speed communications will be required to perform protection signaling with a performance target response time for a command signal between two IEDs, from transmission to reception, of less than 5 milliseconds. This has been established by the Electric Power Research Institute, a collective body of many American and Canadian power utilities, in their Utilities Communications Architecture 2 (MMS/UCA2) project. In late 1998, some European utilities began to show an interest in this ongoing initiative.

IEDs with the capabilities outlined above will also provide significantly more power system data than is presently available, enhance operations and maintenance, and permit the use of adaptive system configuration for protection and control systems. This new generation of equipment must also be easily incorporated into automation systems, at both the station and enterprise levels. The GE Power Management Universal Relay (UR) has been developed to meet these goals.

## 1.2.2 UR HARDWARE ARCHITECTURE

1

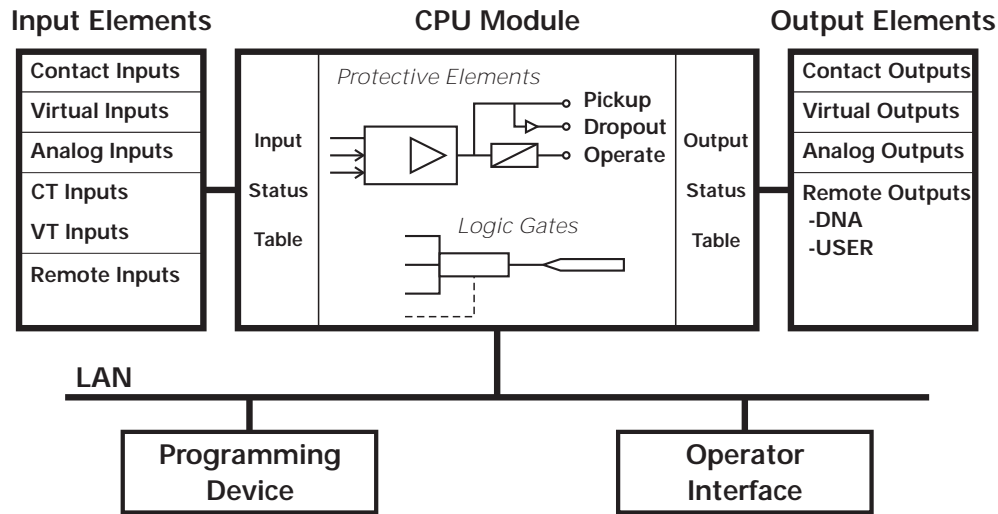


Figure 1-2: UR CONCEPT BLOCK DIAGRAM

827822A1.CDR

## a) UR BASIC DESIGN

The UR is a digital-based device containing a central processing unit (CPU) that handles multiple types of input and output signals. The UR can communicate over a local area network (LAN) with an operator interface, a programming device, or another UR device.

The **CPU module** contains firmware that provides protection elements in the form of logic algorithms, as well as programmable logic gates, timers, and latches for control features.

**Input elements** accept a variety of analog or digital signals from the field. The UR isolates and converts these signals into logic signals used by the relay.

**Output elements** convert and isolate the logic signals generated by the relay into digital or analog signals that can be used to control field devices.

## b) UR SIGNAL TYPES

The **contact inputs and outputs** are digital signals associated with connections to hard-wired contacts. Both 'wet' and 'dry' contacts are supported.

The **virtual inputs and outputs** are digital signals associated with UR internal logic signals. Virtual inputs include signals generated by the local user interface. The virtual outputs are outputs of FlexLogic™ equations used to customize the UR device. Virtual outputs can also serve as virtual inputs to FlexLogic™ equations.

The **analog inputs and outputs** are signals that are associated with transducers, such as Resistance Temperature Detectors (RTDs).

The **CT and VT inputs** refer to analog current transformer and voltage transformer signals used to monitor AC power lines. The UR supports 1 A and 5 A CTs.

The **remote inputs and outputs** provide a means of sharing digital point state information between remote UR devices. The remote outputs interface to the remote inputs of other UR devices. Remote outputs are FlexLogic™ operands inserted into UCA2 GOOSE messages and are of two assignment types: DNA standard functions and USER defined functions.

## c) UR SCAN OPERATION

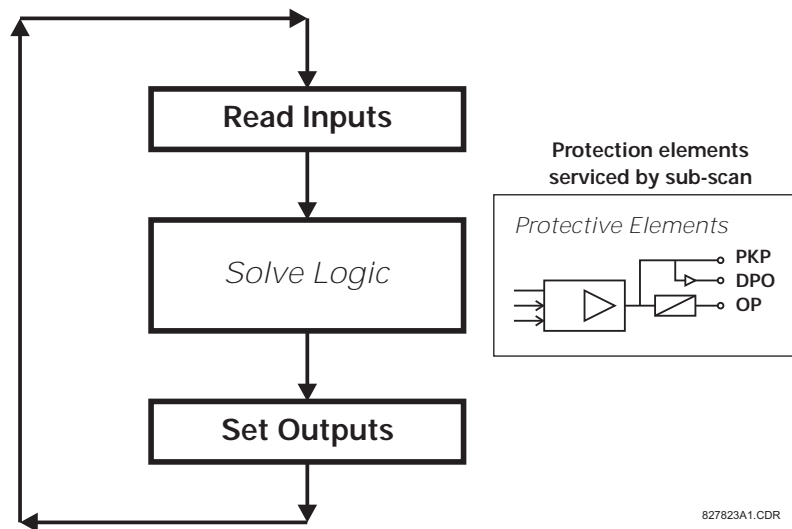


Figure 1–3: UR SCAN OPERATION

The UR device operates in a cyclic scan fashion. The UR reads the inputs into an input status table, solves the logic program (FlexLogic™ equation), and then sets each output to the appropriate state in an output status table. Any resulting task execution is priority interrupt-driven.

## 1.2.3 UR SOFTWARE ARCHITECTURE

The firmware (software embedded in the relay) is designed in functional modules which can be installed in any relay as required. This is achieved with Object-Oriented Design and Programming (OOD/OOP) techniques.

Object-Oriented techniques involve the use of 'objects' and 'classes'. An 'object' is defined as "a logical entity that contains both data and code that manipulates that data". A 'class' is the generalized form of similar objects. By using this concept, one can create a Protection Class with the Protection Elements as objects of the class such as Time Overcurrent, Instantaneous Overcurrent, Current Differential, Undervoltage, Overvoltage, Underfrequency, and Distance. These objects represent completely self-contained software modules. The same object-class concept can be used for Metering, I/O Control, HMI, Communications, or any functional entity in the system.

Employing OOD/OOP in the software architecture of the Universal Relay achieves the same features as the hardware architecture: modularity, scalability, and flexibility. The application software for any Universal Relay (e.g. Feeder Protection, Transformer Protection, Distance Protection) is constructed by combining objects from the various functionality classes. This results in a 'common look and feel' across the entire family of UR platform-based applications.

## 1.2.4 IMPORTANT UR CONCEPTS

As described above, the architecture of the UR relay is different from previous devices. In order to achieve a general understanding of this device, some sections of Chapter 5 are quite helpful. The most important functions of the relay are contained in "Elements". A description of UR elements can be found in the INTRODUCTION TO ELEMENTS section. An example of a simple element, and some of the organization of this manual, can be found in the DIGITAL ELEMENTS MENU section. An explanation of the use of inputs from CTs and VTs is in the INTRODUCTION TO AC SOURCES section. A description of how digital signals are used and routed within the relay is contained in the INTRODUCTION TO FLEX-LOGIC™ section.

## 1.3.1 PC REQUIREMENTS

1

The Faceplate keypad and display or the URPC software interface can be used to communicate with the relay.

The URPC software interface is the preferred method to edit settings and view actual values because the PC monitor can display more information in a simple comprehensible format.

The following minimum requirements must be met for the URPC software to properly operate on a PC.

Processor:	Intel® Pentium 300 or higher
RAM Memory:	64 MB minimum (128 MB recommended)
Hard Disk:	50 MB free space required before installation of URPC software
O/S:	Windows® NT 4.x or Windows® 9x/2000
Device:	CD-ROM drive
Port:	COM1(2) / Ethernet

## 1.3.2 SOFTWARE INSTALLATION

Refer to the following procedure to install the URPC software:

1. **Start** the Windows® operating system.
2. **Insert** the URPC software CD into the CD-ROM drive.
3. If the installation program does not start automatically, choose **Run** from the Windows® **Start** menu and type D:\SETUP.EXE. Press Enter to start the installation.
4. Follow the on-screen instructions to install the URPC software. When the **Welcome** window appears, click on **Next** to continue with the installation procedure.
5. When the **Choose Destination Location** window appears and if the software is not to be located in the default directory, click **Browse** and type in the complete path name including the new directory name.
6. Click **Next** to continue with the installation procedure.
7. The default program group where the application will be added to is shown in the **Select Program Folder** window. If it is desired that the application be added to an already existing program group, choose the group name from the list shown.
8. Click **Next** to begin the installation process.
9. To launch the URPC application, click Finish in the Setup Complete window.
10. Subsequently, double click on the URPC software icon to activate the application.



**Refer to the HUMAN INTERFACES chapter in this manual and the URPC Software Help program for more information about the URPC software interface.**

NOTE

## 1.3.3 CONNECTING URPC® WITH THE G60

This section is intended as a quick start guide to using the URPC software. Please refer to the URPC Help File and the HUMAN INTERFACES chapter for more information.

**a) CONFIGURING AN ETHERNET CONNECTION**

Before starting, verify that the Ethernet network cable is properly connected to the Ethernet port on the back of the relay.

1. Start the URPC software. Enter the password "URPC" at the login password box.
2. Select the **Help > Connection Wizard** menu item to open the Connection Wizard. Click "Next" to continue.
3. Click the "New Interface" button to open the Edit New Interface window.
  - Enter the desired interface name in the **Enter Interface Name** field.
  - Select the "Ethernet" interface from the drop down list and press "Next" to continue.
4. Click the "New Device" button to open the Edit New Device Window.
  - Enter the desired name in the **Enter Interface Name** field.
  - Enter the Modbus address of the relay (from **SETTINGS** ⇒ **PRODUCT SETUP** ⇒ **COMMUNICATIONS** ⇒ **MODBUS PROTOCOL** ⇒ **MODBUS SLAVE ADDRESS**) in the **Enter Modbus Address** field.
  - Enter the IP address (from **SETTINGS** ⇒ **PRODUCT SETUP** ⇒ **COMMUNICATIONS** ⇒ **NETWORK** ⇒ **IP ADDRESS**) in the **Enter TCP/IP Address** field.
5. Click the "4.1 Read Device Information" button then "OK" when the relay information has been received. Click "Next" to continue.
6. Click the "New Site" button to open the Edit Site Name window.
  - Enter the desired site name in the **Enter Site Name** field.
7. Click the "OK" button then click "Finish". The new Site List tree will be added to the Site List window (or Online window) located in the top left corner of the main URPC window.

The Site Device has now been configured for Ethernet communications. Proceed to Section c) CONNECTING TO THE RELAY below to begin communications.

**b) CONFIGURING AN RS232 CONNECTION**

Before starting, verify that the RS232 serial cable is properly connected to the RS232 port on the front panel of the relay.


1. Start the URPC software. Enter the password "URPC" at the login password box.
2. Select the **Help > Connection Wizard** menu item to open the Connection Wizard. Click "Next" to continue.
3. Click the "New Interface" button to open the Edit New Interface window.
  - Enter the desired interface name in the **Enter Interface Name** field.
  - Select the "RS232" interface from the drop down list and press "Next" to continue.
4. Click the "New Device" button to open the Edit New Device Window.
  - Enter the desired name in the **Enter Interface Name** field.
  - Enter the PC COM port number in the **COM Port** field.
5. Click "OK" then click "Next" to continue.
6. Click the "New Site" button to open the Edit Site Name window.
  - Enter the desired site name in the **Enter Site Name** field.
7. Click the "OK" button then click "Finish". The new Site List tree will be added to the Site List window (or Online window) located in the top left corner of the main URPC window.

The Site Device has now been configured for RS232 communications. Proceed to Section c) CONNECTING TO THE RELAY below to begin communications.



**c) CONNECTING TO THE RELAY**

1. Select the Display Properties window through the Site List tree as shown below:

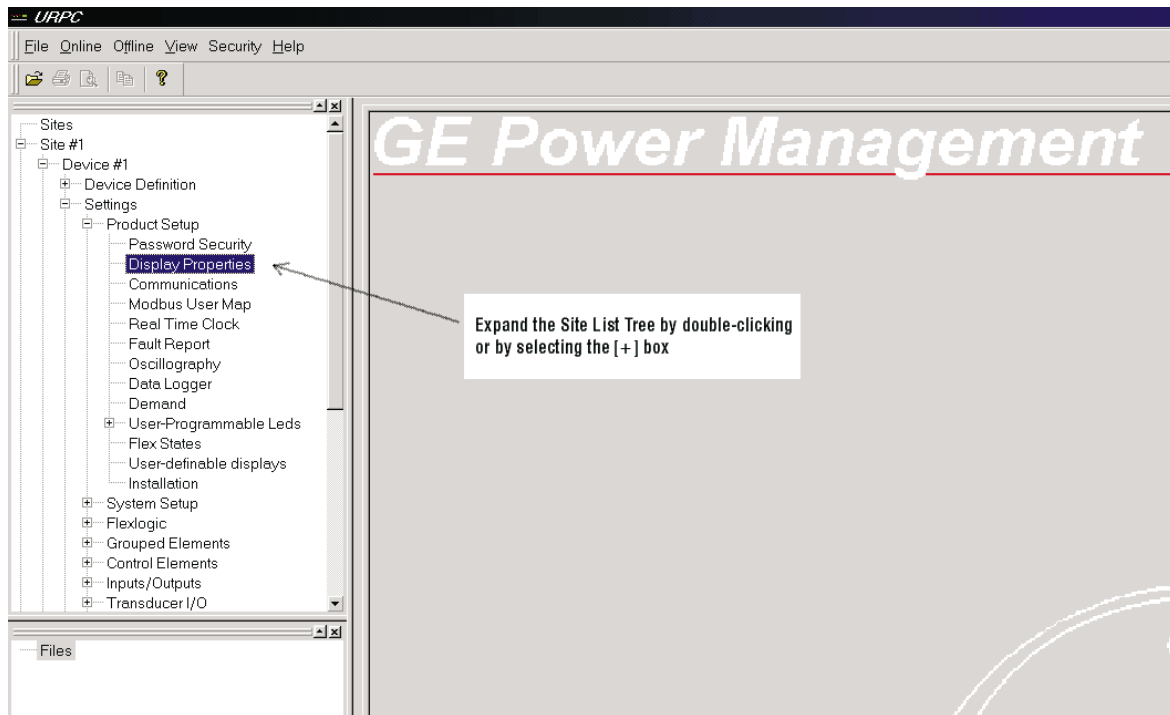

2. The Display Properties window will open with a flashing status indicator.
  - If the indicator is red, click the Connect button (lightning bolt) in the menu bar of the Displayed Properties window.
3. In a few moments, the flashing light should turn green, indicating that URPC is communicating with the relay.



**Refer to the HUMAN INTERFACES chapter in this manual and the URPC Software Help program for more information about the URPC software interface.**


NOTE

## 1.4.1 MOUNTING AND WIRING

Please refer to the **HARDWARE** chapter for detailed relay mounting and wiring instructions. Review all **WARNINGS AND CAUTIONS**.

## 1.4.2 COMMUNICATIONS

The URPC software communicates to the relay via the faceplate RS232 port or the rear panel RS485 / Ethernet ports. To communicate via the faceplate RS232 port, a standard "straight-through" serial cable is used. The DB-9 male end is connected to the relay and the DB-9 or DB-25 female end is connected to the PC COM1 or COM2 port as described in the **HARDWARE** chapter.

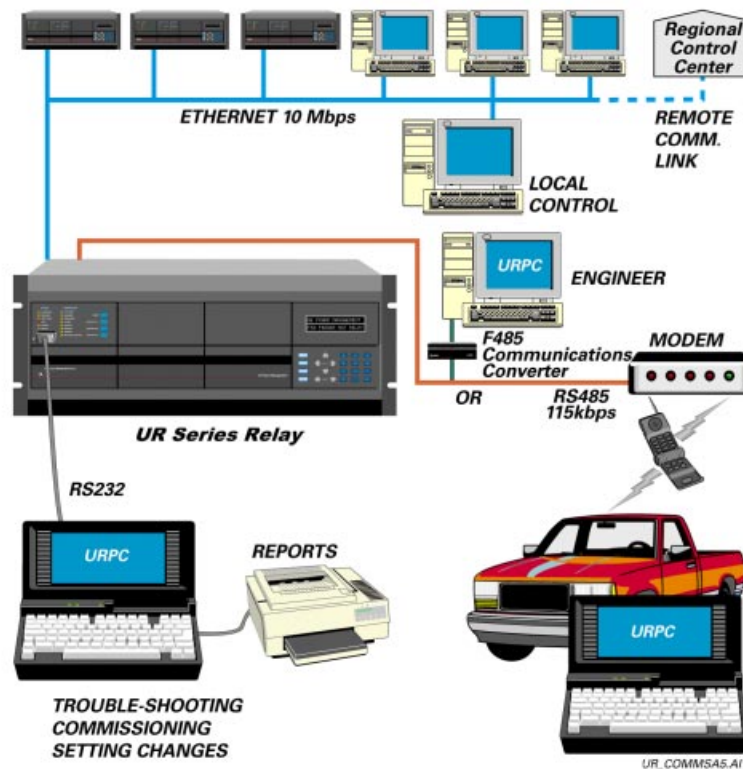

**Figure 1-4: RELAY COMMUNICATIONS OPTIONS**

To communicate through the G60 rear RS485 port from a PC RS232 port, the GE Power Management RS232/RS485 converter box is required. This device (catalog number F485) connects to the computer using a "straight-through" serial cable. A shielded twisted-pair (20, 22, or 24 AWG) connects the F485 converter to the G60 rear communications port. The converter terminals (+, -, GND) are connected to the G60 communication module (+, -, COM) terminals. Refer to the **CPU COMMUNICATION PORTS** section in the **HARDWARE** chapter for option details. The line should be terminated with an R-C network (i.e. 120  $\Omega$ , 1 nF) as described in the **HARDWARE** chapter.

## 1.4.3 FACEPLATE DISPLAY

All messages are displayed on a 2  $\times$  20 character vacuum fluorescent display to make them visible under poor lighting conditions. Messages are displayed in English and do not require the aid of an instruction manual for deciphering. While the keypad and display are not actively being used, the display will default to defined messages. Any high priority event driven message will automatically override the default message and appear on the display.

## 1.5.1 FACEPLATE KEYPAD

1


Display messages are organized into 'pages' under the following headings: Actual Values, Settings, Commands, and Targets. The **MENU** key navigates through these pages. Each heading page is broken down further into logical subgroups.

The **MESSAGE** **VALUE** keys navigate through the subgroups. The **VALUE** keys scroll increment or decrement numerical setting values when in programming mode. These keys also scroll through alphanumeric values in the text edit mode. Alternatively, values may also be entered with the numeric keypad.

The **ENTER** key initiates and advance to the next character in text edit mode or enters a decimal point. The **HELP** key may be pressed at any time for context sensitive help messages. The **ENTER** key stores altered setting values.


## 1.5.2 MENU NAVIGATION

Press the **MENU** key to select the desired header display page (top-level menu). The header title appears momentarily followed by a header display page menu item. Each press of the **MENU** key advances through the main heading pages as illustrated below.

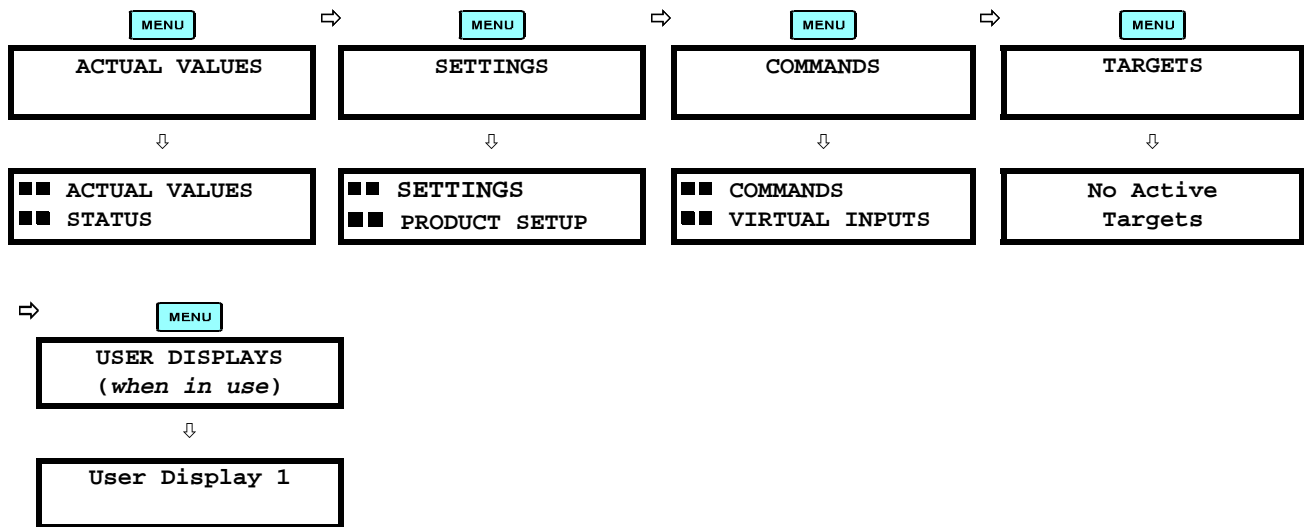

## 1.5.3 MENU HIERARCHY

The setting and actual value messages are arranged hierarchically. The header display pages are indicated by double scroll bar characters (■ ■), while sub-header pages are indicated by single scroll bar characters (■). The header display pages represent the highest level of the hierarchy and the sub-header display pages fall below this level. The MESSAGE **MESSAGE** and **VALUE** keys move within a group of headers, sub-headers, setting values, or actual values. Continually pressing the MESSAGE **MESSAGE** key from a header display displays specific information for the header category. Conversely, continually pressing the **MESSAGE** key from a setting value or actual value display returns to the header display.

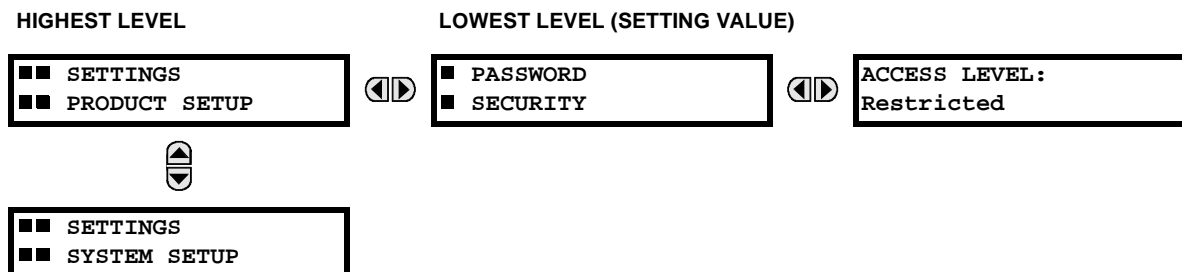




## 1.5.4 RELAY ACTIVATION

The relay is defaulted to the "Not Programmed" state when it leaves the factory. This safeguards against the installation of a relay whose settings have not been entered. When powered up successfully, the TROUBLE indicator will be on and the IN SERVICE indicator off. The relay in the "Not Programmed" state will block signaling of any output relay. These conditions will remain until the relay is explicitly put in the "Programmed" state.

Select the menu message **SETTINGS** ⇒ **PRODUCT SETUP** ⇒ **INSTALLATION** ⇒ **RELAY SETTINGS**

**RELAY SETTINGS:**  
 Not Programmed

To put the relay in the "Programmed" state, press either of the  VALUE  keys once and then press . The faceplate TROUBLE indicator will turn off and the IN SERVICE indicator will turn on. The settings for the relay can be programmed manually (refer to the SETTINGS chapter) via the faceplate keypad or remotely (refer to the URPC Help file) via the URPC software interface.

## 1.5.5 BATTERY TAB

The battery tab is installed in the power supply module before the G60 shipped from the factory. The battery tab prolongs battery life in the event the relay is powered down for long periods of time before installation. The battery is responsible for backing up event records, oscillography, data logger, and real-time clock information when the relay is powered off. The battery failure self-test error generated by the relay is a minor and should not affect the relay functionality. When the relay is installed and ready for commissioning, the tab should be removed. The battery tab should be re-inserted if the relay is powered off for an extended period of time. If required, contact the factory for a replacement battery or battery tab.

## 1.5.6 RELAY PASSWORDS

It is recommended that passwords be set up on the relay for each security level and assigned to specific personnel. There are two user password SECURITY access levels:

## 1. COMMAND

The COMMAND access level restricts the user from making any settings changes, but allows the user to perform the following operations:

- change state of virtual inputs
- clear event records
- clear oscillography records

## 2. SETTING

The SETTING access level allows the user to make any changes to any of the setting values.



**Refer to the CHANGING SETTINGS section (in the HUMAN INTERFACES chapter) for complete instructions on setting up security level passwords.**

NOTE

## 1.5.7 FLEXLOGIC™ CUSTOMIZATION

FlexLogic™ equation editing is required for setting up user-defined logic for customizing the relay operations. See section FLEXLOGIC™ in the SETTINGS chapter.

## 1.5.8 COMMISSIONING

Templated tables for charting all the required settings before entering them via the keypad are available in the COMMISSIONING chapter.

## 2.1.1 OVERVIEW

The G60 Generator Management Relay is a microprocessor based relay that provides protection, monitoring, control, and recording functions for AC generators driven by steam, gas, or hydraulic turbine. Current, voltage and frequency protection are provided along with fault diagnostics.

Voltage, current, and power metering is built into the relay as a standard feature. Current parameters are available as total waveform RMS magnitude, or as fundamental frequency only RMS magnitude and angle (phasor).

The internal clock used for time-tagging can be synchronized with an IRIG-B signal. This precise time stamping allows the sequence of events to be determined throughout the system. Events can also be programmed (via FlexLogic™ equations) to trigger oscillography data capture which may be set to record the measured parameters before and after the event for viewing on a personal computer (PC). These tools significantly reduce troubleshooting time and simplify report generation in the event of a system fault.


A faceplate RS232 port may be used to connect to a PC for the programming of settings and the monitoring of actual values. A variety of communications modules are available. Two rear RS485 ports allow independent access by operating and engineering staff. All serial ports use the Modbus® RTU protocol. The RS485 ports may be connected to system computers with baud rates up to 115.2 kbps. The RS232 port has a fixed baud rate of 19.2 kbps. Optional communications modules include a 10BaseF Ethernet interface which can be used to provide fast, reliable communications in noisy environments. Another option provides two 10BaseF fiber optic ports for redundancy. The Ethernet port supports MMS/UCA2, Modbus®/TCP, and TFTP protocols, and allows access to the relay via any standard web browser (UR web pages). The DNP 3.0 or IEC 60870-5-104 protocol is supported on a user-specified port, including serial and Ethernet ports.

The relay uses flash memory technology which allows field upgrading as new features are added. The following SINGLE LINE DIAGRAM illustrates the relay functionality using ANSI (American National Standards Institute) device numbers.

**Table 2-1: ANSI DEVICE NUMBERS AND FUNCTIONS**

DEVICE NUMBER	FUNCTION	DEVICE NUMBER	FUNCTION
24	Volts Per Hertz	51P	Phase Time Overcurrent
25	Synchrocheck	59N	Neutral Overvoltage
27P	Phase Undervoltage	59P	Phase Overvoltage
27TN	Third Harmonic Neutral Undervoltage	59X	Auxiliary Overvoltage
27X	Auxiliary Undervoltage	59_2	Negative Sequence Overvoltage
32	Sensitive Directional Power	64TN	100% Stator Ground
40	Loss of Excitation	67N	Neutral Directional Overcurrent
46	Generator Unbalance	67P	Phase Directional Overcurrent
50G	Ground Instantaneous Overcurrent	68/78	Power Swing Detection
50N	Neutral Instantaneous Overcurrent	81O	Overfrequency
50P	Phase Instantaneous Overcurrent	81U	Underfrequency
50/27	Accidental Energization	87S	Stator Differential
51G	Ground Time Overcurrent		

2

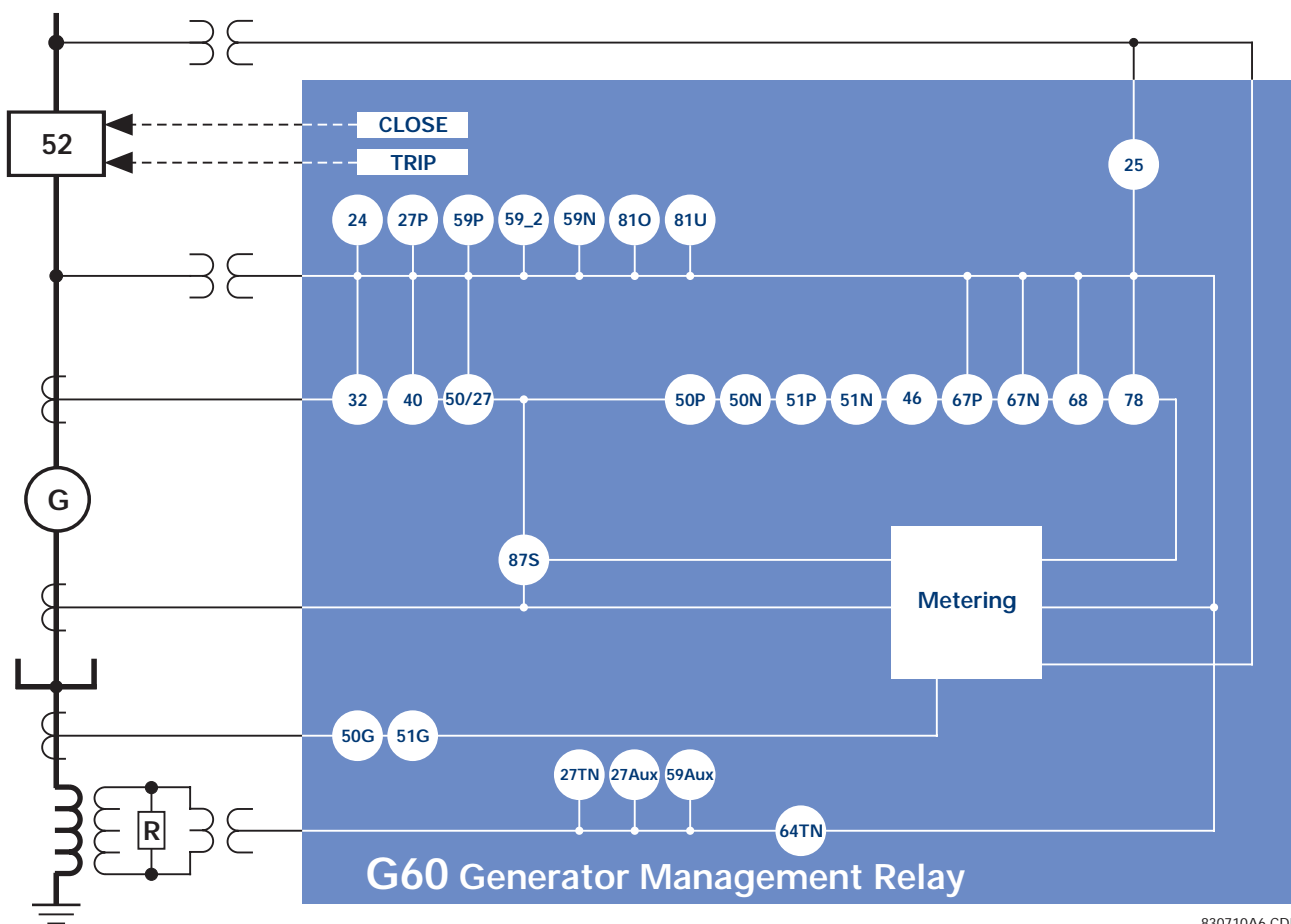

830710A6.CDR

Figure 2–1: SINGLE LINE DIAGRAM

Table 2–2: OTHER DEVICE FUNCTIONS

FUNCTION
Contact Inputs (up to 96)
Contact Outputs (up to 96)
Data Logger
Digital Counters (8)
Digital Elements (16)
DNP 3.0 or IEC 60870-5-104 Communications
Event Recorder
FlexLogic™ Equations
FlexElements™
Generator Unbalance
Metering: Current, Voltage, Power, Frequency
MMS/UCA Communications

FUNCTION
MMS/UCA Remote I/O ("GOOSE")
Modbus Communications
Modbus User Map
Oscillography
Setting Groups (8)
Stator Differential
Transducer I/O
User-programmable LEDs
User-definable displays
Virtual Inputs (32)
Virtual Outputs (64)
VT Fuse Failure

## 2.1.2 ORDERING

The relay is available as a 19-inch rack horizontal mount unit or as a reduced size (¾) vertical mount unit, and consists of five UR module functions: Power Supply, CPU, CT/VT DSP, Digital Input/Output, and Transducer Input/Output. Each of these modules can be supplied in a number of configurations which must be specified at the time of ordering. The information required to completely specify the relay is provided in the following table (full details of available relay modules are contained in the HARDWARE chapter).

Table 2–3: ORDER CODES

	G60 - * 00 - H C * - F ** - H ** - M ** . P ** . U ** . W **										For Full Sized Horizontal Mount
	G60 - * 00 - V F * - F ** - H ** - M ** . P ** .										For Reduced Size Vertical Mount
<b>BASE UNIT</b>	G60										Base Unit
<b>CPU</b>	A										RS485 + RS485
	C										RS485 + 10BaseF (MMS/UC2 and ModBus TCP/IP)
	D										RS485 + Redundant 10BaseF (MMS/UC2 and ModBus TCP/IP)
<b>SOFTWARE OPTIONS</b>	00										No Software Options
<b>MOUNTING / FACEPLATE</b>	H C										Horizontal
	V F										Faceplate with Keypad & Display
<b>POWER SUPPLY</b>	H										125 / 250 V AC/DC
	L										24 - 48 V (DC only)
<b>CT/VT DSP</b>	8A										Standard 4CT/4VT
	8B										Sensitive Ground 4CT/4VT
	8C										Standard 8CT
	8D										Sensitive Ground CT
<b>DIGITAL I/O</b>			XX	XX	XX	XX	XX	XX	XX	XX	No module
	6A	6A	6A	6A	6A	6A	6A	6A	6A	6A	2 Form-A (Voltage w/ opt Current) & 2 Form-C Outputs, 8 Digital Inputs
	6B	6B	6B	6B	6B	6B	6B	6B	6B	6B	2 Form-A (Voltage w/ opt Current) & 4 Form-C Outputs, 4 Digital Inputs
	6C	6C	6C	6C	6C	6C	6C	6C	6C	6C	8 Form-C Outputs
	6D	6D	6D	6D	6D	6D	6D	6D	6D	6D	16 Digital Inputs
	6E	6E	6E	6E	6E	6E	6E	6E	6E	6E	4 Form-C Outputs, 8 Digital Inputs
	6F	6F	6F	6F	6F	6F	6F	6F	6F	6F	8 Fast Form-C Outputs
	6G	6G	6G	6G	6G	6G	6G	6G	6G	6G	4 Form-A (Voltage w/ opt Current) Outputs, 8 Digital Inputs
	6H	6H	6H	6H	6H	6H	6H	6H	6H	6H	6 Form-A (Voltage w/ opt Current) Outputs, 4 Digital Inputs
	6K	6K	6K	6K	6K	6K	6K	6K	6K	6K	4 Form-C & 4 Fast Form-C Outputs
	6L	6L	6L	6L	6L	6L	6L	6L	6L	6L	2 Form-A (Current w/ opt Voltage) & 2 Form-C Outputs, 8 Digital Inputs
	6M	6M	6M	6M	6M	6M	6M	6M	6M	6M	2 Form-A (Current w/ opt Voltage) & 4 Form-C Outputs, 4 Digital Inputs
	6N	6N	6N	6N	6N	6N	6N	6N	6N	6N	4 Form-A (Current w/ opt Voltage) Outputs, 8 Digital Inputs
	6P	6P	6P	6P	6P	6P	6P	6P	6P	6P	6 Form-A (Current w/ opt Voltage) Outputs, 4 Digital Inputs
	6R	6R	6R	6R	6R	6R	6R	6R	6R	6R	2 Form-A (No Monitoring) & 2 Form-C Outputs, 8 Digital Inputs
	6S	6S	6S	6S	6S	6S	6S	6S	6S	6S	2 Form-A (No Monitoring) & 4 Form-C Outputs, 4 Digital Inputs
	6T	6T	6T	6T	6T	6T	6T	6T	6T	6T	4 Form-A (No Monitoring) Outputs, 8 Digital Inputs
	6U	6U	6U	6U	6U	6U	6U	6U	6U	6U	6 Form-A (No Monitoring) Outputs, 4 Digital Inputs
<b>TRANSDUCER I/O</b>	5C	5C	5C	5C	5C	5C	5C	5C	5C	5C	8 RTD Inputs
	5E	5E	5E	5E	5E	5E	5E	5E	5E	5E	4 dcmA Inputs, 4 RTD Inputs
	5F	5F	5F	5F	5F	5F	5F	5F	5F	5F	8 dcmA Inputs

The order codes for replacement modules to be ordered separately are shown in the following table. **When ordering a replacement CPU module or Faceplate, please provide the serial number of your existing unit.**

Table 2–4: ORDER CODES FOR REPLACEMENT MODULES

	UR - ** -	
<b>POWER SUPPLY</b>	1H	125 / 250 V AC/DC
	1L	24 - 48 V (DC only)
<b>CPU</b>	9A	RS485 + RS485 (ModBus RTU, DNP 3.0)
	9C	RS485 + 10BaseF (MMS/UCA2, ModBus TCP/IP, DNP 3.0)
	9D	RS485 + Redundant 10BaseF (MMS/UCA2, ModBus TCP/IP, DNP 3.0)
<b>FACEPLATE</b>	3C	Horizontal Faceplate with Display & Keypad
	3F	Vertical Faceplate with Display & Keypad
<b>DIGITAL I/O</b>	6A	2 Form-A (Voltage w/ opt Current) & 2 Form-C Outputs, 8 Digital Inputs
	6B	2 Form-A (Voltage w/ opt Current) & 4 Form-C Outputs, 4 Digital Inputs
	6C	8 Form-C Outputs
	6D	16 Digital Inputs
	6E	4 Form-C Outputs, 8 Digital Inputs
	6F	8 Fast Form-C Outputs
	6G	4 Form-A (Voltage w/ opt Current) Outputs, 8 Digital Inputs
	6H	6 Form-A (Voltage w/ opt Current) Outputs, 4 Digital Inputs
	6K	4 Form-C & 4 Fast Form-C Outputs
	6L	2 Form-A (Current w/ opt Voltage) & 2 Form-C Outputs, 8 Digital Inputs
	6M	2 Form-A (Current w/ opt Voltage) & 4 Form-C Outputs, 4 Digital Inputs
	6N	4 Form-A (Current w/ opt Voltage) Outputs, 8 Digital Inputs
	6P	6 Form-A (Current w/ opt Voltage) Outputs, 4 Digital Inputs
	6R	2 Form-A (No Monitoring) & 2 Form-C Outputs, 8 Digital Inputs
	6S	2 Form-A (No Monitoring) & 4 Form-C Outputs, 4 Digital Inputs
	6T	4 Form-A (No Monitoring) Outputs, 8 Digital Inputs
	6U	6 Form-A (No Monitoring) Outputs, 4 Digital Inputs
<b>CT/VT DSP</b>	8A	Standard 4CT/4VT
	8B	Sensitive Ground 4CT/4VT
	8C	Standard 8CT
	8D	Sensitive Ground 8CT
	8Z	HI-Z 4CT
<b>L60 INTER-RELAY COMMUNICATIONS</b>	7U	110/125 V, 20 mA Input/Output Channel Interface
	7V	48/60 V, 20 mA Input/Output Channel Interface
	7Y	125 V Input, 5V Output, 20 mA Channel Interface
	7Z	5 V Input, 5V Output, 20 mA Channel Interface
<b>L90 INTER-RELAY COMMUNICATIONS</b>	7A	820 nm, multi-mode, LED, 1 Channel
	7B	1300 nm, multi-mode, LED, 1 Channel
	7C	1300 nm, single-mode, ELED, 1 Channel
	7D	1300 nm, single-mode, LASER, 1 Channel
	7E	Channel 1: G.703; Channel 2: 820 nm, multi-mode LED
	7F	Channel 1: G.703; Channel 2: 1300 nm, multi-mode LED
	7G	Channel 1: G.703; Channel 2: 1300 nm, single-mode ELED
	7Q	Channel 1: G.703; Channel 2: 820 nm, single-mode LASER
	7H	820 nm, multi-mode, LED, 2 Channels
	7I	1300 nm, multi-mode, LED, 2 Channels
	7J	1300 nm, single-mode, ELED, 2 Channels
	7K	1300 nm, single-mode, LASER, 2 Channels
	7L	Channel 1 - RS422; Channel 2 - 820 nm, multi-mode, LED
	7M	Channel 1 - RS422; Channel 2 - 1300 nm, multi-mode, LED
	7N	Channel 1 - RS422; Channel 2 - 1300 nm, single-mode, ELED
	7P	Channel 1 - RS422; Channel 2 - 1300 nm, single-mode, LASER
	7R	G.703, 1 Channel
	7S	G.703, 2 Channels
	7T	RS422, 1 Channel
	7W	RS422, 2 Channels
	72	1550 nm, single-mode, LASER, 1 Channel
	73	1550 nm, single-mode, LASER, 2 Channel
	74	Channel 1 - RS422; Channel 2 - 1550 nm, single-mode, LASER
	75	Channel 1 - G.703, Channel 2 - 1550 nm, single -mode, LASER
<b>TRANSDUCER I/O</b>	5C	8 RTD Inputs
	5E	4 dcmA Inputs, 4 RTD Inputs
	5F	8 dcmA Inputs



**SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE****2.2.1 PROTECTION ELEMENTS**

The operating times below include the activation time of a trip rated Form-A output contact unless otherwise indicated. FlexLogic™ operands of a given element are 4 ms faster. This should be taken into account when using FlexLogic™ to interconnect with other protection or control elements of the relay, building FlexLogic™ equations, or interfacing with other IEDs or power system devices via communications or different output contacts.

**2****STATOR DIFFERENTIAL**

Pickup:	0.050 to 1.00 pu in steps of 0.01
Slope 1/2:	1 to 100% in steps of 1
Break 1:	1.00 to 1.50 pu in steps of 0.01
Break 2:	1.50 to 30.00 pu in steps of 0.01

**POWER SWING DETECT**

Functions:	Power swing block, Out-of-step trip
Measured Impedance:	Positive-sequence
Blocking & Tripping Modes:	2-step or 3-step
Tripping Mode:	Early or Delayed
Current Supervision:	
Pickup Level:	0.050 to 30.000 pu in steps of 0.001
Dropout Level:	97 to 98% of Pickup
Fwd / Reverse Reach (sec. $\Omega$ ):	0.10 to 500.00 $\Omega$ in steps of 0.01
Impedance Accuracy:	$\pm 5\%$
Fwd / Reverse Angle Impedances:	40 to 90° in steps of 1
Angle Accuracy:	$\pm 2^\circ$
Characteristic Limit Angles:	40 to 140° in steps of 1
Timers:	0.000 to 65.535 s in steps of 0.001
Timing Accuracy:	$\pm 3\%$ or 4 ms, whichever is greater

**PHASE/NEUTRAL/GROUND TOC**

Current:	Phasor or RMS
Pickup Level:	0.000 to 30.000 pu in steps of 0.001
Dropout Level:	97% to 98% of Pickup
Level Accuracy:	
for 0.1 to $2.0 \times CT$ :	$\pm 0.5\%$ of reading or $\pm 1\%$ of rated (whichever is greater)
for $> 2.0 \times CT$ :	$\pm 1.5\%$ of reading $> 2.0 \times CT$ rating
Curve Shapes:	IEEE Moderately/Very/Extremely Inverse; IEC (and BS) A/B/C and Short Inverse; GE IAC Inverse, Short/Very/Extremely Inverse; $I^2t$ ; FlexCurve™ (programmable); Definite Time (0.01 s base curve)
Curve Multiplier:	Time Dial = 0.00 to 600.00 in steps of 0.01
Reset Type:	Instantaneous/Timed (per IEEE)
Timing Accuracy:	Operate at $> 1.03 \times$ Actual Pickup $\pm 3.5\%$ of operate time or $\pm \frac{1}{2}$ cycle (whichever is greater)

**PHASE/NEUTRAL/GROUND IOC**

Pickup Level:	0.000 to 30.000 pu in steps of 0.001
Dropout Level:	97 to 98% of Pickup
Level Accuracy:	
0.1 to $2.0 \times CT$ rating:	$\pm 0.5\%$ of reading or $\pm 1\%$ of rated (whichever is greater)
$> 2.0 \times CT$ rating:	$\pm 1.5\%$ of reading
Overreach:	$< 2\%$
Pickup Delay:	0.00 to 600.00 s in steps of 0.01
Reset Delay:	0.00 to 600.00 s in steps of 0.01
Operate Time:	$< 20$ ms at $3 \times$ Pickup at 60 Hz
Timing Accuracy:	Operate at $1.5 \times$ Pickup $\pm 3\%$ or $\pm 4$ ms (whichever is greater)

**PHASE DIRECTIONAL OVERCURRENT**

Relay Connection:	90° (quadrature)
Quadrature Voltage:	
ABC Phase Seq.: phase A ( $V_{BC}$ ), phase B ( $V_{CA}$ ), phase C ( $V_{AB}$ )	
ACB Phase Seq.: phase A ( $V_{CB}$ ), phase B ( $V_{AC}$ ), phase C ( $V_{BA}$ )	
Polarizing Voltage Threshold:	0.000 to 3.000 pu in steps of 0.001
Current Sensitivity Threshold:	0.05 pu
Characteristic Angle:	0 to 359° in steps of 1
Angle Accuracy:	$\pm 2^\circ$
Operation Time (FlexLogic™ Operands):	
Tripping (reverse load, forward fault):	$< 12$ ms, typically
Blocking (forward load, reverse fault):	$< 8$ ms, typically

**NEUTRAL DIRECTIONAL OVERCURRENT**

Directionality:	Co-existing forward and reverse
Polarizing:	Voltage, Current, Dual
Polarizing Voltage:	$V_0$ or $V_X$
Polarizing Current:	IG
Operating Current:	$I_0$
Level Sensing:	$3 \times ( I_0  - K \times  I_1 )$ , $K = 0.0625$ ; IG
Characteristic Angle:	$-90$ to $90^\circ$ in steps of 1
Limit Angle:	40 to $90^\circ$ in steps of 1, independent for forward and reverse
Angle Accuracy:	$\pm 2^\circ$
Offset Impedance:	0.00 to 250.00 $\Omega$ in steps of 0.01
Pickup Level:	0.05 to 30.00 pu in steps of 0.01
Dropout Level:	97 to 98%
Operation Time:	$< 16$ ms at $3 \times$ Pickup at 60 Hz

**GENERATOR UNBALANCE**

Gen. Nominal Current:	0.000 to 1.250 pu in steps of 0.001
Stages:	2 ( $I^2t$ with linear reset and definite time)
Pickup Level:	0.00 to 100.00% in steps of 0.01
Dropout Level:	97 to 98% of pickup
Level Accuracy:	
0.1 to 2 x CT rating:	$\pm 0.5\%$ of reading or 1% of rated (whichever is greater)
> 2.0 x CT rating:	$\pm 1.5\%$ of reading
Time Dial (K-value):	0.00 to 100.00 in steps of 0.01
Pickup Delay:	0.0 to 1000.0 s in steps of 0.1
Reset Delay:	0.0 to 1000.0 s in steps of 0.1
Time Accuracy:	$\pm 3\%$ or $\pm 20$ ms, whichever is greater
Operate Time:	< 50 ms at 60 Hz

**PHASE UNDERVOLTAGE**

Pickup Level:	0.000 to 3.000 pu in steps of 0.001
Dropout Level:	102 to 103% of Pickup
Level Accuracy:	$\pm 0.5\%$ of reading from 10 to 208 V
Curve Shapes:	GE IAV Inverse; Definite Time (0.1s base curve)
Curve Multiplier:	Time Dial = 0.00 to 600.00 in steps of 0.01
Timing Accuracy:	Operate at < $0.90 \times$ Pickup $\pm 3.5\%$ of operate time or $\pm 4$ ms (whichever is greater)

**PHASE OVERVOLTAGE**

Voltage:	Phasor only
Pickup Level:	0.000 to 3.000 pu in steps of 0.001
Dropout Level:	97 to 98% of Pickup
Level Accuracy:	$\pm 0.5\%$ of reading from 10 to 208 V
Pickup Delay:	0.00 to 600.00 in steps of 0.01 s
Operate Time:	< 30 ms at $1.10 \times$ Pickup at 60 Hz
Timing Accuracy:	$\pm 3\%$ or $\pm 4$ ms (whichever is greater)

**NEUTRAL OVERVOLTAGE**

Pickup Level:	0.000 to 1.250 pu in steps of 0.001
Dropout Level:	97 to 98% of Pickup
Level Accuracy:	$\pm 0.5\%$ of reading from 10 to 208 V
Pickup Delay:	0.00 to 600.00 s in steps of 0.01
Reset Delay:	0.00 to 600.00 s in steps of 0.01
Timing Accuracy:	$\pm 3\%$ or $\pm 4$ ms (whichever is greater)
Operate Time:	< 30 ms at $1.10 \times$ Pickup at 60 Hz

**NEGATIVE SEQUENCE OVERVOLTAGE**

Pickup Level:	0.000 to 1.250 pu in steps of 0.001
Dropout Level:	97 to 98% of Pickup
Level Accuracy:	$\pm 0.5\%$ of reading from 10 to 208 V
Pickup Delay:	0 to 600.00 s in steps of 0.01
Reset Delay:	0 to 600.00 s in steps of 0.01
Time Accuracy:	$\pm 3\%$ or $\pm 20$ ms, whichever is greater
Operate Time:	< 30 ms at $1.10 \times$ Pickup at 60 Hz

**AUXILIARY UNDERVOLTAGE**

Pickup Level:	0.000 to 3.000 pu in steps of 0.001
Dropout Level:	102 to 103% of Pickup
Level Accuracy:	$\pm 0.5\%$ of reading from 10 to 208 V
Curve Shapes:	GE IAV Inverse Definite Time
Curve Multiplier:	Time Dial = 0 to 600.00 in steps of 0.01
Timing Accuracy:	$\pm 3\%$ of operate time or $\pm 4$ ms (whichever is greater)

**AUXILIARY OVERVOLTAGE**

Pickup Level:	0.000 to 3.000 pu in steps of 0.001
Dropout Level:	97 to 98% of Pickup
Level Accuracy:	$\pm 0.5\%$ of reading from 10 to 208 V
Pickup Delay:	0 to 600.00 s in steps of 0.01
Reset Delay:	0 to 600.00 s in steps of 0.01
Timing Accuracy:	$\pm 3\%$ of operate time or $\pm 4$ ms (whichever is greater)
Operate Time:	< 30 ms at $1.10 \times$ pickup at 60 Hz

**VOLTS PER HERTZ**

Voltage:	Phasor only
Pickup Level:	0.80 to 4.00 in steps of 0.01 pu V/Hz
Dropout Level:	97 to 98% of Pickup
Level Accuracy:	$\pm 0.02$ pu
Timing Curves:	Definite Time; Inverse A, B, and C, FlexCurve™ A and B
Pickup Delay:	0.00 to 600.00 s in steps of 0.01
Reset Delay:	0.0 to 1000.0 s in steps of 0.1
Timing Accuracy:	$\pm 3\%$ or $\pm 4$ ms (whichever is greater)

**100% STATOR GROUND**

Operating quantity:	$\frac{V_{\text{neutral\_3rd}}}{V_{\text{neutral\_3rd}} + V_{\text{zero\_3rd}}}$
Pickup level:	0.000 to 0.250 pu in steps of 0.001
Dropout level:	97 to 98% of pickup
Level Accuracy:	$\pm 2\%$ of reading from 1 to 120 V
Pickup delay:	0 to 600.00 s in steps of 0.01
3rd harmonic supervision level:	0.0010 to 0.1000 pu in steps of 0.0001
Time accuracy:	$\pm 3\%$ or $\pm 20$ ms, whichever is greater
Operate time:	< 30 ms at $1.10 \times$ Pickup at 60 Hz

**THIRD HARMONIC NEUTRAL UNDERVOLTAGE**

Operating quantity:	3rd harmonic of auxiliary undervoltage
Undervoltage:	
Pickup level:	0.000 to 3.000 pu in steps of 0.001
Dropout level:	102 to 103% of pickup
Accuracy:	$\pm 2\%$ of reading from 1 to 120 V
Power:	
Pickup level:	0.000 to 1.200 pu in steps of 0.001
Dropout level:	97 to 98% of pickup
Accuracy:	$\pm 5\%$ or $\pm 0.01$ pu, whichever is greater
Undervoltage Inhibit	
Level:	0.000 to 3.000 pu in steps of 0.001 pu
Accuracy:	$\pm 0.5\%$ of reading from 10 to 208 V
Pickup Delay:	0 to 600.00 s in steps of 0.01
Time Accuracy:	$\pm 3\%$ or $\pm 20$ ms, whichever is greater
Operate Time:	< 30 ms at $1.10 \times$ pickup at 60 Hz

**UNDERFREQUENCY**

Minimum Signal:	0.10 to 1.25 pu in steps of 0.01
Pickup Level:	20.00 to 65.00 Hz in steps of 0.01
Dropout Level:	Pickup + 0.03 Hz
Level Accuracy:	±0.01 Hz
Time Delay:	0 to 65.535 s in steps of 0.001
Timer Accuracy:	±3% or 4 ms, whichever is greater

**OVERFREQUENCY**

Pickup Level:	20.00 to 65.00 Hz in steps of 0.01
Dropout Level:	Pickup – 0.03 Hz
Level Accuracy:	±0.01 Hz
Time Delay:	0 to 65.535 s in steps of 0.001
Timer Accuracy:	±3% or 4 ms, whichever is greater

**SYNCHROCHECK**

Max Volt Difference:	0 to 100000 V in steps of 1
Max Angle Difference:	0 to 100° in steps of 1
Max Freq Difference:	0.00 to 2.00 Hz in steps of 0.01
Dead Source Function:	None, LV1 & DV2, DV1 & LV2, DV1 or DV2, DV1 xor DV2, DV1 & DV2 (L=Live, D=Dead)

**SENSITIVE DIRECTIONAL POWER**

Measured Power:	3-phase, true RMS
Number of Stages:	2
Characteristic Angle:	0 to 359° in steps of 1
Calibration Angle:	0.00 to 0.95° in steps of 0.05
Minimum Power:	–1.200 to 1.200 pu in steps of 0.001
Pickup Level Accuracy:	±1% or ±0.001 pu, whichever is greater
Hysteresis:	2% or 0.001 pu, whichever is greater
Pickup Delay:	0 to 600.00 s in steps of 0.01
Time Accuracy:	±3% or ±4 ms, whichever is greater
Operate Time:	50 ms

**ACCIDENTAL ENERGIZATION**

Operating condition:	Overcurrent
Arming condition:	Undervoltage and/or Machine Offline
Overcurrent:	
Pickup level:	0.000 to 3.000 pu in steps of 0.001
Dropout Level:	97 to 98% of pickup
Level Accuracy:	±0.5% of reading from 0.1 to 2.0 × CT rating

Undervoltage:	
Pickup level:	0.000 to 3.000 pu in steps of 0.001
Dropout Level:	102 to 103% of pickup
Level Accuracy:	±0.5% of reading 10 to 208 V
Operate Time:	< 30 ms at 1.10 × Pickup at 60 Hz

**LOSS OF EXCITATION**

Operating condition:	Positive-sequence impedance
Characteristic:	2 independent offset mho circles
Center:	0.10 to 300.0 Ω (sec.) in steps of 0.01
Radius:	0.10 to 300.0 Ω (sec.) in steps of 0.01
Reach accuracy:	±3%
Undervoltage Supv	
Level:	0.000 to 3.000 pu in steps of 0.001
Accuracy:	± 0.5% of reading from 10 to 208 V
Pickup delay:	0 to 65.535 s in steps of 0.001
Timing accuracy:	±3% or ±20 ms, whichever is greater
Operate time:	<50 ms

**FLEXLOGIC™**

Programming language:	Reverse Polish Notation with graphical visualization (keypad programmable)
Lines of code:	512
Number of Internal Variables:	64
Supported operations:	NOT, XOR, OR (2 to 16 inputs), AND (2 to 16 inputs), NOR (2 to 16 inputs), NAND (2 to 16 inputs), LATCH (Reset dominant), EDGE DETECTORS, TIMERS
Inputs:	any logical variable, contact, or virtual input
Number of timers:	32
Pickup delay:	0 to 60000 (ms, sec., min.) in steps of 1
Dropout delay:	0 to 60000 (ms, sec., min.) in steps of 1

**FLEXCURVES™**

Number:	2 (A and B)
Number of reset points:	40 (0 through 1 of pickup)
Number of operate points:	80 (1 through 20 of pickup)
Time delay:	0 to 65535 ms in steps of 1

**FLEXELEMENTS™**

Number of elements:	16
Operating signal:	any analog actual value, or two values in differential mode
Operating signal mode:	Signed or Absolute Value
Operating mode:	Level, Delta
Compensation direction:	Over, Under
Pickup Level:	–30.000 to 30.000 pu in steps of 0.001
Hysteresis:	0.1 to 50.0% in steps of 0.1
Delta dt:	20 ms to 60 days
Pickup and dropout delay:	0.000 to 65.535 in steps of 0.001

**FLEX STATES**

Number:	up to 256 logical variables grouped under 16 Modbus addresses
Programmability:	any logical variable, contact, or virtual input

**USER-PROGRAMMABLE LEDS**

Number:	48 plus Trip and Alarm
Programmability:	from any logical variable, contact, or virtual input
Reset mode:	Self-reset or Latched

**USER-DEFINABLE DISPLAYS**

Number of displays:	8
Lines of display:	2 × 20 alphanumeric characters
Parameters	up to 5, any Modbus register addresses

**2.2.3 MONITORING****OSCILLOGRAPHY**

Max. No. of Records:	64
Sampling Rate:	64 samples per power cycle
Triggers:	Any element pickup, dropout or operate Digital input change of state Digital output change of state FlexLogic™ equation
Data:	AC input channels Element state Digital input state Digital output state
Data Storage:	In non-volatile memory

**EVENT RECORDER**

Capacity:	1024 events
Time-tag:	to 1 microsecond
Triggers:	Any element pickup, dropout or operate Digital input change of state Digital output change of state Self-test events
Data Storage:	In non-volatile memory

**DATA LOGGER**

Number of Channels:	1 to 16
Parameters:	Any available analog Actual Value
Sampling Rate:	1 sec.; 1, 5, 10, 15, 20, 30, 60 min.
Storage Capacity:	(NN is dependent on memory)
1-second rate:	01 channel for NN days 16 channels for NN days
↓	↓
60-minute rate:	01 channel for NN days 16 channels for NN days

## 2.2.4 METERING

**RMS CURRENT: PHASE, NEUTRAL, AND GROUND**

Accuracy at

0.1 to  $2.0 \times$  CT rating:  $\pm 0.25\%$  of reading or  $\pm 0.1\%$  of rated (whichever is greater)>  $2.0 \times$  CT rating:  $\pm 1.0\%$  of reading**RMS VOLTAGE**Accuracy:  $\pm 0.5\%$  of reading from 10 to 208 V**REAL POWER WATT**Accuracy:  $\pm 1.0\%$  of reading at  $-0.8 < PF \leq -1.0$  and  $0.8 < PF \leq 1.0$ **REACTIVE POWER VAR**Accuracy:  $\pm 1.0\%$  of reading at  $-0.2 \leq PF \leq 0.2$ **APPARENT POWER VA**Accuracy:  $\pm 1.0\%$  of reading**WATT-HOURS (POSITIVE & NEGATIVE)**Accuracy:  $\pm 2.0\%$  of readingRange:  $\pm 0$  to  $2 \times 10^9$  MWh

Parameters: 3-phase only

Update Rate: 50 ms

**VAR-HOURS (POSITIVE & NEGATIVE)**Accuracy:  $\pm 2.0\%$  of readingRange:  $\pm 0$  to  $2 \times 10^9$  Mvarh

Parameters: 3-phase only

Update Rate: 50 ms

**FREQUENCY**

Accuracy at

 $V = 0.8$  to  $1.2$  pu:  $\pm 0.01$  Hz (when voltage signal is used for frequency measurement) $I = 0.1$  to  $0.25$  pu:  $\pm 0.05$  Hz $I > 0.25$  pu:  $\pm 0.02$  Hz (when current signal is used for frequency measurement)

## 2.2.5 INPUTS

**AC CURRENT**

CT Rated Primary: 1 to 50000 A

CT Rated Secondary: 1 A or 5 A by connection

Nominal Frequency: 20 to 65 Hz

Relay Burden: &lt; 0.2 VA at rated secondary

Conversion Range:

Standard CT Module:  $0.02$  to  $46 \times$  CT rating RMS symmetrical  
Sensitive Ground Module: $0.002$  to  $4.6 \times$  CT rating RMS symmetrical

Current Withstand: 20 ms at 250 times rated

1 sec. at 100 times rated

Cont. at 3 times rated

**AC VOLTAGE**

VT Rated Secondary: 50.0 to 240.0 V

VT Ratio: 0.1 to 24000.0

Nominal Frequency: 20 to 65 Hz

Relay Burden: &lt; 0.25 VA at 120 V

Conversion Range: 1 to 275 V

Voltage Withstand: cont. at 260 V to neutral  
1 min./hr at 420 V to neutral**CONTACT INPUTS**Dry Contacts: 1000  $\Omega$  maximum

Wet Contacts: 300 V DC maximum

Selectable Thresholds: 16 V, 30 V, 80 V, 140 V

Recognition Time: &lt; 1 ms

Debounce Timer: 0.0 to 16.0 ms in steps of 0.5

**IRIG-B INPUT**

Amplitude Modulation: 1 to 10 V pk-pk

DC Shift: TTL

Input Impedance: 22 k $\Omega$ **RTD INPUTS**Types (3-wire): 100  $\Omega$  Platinum, 100 & 120  $\Omega$  Nickel, 10  $\Omega$  Copper

Sensing Current: 5 mA

Range:  $-50$  to  $+250^\circ\text{C}$ Accuracy:  $\pm 2^\circ\text{C}$ 

Isolation: 36 V pk-pk

**DCMA INPUTS**Current Input (mA DC): 0 to  $-1$ , 0 to  $+1$ ,  $-1$  to  $+1$ , 0 to 5, 0 to 10, 0 to 20, 4 to 20 (programmable)Input Impedance: 379  $\Omega \pm 10\%$ Conversion Range:  $-1$  to  $+20$  mA DCAccuracy:  $\pm 0.2\%$  of full scale

Type: Passive

## 2.2.6 POWER SUPPLY

**LOW RANGE**

Nominal DC Voltage: 24 to 48 V at 3 A

Min./Max. DC Voltage: 20 / 60 V

NOTE: Low range is DC only.

**HIGH RANGE**

Nominal DC Voltage: 125 to 250 V at 0.7 A

Min./Max. DC Voltage: 88 / 300 V

Nominal AC Voltage: 100 to 240 V at 50/60 Hz, 0.7 A

Min./Max. AC Voltage: 88 / 265 V at 48 to 62 Hz

**ALL RANGES**Volt Withstand:  $2 \times$  Highest Nominal Voltage for 10 ms

Voltage Loss Hold-Up: 50 ms duration at nominal

Power Consumption: Typical = 35 VA; Max. = 75 VA

**INTERNAL FUSE****RATINGS**

Low Range Power Supply: 7.5 A / 600 V

High Range Power Supply: 5 A / 600 V

**INTERRUPTING CAPACITY**

AC: 100 000 A RMS symmetrical

DC: 10 000 A

## 2.2.7 OUTPUTS

**FORM-A RELAY**

Make and Carry for 0.2 sec.: 30 A as per ANSI C37.90

Carry Continuous: 6 A

Break at L/R of 40 ms: 0.25 A DC max.

Operate Time: &lt; 4 ms

Contact Material: Silver alloy

**FORM-A VOLTAGE MONITOR**

Applicable Voltage: approx. 15 to 250 V DC

Trickle Current: approx. 1 to 2.5 mA

**FORM-A CURRENT MONITOR**

Threshold Current: approx. 80 to 100 mA

**FORM-C AND CRITICAL FAILURE RELAY**

Make and Carry for 0.2 sec: 10 A

Carry Continuous: 6 A

Break at L/R of 40 ms: 0.1 A DC max.

Operate Time: &lt; 8 ms

Contact Material: Silver alloy

**FAST FORM-C RELAY**

Make and Carry: 0.1 A max. (resistive load)

Minimum Load Impedance:

INPUT VOLTAGE	IMPEDANCE	
	2 W RESISTOR	1 W RESISTOR
250 V DC	20 K $\Omega$	50 K $\Omega$
120 V DC	5 K $\Omega$	2 K $\Omega$
48 V DC	2 K $\Omega$	2 K $\Omega$
24 V DC	2 K $\Omega$	2 K $\Omega$

Note: values for 24 V and 48 V are the same due to a required 95% voltage drop across the load impedance.

Operate Time: &lt; 0.6 ms

INTERNAL LIMITING RESISTOR:

Power: 2 watts

Resistance: 100 ohms

**CONTROL POWER EXTERNAL OUTPUT  
(FOR DRY CONTACT INPUT)**

Capacity: 100 mA DC at 48 V DC

Isolation:  $\pm 300$  Vpk

## 2.2.8 COMMUNICATIONS

**RS232**Front Port: 19.2 kbps, Modbus<sup>®</sup> RTU**RS485**1 or 2 Rear Ports: Up to 115 kbps, Modbus<sup>®</sup> RTU, isolated together at 36 Vpk

Typical Distance: 1200 m

**ETHERNET PORT**

10BaseF: 820 nm, multi-mode, supports half-duplex/full-duplex fiber optic with ST connector

Redundant 10BaseF: 820 nm, multi-mode, half-duplex/full-duplex fiber optic with ST connector

Power Budget: 10 db

Max Optical Ip Power: -7.6 dBm

Typical Distance: 1.65 km

## 2.2.9 ENVIRONMENTAL

Operating Temperatures:

Cold: IEC 60028-2-1, 16 h at -40°C

Dry Heat: IEC 60028-2-2, 16 h at 85°C

Humidity (noncondensing): IEC 60068-2-30, 95%, Variant 1, 6 days

Altitude: Up to 2000 m

Installation Category: II

## 2.2.10 TYPE TESTS

Electrical Fast Transient: ANSI/IEEE C37.90.1  
IEC 61000-4-4  
IEC 60255-22-4

Oscillatory Transient: ANSI/IEEE C37.90.1  
IEC 61000-4-12

Insulation Resistance: IEC 60255-5

Dielectric Strength: IEC 60255-6  
ANSI/IEEE C37.90

Electrostatic Discharge: EN 61000-4-2

Surge Immunity: EN 61000-4-5

RFI Susceptibility: ANSI/IEEE C37.90.2  
IEC 61000-4-3  
IEC 60255-22-3  
Ontario Hydro C-5047-77

Conducted RFI: IEC 61000-4-6

Voltage Dips/Interruptions/Variations:  
IEC 61000-4-11  
IEC 60255-11

Power Frequency Magnetic Field Immunity:  
IEC 61000-4-8

Vibration Test (sinusoidal): IEC 60255-21-1

Shock and Bump: IEC 60255-21-2



**Type test report available upon request.**

NOTE

## 2.2.11 PRODUCTION TESTS

**THERMAL**

Products go through a 12 h burn-in process at 60°C

## 2.2.12 APPROVALS

**APPROVALS**

UL approval pending

CSA approval pending

Manufactured under an ISO9000 Registered system.

CE:  
LVD 73/23/EEC: IEC 1010-1  
EMC 81/336/EEC: EN 50081-2  
EN 50082-2

## 2.2.13 MAINTENANCE

Cleaning: Normally, cleaning is not required; but for situations where dust has accumulated on the faceplate display, a dry cloth can be used.





## 3.1.1 PANEL CUTOUT

The relay is available as a 19-inch rack horizontal mount unit or as a reduced size ( $\frac{3}{4}$ ) vertical mount unit, with a removable faceplate. The modular design allows the relay to be easily upgraded or repaired by a qualified service person. The faceplate is hinged to allow easy access to the removable modules, and is itself removable to allow mounting on doors with limited rear depth. There is also a removable dust cover that fits over the faceplate, which must be removed when attempting to access the keypad or RS232 communications port.

The vertical and horizontal case dimensions are shown below, along with panel cutout details for panel mounting. When planning the location of your panel cutout, ensure that provision is made for the faceplate to swing open without interference to or from adjacent equipment.

The relay must be mounted such that the faceplate sits semi-flush with the panel or switchgear door, allowing the operator access to the keypad and the RS232 communications port. The relay is secured to the panel with the use of four screws supplied with the relay.

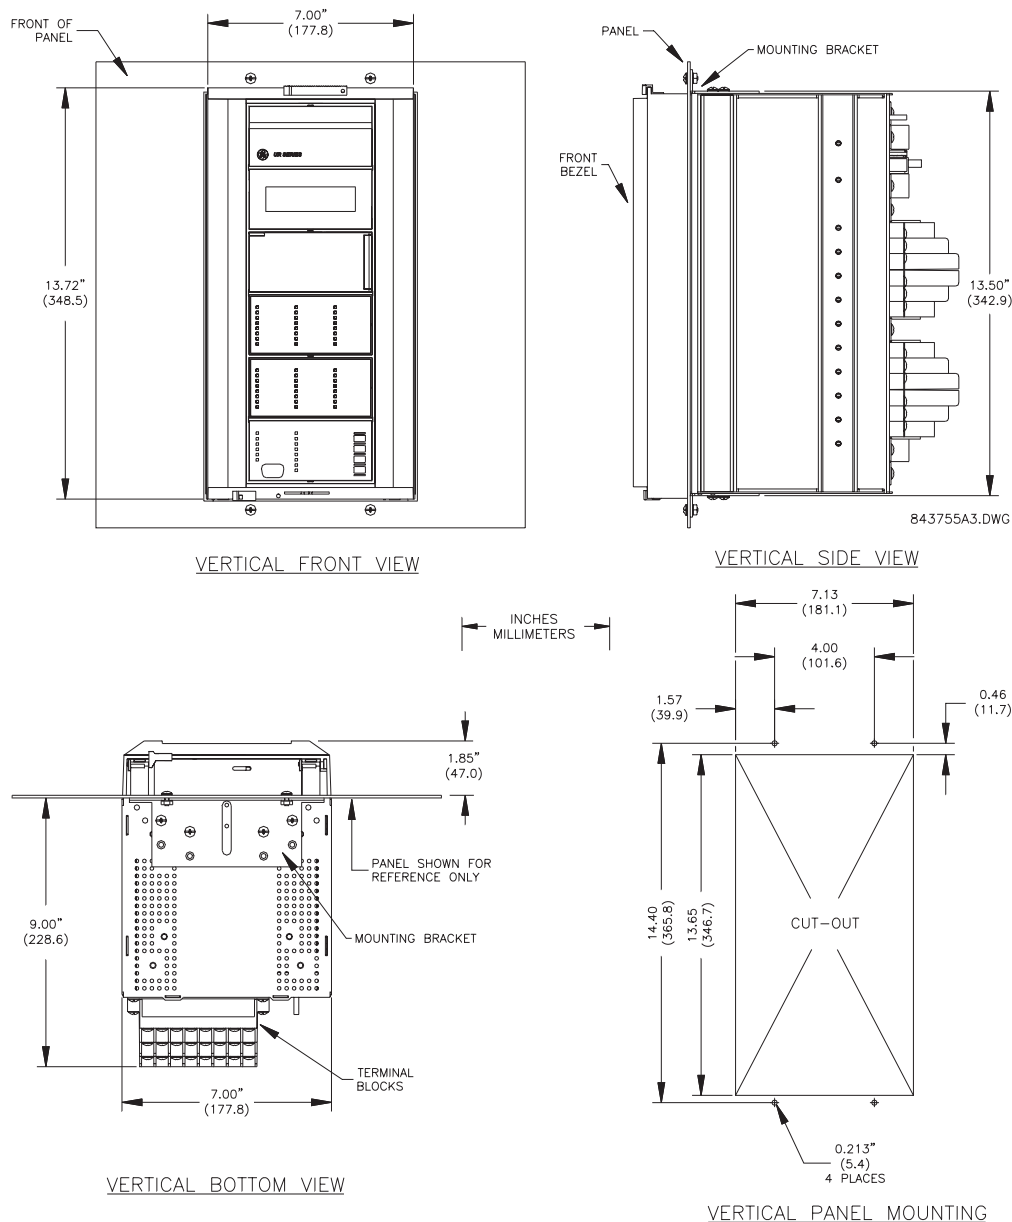


Figure 3-1: G60 VERTICAL MOUNTING AND DIMENSIONS

3

STEP 1 – CREATE THE HOLES AND CUT-OUT INTO THE PANEL  
AS PER DRAWING 843753.

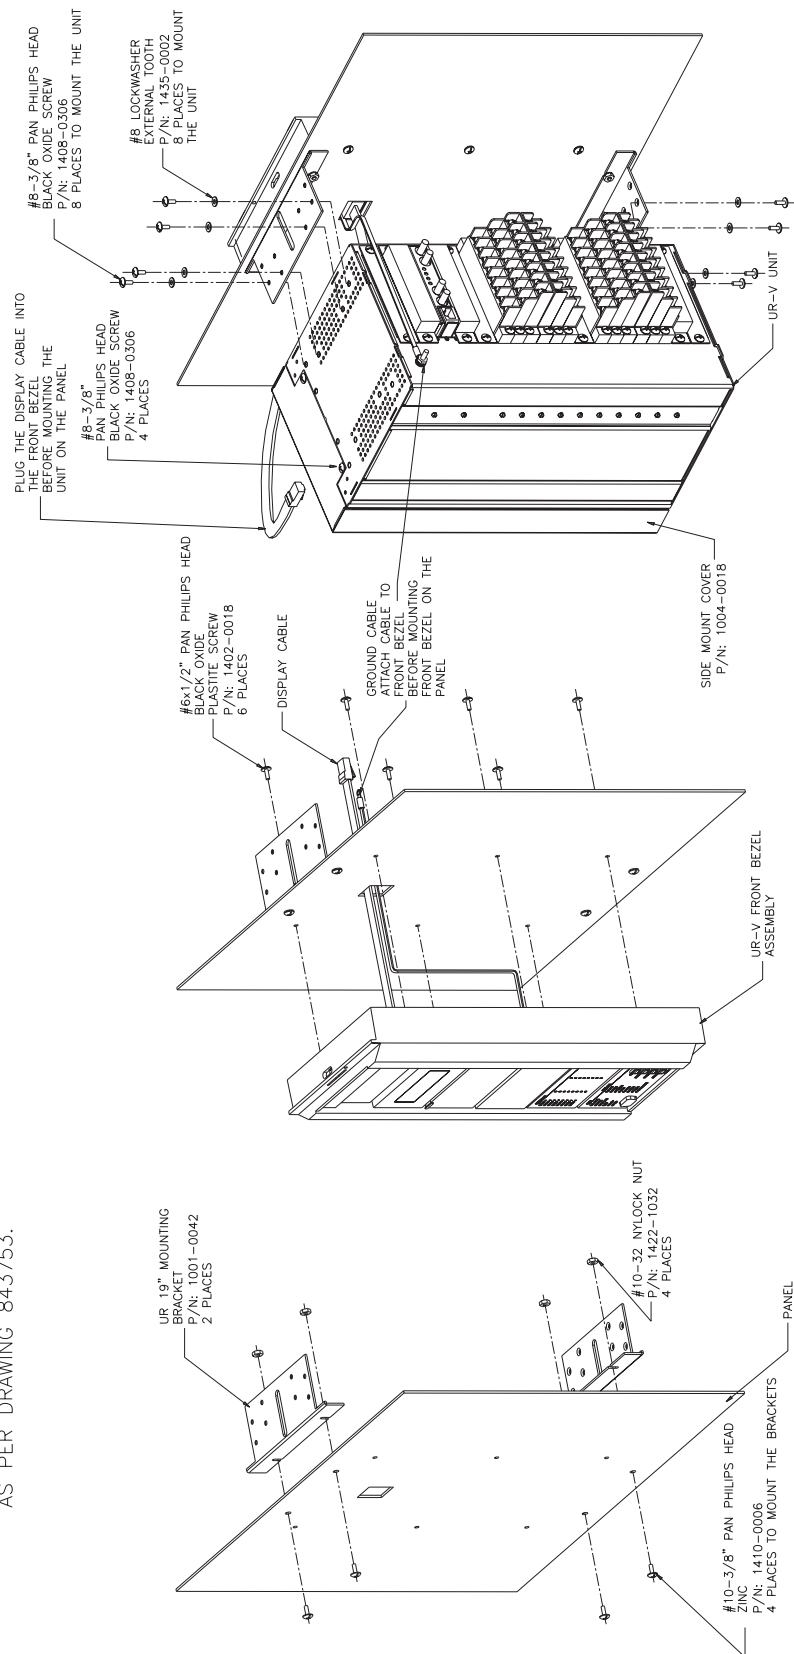


Figure 3-2: G60 VERTICAL SIDE MOUNTING INSTALLATION

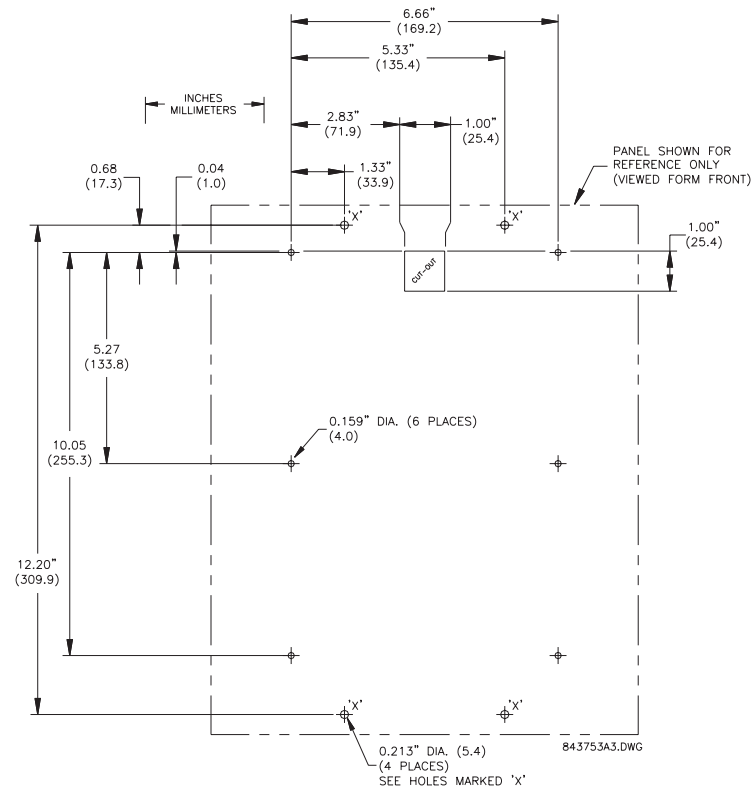


Figure 3-3: G60 VERTICAL SIDE MOUNTING REAR DIMENSIONS

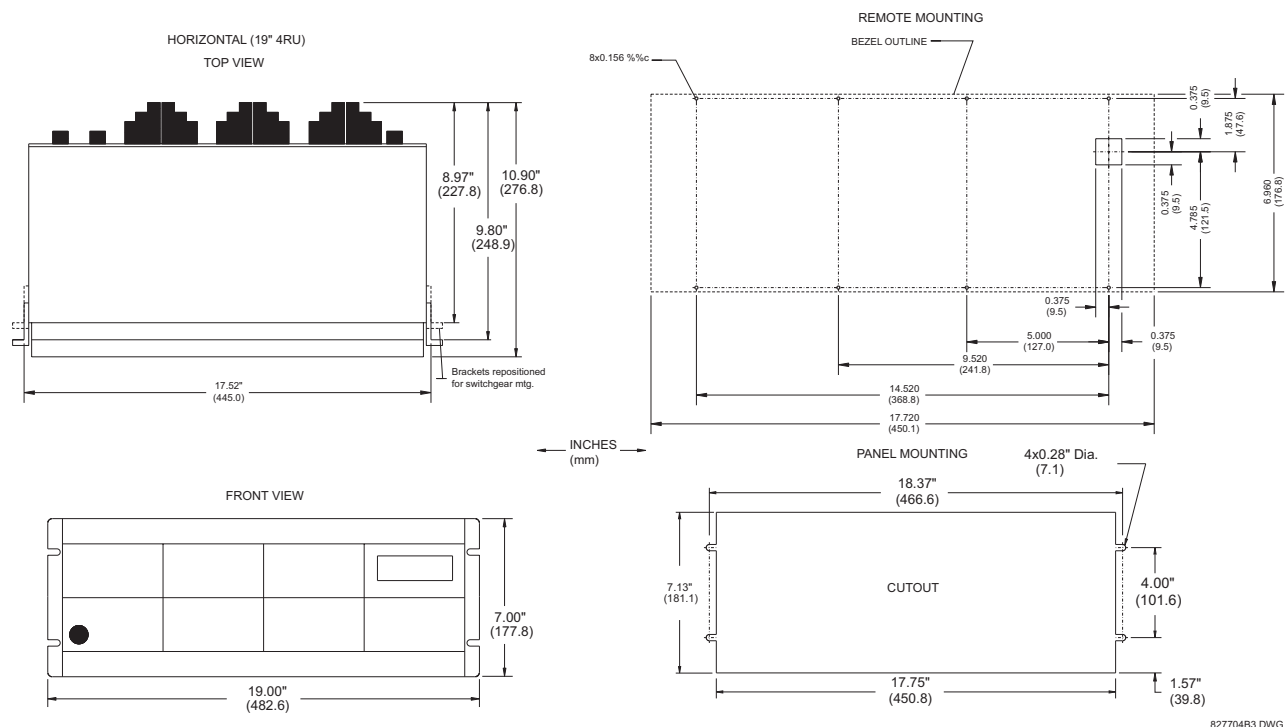


Figure 3-4: G60 HORIZONTAL MOUNTING AND DIMENSIONS

## 3.1.2 MODULE WITHDRAWAL / INSERTION



WARNING

Module withdrawal and insertion may only be performed when control power has been removed from the unit. Inserting an incorrect module type into a slot may result in personal injury, damage to the unit or connected equipment, or undesired operation!



WARNING

Proper electrostatic discharge protection (i.e. a static strap) must be used when coming in contact with modules while the relay is energized!

The relay, being modular in design, allows for the withdrawal and insertion of modules. Modules must only be replaced with like modules in their original factory configured slots.

The faceplate can be opened to the left, once the sliding latch on the right side has been pushed up, as shown in the figure below. This allows for easy accessibility of the modules for withdrawal.

3

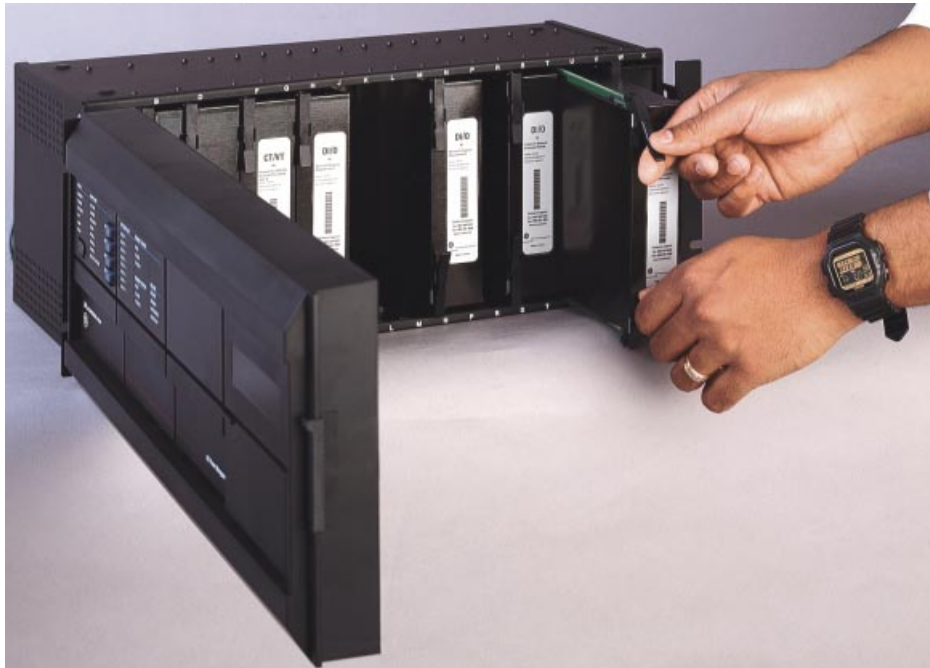


Figure 3-5: UR MODULE WITHDRAWAL/INSERTION

**WITHDRAWAL:** The ejector/inserter clips, located at the top and bottom of each module, must be pulled simultaneously to release the module for removal. Before performing this action, **control power must be removed from the relay**. Record the original location of the module to ensure that the same or replacement module is inserted into the correct slot.

**INSERTION:** Ensure that the **correct** module type is inserted into the **correct** slot position. The ejector/insert clips located at the top and at the bottom of each module must be in the disengaged position as the module is smoothly inserted into the slot. Once the clips have cleared the raised edge of the chassis, engage the clips simultaneously. When the clips have locked into position, the module will be fully inserted.



NOTE

Type 9C and 9D CPU modules are equipped with 10BaseT and 10BaseF Ethernet connectors for communications. These connectors must be individually disconnected from the module before the it can be removed from the chassis.

### 3.1.3 REAR TERMINAL LAYOUT




### Figure 3–6: REAR TERMINAL VIEW



**Do not touch any rear terminals while the relay is energized!**

The relay follows a convention with respect to terminal number assignments which are three characters long assigned in order by module slot position, row number, and column letter. Two-slot wide modules take their slot designation from the first slot position (nearest to CPU module) which is indicated by an arrow marker on the terminal block. See the following figure for an example of rear terminal assignments.

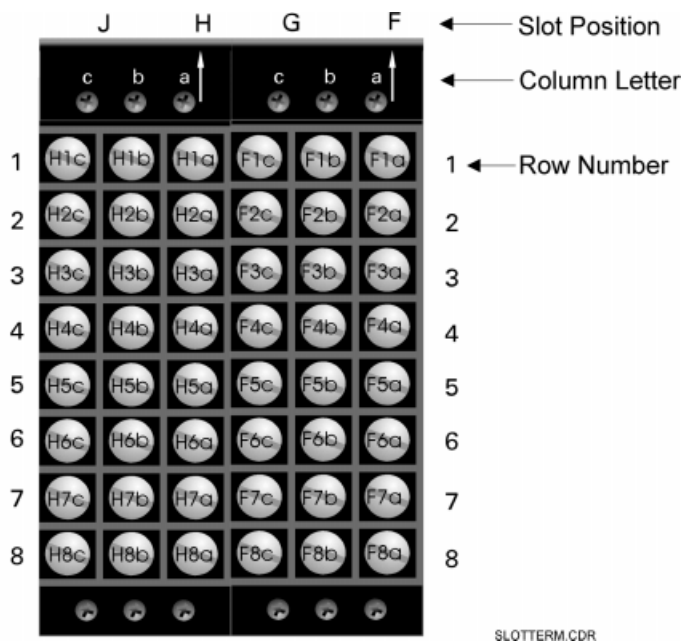

**Figure 3–7: EXAMPLE OF MODULES IN F & H SLOTS**

# 3



## 3.2.2 DIELECTRIC STRENGTH

## a) RATINGS

The dielectric strength of UR module hardware is shown in the following table:

**Table 3–1: DIELECTRIC STRENGTH OF UR MODULE HARDWARE**

MODULE TYPE	MODULE FUNCTION	TERMINALS		DIELECTRIC STRENGTH (AC)
		FROM	TO	
1	Power Supply	High (+); Low (+); (–)	Chassis	2000 V AC for 1 min. (See Precaution 1)
1	Power Supply	48 V DC (+) and (–)	Chassis	2000 V AC for 1 min. (See Precaution 1)
1	Power Supply	Relay Terminals	Chassis	2000 V AC for 1 min. (See Precaution 1)
2	Reserved for Future	N/A	N/A	N/A
3	Reserved for Future	N/A	N/A	N/A
4	Reserved for Future	N/A	N/A	N/A
5	Analog I/O	All except 8b	Chassis	< 50 V DC
6	Digital I/O	All (See Precaution 2)	Chassis	2000 V AC for 1 min.
8	CT/VT	All	Chassis	2000 V AC for 1 min.
9	CPU	All except 7b	Chassis	< 50 VDC

## b) TESTING

Filter networks and transient protection clamps are used in module hardware to prevent damage caused by high peak voltage transients, radio frequency interference (RFI) and electromagnetic interference (EMI). These protective components **can be damaged** by application of the ANSI/IEEE C37.90 specified test voltage for a period longer than the specified one minute. For testing of dielectric strength where the test interval may exceed one minute, always observe the following precautions:

**Test Precautions:**

1. The connection from ground to the Filter Ground (Terminal 8b) and Surge Ground (Terminal 8a) must be removed before testing.
2. Some versions of the digital I/O module have a Surge Ground connection on Terminal 8b. On these module types, this connection must be removed before testing.

## 3.2.3 CONTROL POWER




**CONTROL POWER SUPPLIED TO THE RELAY MUST BE CONNECTED TO THE MATCHING POWER SUPPLY RANGE OF THE RELAY. IF THE VOLTAGE IS APPLIED TO THE WRONG TERMINALS, DAMAGE MAY OCCUR!**

The power supply module can be ordered with either of two possible voltage ranges. Each range has a dedicated input connection for proper operation. The ranges are as shown below (see the Technical Specifications section for details).

**Table 3–2: CONTROL POWER VOLTAGE RANGE**

RANGE	NOMINAL VOLTAGE
LO	24 to 48 V (DC only)
HI	125 to 250 V

The power supply module provides power to the relay and supplies power for dry contact input connections.

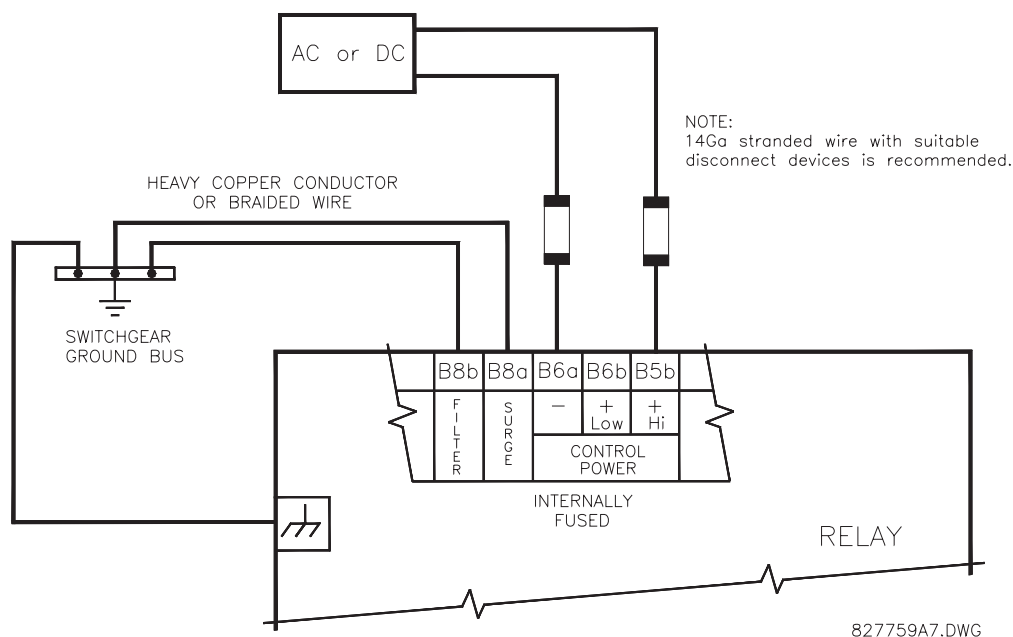

**Figure 3-9: CONTROL POWER CONNECTION**

The power supply module provides 48 V DC power for dry contact input connections and a critical failure relay (see TYPICAL WIRING DIAGRAM). The critical failure relay is a Form-C that will be energized once control power is applied and the relay has successfully booted up with no critical self-test failures. If any of the on-going self-test features detect a critical failure or control power is lost, the relay will de-energize.

### 3.2.4 CT/VT MODULES

A CT/VT module may have voltage inputs on channels 1 through 4 inclusive, or channels 5 through 8 inclusive. Channels 1 and 5 are intended for connection to phase A, and are labeled as such in the relay. Channels 2 and 6 are intended for connection to phase B, and are labeled as such in the relay. Channels 3 and 7 are intended for connection to phase C and are labeled as such in the relay. Channels 4 and 8 are intended for connection to a single phase source. If voltage, this channel is labelled the auxiliary voltage (VX). If current, this channel is intended for connection to a CT between a system neutral and ground, and is labelled the ground current (IG).

#### a) AC CURRENT TRANSFORMER INPUTS



**VERIFY THAT THE CONNECTION MADE TO THE RELAY NOMINAL CURRENT OF 1 A OR 5 A MATCHES THE SECONDARY RATING OF THE CONNECTED CTs. UNMATCHED CTs MAY RESULT IN EQUIPMENT DAMAGE OR INADEQUATE PROTECTION.**

The CT/VT module may be ordered with a standard ground current input that is the same as the phase current inputs (type 8A) or with a sensitive ground input (type 8B) which is 10 times more sensitive (see the Technical Specifications section for more details). Each AC current input has an isolating transformer and an automatic shorting mechanism that shorts the input when the module is withdrawn from the chassis. There are no internal ground connections on the current inputs. Current transformers with 1 to 50000 A primaries and 1 A or 5 A secondaries may be used.

CT connections for both ABC and ACB phase rotations are identical as shown in the TYPICAL WIRING DIAGRAM.

The exact placement of a zero sequence CT so that ground fault current will be detected is shown below. Twisted pair cabling on the zero sequence CT is recommended.



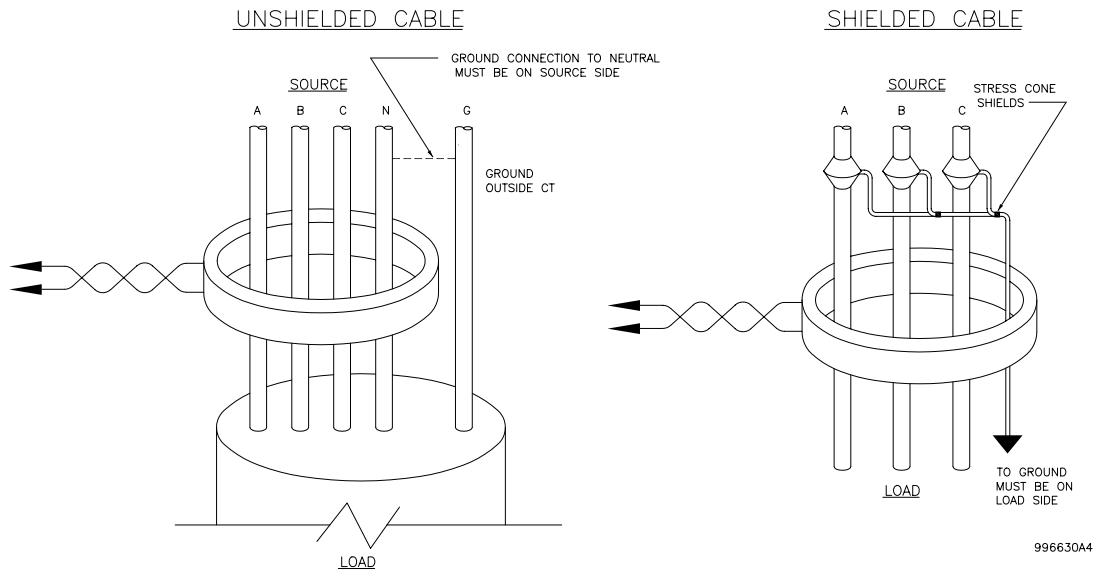


Figure 3-10: ZERO-SEQUENCE CORE BALANCE CT INSTALLATION

## b) AC VOLTAGE TRANSFORMER INPUTS

The phase voltage channels are used for most metering and protection purposes. The auxiliary voltage channel is used as input for the Synchrocheck and Volts/Hertz features.

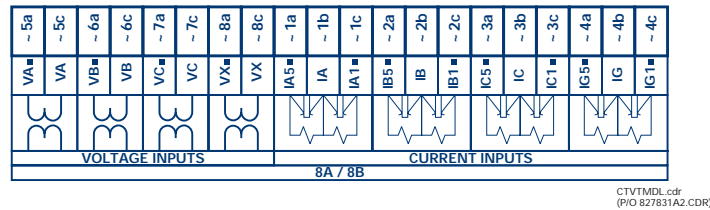


Figure 3-11: CT/VT MODULE WIRING

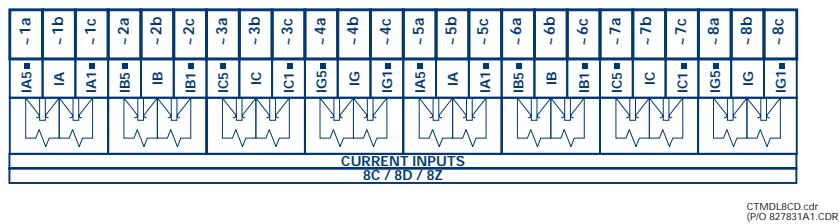


Figure 3-12: CT MODULE WIRING



Wherever a tilde “~” symbol appears, substitute with the Slot Position of the module.

## 3.2.5 CONTACT INPUTS/OUTPUTS

Every digital input/output module has 24 terminal connections. They are arranged as 3 terminals per row, with 8 rows in total. A given row of three terminals may be used for the outputs of one relay. For example, for Form-C relay outputs, the terminals connect to the normally open (NO), normally closed (NC), and common contacts of the relay. For a Form-A output, there are options of using current or voltage detection for feature supervision, depending on the module ordered. The terminal configuration for contact inputs is different for the two applications. When a digital I/O module is ordered with contact inputs, they are arranged in groups of four and use two rows of three terminals. Ideally, each input would be totally isolated from any other input. However, this would require that every input have two dedicated terminals and limit the available number of contacts based on the available number of terminals. So, although each input is individually optically isolated, each group of four inputs uses a single common as a reasonable compromise. This allows each group of four outputs to be supplied by wet contacts from different voltage sources (if required) or a mix of wet and dry contacts.


3

The tables and diagrams on the following pages illustrate the module types (6A, etc.) and contact arrangements that may be ordered for the relay. Since an entire row is used for a single contact output, the name is assigned using the module slot position and row number. However, since there are two contact inputs per row, these names are assigned by module slot position, row number, and column position.

## UR RELAY FORM-A OUTPUT CONTACTS

Some Form-A outputs include circuits to monitor the DC voltage across the output contact when it is open, and the DC current through the output contact when it is closed. Each of the monitors contains a level detector whose output is set to logic "On = 1" when the current in the circuit is above the threshold setting. The voltage monitor is set to "On = 1" when the current is above about 1 to 2.5 mA, and the current monitor is set to "On = 1" when the current exceeds about 80 to 100 mA. The voltage monitor is intended to check the health of the overall trip circuit, and the current monitor can be used to seal-in the output contact until an external contact has interrupted current flow. The block diagrams of the circuits are below above for the Form-A outputs with:

- optional voltage monitor
- optional current monitor
- with no monitoring

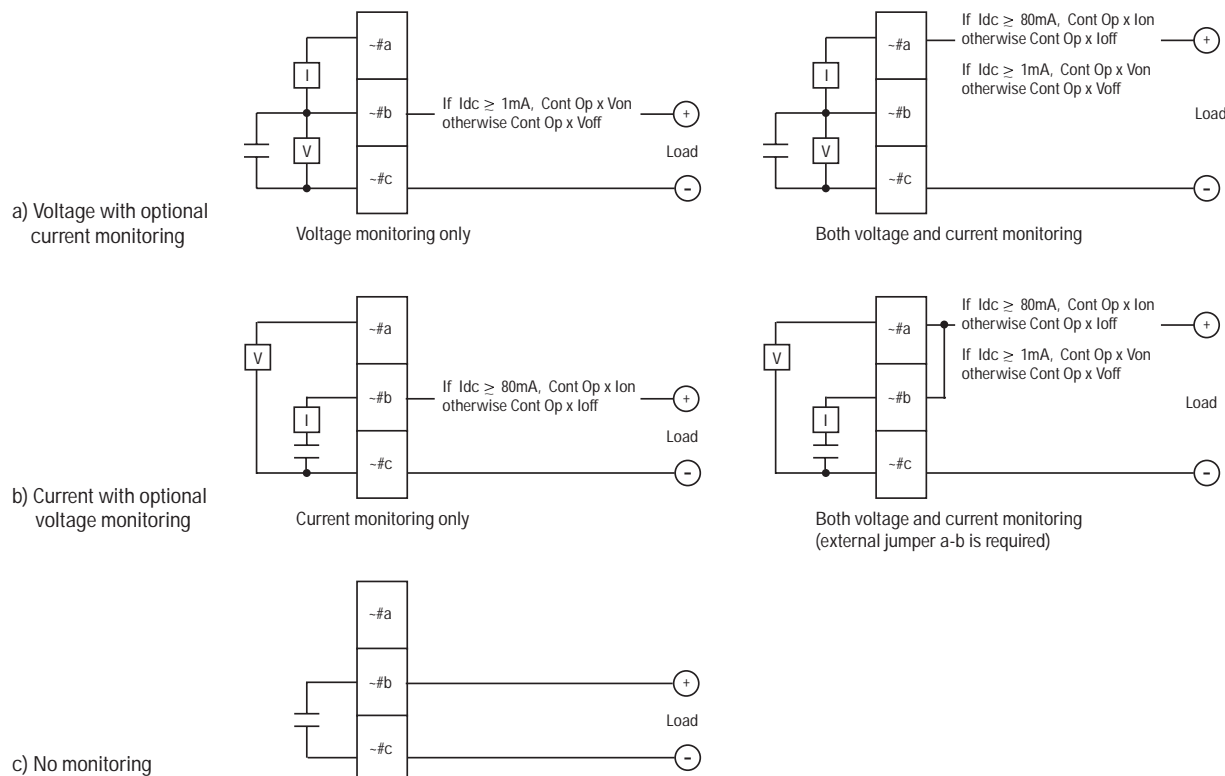

827821A4.CDR

The operation of voltage and current monitors is reflected with the corresponding FlexLogic™ operands (Cont Op # Von, Cont Op # Voff, Cont Op # Ion, and Cont Op # Ioff) which can be used in protection, control and alarm logic. The typical application of the voltage monitor is Breaker Trip Circuit Integrity monitoring; a typical application of the Current monitor is seal-in of the control command. Refer DIGITAL ELEMENTS section for an example of how Form A contacts can be applied for Breaker Trip Circuit Integrity Monitoring.



**Relay contacts must be considered unsafe to touch when the unit is energized!! If the relay contacts need to be used for low voltage accessible applications, it is the customer's responsibility to ensure proper insulation levels!**



#### USE OF FORM-A OUTPUTS IN HIGH IMPEDANCE CIRCUITS

For Form-A output contacts internally equipped with a voltage measuring circuit across the contact, the circuit has an impedance that can cause a problem when used in conjunction with external high input impedance monitoring equipment such as modern relay test set trigger circuits. These monitoring circuits may continue to read the Form-A contact as being closed after it has closed and subsequently opened, when measured as an impedance.

The solution to this problem is to use the voltage measuring trigger input of the relay test set, and connect the Form-A contact through a voltage-dropping resistor to a DC voltage source. If the 48 V DC output of the power supply is used as a source, a 500 Ω, 10 W resistor is appropriate. In this configuration, the voltage across either the Form-A contact or the resistor can be used to monitor the state of the output.



**Wherever a tilde “~” symbol appears, substitute with the Slot Position of the module; wherever a number sign “#” appears, substitute the contact number**



**When current monitoring is used to seal-in the Form-A contact outputs, the FlexLogic™ Operand driving the contact output should be given a reset delay of 10 ms to prevent damage of the output contact (in situations when the element initiating the contact output is bouncing, at values in the region of the pickup value).**

**Table 3–3: DIGITAL I/O MODULE ASSIGNMENTS**

~6A I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-C
~4	Form-C
~5a, ~5c	2 Inputs
~6a, ~6c	2 Inputs
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6B I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-C
~4	Form-C
~5	Form-C
~6	Form-C
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6C I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT
~1	Form-C
~2	Form-C
~3	Form-C
~4	Form-C
~5	Form-C
~6	Form-C
~7	Form-C
~8	Form-C

~6D I/O MODULE	
TERMINAL ASSIGNMENT	INPUT
~1a, ~1c	2 Inputs
~2a, ~2c	2 Inputs
~3a, ~3c	2 Inputs
~4a, ~4c	2 Inputs
~5a, ~5c	2 Inputs
~6a, ~6c	2 Inputs
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6E I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-C
~2	Form-C
~3	Form-C
~4	Form-C
~5a, ~5c	2 Inputs
~6a, ~6c	2 Inputs
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6F I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT
~1	Fast Form-C
~2	Fast Form-C
~3	Fast Form-C
~4	Fast Form-C
~5	Fast Form-C
~6	Fast Form-C
~7	Fast Form-C
~8	Fast Form-C

~6G I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-A
~4	Form-A
~5a, ~5c	2 Inputs
~6a, ~6c	2 Inputs
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6H I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-A
~4	Form-A
~5	Form-A
~6	Form-A
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6K I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT
~1	Form-C
~2	Form-C
~3	Form-C
~4	Form-C
~5	Fast Form-C
~6	Fast Form-C
~7	Fast Form-C
~8	Fast Form-C

~6L I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-C
~4	Form-C
~5a, ~5c	2 Inputs
~6a, ~6c	2 Inputs
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6M I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-C
~4	Form-C
~5	Form-C
~6	Form-C
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6N I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-A
~4	Form-A
~5a, ~5c	2 Inputs
~6a, ~6c	2 Inputs
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6P I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-A
~4	Form-A
~5	Form-A
~6	Form-A
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6R I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-C
~4	Form-C
~5a, ~5c	2 Inputs
~6a, ~6c	2 Inputs
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6S I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-C
~4	Form-C
~5	Form-C
~6	Form-C
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6T I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-A
~4	Form-A
~5a, ~5c	2 Inputs
~6a, ~6c	2 Inputs
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

~6U I/O MODULE	
TERMINAL ASSIGNMENT	OUTPUT OR INPUT
~1	Form-A
~2	Form-A
~3	Form-A
~4	Form-A
~5	Form-A
~6	Form-A
~7a, ~7c	2 Inputs
~8a, ~8c	2 Inputs

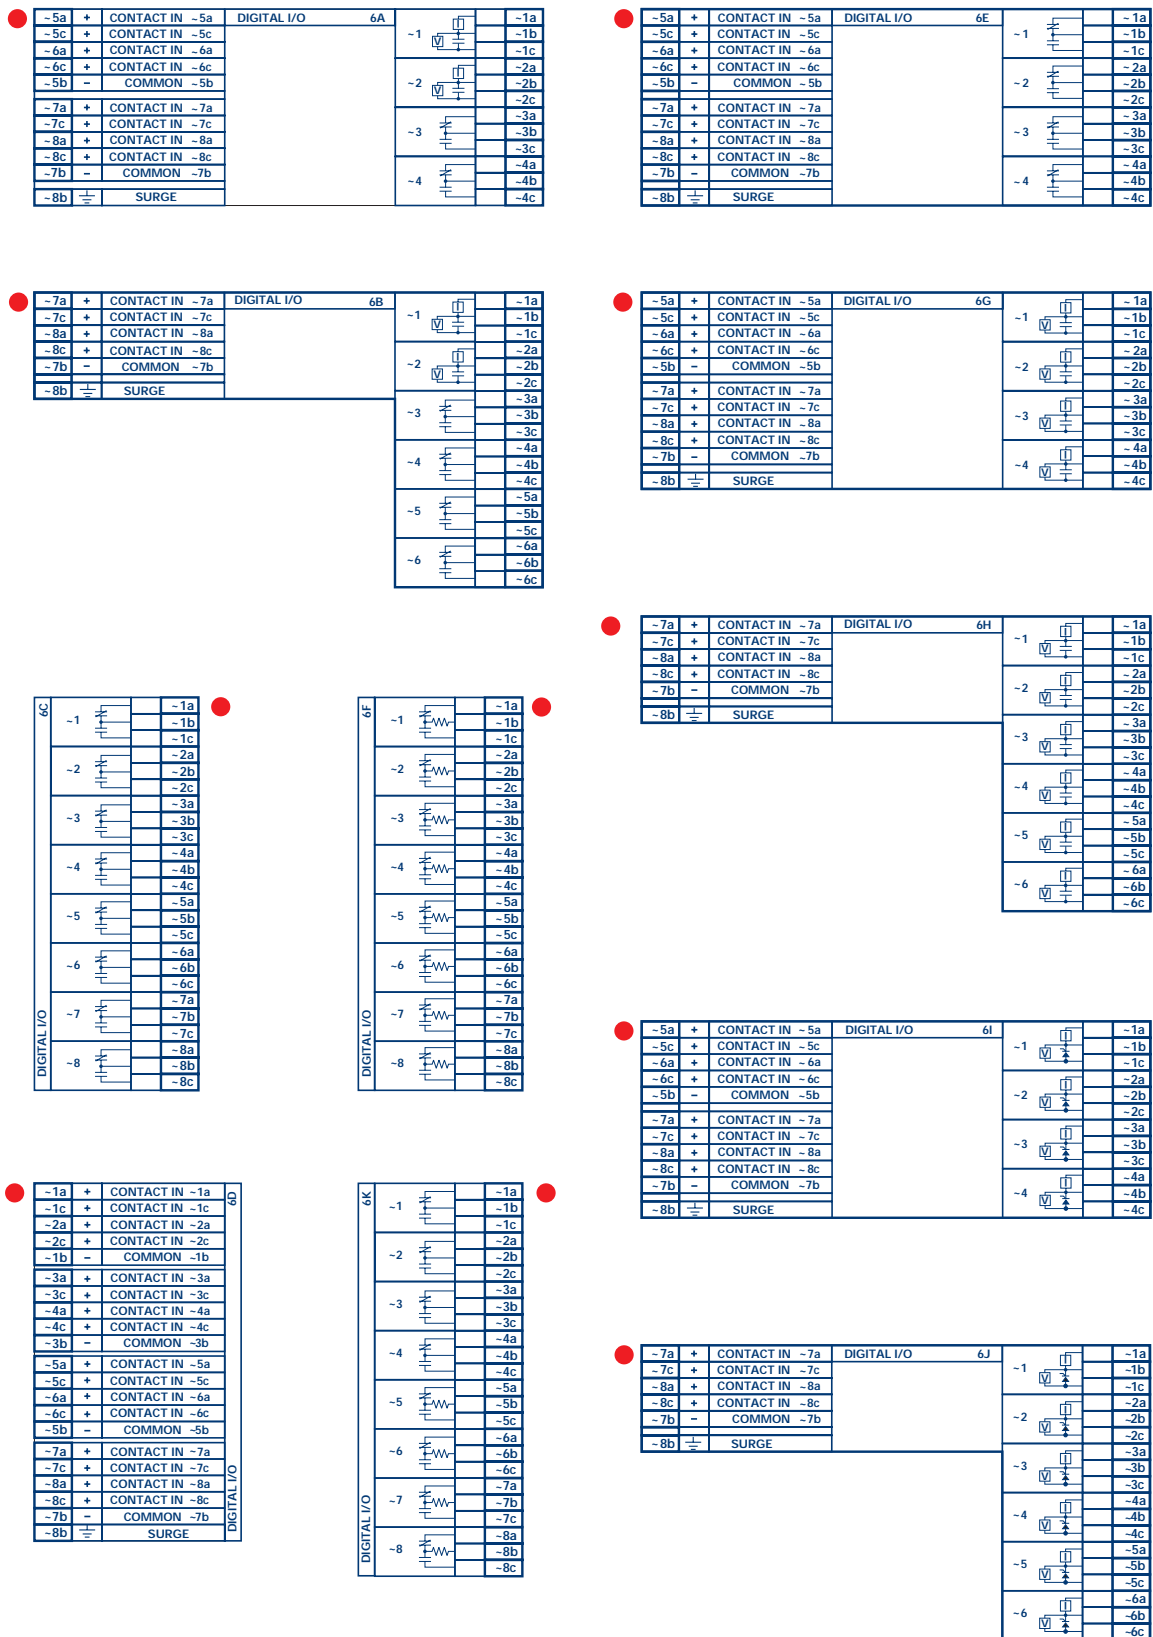


Figure 3-14: DIGITAL I/O MODULE WIRING (SHEET 1 OF 2)

3

827719AR.CDR  
Sheet 2 of 2

Figure 3-15: DIGITAL I/O MODULE WIRING (SHEET 2 OF 2)



**CORRECT POLARITY MUST BE OBSERVED FOR ALL CONTACT INPUT CONNECTIONS OR EQUIPMENT DAMAGE MAY RESULT.**

A dry contact has one side connected to terminal B3b. This is the positive 48 V DC voltage rail supplied by the power supply module. The other side of the dry contact is connected to the required contact input terminal. Each contact input group has its own common (negative) terminal which must be connected to the DC negative terminal (B3a) of the power supply module. When a dry contact closes, a current of 1 to 3 mA will flow through the associated circuit.

A wet contact has one side connected to the positive terminal of an external DC power supply. The other side of this contact is connected to the required contact input terminal. In addition, the negative side of the external source must be connected to the relay common (negative) terminal of each contact input group. The maximum external source voltage for this arrangement is 300 V DC.

The voltage threshold at which each group of four contact inputs will detect a closed contact input is programmable as 16 V DC for 24 V sources, 30 V DC for 48 V sources, 80 V DC for 110 to 125 V sources, and 140 V DC for 250 V sources.

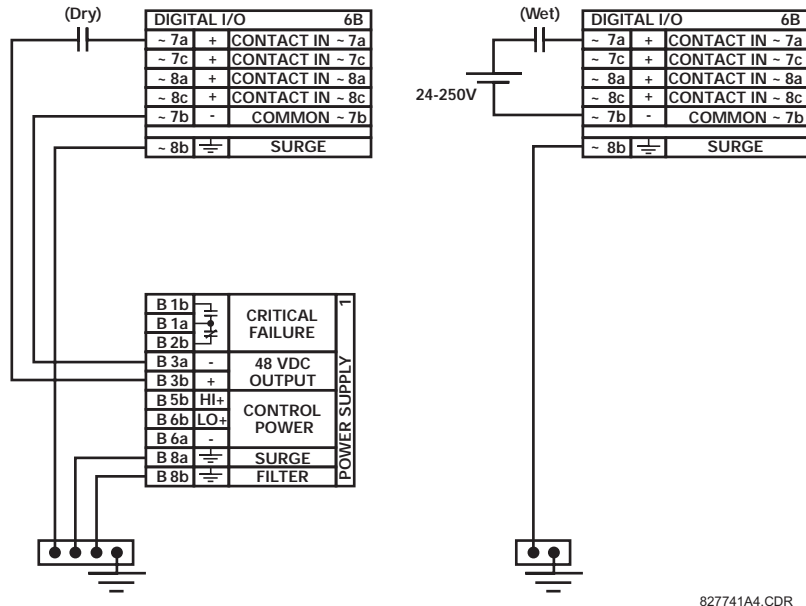


Figure 3-16: DRY AND WET CONTACT INPUT CONNECTIONS



Wherever a tilde “~” symbol appears, substitute with the Slot Position of the module.

Contact outputs may be ordered as Form-A or Form-C. The Form A contacts may be connected for external circuit supervision. These contacts are provided with voltage and current monitoring circuits used to detect the loss of DC voltage in the circuit, and the presence of DC current flowing through the contacts when the Form-A contact closes. If enabled, the current monitoring can be used as a seal-in signal to ensure that the Form-A contact does not attempt to break the energized inductive coil circuit and weld the output contacts.

## 3.2.6 TRANSDUCER INPUTS/OUTPUTS

Transducer input/output modules can receive input signals from external dcmA output transducers (dcmA In) or resistance temperature detectors (RTD). Hardware and software is provided to receive signals from these external transducers and convert these signals into a digital format for use as required.


Every transducer input/output module has a total of 24 terminal connections. These connections are arranged as three terminals per row with a total of eight rows. A given row may be used for either inputs or outputs, with terminals in column "a" having positive polarity and terminals in column "c" having negative polarity. Since an entire row is used for a single input/output channel, the name of the channel is assigned using the module slot position and row number.


Each module also requires that a connection from an external ground bus be made to Terminal 8b. The figure below illustrates the transducer module types (5C, 5E, and 5F) and channel arrangements that may be ordered for the relay.



Wherever a tilde "~" symbol appears, substitute with the Slot Position of the module.

NOTE

~1a	Hot	RTD ~1	5C
~1c	Comp		
~1b	Return	for RTD ~1 & ~2	
~2a	Hot	RTD ~2	
~2c	Comp		
~3a	Hot	RTD ~3	
~3c	Comp		
~3b	Return	for RTD ~3 & ~4	
~4a	Hot	RTD ~4	
~4c	Comp		
~5a	Hot	RTD ~5	
~5c	Comp		
~5b	Return	for RTD ~5 & ~6	
~6a	Hot	RTD ~6	
~6c	Comp		
~7a	Hot	RTD ~7	
~7c	Comp		
~7b	Return	for RTD ~7 & ~8	
~8a	Hot	RTD ~8	
~8c	Comp		
~8b		SURGE	ANALOG I/O

~1a	+	dcmA In ~1	5E
~1c	-		
~2a	+	dcmA In ~2	
~2c	-		
~3a	+	dcmA In ~3	
~3c	-		
~4a	+	dcmA In ~4	
~4c	-		
~5a	Hot	RTD ~5	ANALOG I/O
~5c	Comp		
~5b	Return	for RTD ~5 & ~6	
~6a	Hot	RTD ~6	
~6c	Comp		
~7a	Hot	RTD ~7	
~7c	Comp		
~7b	Return	for RTD ~7 & ~8	
~8a	Hot	RTD ~8	
~8c	Comp		
~8b		SURGE	

~1a	+	dcmA In ~ 1	5F  <
-----	---	-------------	---

ANALOGIO.CDR  
FROM 827831A6.CDR

Figure 3-17: TRANSDUCER I/O MODULE WIRING



## 3.2.7 RS232 FACEPLATE PROGRAM PORT

A 9 pin RS232C serial port is located on the relay's faceplate for programming with a portable (personal) computer. All that is required to use this interface is a personal computer running the URPC software provided with the relay. Cabling for the RS232 port is shown in the following figure for both 9 pin and 25 pin connectors.

Note that the baud rate for this port is fixed at **19200 bps**.

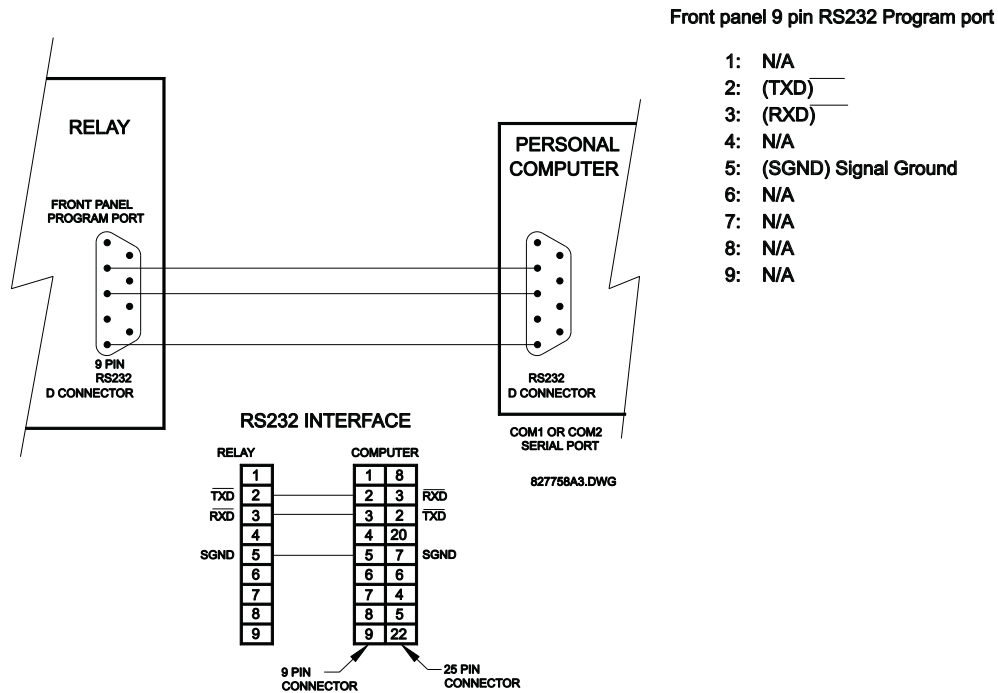


Figure 3-18: RS232 FACEPLATE PORT CONNECTION

## 3.2.8 CPU COMMUNICATION PORTS

In addition to the RS232 port on the faceplate, the relay provides the user with two additional communication port(s) depending on the CPU module installed.

Table 3-4: CPU COMMUNICATION PORT OPTIONS

CPU TYPE	COM 1	COM 2
9A	RS485	RS485
9C	10BASE-F	RS485
9D	Redundant 10BASE-F	RS485

D2a	+	RS485 COM 1	9A       CPU
D3a	-		
D4a	COM		
D3b	+	RS485 COM 2	
D4b	-		
D5b	COM		
D5a	+	IRIG-B	
D6a	-		
D7b	⏏	SURGE	

<div><div>Tx</div><div>Rx</div></div> 10BaseF	NORMAL	COM 1
<div><div></div><div></div></div> 10BaseT	TEST ONLY	
D3b	+	RS485 COM 2
D4b	-	
D5b	COM	
D5a	+	IRIG-B
D6a	-	
D7b	<div><div></div><div></div></div>	SURGE

<div><div>Tx1</div><div>Rx1</div></div> 10BaseF	NORMAL	COM 1
<div><div>Tx2</div><div>Rx2</div></div> 10BaseF	ALTERNATE	
<div><div></div><div></div></div> 10BaseT	TEST ONLY	
D3b	+	RS485 COM 2
D4b	-	
D5b	COM	IRIG-B
D5a	+	
D6a	-	
D7b	⊥	SURGE GROUND

COMMOD.CDR  
P/O 827719C2.CDR

Figure 3-19: CPU MODULE COMMUNICATIONS WIRING

## a) RS485 PORTS

RS485 data transmission and reception are accomplished over a single twisted pair with transmit and receive data alternating over the same two wires. Through the use of these port(s), continuous monitoring and control from a remote computer, SCADA system or PLC is possible.

To minimize errors from noise, the use of shielded twisted pair wire is recommended. Correct polarity must also be observed. For instance, the relays must be connected with all RS485 “+” terminals connected together, and all RS485 “-” terminals connected together. The COM terminal should be connected to the common wire inside the shield, when provided. To avoid loop currents, the shield should be grounded at one point only. Each relay should also be daisy chained to the next one in the link. A maximum of 32 relays can be connected in this manner without exceeding driver capability. For larger systems, additional serial channels must be added. It is also possible to use commercially available repeaters to increase the number of relays on a single channel to more than 32. Star or stub connections should be avoided entirely.

Lightning strikes and ground surge currents can cause large momentary voltage differences between remote ends of the communication link. For this reason, surge protection devices are internally provided at both communication ports. An isolated power supply with an optocoupled data interface also acts to reduce noise coupling. To ensure maximum reliability, all equipment should have similar transient protection devices installed.

Both ends of the RS485 circuit should also be terminated with an impedance as shown below.

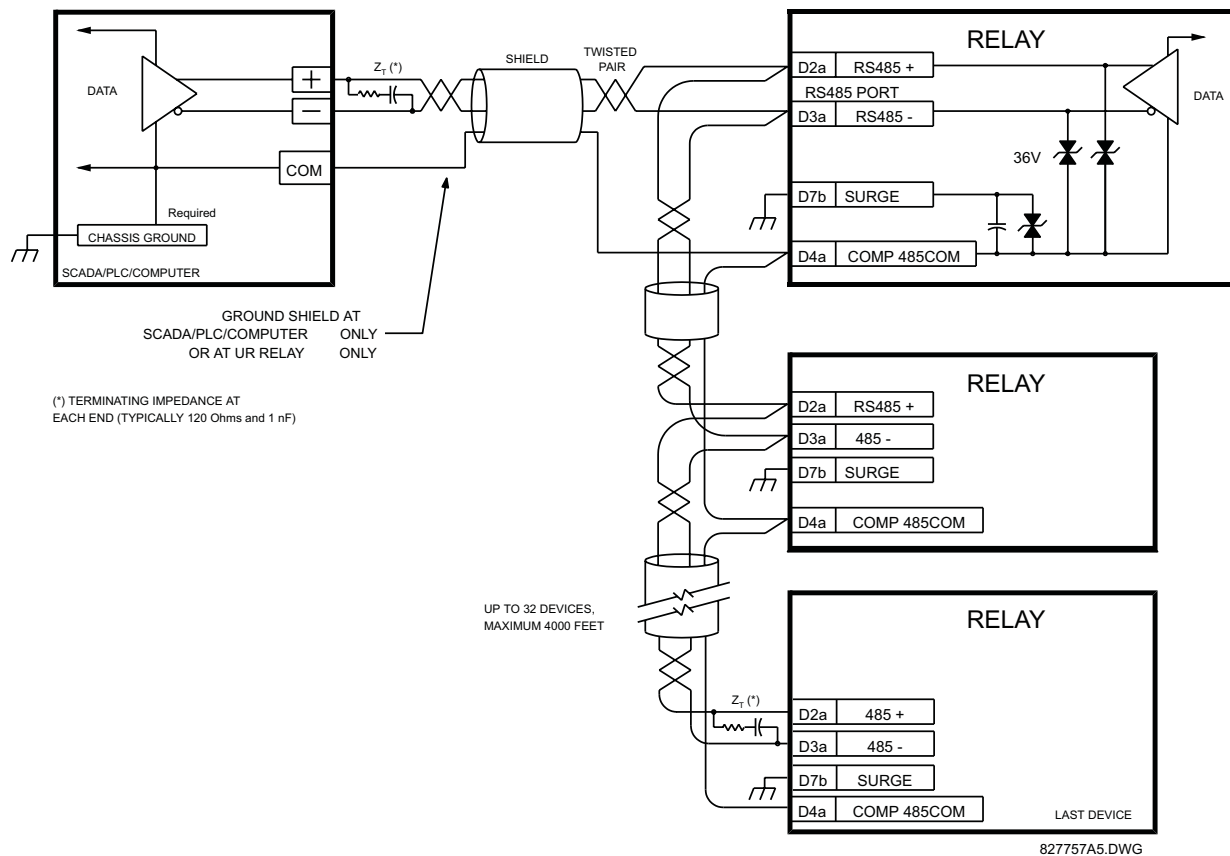


Figure 3–20: RS485 SERIAL CONNECTION

## b) 10BASE-F FIBER OPTIC PORT



**ENSURE THE DUST COVERS ARE INSTALLED WHEN THE FIBER IS NOT IN USE. DIRTY OR SCRATCHED CONNECTORS CAN LEAD TO HIGH LOSSES ON A FIBER LINK.**




**OBSERVING ANY FIBER TRANSMITTER OUTPUT MAY CAUSE INJURY TO THE EYE.**

The fiber optic communication ports allow for fast and efficient communications between relays at 10 Mbps. Optical fiber may be connected to the relay supporting a wavelength of 820 nanometers in multimode. Optical fiber is only available for CPU types 9C and 9D. The 9D CPU has a 10BaseF transmitter and receiver for optical fiber communications and a second pair of identical optical fiber transmitter and receiver for redundancy.

The optical fiber sizes supported include 50/125  $\mu\text{m}$ , 62.5/125  $\mu\text{m}$  and 100/140  $\mu\text{m}$ . The fiber optic port is designed such that the response times will not vary for any core that is 100  $\mu\text{m}$  or less in diameter. For optical power budgeting, splices are required every 1 km for the transmitter/receiver pair (the ST type connector contributes for a connector loss of 0.2 dB). When splicing optical fibers, the diameter and numerical aperture of each fiber must be the same. In order to engage or disengage the ST type connector, only a quarter turn of the coupling is required.

3

## 3.2.9 IRIG-B

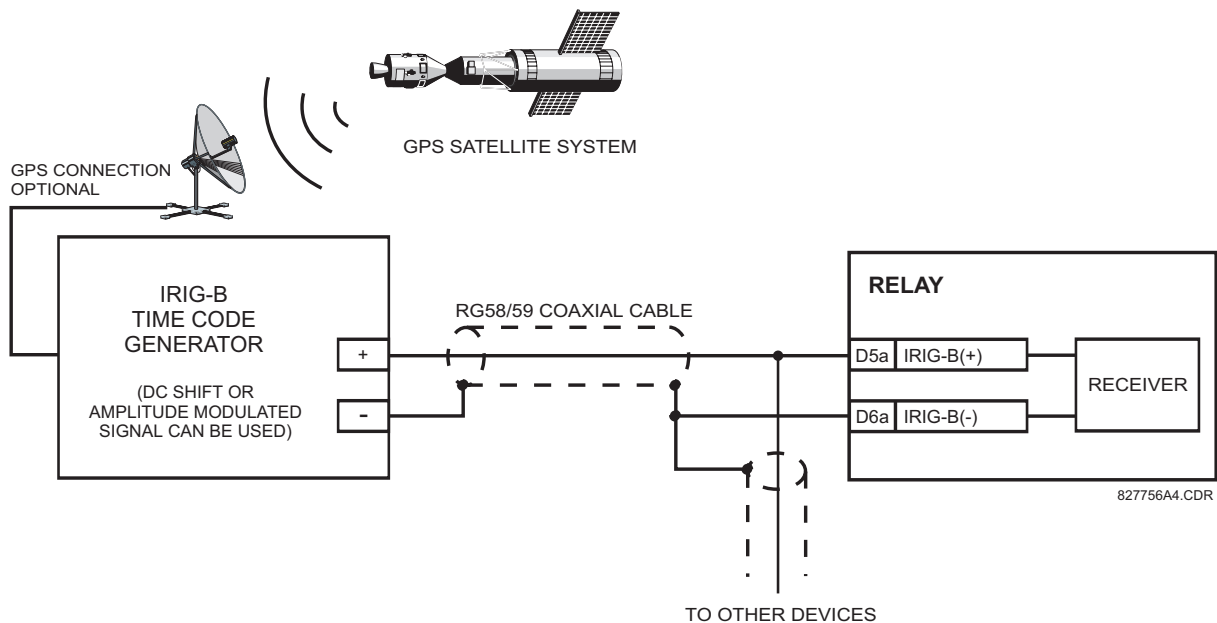

**Figure 3–21: IRIG-B CONNECTION**

IRIG-B is a standard time code format that allows stamping of events to be synchronized among connected devices within 1 millisecond. The IRIG time code formats are serial, width-modulated codes which can be either DC level shifted or amplitude modulated (AM). Third party equipment is available for generating the IRIG-B signal; this equipment may use a GPS satellite system to obtain the time reference so that devices at different geographic locations can also be synchronized.



---

**4.1.1 GRAPHICAL USER INTERFACE**

---

The URPC software provides a graphical user interface (GUI) as one of two human interfaces to a UR device. The alternate human interface is implemented via the device's faceplate keypad and display (see FACEPLATE INTERFACE section in this chapter).

URPC provides a single facility to configure, monitor, maintain, and trouble-shoot the operation of relay functions, connected over local or wide area communication networks. It can be used while disconnected (i.e. off-line) or connected (i.e. on-line) to a UR device. In off-line mode, settings files can be created for eventual downloading to the device. In on-line mode, you can communicate with the device in real-time.

The URPC software, provided with every G60 relay, can be run from any computer supporting Microsoft Windows® 95, 98, or NT. This chapter provides a summary of the basic URPC software interface features. The URPC Help file provides details for getting started and using the URPC software interface.

---

**4.1.2 CREATING A SITE LIST**

---

To start using the URPC program, a Site List must first be created. See the instructions in the URPC Help program under the topic "Creating a Site List".

---

**4.1.3 URPC® SOFTWARE OVERVIEW**

---

**a) ENGAGING A COMMUNICATING DEVICE**

The URPC software may be used in on-line mode (relay connected) to directly communicate with a UR relay. Communicating relays are organized and grouped by communication interfaces and into sites. Sites may contain any number of relays selected from the UR product series.

**b) USING SETTINGS FILES**

The URPC software interface supports three ways of handling changes to relay settings:

- In off-line mode (relay disconnected) to create or edit relay settings files for later download to communicating relays.
- While connected to a communicating relay to directly modify any relay settings via relay data view windows, and then save the settings to the relay.
- You can create/edit settings files and then write them to the relay while the interface is connected to the relay.

Settings files are organized on the basis of file names assigned by the user. A settings file contains data pertaining to the following types of relay settings:

- Device Definition
- Product Setup
- System Setup
- FlexLogic™
- Grouped Elements
- Control Elements
- Inputs/Outputs
- Testing

Factory default values are supplied and can be restored after any changes.

**c) CREATING / EDITING FLEXLOGIC™ EQUATIONS**

You can create or edit a FlexLogic™ equation in order to customize the relay. You can subsequently view the automatically generated logic diagram.

**d) VIEWING ACTUAL VALUES**

You can view real-time relay data such as input/output status and measured parameters.

**e) VIEWING TRIGGERED EVENTS**

While the interface is in either on-line or off-line mode, you can view and analyze data generated by triggered specified parameters, via:

- **Event Recorder facility**

The event recorder captures contextual data associated with the last 1024 events, listed in chronological order from most recent to oldest.

- **Oscillography facility**

The oscillography waveform traces and digital states are used to provide a visual display of power system and relay operation data captured during specific triggered events.

**f) CREATING INTERACTIVE SINGLE LINE DIAGRAMS**

The URPC® software provides an icon-based interface facility for designing and monitoring electrical schematic diagrams of sites employing UR relays.

**g) FILE SUPPORT**

- **Execution**

Any URPC file which is double clicked or opened will launch the application, or provide focus to the already opened application. If the file was a settings file (\*.urs) which had been removed from the Settings List tree menu, it will be added back to the Settings List tree menu.

- **Drag and Drop**

The Site List and Settings List control bar windows are each mutually a drag source and a drop target for device-order-code-compatible files or individual menu items. Also, the Settings List control bar window and any Windows Explorer directory folder are each mutually a file drag source and drop target.

New files which are dropped into the Settings List window are added to the tree which is automatically sorted alphabetically with respect to settings file names. Files or individual menu items which are dropped in the selected device menu in the Site List window will automatically be sent to the on-line communicating device.

**h) UR FIRMWARE UPGRADES**

The firmware of a UR device can be upgraded, locally or remotely, via the URPC® software. The corresponding instructions are provided by the URPC® Help program under the topic “Upgrading Firmware”.



Modbus addresses assigned to firmware modules, features, settings, and corresponding data items (i.e. default values, min/max values, data type, and item size) may change slightly from version to version of firmware. The addresses are rearranged when new features are added or existing features are enhanced or modified. The “EEPROM DATA ERROR” message displayed after upgrading/downgrading the firmware is a resettable, self-test message intended to inform users that the Modbus addresses have changed with the upgraded firmware. This message does not signal any problems when appearing after firmware upgrades.

## 4.1.4 URPC® SOFTWARE MAIN WINDOW

The URPC software main window supports the following primary display components:

- Title bar which shows the pathname of the active data view
- Main window menu bar
- Main window tool bar
- Site List control bar window
- Settings List control bar window
- Device data view window(s), with common tool bar
- Settings File data view window(s), with common tool bar
- Workspace area with data view tabs
- Status bar

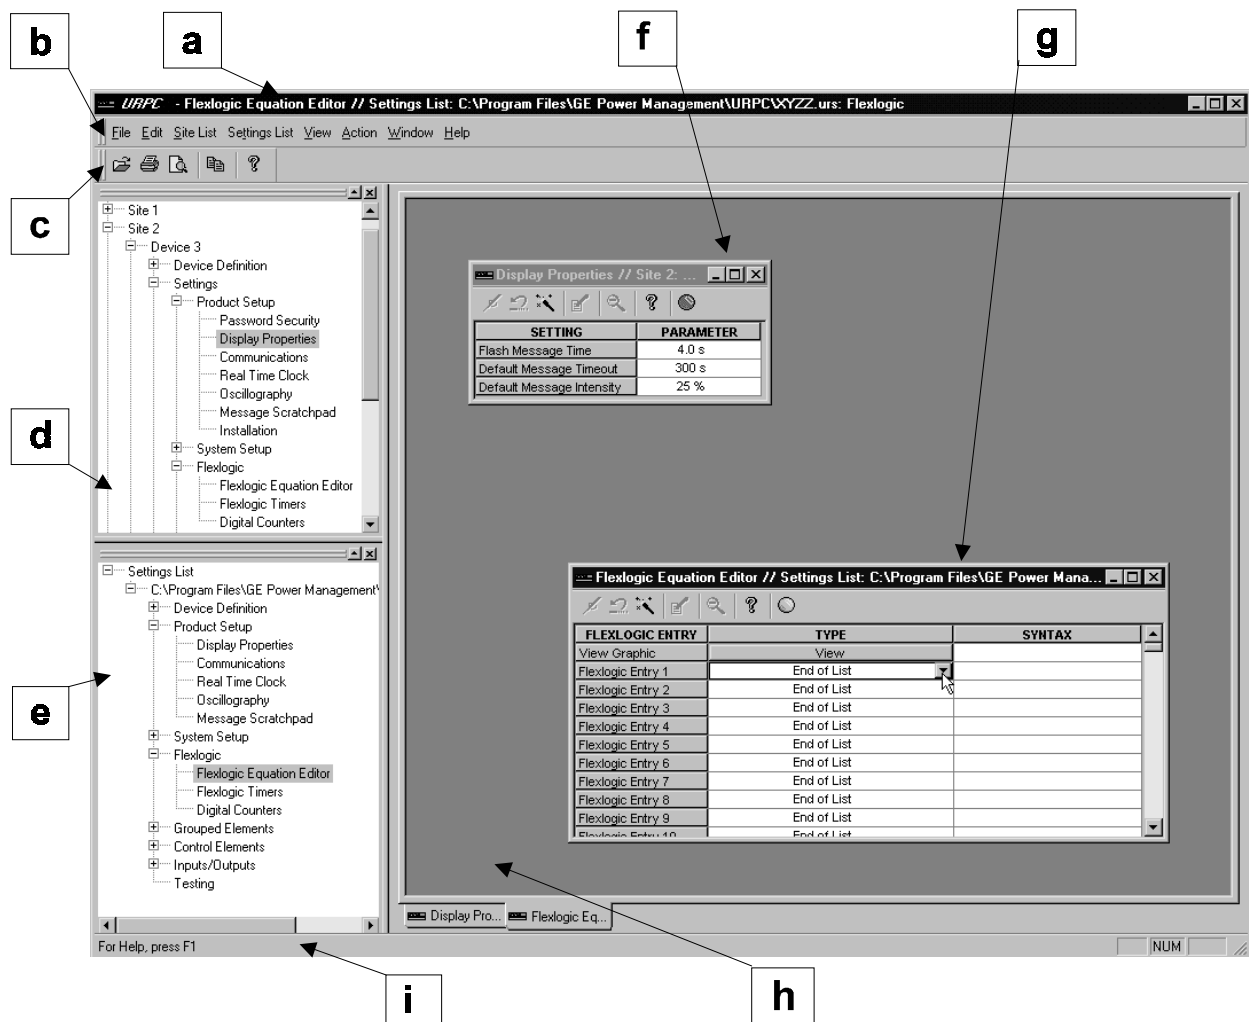


Figure 4-1: URPC SOFTWARE MAIN WINDOW

## 4.2.1 FACEPLATE

The keypad/display/LED interface is one of two alternate human interfaces supported. The other alternate human interface is implemented via the URPC software. The UR faceplate interface is available in two configurations: horizontal or vertical. The faceplate interface consists of several functional panels.

The faceplate is hinged to allow easy access to the removable modules. There is also a removable dust cover that fits over the faceplate which must be removed in order to access the keypad panel. The following two figures show the horizontal and vertical arrangement of faceplate panels.

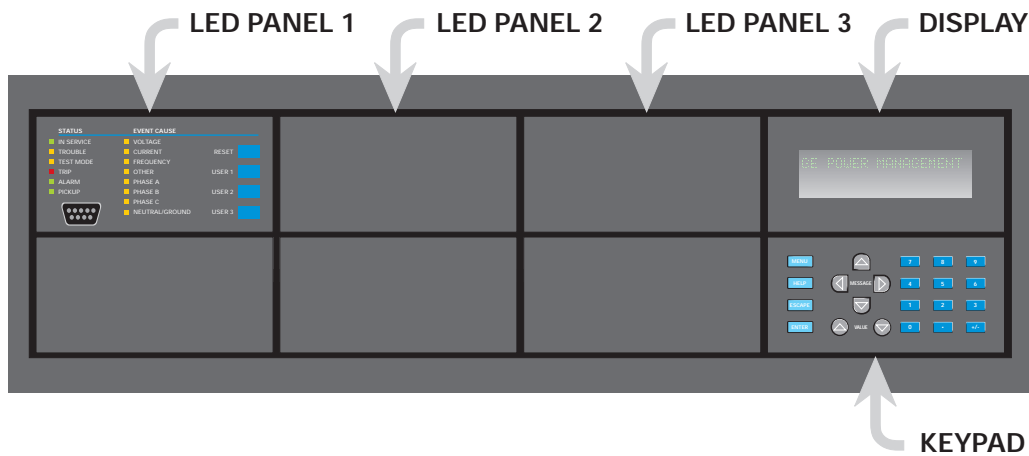


Figure 4-2: UR HORIZONTAL FACEPLATE PANELS

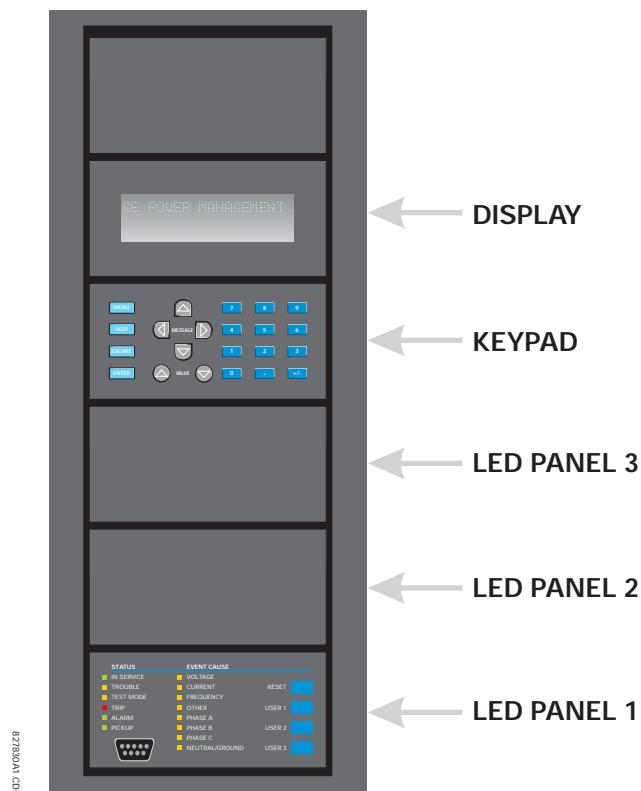


Figure 4-3: UR VERTICAL FACEPLATE PANELS



## 4.2.2 LED INDICATORS

## a) LED PANEL 1

This panel provides several LED indicators, several keys, and a communications port. The RESET key is used to reset any latched LED indicator or target message, once the condition has been cleared (these latched conditions can also be reset via the **SETTINGS** ⇒ **INPUT/OUTPUTS** ⇒ **RESETTING** menu). The USER keys are not used in this relay. The RS232 port is intended for connection to a portable PC.

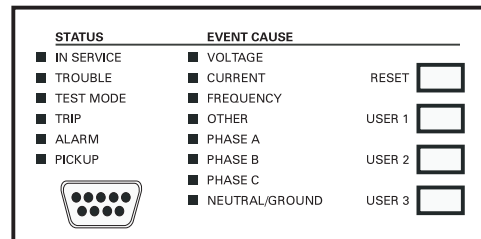


Figure 4-4: LED PANEL 1

## STATUS INDICATORS:

- **IN SERVICE:** Indicates that control power is applied; all monitored I/O and internal systems are OK; the relay has been programmed.
- **TROUBLE:** Indicates that the relay has detected an internal problem.
- **TEST MODE:** Indicates that the relay is in test mode.
- **TRIP:** Indicates that the selected FlexLogic™ operand serving as a Trip switch has operated. This indicator always latches; the RESET command must be initiated to allow the latch to be reset.
- **ALARM:** Indicates that the selected FlexLogic™ operand serving as an Alarm switch has operated. This indicator is never latched.
- **PICKUP:** Indicates that an element is picked up. This indicator is never latched.

## EVENT CAUSE INDICATORS:

These indicate the input type that was involved in a condition detected by an element that is operated or has a latched flag waiting to be reset.

- **VOLTAGE:** Indicates voltage was involved.
- **CURRENT:** Indicates current was involved.
- **FREQUENCY:** Indicates frequency was involved.
- **OTHER:** Indicates a composite function was involved.
- **PHASE A:** Indicates Phase A was involved.
- **PHASE B:** Indicates Phase B was involved.
- **PHASE C:** Indicates Phase C was involved.
- **NEUTRAL/GROUND:** Indicates neutral or ground was involved.

### b) LED PANELS 2 & 3

These panels provide 48 amber LED indicators whose operation is controlled by the user. Support for applying a customized label beside every LED is provided.

User customization of LED operation is of maximum benefit in installations where languages other than English are used to communicate with operators. Refer to the USER-PROGRAMMABLE LEDs section in Chapter 5 for the settings used to program the operation of the LEDs on these panels.

USER-PROGRAMMABLE LEDs		
■ (1)	■ (9)	■ (17)
■ (2)	■ (10)	■ (18)
■ (3)	■ (11)	■ (19)
■ (4)	■ (12)	■ (20)
■ (5)	■ (13)	■ (21)
■ (6)	■ (14)	■ (22)
■ (7)	■ (15)	■ (23)
■ (8)	■ (16)	■ (24)

USER-PROGRAMMABLE LEDs		
■ (25)	■ (33)	■ (41)
■ (26)	■ (34)	■ (42)
■ (27)	■ (35)	■ (43)
■ (28)	■ (36)	■ (44)
■ (29)	■ (37)	■ (45)
■ (30)	■ (38)	■ (46)
■ (31)	■ (39)	■ (47)
■ (32)	■ (40)	■ (48)

Figure 4–5: LED PANELS 2 AND 3 (INDEX TEMPLATE)

## 4

### c) DEFAULT LABELS FOR LED PANEL 2

SETTINGS IN USE		
■ GROUP 1	■	■
■ GROUP 2	■	■
■ GROUP 3	■	■
■ GROUP 4	■	■
■ GROUP 5	■	■
■ GROUP 6	■	■
■ GROUP 7	■	■
■ GROUP 8	■	■

The default labels are meant to represent:

- **GROUP 1...8:** The illuminated GROUP is the active settings group.
- **SYNCHROCHECK NO n IN-SYNCH:** Voltages have satisfied the synchrocheck element.

The relay is shipped with the default label for the LED panel 2. The LEDs, however, are not pre-programmed. To match the pre-printed label, the LED settings must be entered as shown in the USER-PROGRAMMABLE LEDs section of the SETTINGS chapter. The LEDs are fully user-programmable. The default labels can be replaced by user-printed labels for both LED panels 2 and 3 as explained in the next section.

## 4.2.3 CUSTOM LABELING OF LEDS

Custom labeling of an LED-only panel is facilitated by downloading a 'zip' file from


<http://www.ge.com/indsys/pm/drawings/ur/custmod.zip>.

This file provides templates and instructions for creating appropriate labeling for the LED panel. The following procedures are contained in the downloadable file. The CorelDRAW panel-templates provide relative LED locations and located example-text (x) edit boxes. The following procedure demonstrates how to install/uninstall the custom panel labeling.

1. Remove the clear LEXAN FRONT COVER (P/N: 1501-0014).



2. Pop out the LED MODULE and/or BLANK MODULE with a screwdriver as shown below. Be careful not to damage the plastic.

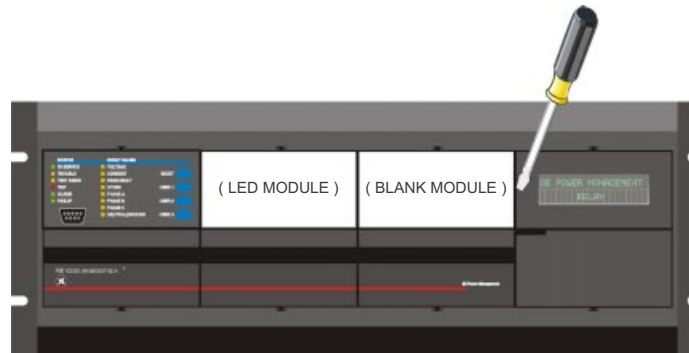

3. Place the left side of the customized module back to the front panel frame, then snap back the right side.
4. Put the clear LEXAN FRONT COVER back into place.

## 4.2.4 CUSTOMIZING THE DISPLAY MODULE

The following items are required to customize the UR display module:

- Black and white or color printer (color preferred)
  - CorelDRAW version 5.0 or later software
  - 1 each of: 8.5 x 11 white paper, exacto knife, ruler, custom display module (P/N: 1516-0069), custom module cover (P/N: 1502-0015)
1. Open the LED panel customization template in CorelDRAW. Add text in places of the Xs on the template(s) with the **Edit > Text** menu command. Delete the X place holders as required. Setup the print copy by selecting the **File > Print** menu command and pressing the "Properties" button.
  2. On the **Page Setup** tab, choose **Paper Size**: "Letter" and **Orientation**: "Landscape" and press "OK".
  3. Click the "Options" button and select the **Layout** tab.
  4. For **Position and Size** enable the "Center image" and "Maintain aspect ratio" check boxes and press "OK", then "OK" once more to print.
  5. From the printout, cut-out the BACKGROUND TEMPLATE from the three windows (use the cropmarks as a guide).

6. Put the BACKGROUND TEMPLATE on top of the custom display module (P/N: 1513-0069) and snap the clear cutome module cover (P/N: 1502-0015) over it and the templates.

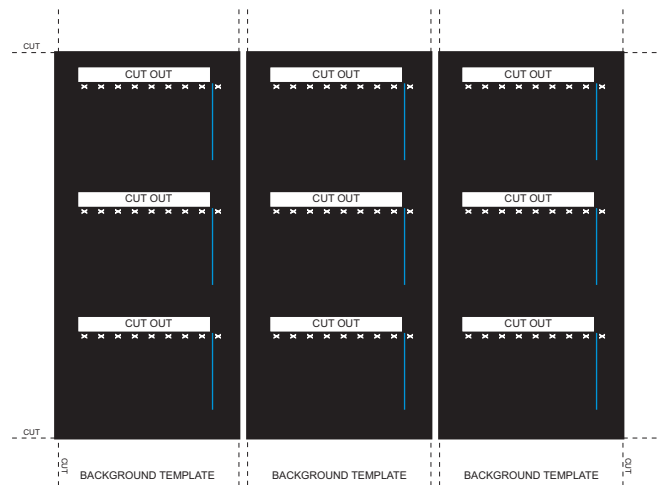


Figure 4-6: LED PANEL CUSTOMIZATION TEMPLATES (EXAMPLE)

#### 4.2.5 DISPLAY

All messages are displayed on a  $2 \times 20$  character vacuum fluorescent display to make them visible under poor lighting conditions. Messages are displayed in English and do not require the aid of an instruction manual for deciphering. While the keypad and display are not actively being used, the display will default to defined messages. Any high priority event driven message will automatically override the default message and appear on the display.

#### 4.2.6 KEYPAD

Display messages are organized into 'pages' under the following headings: Actual Values, Settings, Commands, and Targets. The **MENU** key navigates through these pages. Each heading page is broken down further into logical subgroups.

The **MESSAGE** keys navigate through the subgroups. The **VALUE** keys scroll increment or decrement numerical setting values when in programming mode. These keys also scroll through alphanumeric values in the text edit mode. Alternatively, values may also be entered with the numeric keypad.

The **ENTER** key initiates and advance to the next character in text edit mode or enters a decimal point. The **HELP** key may be pressed at any time for context sensitive help messages. The **ENTER** key stores altered setting values.


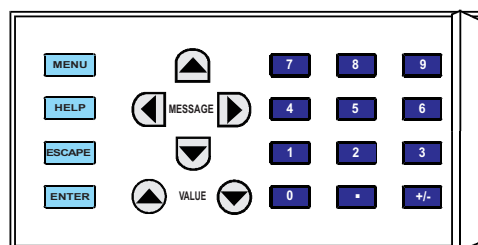


Figure 4-7: KEYPAD

## 4.2.7 MENUS


## a) NAVIGATION

Press the **MENU** key to select the desired header display page (top-level menu). The header title appears momentarily followed by a header display page menu item. Each press of the **MENU** key advances through the main heading pages as illustrated below.

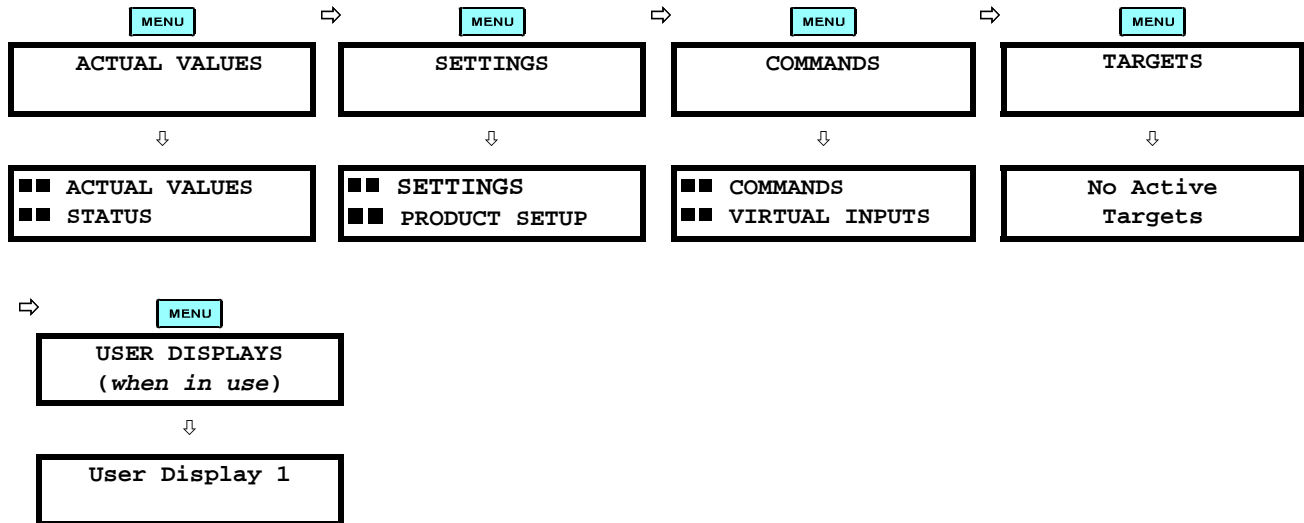


## b) HIERARCHY

The setting and actual value messages are arranged hierarchically. The header display pages are indicated by double scroll bar characters (■ ■), while sub-header pages are indicated by single scroll bar characters (■). The header display pages represent the highest level of the hierarchy and the sub-header display pages fall below this level. The MESSAGE **▲** and **▼** keys move within a group of headers, sub-headers, setting values, or actual values. Continually pressing the MESSAGE **▶** key from a header display displays specific information for the header category. Conversely, continually pressing the **◀** MESSAGE key from a setting value or actual value display returns to the header display.

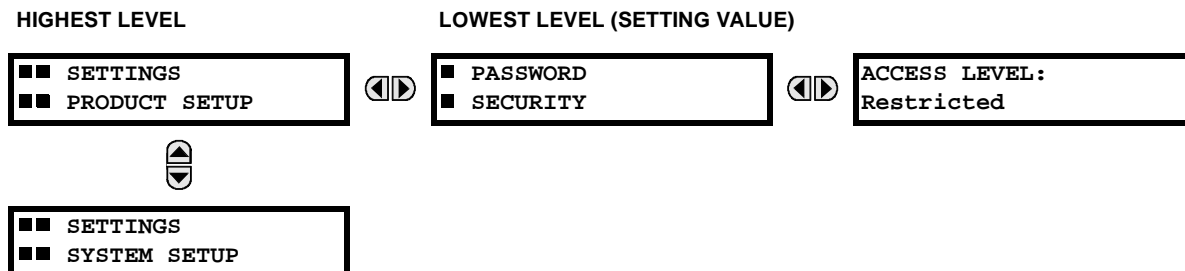


## c) EXAMPLE MENU NAVIGATION

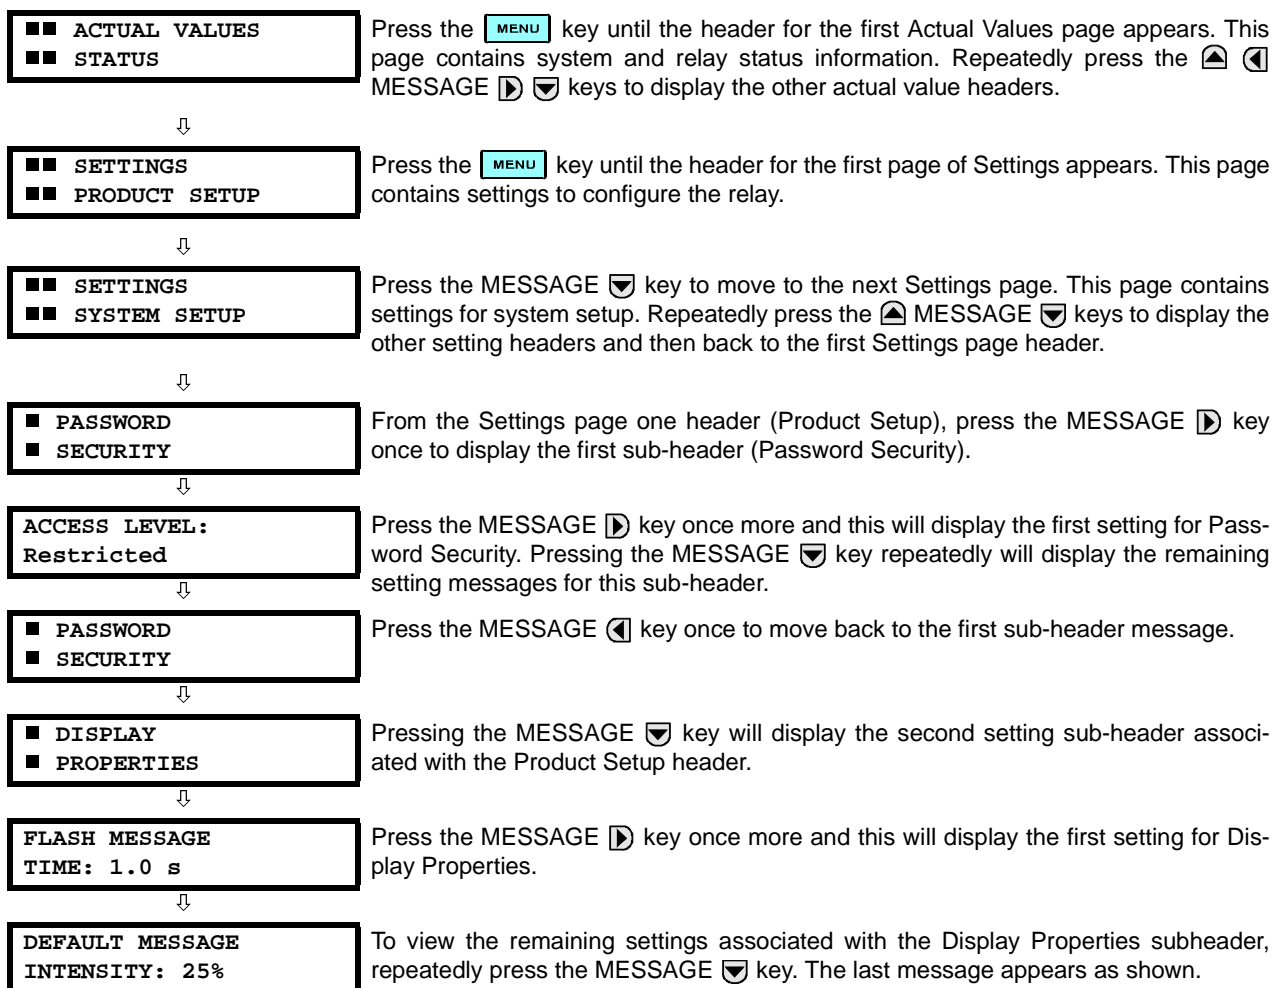

## 4.2.8 CHANGING SETTINGS


## a) ENTERING NUMERICAL DATA

Each numerical setting has its own minimum, maximum, and increment value associated with it. These parameters define what values are acceptable for a setting.

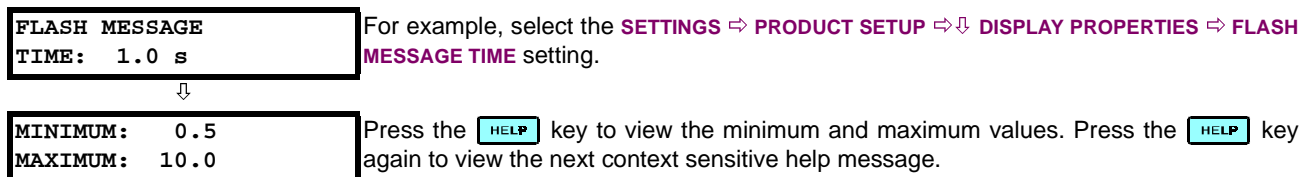

Two methods of editing and storing a numerical setting value are available.

- **0 to 9** and **.** (decimal point): The relay numeric keypad works the same as that of any electronic calculator. A number is entered one digit at a time. The leftmost digit is entered first and the rightmost digit is entered last. Pressing the MESSAGE **◀** key or pressing the ESCAPE key, returns the original value to the display.
- **▲ VALUE ▼**: The VALUE **▲** key increments the displayed value by the step value, up to the maximum value allowed. While at the maximum value, pressing the VALUE **▲** key again will allow the setting selection to continue upward from the minimum value. The VALUE **▼** key decrements the displayed value by the step value, down to the



minimum value. While at the minimum value, pressing the VALUE  key again will allow the setting selection to continue downward from the maximum value.

FLASH MESSAGE  
TIME: 2.5 s



NEW SETTING  
HAS BEEN STORED

As an example, set the flash message time setting to 2.5 seconds. Press the appropriate numeric keys in the sequence "2 . 5". The display message will change as the digits are being entered.

Until the  key is pressed, editing changes are not registered by the relay. Therefore, press the  key to store the new value in memory. This flash message will momentarily appear as confirmation of the storing process. Numerical values which contain decimal places will be rounded-off if more decimal place digits are entered than specified by the step value.

### b) ENTERING ENUMERATION DATA

Enumeration settings have data values which are part of a set, whose members are explicitly defined by a name. A set is comprised of two or more members.

ACCESS LEVEL:  
Restricted




For example, the selections available for **ACCESS LEVEL** are "Restricted", "Command", "Setting", and "Factory Service".



Enumeration type values are changed using the  VALUE  keys. The VALUE  key displays the next selection while the VALUE  key displays the previous selection.

ACCESS LEVEL:  
Setting



NEW SETTING  
HAS BEEN STORED

If the **ACCESS LEVEL** needs to be "Setting", press the  VALUE  keys until the proper selection is displayed. Press the  key at any time for the context sensitive help messages.








Changes are not registered by the relay until the  key is pressed. Pressing  stores the new value in memory. This flash message momentarily appears as confirmation of the storing process.

### c) ENTERING ALPHANUMERIC TEXT

Text settings have data values which are fixed in length, but user-defined in character. They may be comprised of upper case letters, lower case letters, numerals, and a selection of special characters.

In order to allow the relay to be customized for specific applications, there are several places where text messages may be programmed. One example is the MESSAGE SCRATCHPAD. To enter alphanumeric text messages, the following procedure should be followed:

Example: to enter the text, "Breaker #1"

1. Press  to enter text edit mode.
2. Press the VALUE  or VALUE  key until the character 'B' appears; press  to advance the cursor to the next position.
3. Repeat step 2 for the remaining characters: r,e,a,k,e,r, ,#,1.
4. Press  to store the text.
5. If you have any problem, press the  key to view the context sensitive help. Flash messages will sequentially appear for several seconds each. For the case of a text setting message, the  key displays how to edit and store a new value.

## d) ACTIVATING THE RELAY


**RELAY SETTINGS:**  
Not Programmed

When the relay is powered up, the TROUBLE indicator will be on, the IN SERVICE indicator off, and this message displayed. This indicates that the relay is in the "Not Programmed" state and is safeguarding (output relays blocked) against the installation of a relay whose settings have not been entered. This message will remain until the relay is explicitly put in the "Programmed" state.


To change the **RELAY SETTINGS:** "Not Programmed" mode to "Programmed", proceed as follows:

1. Press the **MENU** key until the **SETTINGS** header flashes momentarily and the **SETTINGS PRODUCT SETUP** message appears on the display.
2. Press the MESSAGE **▶** key until the **PASSWORD SECURITY** message appears on the display.
3. Press the MESSAGE **▼** key until the **INSTALLATION** message appears on the display.
4. Press the MESSAGE **▶** key until the **RELAY SETTINGS: Not Programmed** message is displayed.

4

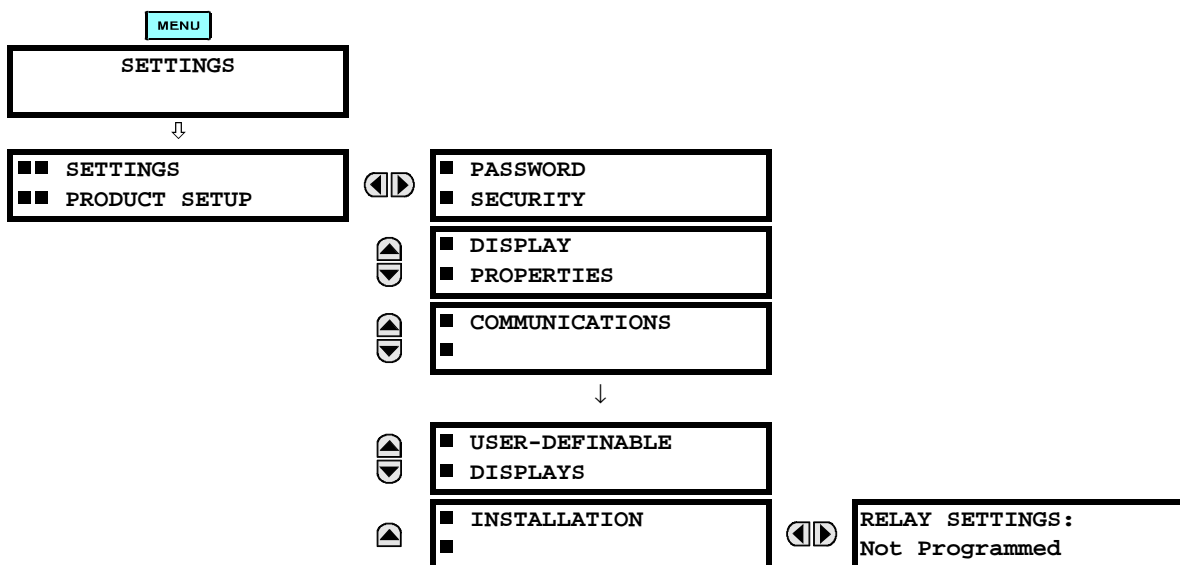

5. After the **RELAY SETTINGS: Not Programmed** message appears on the display, press the VALUE **▲** key or the VALUE **▼** key to change the selection to "Programmed".
6. Press the **ENTER** key.




7. When the "NEW SETTING HAS BEEN STORED" message appears, the relay will be in "Programmed" state and the IN SERVICE indicator will turn on.


## e) ENTERING INITIAL PASSWORDS






To enter the initial SETTING (or COMMAND) PASSWORD, proceed as follows:


1. Press the **MENU** key until the 'SETTINGS' header flashes momentarily and the 'SETTINGS PRODUCT SETUP' message appears on the display.
2. Press the MESSAGE **▶** key until the 'ACCESS LEVEL:' message appears on the display.

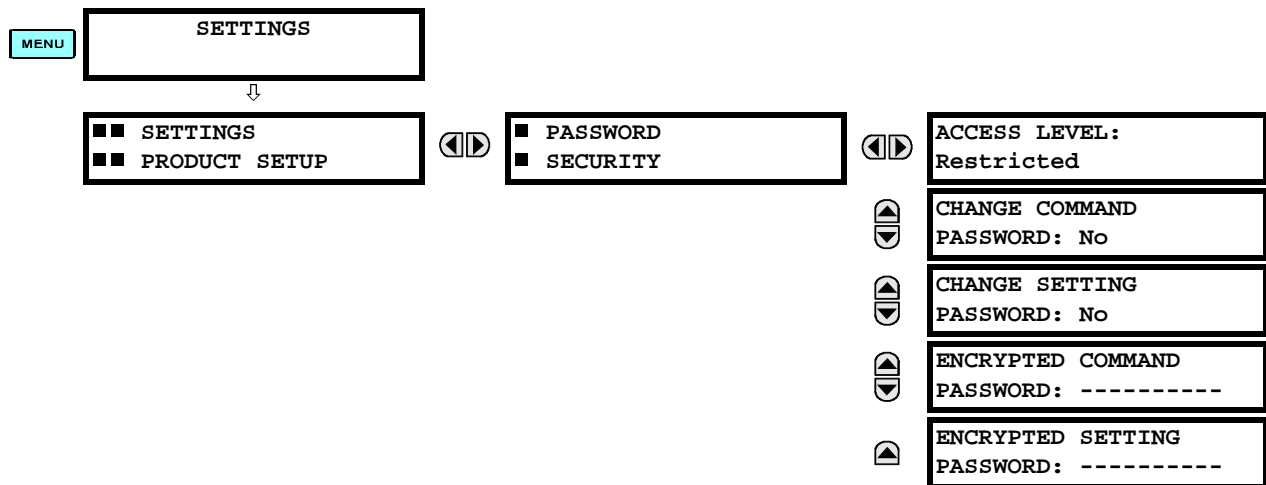

3. Press the MESSAGE  key until the 'CHANGE SETTING (or COMMAND) PASSWORD:' message appears on the display.



4. After the 'CHANGE...PASSWORD' message appears on the display, press the VALUE  key or the VALUE  key to change the selection to Yes.
5. Press the  key and the display will prompt you to 'ENTER NEW PASSWORD'.
6. Type in a numerical password (up to 10 characters) and press the  key.
7. When the 'VERIFY NEW PASSWORD' is displayed, re-type in the same password and press .

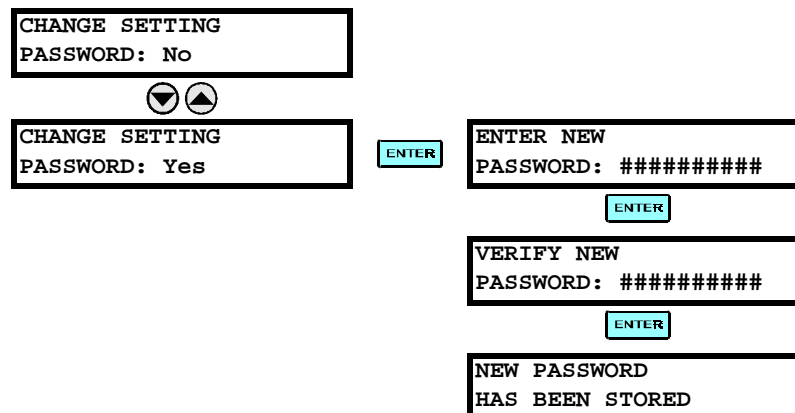

8. When the 'NEW PASSWORD HAS BEEN STORED' message appears, your new SETTING (or COMMAND) PASSWORD will be active.


#### f) CHANGING EXISTING PASSWORD


To change an existing password, follow the instructions in the previous section with the following exception. A message will prompt you to type in the existing password (for each security level) before a new password can be entered.


In the event that a password has been lost (forgotten), submit the corresponding Encrypted Password from the PASSWORD SECURITY menu to the Factory for decoding.



## 5.1.1 SETTINGS MAIN MENU

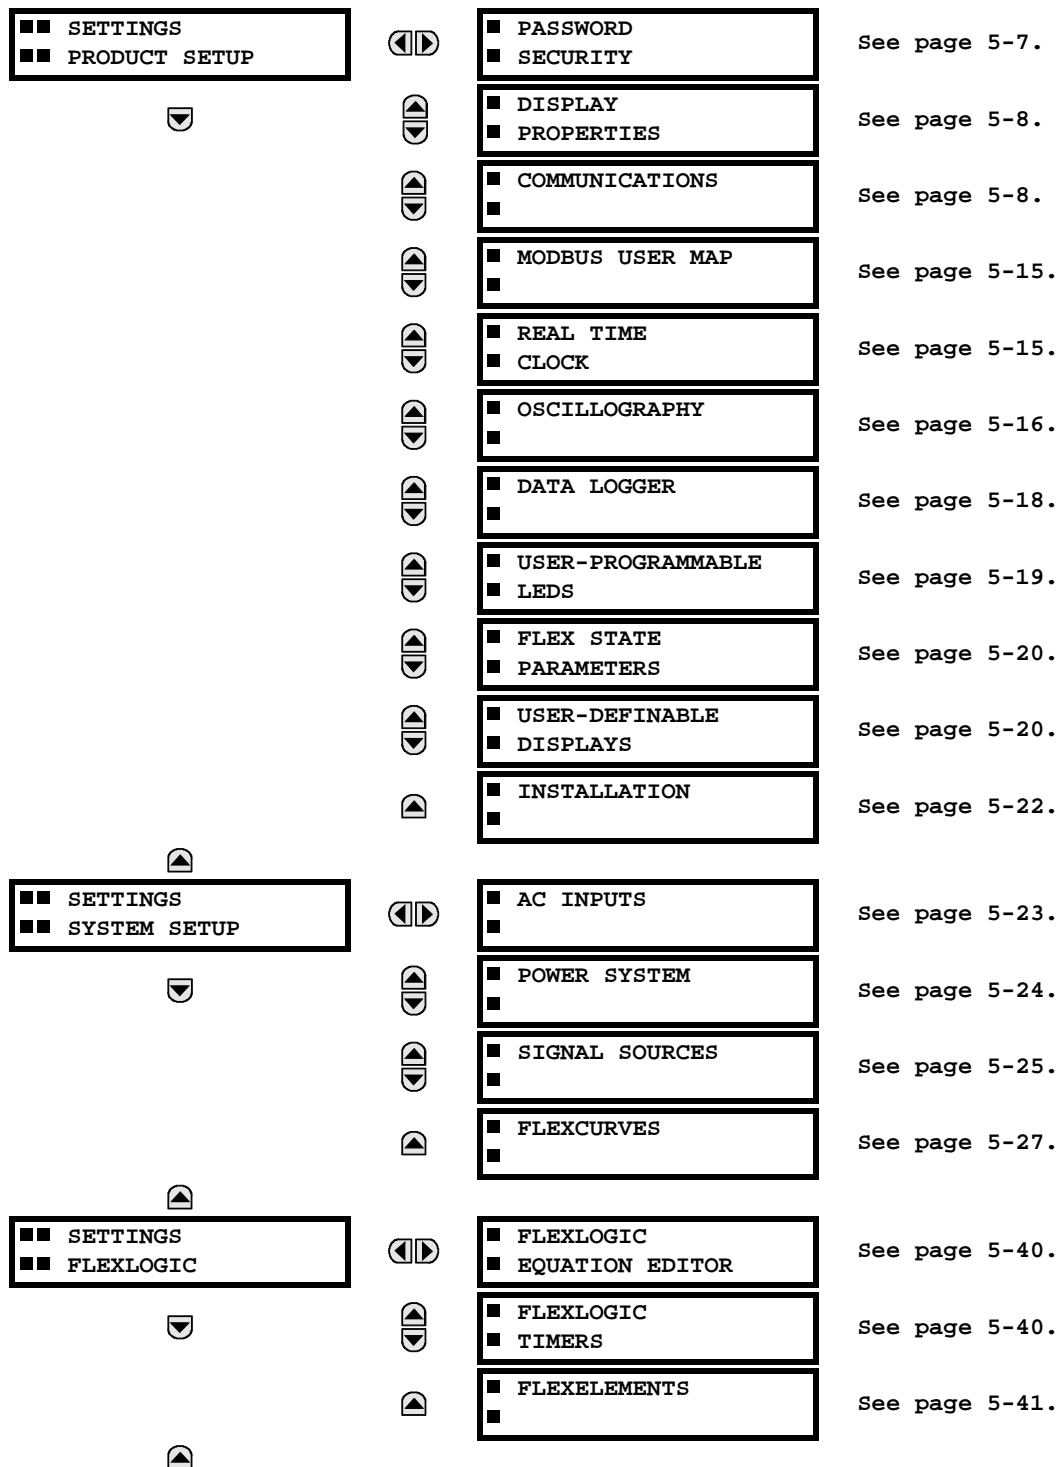

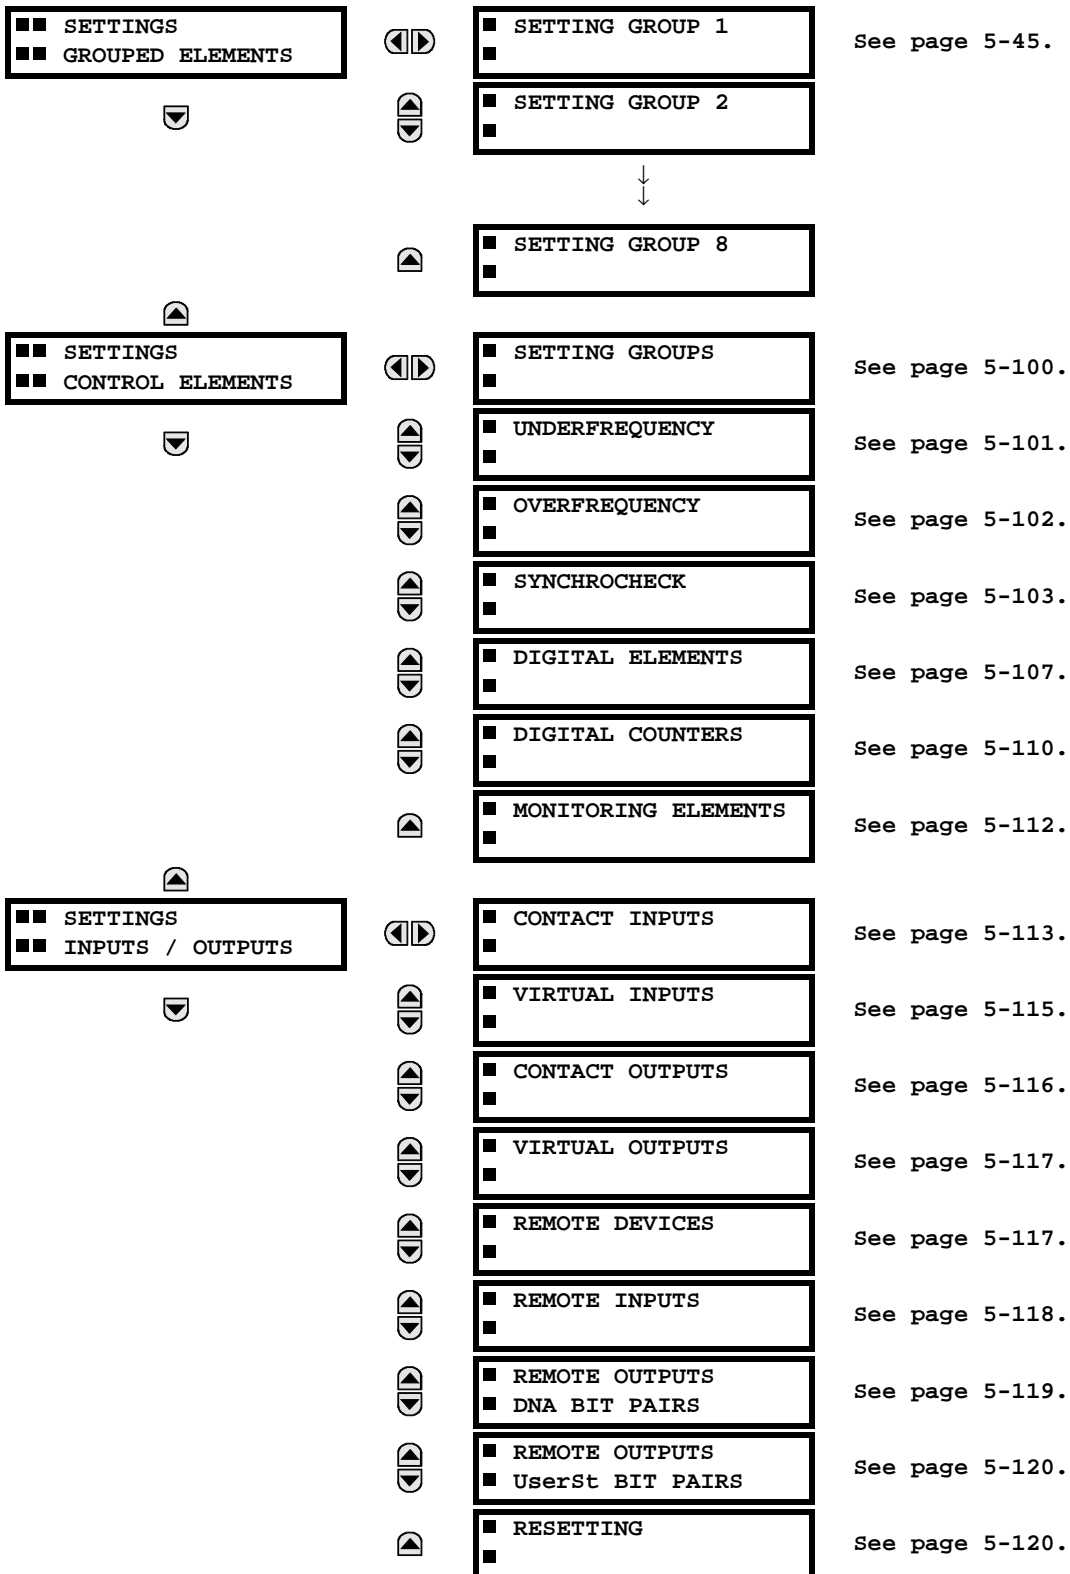

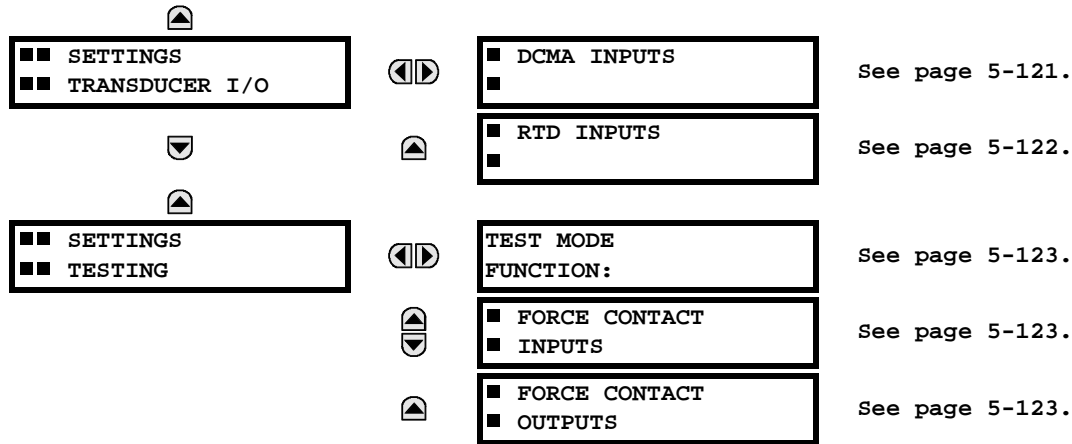

### 5.1.2 INTRODUCTION TO ELEMENTS

In the design of UR relays, the term “element” is used to describe a feature that is based around a comparator. The comparator is provided with an input (or set of inputs) that is tested against a programmed setting (or group of settings) to determine if the input is within the defined range that will set the output to logic 1, also referred to as “setting the flag”. A single comparator may make multiple tests and provide multiple outputs; for example, the time overcurrent comparator sets a Pickup flag when the current input is above the setting and sets an Operate flag when the input current has been at a level above the pickup setting for the time specified by the time-current curve settings. All comparators, except the Digital Element which uses a logic state as the input, use analog parameter actual values as the input.

Elements are arranged into two classes, GROUPED and CONTROL. Each element classed as a GROUPED element is provided with eight alternate sets of settings, in setting groups numbered 1 through 8. The performance of a GROUPED element is defined by the setting group that is active at a given time. The performance of a CONTROL element is independent of the selected active setting group.

The main characteristics of an element are shown on the element scheme logic diagram. This includes the input(s), settings, fixed logic, and the output operands that are generated (abbreviations used on scheme logic diagrams are defined in Appendix F).

Some settings for current and voltage elements are specified in per-unit (pu) calculated quantities:

**pu quantity** = (actual quantity) / (base quantity)

- For current elements, the ‘base quantity’ is the nominal secondary or primary current of the CT. Where the current source is the sum of two CTs with different ratios, the ‘base quantity’ will be the common secondary or primary current to which the sum is scaled (i.e. normalized to the larger of the 2 rated CT inputs). For example, if CT1 = 300 / 5 A and CT2 = 100 / 5 A, then in order to sum these, CT2 is scaled to the CT1 ratio. In this case, the ‘base quantity’ will be 5 A secondary or 300 A primary.
- For voltage elements, the ‘base quantity’ is the nominal secondary or primary voltage of the VT.

Some settings are common to most elements and are discussed below:

#### FUNCTION Setting

This setting programs the element to be operational when selected as “Enabled”. The factory default is “Disabled”. Once programmed to “Enabled”, any element associated with the Function becomes active and all options become available.

#### NAME Setting

This setting is used to uniquely identify the element.

#### SOURCE Setting

This setting is used to select the parameter or set of parameters to be monitored.

**PICKUP Setting**

For simple elements, this setting is used to program the level of the measured parameter above or below which the pickup state is established. In more complex elements, a set of settings may be provided to define the range of the measured parameters which will cause the element to pickup.

**PICKUP DELAY Setting**

This setting sets a time-delay-on-pickup, or on-delay, for the duration between the Pickup and Operate output states.

**RESET DELAY Setting**

This setting is used to set a time-delay-on-dropout, or off-delay, for the duration between the Operate output state and the return to logic 0 after the input transits outside the defined pickup range.

**BLOCK Setting**

The default output operand state of all comparators is a logic 0 or “flag not set”. The comparator remains in this default state until a logic 1 is asserted at the RUN input, allowing the test to be performed. If the RUN input changes to logic 0 at any time, the comparator returns to the default state. The RUN input is used to supervise the comparator. The BLOCK input is used as one of the inputs to RUN control.

**TARGET Setting**

This setting is used to define the operation of an element target message. When set to Disabled, no target message or illumination of a faceplate LED indicator is issued upon operation of the element. When set to Self-Reset, the target message and LED indication follow the Operate state of the element, and self-resets once the operate element condition clears. When set to Latched, the target message and LED indication will remain visible after the element output returns to logic 0 - until a RESET command is received by the relay.

**EVENTS Setting**

This setting is used to control whether the Pickup, Dropout or Operate states are recorded by the event recorder. When set to Disabled, element pickup, dropout or operate are not recorded as events.

When set to Enabled, an event is created for:

- (Element) PKP (pickup)
- (Element) DPO (dropout)
- (Element) OP (operate)

The DPO event is created when the measure and decide comparator output transits from the pickup state (logic 1) to the dropout state (logic 0). This could happen when the element is in the operate state if the reset delay time is not '0'.


**5.1.3 INTRODUCTION TO AC SOURCES****a) BACKGROUND**

The G60 may be used on systems with breaker-and-a-half or ring bus configurations. In these applications, each of the two three-phase sets of individual phase currents (one associated with each breaker) can be used as an input to a breaker failure element. The sum of both breaker phase currents and 3I<sub>0</sub> residual currents may be required for the circuit relaying and metering functions. For a three-winding transformer application, it may be required to calculate watts and vars for each of three windings, using voltage from different sets of VTs. All these requirements can be satisfied with a single UR relay, equipped with sufficient CT and VT input channels, by selecting the parameter to be measured. A mechanism is provided to specify the AC parameter (or group of parameters) used as the input to protection/control comparators and some metering elements.

Selection of the parameter(s) to be measured is partially performed by the design of a measuring element or protection/control comparator, by identifying the type of parameter (fundamental frequency phasor, harmonic phasor, symmetrical component, total waveform RMS magnitude, phase-phase or phase-ground voltage, etc.) to be measured. The user completes the selection process by selecting the instrument transformer input channels to be used and some of the parameters calculated from these channels. The input parameters available include the summation of currents from multiple input channels. For the summed currents of phase, 3I<sub>0</sub> and ground current, current from CTs with different ratios are adjusted to a single ratio before the summation.

A mechanism called a "Source" configures the routing of input CT and VT channels to measurement sub-systems. Sources, in the context of the UR family of relays, refer to the logical grouping of current and voltage signals such that one Source contains all of the signals required to measure the load or fault in a particular power apparatus. A given Source may contain all or some of the following signals: three-phase currents, single-phase ground current, three-phase voltages and an auxiliary voltage from a single VT for checking for synchronism.

To illustrate the concept of Sources, as applied to current inputs only, consider the breaker-and-a-half scheme as illustrated in the following figure. In this application, the current flows as shown by the labeled arrows. Some current flows through the upper bus bar to some other location or power equipment, and some current flows into transformer winding 1. The current into winding 1 of the power transformer is the phasor sum (or difference) of the currents in CT1 and CT2 (whether the sum or difference is used, depends on the relative polarity of the CT connections). The same considerations apply to transformer winding 2. The protection elements need access to the net current for the protection of the transformer, but some elements may need access to the individual currents from CT1 and CT2.

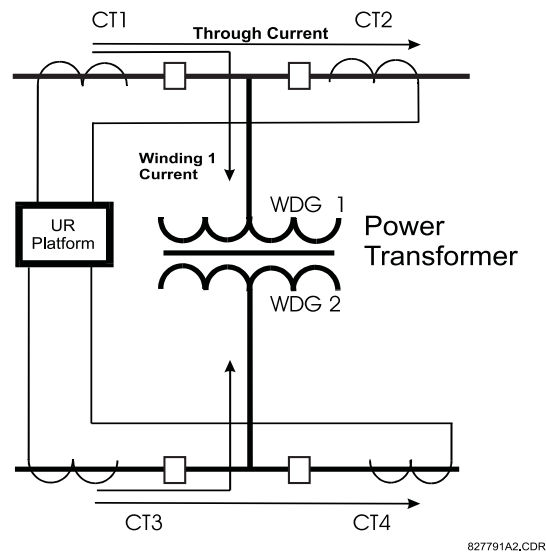

**Figure 5-1: BREAKER-AND-A-HALF SCHEME**

In conventional analog or electronic relays, the sum of the currents is obtained from an appropriate external connection of all the CTs through which any portion of the current for the element being protected could flow. Auxiliary CTs are required to perform ratio matching if the ratios of the primary CTs to be summed are not identical. In the UR platform, provisions have been included for all the current signals to be brought to the UR device where grouping, ratio correction and summation are applied internally via configuration settings.

A major advantage of using internal summation is that the individual currents are available to the protection device, as additional information to calculate a restraint current, for example, or to allow the provision of additional protection features that operate on the individual currents such as breaker failure.

Given the flexibility of this approach, it becomes necessary to add configuration settings to the platform to allow the user to select which sets of CT inputs will be added to form the net current into the protected device.

The internal grouping of current and voltage signals forms an internal Source. This Source can be given a specific name through the settings, and becomes available to protection and metering elements in the UR platform. Individual names can be given to each Source to help identify them more clearly for later use. For example, in the scheme shown in the BREAKER-AND-A-HALF SCHEME above, the user would configure one Source to be the sum of CT1 and CT2 and could name this Source as 'Wdg 1 Current'.

Once the Sources have been configured, the user has them available as selections for the choice of input signal for the protection elements and as metered quantities.

### b) CT/VT MODULE CONFIGURATIONS

CT and VT input channels are contained in CT/VT modules in UR products. The type of input channel can be phase/neutral/other voltage, phase/ground current, or sensitive ground current. The CT/VT modules calculate total waveform RMS levels, fundamental frequency phasors, symmetrical components and harmonics for voltage or current, as allowed by the hardware in each channel. These modules may calculate other parameters as directed by the CPU module.

A CT/VT module can contain up to eight input channels numbered 1 through 8. The numbering of channels in a CT/VT module corresponds to the module terminal numbering of 1 through 8 and is arranged as follows; channels 1, 2, 3 and 4 are always provided as a group, hereafter called a "bank," and all four are either current or voltage, as are channels 5, 6, 7 and 8. Channels 1, 2, 3 and 5, 6, 7 are arranged as phase A, B and C respectively. Channels 4 and 8 are either another current or voltage.

Banks are ordered sequentially from the block of lower-numbered channels to the block of higher-numbered channels, and from the CT/VT module with the lowest slot position letter to the module with the highest slot position letter, as follows:

INCREASING SLOT POSITION LETTER -->		
CT/VT MODULE 1	CT/VT MODULE 2	CT/VT MODULE 3
< bank 1 >	< bank 3 >	< bank 5 >
< bank 2 >	< bank 4 >	< bank 6 >

The UR platform allows for a maximum of three sets of three-phase voltages and six sets of three-phase currents. The result of these restrictions leads to the maximum number of CT/VT modules in a chassis to three. The maximum number of Sources is six. A summary of CT/VT module configurations is shown below.

ITEM	MAXIMUM NUMBER
CT/VT Module	3
CT Bank (3 phase channels, 1 ground channel)	6
VT Bank (3 phase channels, 1 auxiliary channel)	3

### c) CT/VT INPUT CHANNEL CONFIGURATION SETTINGS

Upon startup of the relay, configuration settings for every bank of current or voltage input channels in the relay are automatically generated, as determined from the order code. Within each bank, a channel identification label is automatically assigned to each bank of channels in a given product. The 'bank' naming convention is based on the physical location of the channels, required by the user to know how to connect the relay to external circuits. Bank identification consists of the letter designation of the slot in which the CT/VT module is mounted as the first character, followed by numbers indicating the channel, either 1 or 5.

For three-phase channel sets, the number of the lowest numbered channel identifies the set. For example, F1 represents the three-phase channel set of F1/F2/F3, where F is the slot letter and 1 is the first channel of the set of three channels.

Upon startup, the CPU configures the settings required to characterize the current and voltage inputs, and will display them in the appropriate section in the sequence of the banks (as described above) as shown below for a maximum configuration:

F1, F5, M1, M5, U1, U5.

The above section explains how the input channels are identified and configured to the specific application instrument transformers and the connections of these transformers. The specific parameters to be used by each measuring element and comparator, and some actual values are controlled by selecting a specific Source. The Source is a group of current and voltage input channels selected by the user to facilitate this selection. With this mechanism, a user does not have to make multiple selections of voltage and current for those elements that need both parameters, such as a distance element or a watt calculation. It also gathers associated parameters for display purposes.

The basic idea of arranging a Source is to select a point on the power system where information is of interest. An application example of the grouping of parameters in a Source is a transformer winding, on which a three phase voltage is measured, and the sum of the currents from CTs on each of two breakers is required to measure the winding current flow.



## 5.2.1 PASSWORD SECURITY

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ PASSWORD SECURITY

<div> <div>■ PASSWORD</div> <div>■ SECURITY</div> </div>	<div>◀▶</div>	<div>ACCESS LEVEL:</div> <div>Restricted</div>	<div>Range: Restricted, Command, Setting, Factory Service (for factory use only)</div>
MESSAGE	<div>▲</div> <div>▼</div>	<div>CHANGE COMMAND</div> <div>PASSWORD: No</div>	<div>Range: No, Yes</div>
MESSAGE	<div>▲</div> <div>▼</div>	<div>CHANGE SETTING</div> <div>PASSWORD: No</div>	<div>Range: No, Yes</div>
MESSAGE	<div>▲</div> <div>▼</div>	<div>ENCRYPTED COMMAND</div> <div>PASSWORD: -----</div>	<div>Range: 0 to 9999999999</div> <div>Note: ----- indicates no password</div>
MESSAGE	<div>▲</div> <div>▼</div>	<div>ENCRYPTED SETTING</div> <div>PASSWORD: -----</div>	<div>Range: 0 to 9999999999</div> <div>Note: ----- indicates no password</div>

The G60 provides two user levels of password security: Command and Setting. Operations under password supervision are as follows:

**COMMAND:**

- Changing the state of virtual inputs
- Clearing the event records
- Clearing the oscillography records

**SETTING:**

- Changing any setting.

The Command and Setting passwords are defaulted to "Null" when the relay is shipped from the factory. When a password is set to "Null", the password security feature is disabled.

Programming a password code is required to enable each access level. A password consists of 1 to 10 numerical characters. When a **CHANGE ... PASSWORD** setting is set to "Yes", the following message sequence is invoked:

1. ENTER NEW PASSWORD: \_\_\_\_\_
2. VERIFY NEW PASSWORD: \_\_\_\_\_
3. NEW PASSWORD HAS BEEN STORED

To gain write access to a "Restricted" setting, set **ACCESS LEVEL** to "Setting" and then change the setting, or attempt to change the setting and follow the prompt to enter the programmed password. If the password is correctly entered, access will be allowed. If no keys are pressed for longer than 30 minutes or control power is cycled, accessibility will automatically revert to the "Restricted" level.

If an entered password is lost (or forgotten), consult the factory service department with the corresponding **ENCRYPTED PASSWORD**.



**If the SETTING password and COMMAND password are set the same, the one password will allow access to commands and settings.**

NOTE

## 5.2.2 DISPLAY PROPERTIES

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ DISPLAY PROPERTIES

■ DISPLAY ■ PROPERTIES	MESSAGE	FLASH MESSAGE TIME: 1.0 s	Range: 0.5 to 10.0 s in steps of 0.1
	MESSAGE	DEFAULT MESSAGE TIMEOUT: 300 s	Range: 10 to 900 s in steps of 1
	MESSAGE	DEFAULT MESSAGE INTENSITY: 25 %	Range: 25%, 50%, 75%, 100%

Some relay messaging characteristics can be modified to suit different situations using the display properties settings.

Flash messages are status, warning, error, or information messages displayed for several seconds in response to certain key presses during setting programming. These messages override any normal messages. The time a flash message remains on the display can be changed to accommodate different reading rates. If no keys are pressed for a period of time, the relay automatically displays a default message. This time can be modified to ensure messages remain on the screen long enough during programming or reading of actual values.

To extend the life of the phosphor in the vacuum fluorescent display, the brightness can be attenuated when displaying default messages. When interacting with the display using the keypad, the display always operates at full brightness.

## 5.2.3 COMMUNICATIONS

## a) SERIAL PORTS

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ COMMUNICATIONS ⇒ SERIAL PORTS

■ COMMUNICATIONS ■ SERIAL PORTS		
MESSAGE	RS485 COM1 BAUD RATE: 19200	Range: 300, 1200, 2400, 4800, 9600, 14400, 19200, 28800, 33600, 38400, 57600, 115200. Only active if CPU 9A is ordered.
MESSAGE	RS485 COM1 PARITY: None	Range: None, Odd, Even Only active if CPU Type 9A is ordered
MESSAGE	RS485 COM1 RESPONSE MIN TIME: 0 ms	Range: 0 to 1000 ms in steps of 10 Only active if CPU Type 9A is ordered
MESSAGE	RS485 COM2 BAUD RATE: 19200	Range: 300, 1200, 2400, 4800, 9600, 14400, 19200, 28800, 33600, 38400, 57600, 115200
MESSAGE	RS485 COM2 PARITY: None	Range: None, Odd, Even
MESSAGE	RS485 COM2 RESPONSE MIN TIME: 0 ms	Range: 0 to 1000 ms in steps of 10

The G60 is equipped with up to 3 independent serial communication ports. The faceplate RS232 port is intended for local use and has fixed parameters of 19200 baud and no parity. The rear COM1 port type will depend on the CPU ordered: it may be either an Ethernet or an RS485 port. The rear COM2 port is RS485. The RS485 ports have settings for baud rate and parity. It is important that these parameters agree with the settings used on the computer or other equipment that is connected to these ports. Any of these ports may be connected to a personal computer running URPC. This software is used for downloading or uploading setting files, viewing measured parameters, and upgrading the relay firmware to the latest version. A maximum of 32 relays can be daisy-chained and connected to a DCS, PLC or PC using the RS485 ports.



**For each RS485 port, the minimum time before the port will transmit after receiving data from a host can be set. This feature allows operation with hosts which hold the RS485 transmitter active for some time after each transmission.**

## b) NETWORK

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ COMMUNICATIONS ⇒ NETWORK

■ COMMUNICATIONS			
	▲▼	■ NETWORK	
MESSAGE	◀▶	IP ADDRESS: 0.0.0.0	Range: Standard IP address format Only active if CPU Type 9C or 9D is ordered.
MESSAGE	▲▼	SUBNET IP MASK: 0.0.0.0	Range: Standard IP address format Only active if CPU Type 9C or 9D is ordered.
MESSAGE	▲▼	GATEWAY IP ADDRESS: 0.0.0.0	Range: Standard IP address format Only active if CPU Type 9C or 9D is ordered.
MESSAGE	▲▼	■ OSI NETWORK ■ ADDRESS (NSAP)	Note: Press the MESSAGE ⇌ key to enter the OSI NETWORK ADDRESS. Only active if CPU Type 9C or 9D is ordered.
MESSAGE	▲▼	ETHERNET OPERATION MODE: Half-Duplex	Range: Half-Duplex, Full-Duplex Only active if CPU Type 9C or 9D is ordered.
MESSAGE	▲▼	ETHERNET PRI LINK MONITOR: Disabled	Range: Disabled, Enabled Only active if CPU Type 9C or 9D is ordered.
MESSAGE	▲▼	ETHERNET SEC LINK MONITOR: Disabled	Range: Disabled, Enabled Only active if CPU Type 9C or 9D is ordered.

The Network setting messages will appear only if the UR is ordered with an Ethernet card. The Ethernet Primary and Secondary Link Monitor settings allow internal self test targets to be triggered when either the Primary or Secondary ethernet fibre link status indicates a connection loss. The IP addresses are used with DNP/Network, Modbus/TCP, MMS/UCA2, IEC 60870-5-104, TFTP, and HTTP (web server) protocols. The NSAP address is used with the MMS/UCA2 protocol over the OSI (CLNP/TP4) stack only. Each network protocol has a setting for the **TCP/UDP PORT NUMBER**. These settings are used only in advanced network configurations. They should normally be left at their default values, but may be changed if required; for example, to allow access to multiple URs behind a router. By setting a different TCP/UDP Port Number for a given protocol on each UR, the router can map the URs to the same external IP address. The client software (URPC, for example) must be configured to use the correct port number if these settings are used.



**Do not set more than one protocol to use the same TCP/UDP Port Number, as this will result in unreliable operation of those protocols.**



When the NSAP address, any TCP/UDP Port Number, or any User Map setting (when used with DNP) is changed, it will not become active until power to the relay has been cycled (OFF/ON).

## c) MODBUS PROTOCOL

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ COMMUNICATIONS ⇒ MODBUS PROTOCOL

■ COMMUNICATIONS	
■ MODBUS PROTOCOL	
MESSAGE	MODBUS SLAVE ADDRESS: 254 <i>Range: 1 to 254 in steps of 1</i>
MESSAGE	MODBUS TCP PORT NUMBER: 502 <i>Range: 1 to 65535 in steps of 1</i>

The serial communication ports utilize the Modbus protocol, unless configured for DNP operation (see DNP PROTOCOL below). This allows the URPC program to be used. UR relays operate as Modbus slave devices only. When using Modbus protocol on the RS232 port, the G60 will respond regardless of the **MODBUS SLAVE ADDRESS** programmed. For the RS485 ports each G60 must have a unique address from 1 to 254. Address 0 is the broadcast address which all Modbus slave devices listen to. Addresses do not have to be sequential, but no two devices can have the same address or conflicts resulting in errors will occur. Generally, each device added to the link should use the next higher address starting at 1. Refer to Appendix B for more information on the Modbus protocol.

## d) DNP PROTOCOL

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ COMMUNICATIONS ⇒ DNP PROTOCOL

■ COMMUNICATIONS	
■ DNP PROTOCOL	
MESSAGE	DNP PORT: NONE <i>Range: NONE, COM1 - RS485, COM2 - RS485, FRONT PANEL - RS232, NETWORK</i>
MESSAGE	DNP ADDRESS: 255 <i>Range: 0 to 65519 in steps of 1</i>
MESSAGE	■ DNP NETWORK ■ CLIENT ADDRESSES <i>Note: Press the MESSAGE ⇌ key to enter the DNP NETWORK CLIENT ADDRESSES</i>
MESSAGE	DNP TCP/UDP PORT NUMBER: 20000 <i>Range: 1 to 65535 in steps of 1</i>
MESSAGE	DNP UNSOL RESPONSE FUNCTION: Disabled <i>Range: Enabled, Disabled</i>
MESSAGE	DNP UNSOL RESPONSE TIMEOUT: 5 s <i>Range: 0 to 60 s in steps of 1</i>
MESSAGE	DNP UNSOL RESPONSE MAX RETRIES: 10 <i>Range: 1 to 255 in steps of 1</i>
MESSAGE	DNP UNSOL RESPONSE DEST ADDRESS: 1 <i>Range: 0 to 65519 in steps of 1</i>
MESSAGE	USER MAP FOR DNP ANALOGS: Disabled <i>Range: Enabled, Disabled</i>
MESSAGE	NUMBER OF SOURCES IN ANALOG LIST: 1 <i>Range: 1 to 6 in steps of 1</i>

MESSAGE		DNP CURRENT SCALE FACTOR: 1	Range: 0.01. 0.1, 1, 10, 100, 1000
MESSAGE		DNP VOLTAGE SCALE FACTOR: 1	Range: 0.01. 0.1, 1, 10, 100, 1000
MESSAGE		DNP CURRENT SCALE FACTOR: 1	Range: 0.01. 0.1, 1, 10, 100, 1000
MESSAGE		DNP POWER SCALE FACTOR: 1	Range: 0.01. 0.1, 1, 10, 100, 1000
MESSAGE		DNP ENERGY SCALE FACTOR: 1	Range: 0.01. 0.1, 1, 10, 100, 1000
MESSAGE		DNP OTHER SCALE FACTOR: 1	Range: 0.01. 0.1, 1, 10, 100, 1000
MESSAGE		DNP CURRENT DEFAULT DEADBAND: 30000	Range: 0 to 65535 in steps of 1
MESSAGE		DNP VOLTAGE DEFAULT DEADBAND: 30000	Range: 0 to 65535 in steps of 1
MESSAGE		DNP POWER DEFAULT DEADBAND: 30000	Range: 0 to 65535 in steps of 1
MESSAGE		DNP ENERGY DEFAULT DEADBAND: 30000	Range: 0 to 65535 in steps of 1
MESSAGE		DNP OTHER DEFAULT DEADBAND: 30000	Range: 0 to 65535 in steps of 1
MESSAGE		DNP TIME SYNC IIN PERIOD: 1440 min	Range: 1 to 10080 min. in steps of 1
MESSAGE		DNP MESSAGE FRAGMENT SIZE: 240	Range: 30 to 2048 in steps of 1
MESSAGE		<input type="checkbox"/> DNP BINARY INPUTS <input type="checkbox"/> USER MAP	

The G60 supports the Distributed Network Protocol (DNP) version 3.0. The G60 can be used as a DNP slave device connected to a single DNP master (usually either an RTU or a SCADA master station). Since the G60 maintains one set of DNP data change buffers and connection information, only one DNP master should actively communicate with the G60 at one time. The DNP PORT setting is used to select the communications port assigned to the DNP protocol. DNP can be assigned to a single port only. Once DNP is assigned to a serial port, the Modbus protocol is disabled on that port. Note that COM1 can be used only in non-ethernet UR relays. When this setting is set to NETWORK, the DNP protocol can be used over either TCP/IP or UDP/IP. Refer to Appendix E for more information on the DNP protocol.

The **DNP ADDRESS** setting is the DNP slave address. This number identifies the G60 on a DNP communications link. Each DNP slave should be assigned a unique address.

The **DNP NETWORK CLIENT ADDRESS** settings can force the G60 to respond to a maximum of five specific DNP masters.

The **DNP UNSOL RESPONSE FUNCTION** should be set to "Disabled" for RS485 applications since there is no collision avoidance mechanism.

The **DNP UNSOL RESPONSE TIMEOUT** sets the time the G60 waits for a DNP master to confirm an unsolicited response.

The **DNP UNSOL RESPONSE MAX RETRIES** setting determines the number of times the G60 will retransmit an unsolicited response without receiving a confirmation from the master. A value of 255 allows infinite re-tries.

The **DNP UNSOL RESPONSE DEST ADDRESS** setting is the DNP address to which all unsolicited responses are sent. The IP address to which unsolicited responses are sent is determined by the G60 from either the current DNP TCP connection or the most recent UDP message.

The **USER MAP FOR DNP ANALOGS** setting allows the large pre-defined Analog Inputs points list to be replaced by the much smaller Modbus User Map. This can be useful for users wishing to read only selected Analog Input points from the G60. See Appendix E for more information.

The **NUMBER OF SOURCES IN ANALOG LIST** setting allows the selection of the number of current/voltage source values that are included in the Analog Inputs points list. This allows the list to be customized to contain data for only the sources that are configured. This setting is relevant only when the User Map is not used.

The **DNP SCALE FACTOR** settings are numbers used to scale Analog Input point values. These settings group the G60 Analog Input data into types: current, voltage, power, energy, and other. Each setting represents the scale factor for all Analog Input points of that type. For example, if the **DNP VOLTAGE SCALE FACTOR** setting is set to a value of 1000, all DNP Analog Input points that are voltages will be returned with values 1000 times smaller (e.g. a value of 72000 V on the G60 will be returned as 72). These settings are useful when Analog Input values must be adjusted to fit within certain ranges in DNP masters. Note that a scale factor of 0.1 is equivalent to a multiplier of 10 (i.e. the value will be 10 times larger).

The **DNP DEFAULT DEADBAND** settings are the values used by the G60 to determine when to trigger unsolicited responses containing Analog Input data. These settings group the G60 Analog Input data into types: current, voltage, power, energy, and other. Each setting represents the default deadband value for all Analog Input points of that type. For example, in order to trigger unsolicited responses from the G60 when any current values change by 15 A, the **DNP CURRENT DEFAULT DEADBAND** setting should be set to 15. Note that these settings are the default values of the deadbands. DNP object 34 points can be used to change deadband values, from the default, for each individual DNP Analog Input point. Whenever power is removed and re-applied to the G60, the default deadbands will be in effect.

The **DNP TIME SYNC IIN PERIOD** setting determines how often the "Need Time" Internal Indication (IIN) bit is set by the G60. Changing this time allows the DNP master to send time synchronization commands more or less often, as required.

The **DNP MESSAGE FRAGMENT SIZE** setting determines the size, in bytes, at which message fragmentation occurs. Large fragment sizes allow for more efficient throughput; smaller fragment sizes cause more application layer confirmations to be necessary which can provide for more robust data transfer over noisy communication channels.

The **DNP BINARY INPUTS USER MAP** setting allows for the creation of a custom DNP Binary Inputs points list. The default DNP Binary Inputs list on the G60 contains 928 points representing various binary states (contact inputs and outputs, virtual inputs and outputs, protection element states, etc.). If not all of these points are required in the DNP master, a custom Binary Inputs points list can be created by selecting up to 58 blocks of 16 points. Each block represents 16 Binary Input points. Block 1 represents Binary Input points 0 to 15, block 2 represents Binary Input points 16 to 31, block 3 represents Binary Input points 32 to 47, etc. The minimum number of Binary Input points that can be selected is 16 (1 block). If all of the **BIN INPUT BLOCK X** settings are set to "Not Used", the standard list of 928 points will be in effect. The G60 will form the Binary Inputs points list from the **BIN INPUT BLOCK X** settings up to the first occurrence of a setting value of "Not Used".



**When using either of the User Maps for DNP data points (Analog Inputs and/or Binary Inputs), for UR relays with the ethernet option installed, check the "DNP Points Lists" G60 web page to ensure the desired points lists have been created. This web page can be viewed using Internet Explorer or Netscape Navigator by entering the G60 IP address to access the G60 "Main Menu", then by selecting the "Device Information Menu", and then selecting the "DNP Points Lists".**

### e) UCA/MMS PROTOCOL

**PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ COMMUNICATIONS ⇒ UCA/MMS PROTOCOL**

■ COMMUNICATIONS		
	▲ ▼	■ UCA/MMS PROTOCOL
MESSAGE	◀ ▶	<b>DEFAULT GOOSE UPDATE TIME: 60 s</b> Range: 1 to 60 s in steps of 1 See UserSt BIT PAIRS in the REMOTE OUTPUTS section.
MESSAGE	▲ ▼	<b>UCA LOGICAL DEVICE:</b> UCADevice Range: Up to 16 alphanumeric characters representing the name of the UCA logical device.
MESSAGE	▲ ▼	<b>UCA/MMS TCP PORT NUMBER: 102</b> Range: 1 to 65535 in steps of 1

The G60 supports the Manufacturing Message Specification (MMS) protocol as specified by the Utility Communication Architecture (UCA). UCA/MMS is supported over two protocol stacks: TCP/IP over ethernet and TP4/CLNP (OSI) over ethernet. The G60 operates as a UCA/MMS server. Appendix C describes the UCA/MMS protocol implementation in more detail. The REMOTE INPUTS and REMOTE OUTPUT sections of Chapter 5: SETTINGS describes the peer-to-peer GOOSE message scheme.

The UCA LOGICAL DEVICE setting represents the name of the MMS domain (UCA logical device) in which all UCA objects are located.

#### f) WEB SERVER HTTP PROTOCOL

**PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ COMMUNICATIONS ⇒ WEB SERVER HTTP PROTOCOL**

COMMUNICATIONS

WEB SERVER

HTTP PROTOCOL

MESSAGE HTTP TCP PORT NUMBER: 80 Range: 1 to 65535 in steps of 1

The G60 contains an embedded web server. That is, the G60 is capable of transferring web pages to a web browser such as Microsoft Internet Explorer or Netscape Navigator. This feature is available only if the G60 has the ethernet option installed. The web pages are organized as a series of menus that can be accessed starting at the G60 "Main Menu". Web pages are available showing DNP and IEC 60870-5-104 points lists, Modbus registers, Event Records, Fault Reports, etc. The web pages can be accessed by connecting the UR and a computer to an ethernet network. The Main Menu will be displayed in the web browser on the computer simply by entering the IP address of the G60 into the "Address" box on the web browser.

#### g) TFTP PROTOCOL

**PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ COMMUNICATIONS ⇒ TFTP PROTOCOL**

COMMUNICATIONS

TFTP PROTOCOL

MESSAGE TFTP MAIN UDP PORT NUMBER: 69 Range: 1 to 65535 in steps of 1

MESSAGE TFTP DATA UDP PORT 1 NUMBER: 0 Range: 0 to 65535 in steps of 1

MESSAGE TFTP DATA UDP PORT 2 NUMBER: 0 Range: 0 to 65535 in steps of 1

The Trivial File Transfer Protocol (TFTP) can be used to transfer files from the UR over a network. The G60 operates as a TFTP server. TFTP client software is available from various sources, including Microsoft Windows NT. The file "dir.txt" is an ASCII text file that can be transferred from the G60. This file contains a list and description of all the files available from the UR (event records, oscillography, etc.).



**PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ COMMUNICATIONS ⇒ IEC 60870-5-104 PROTOCOL**

5

The **IEC ----- DEFAULT THRESHOLD** settings are the values used by the UR to determine when to trigger spontaneous responses containing M\_ME\_NC\_1 analog data. These settings group the UR analog data into types: current, voltage, power, energy, and other. Each setting represents the default threshold value for all M\_ME\_NC\_1 analog points of that type. For example, in order to trigger spontaneous responses from the UR when any current values change by 15 A, the **IEC CURRENT DEFAULT THRESHOLD** setting should be set to 15. Note that these settings are the default values of the dead-bands. P\_ME\_NC\_1 (Parameter of measured value, short floating point value) points can be used to change threshold values, from the default, for each individual M\_ME\_NC\_1 analog point. Whenever power is removed and re-applied to the UR, the default thresholds will be in effect.



*GE Power Management*



## 5.2.4 MODBUS® USER MAP

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ MODBUS USER MAP

■ MODBUS USER MAP	◀▶	ADDRESS 1: 0 VALUE: 0	Range: 0 to 65535 in steps of 1
		↓	
MESSAGE ▲		ADDRESS 256: 0 VALUE: 0	Range: 0 to 65535 in steps of 1

The Modbus® User Map provides up to 256 registers with read only access. To obtain a value for a memory map address, enter the desired location in the **ADDRESS** line (the value must be converted from hex to decimal format). The corresponding value from the is displayed in the **VALUE** line. A value of "0" in subsequent register **ADDRESS** lines automatically return values for the previous **ADDRESS** lines incremented by "1". An address value of "0" in the initial register means "none" and values of "0" will be displayed for all registers.

Different **ADDRESS** values can be entered as required in any of the register positions.



**These settings can also be used with the DNP protocol. See the DNP ANALOG INPUT POINTS section in Appendix E for details.**

## 5.2.5 REAL TIME CLOCK

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ REAL TIME CLOCK

■ REAL TIME ■ CLOCK	◀▶	IRIG-B SIGNAL TYPE: None	Range: None, DC Shift, Amplitude Modulated
------------------------	----	-----------------------------	--

The date and time for the relay clock can be synchronized to other relays using an IRIG-B signal. It has the same accuracy as an electronic watch, approximately  $\pm 1$  minute per month.

An IRIG-B signal may be connected to the relay to synchronize the clock to a known time base and to other relays. If an IRIG-B signal is used, only the current year needs to be entered.

See also the **COMMANDS** ↓ **SET DATE AND TIME** menu for manually setting the relay clock.

## 5.2.6 OSCILLOGRAPHY

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ OSCILLOGRAPHY

■ OSCILLOGRAPHY

◀▶

NUMBER OF RECORDS:

15

Range: 1 to 64 in steps of 1

▲▼

TRIGGER MODE:

Automatic Overwrite

Range: Automatic Overwrite, Protected

▲▼

TRIGGER POSITION:

50%

Range: 0 to 100 in steps of 1

▲▼

TRIGGER SOURCE:

Off

Range: FlexLogic™ operand

▲▼

AC INPUT WAVEFORMS:

16 samples/cycle

Range: Off; 8, 16, 32, 64 samples/cycle

▲▼

■ DIGITAL CHANNELS

Range: 2 to 63 channels

◀▶

DIGITAL CHANNEL 2:

Off

Range: FlexLogic™ operand

↓

▲▼

DIGITAL CHANNEL 63:

Off

Range: FlexLogic™ operand

▲▼

■ ANALOG CHANNELS

Range: 1 to 16 channels

◀▶

ANALOG CHANNEL 1:

Off

Range: Off, any analog Actual Value parameter

↓

▲▼

ANALOG CHANNEL 16:

Off

Range: Off, any analog Actual Value parameter

Oscillography records contain waveforms captured at the sampling rate as well as other relay data at the point of trigger. Oscillography records are triggered by a programmable FlexLogic™ operand. Multiple oscillography records may be captured simultaneously.

The **NUMBER OF RECORDS** is selectable, but the number of cycles captured in a single record varies considerably based on other factors such as sample rate and the number of operational CT/VT modules. There is a fixed amount of data storage for oscillography; the more data captured, the less the number of cycles captured per record. See the **ACTUAL VALUES** ⇒

5-16

G60 Generator Management Relay

GE Power Management

**RECORDS** ⇌ **OSCILLOGRAPHY** menu to view the number of cycles captured per record. The following table provides sample configurations with corresponding cycles/record.

**Table 5–1: OSCILLOGRAPHY CYCLES/RECORD EXAMPLE**

# RECORDS	# CT/VTs	SAMPLE RATE	# DIGITALS	# ANALOGS	CYCLES/RECORD
1	1	8	0	0	1872.0
1	1	16	16	0	1685.0
8	1	16	16	0	266.0
8	1	16	16	4	219.5
8	2	16	16	4	93.5
8	2	16	64	16	93.5
8	2	32	64	16	57.6
8	2	64	64	16	32.3
32	2	64	64	16	9.5

A new record may automatically overwrite an older record if **TRIGGER MODE** is set to "Automatic Overwrite".

The **TRIGGER POSITION** is programmable as a percent of the total buffer size (e.g. 10%, 50%, 75%, etc.). A trigger position of 25% consists of 25% pre- and 75% post-trigger data.

The **TRIGGER SOURCE** is always captured in oscillography and may be any FlexLogic™ parameter (element state, contact input, virtual output, etc.). The relay sampling rate is 64 samples per cycle.

The **AC INPUT WAVEFORMS** setting determines the sampling rate at which AC input signals (i.e. current and voltage) are stored. Reducing the sampling rate allows longer records to be stored. This setting has no effect on the internal sampling rate of the relay which is always 64 samples per cycle, i.e. it has no effect on the fundamental calculations of the device.

An **ANALOG CHANNEL** setting selects the metering actual value recorded in an oscillography trace. The length of each oscillography trace depends in part on the number of parameters selected here. Parameters set to 'Off' are ignored. The parameters available in a given relay are dependent on: (a) the type of relay, (b) the type and number of CT/VT hardware modules installed, and (c) the type and number of Analog Input hardware modules installed. Upon startup, the relay will automatically prepare the parameter list. Tables of all possible analog metering actual value parameters are presented in Appendix A: FLEXANALOG PARAMETERS. The parameter index number shown in any of the tables is used to expedite the selection of the parameter on the relay display. It can be quite time-consuming to scan through the list of parameters via the relay keypad/display - entering this number via the relay keypad will cause the corresponding parameter to be displayed.

All eight CT/VT module channels are stored in the oscillography file. The CT/VT module channels are named as follows:

*<slot\_letter><terminal\_number>—<I or V><phase A, B, or C, or 4th input>*

The fourth current input in a bank is called IG, and the fourth voltage input in a bank is called VX. For example, F2-IB designates the IB signal on terminal 2 of the CT/VT module in slot F. If there are no CT/VT modules and Analog Input modules, no analog traces will appear in the file; only the digital traces will appear.



**When the NUMBER OF RECORDS setting is altered, all oscillography records will be CLEARED.**

## 5.2.7 DATA LOGGER

PATH: SETTINGS ⇌ PRODUCT SETUP ⇌ DATA LOGGER

■ DATA LOGGER		DATA LOGGER RATE: 1 min	Range: 1 sec; 1 min, 5 min, 10 min, 15 min, 20 min, 30 min, 60 min
MESSAGE	▲▼	DATA LOGGER CHNL 1: Off	Range: Off, any analog Actual Value parameter
MESSAGE	▲▼	DATA LOGGER CHNL 2: Off	Range: Off, any analog Actual Value parameter
↓			
MESSAGE	▲▼	DATA LOGGER CHNL 16: Off	Range: Off, any analog Actual Value parameter
MESSAGE	▲	DATA LOGGER CONFIG: 0 CHNL x 0.0 DAYS	Range: Not applicable - shows computed data only

The data logger samples and records up to 16 analog parameters at a user-defined sampling rate. This recorded data may be downloaded to the URPC software and displayed with 'parameters' on the vertical axis and 'time' on the horizontal axis. All data is stored in non-volatile memory, meaning that the information is retained when power to the relay is lost.

For a fixed sampling rate, the data logger can be configured with a few channels over a long period or a larger number of channels for a shorter period. The relay automatically partitions the available memory between the channels in use.

5



**Changing any setting affecting Data Logger operation will clear any data that is currently in the log.**

**DATA LOGGER RATE:**

This setting selects the time interval at which the actual value data will be recorded.

**DATA LOGGER CHNL 1 (to 16):**


This setting selects the metering actual value that is to be recorded in Channel 1(16) of the data log. The parameters available in a given relay are dependent on: the type of relay, the type and number of CT/VT hardware modules installed, and the type and number of Analog Input hardware modules installed. Upon startup, the relay will automatically prepare the parameter list. Tables of all possible analog metering actual value parameters are presented in Appendix A: FLEXANALOG PARAMETERS. The parameter index number shown in any of the tables is used to expedite the selection of the parameter on the relay display. It can be quite time-consuming to scan through the list of parameters via the relay keypad/display – entering this number via the relay keypad will cause the corresponding parameter to be displayed.

**DATA LOGGER CONFIG:**

This display presents the total amount of time the Data Logger can record the channels not selected to "Off" without overwriting old data.

## 5.2.8 USER-PROGRAMMABLE LEDs

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ USER-PROGRAMMABLE LEDs

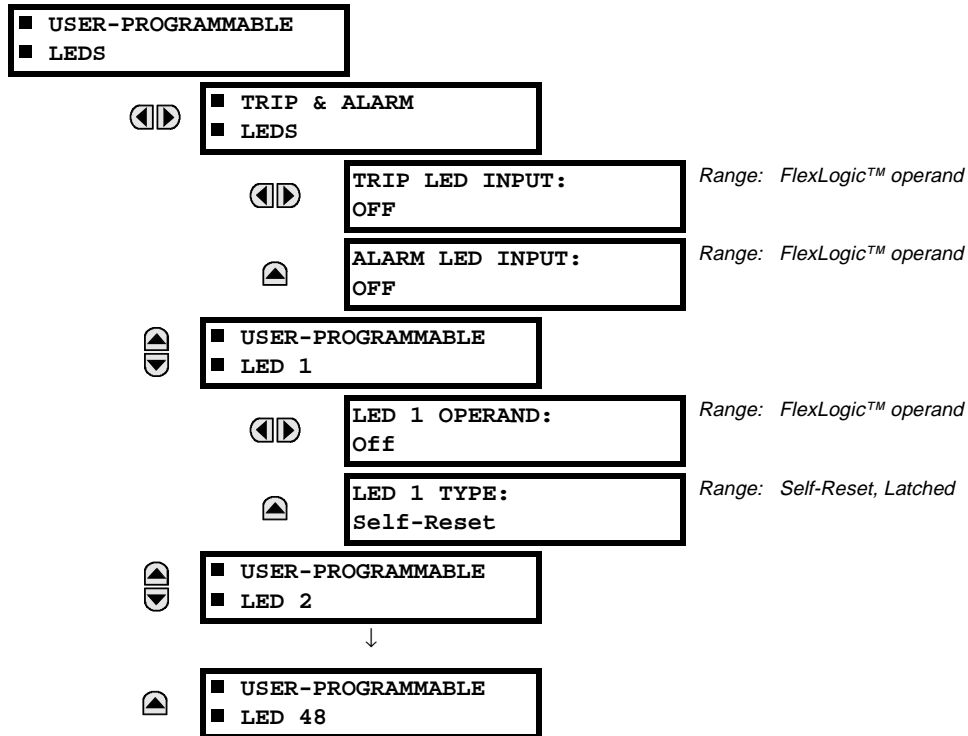

The TRIP and ALARM LEDs are on LED panel 1. Each indicator can be programmed to become illuminated when the selected FlexLogic™ operand is in the logic 1 state. There are 48 amber LEDs across the relay faceplate LED panels. Each of these indicators can be programmed to illuminate when the selected FlexLogic™ operand is in the logic 1 state.

- LEDs 1 through 24 inclusive are on LED panel 2; LEDs 25 through 48 inclusive are on LED panel 3.

Refer to the LED INDICATORS section in the HUMAN INTERFACES chapter for the locations of these indexed LEDs. This menu selects the operands to control these LEDs. Support for applying user-customized labels to these LEDs is provided. If the LED X TYPE setting is "Self-Reset" (default setting), the LED illumination will track the state of the selected LED operand. If the LED X TYPE setting is 'Latched', the LED, once lit, remains so until reset by the faceplate RESET button, from a remote device via a communications channel, or from any programmed operand, even if the LED operand state de-asserts.


Table 5-5: RECOMMENDED SETTINGS FOR LED PANEL 2 LABELS

SETTING	PARAMETER	SETTING	PARAMETER
LED 1 Operand	SETTING GROUP ACT 1	LED 13 Operand	Off
LED 2 Operand	SETTING GROUP ACT 2	LED 14 Operand	Off
LED 3 Operand	SETTING GROUP ACT 3	LED 15 Operand	Off
LED 4 Operand	SETTING GROUP ACT 4	LED 16 Operand	Off
LED 5 Operand	SETTING GROUP ACT 5	LED 17 Operand	SYNC 1 SYNC OP
LED 6 Operand	SETTING GROUP ACT 6	LED 18 Operand	SYNC 2 SYNC OP
LED 7 Operand	SETTING GROUP ACT 7	LED 19 Operand	Off
LED 8 Operand	SETTING GROUP ACT 8	LED 20 Operand	Off
LED 9 Operand	Off	LED 21 Operand	Off
LED 10 Operand	Off	LED 22 Operand	Off
LED 11 Operand	Off	LED 23 Operand	Off
LED 12 Operand	Off	LED 24 Operand	Off

Refer to the CONTROL OF SETTINGS GROUPS example in the CONTROL ELEMENTS section for group activation.

## 5.2.9 FLEX STATE PARAMETERS

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ FLEX STATE PARAMETERS

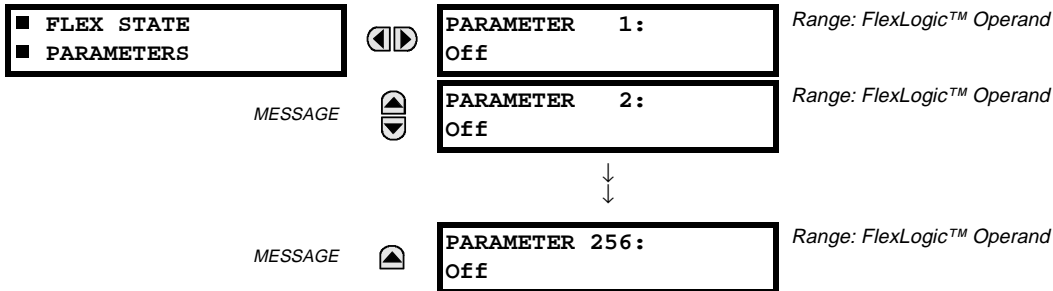


This feature provides a mechanism where any of 256 selected FlexLogic™ operand states can be used for efficient monitoring. The feature allows user-customized access to the FlexLogic™ operand states in the relay. The state bits are packed so that 16 states may be read out in a single Modbus register. The state bits can be configured so that all of the states which are of interest to the user are available in a minimum number of Modbus registers.

The state bits may be read out in the "Flex States" register array beginning at Modbus address 900 hex. 16 states are packed into each register, with the lowest-numbered state in the lowest-order bit. There are 16 registers in total to accommodate the 256 state bits.

## 5.2.10 USER-DEFINABLE DISPLAYS

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ USER-DEFINABLE DISPLAYS

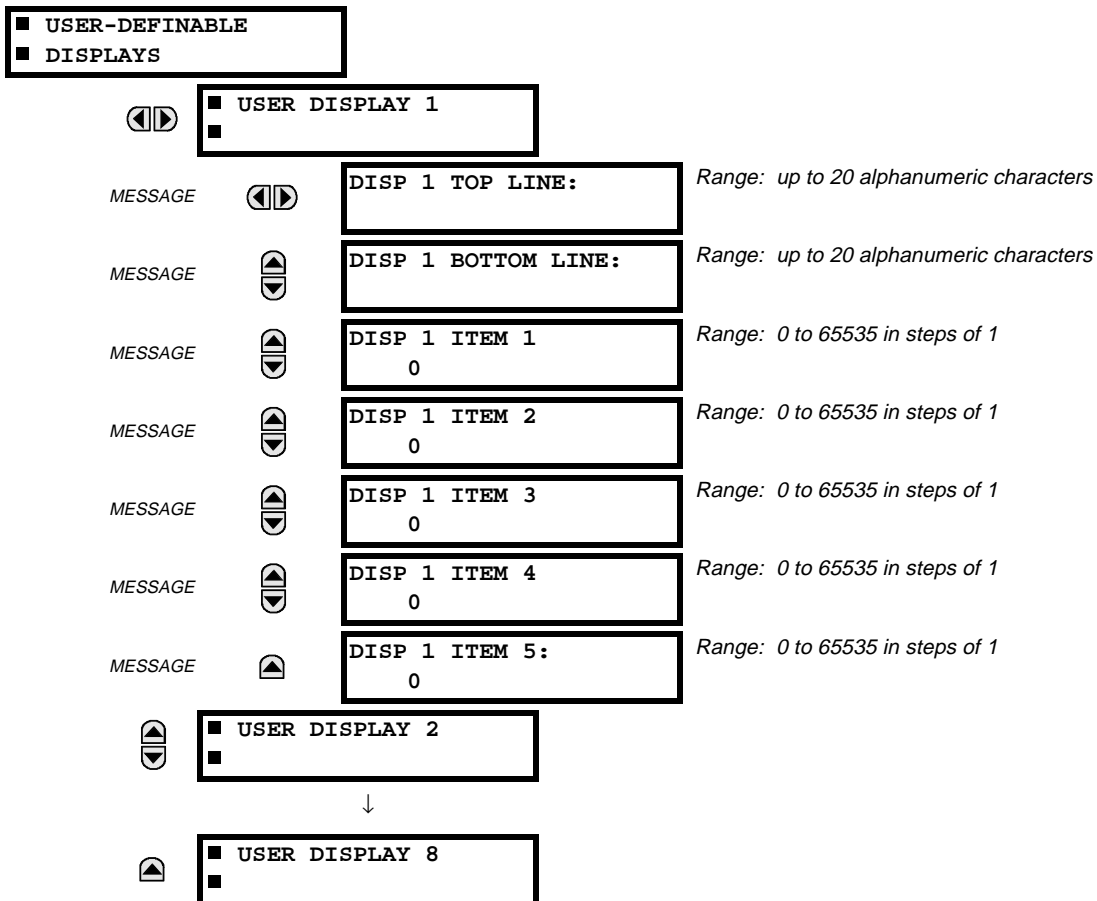

This menu provides a mechanism for manually creating up to 8 user-defined information displays in a convenient viewing sequence in the USER DISPLAYS menu (between the TARGETS and ACTUAL VALUES top-level menus). The sub-menus facilitate text entry and Modbus Register data pointer options for defining the User Display content.

Also, any existing system display can be automatically copied into an available User Display by selecting the existing display and pressing the **ENTER** key. The display will then prompt “ADD TO USER DISPLAY LIST?”. After selecting ‘Yes’, a message will indicate that the selected display has been added to the user display list. When this type of entry occurs, the sub-menus are automatically configured with the proper content - this content may subsequently be edited.

This menu is used **to enter** user-defined text and/or user-selected Modbus-registered data fields into the particular User Display. Each User Display consists of two 20-character lines (TOP & BOTTOM). The Tilde (~) character is used to mark the start of a data field - the length of the data field needs to be accounted for. Up to 5 separate data fields (ITEM 1...5) can be entered in a User Display - the nth Tilde (~) refers to the nth ITEM.

A User Display may be entered from the faceplate keypad or the URPC interface (preferred for convenience).


To enter text characters in the TOP LINE and BOTTOM LINE from the faceplate keypad:

1. Select the line to be edited.
2. Press the **ENTER** key to enter text edit mode.
3. Use either VALUE key to scroll through the characters. A space is selected like a character.
4. Press the **ENTER** key to advance the cursor to the next position.
5. Repeat step 3 and continue entering characters until the desired text is displayed.
6. The **HELP** key may be pressed at any time for context sensitive help information.
7. Press the **ENTER** key to store the new settings.

To enter a numerical value for any of the 5 ITEMS (the *decimal form* of the selected Modbus Register Address) from the faceplate keypad, use the number keypad. Use the value of ‘0’ for any ITEMS not being used. Use the **HELP** key at any selected system display (Setting, Actual Value, or Command) which has a Modbus address, to view the *hexadecimal form* of the Modbus Register Address, then manually convert it to decimal form before entering it (URPC usage would conveniently facilitate this conversion).

Use the **MENU** key to go to the USER DISPLAYS menu **to view** the user-defined content. The current user displays will show in sequence, changing every 4 seconds. While viewing a User Display, press the **ENTER** key and then select the ‘Yes’ option **to remove** the display from the user display list. Use the **MENU** key again **to exit** the USER DISPLAYS menu.

#### EXAMPLE USER DISPLAY SETUP AND RESULT:

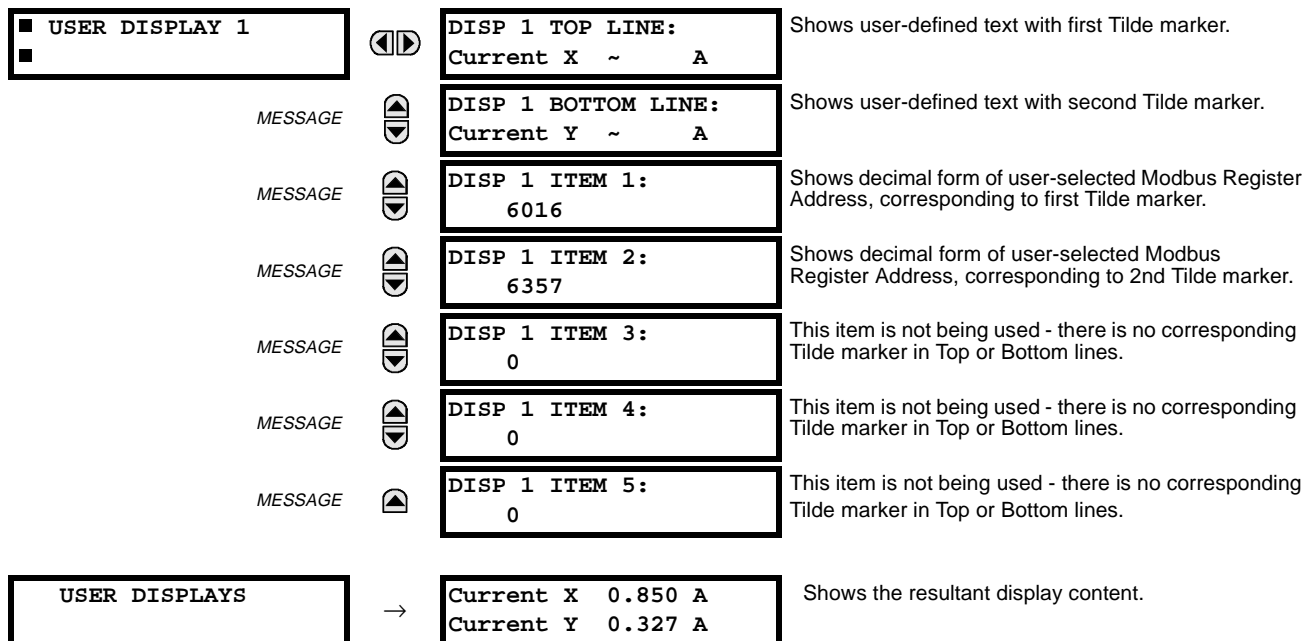

## 5.2.11 INSTALLATION

PATH: SETTINGS ⇒ PRODUCT SETUP ⇒ INSTALLATION

<div>■ INSTALLATION</div> <div>■</div>		<b>RELAY SETTINGS:</b> Not Programmed	Range: Not Programmed, Programmed
		<b>RELAY NAME:</b> Relay-1	Range: up to 20 alphanumeric characters

MESSAGE

To safeguard against the installation of a relay whose settings have not been entered, the unit will not allow signaling of any output relay until **RELAY SETTINGS** is set to "Programmed". This setting is defaulted to "Not Programmed" when the relay leaves the factory. The UNIT NOT PROGRAMMED self-test error message is displayed automatically until the relay is put into the Programmed state.

The **RELAY NAME** setting allows the user to uniquely identify a relay. This name will appear on generated reports. This name is also used to identify specific devices which are engaged in automatically sending/receiving data over the Ethernet communications channel using the UCA2/MMS protocol.



## 5.3.1 AC INPUTS

## a) CURRENT BANKS

PATH: SETTINGS ⇒ SYSTEM SETUP ⇒ AC INPUTS ⇒ CURRENT BANK X1

<div>■ CURRENT BANK X1</div> <div>MESSAGE</div> <div>MESSAGE</div> <div>MESSAGE</div>	<div>◀▶</div>	<div>PHASE CT X1</div> <div>PRIMARY: 1 A</div>	Range: 1 to 65000 A in steps of 1
	<div>▲▼</div>	<div>PHASE CT X1</div> <div>SECONDARY: 1 A</div>	Range: 1 A, 5 A
	<div>▲▼</div>	<div>GROUND CT X1</div> <div>PRIMARY: 1 A</div>	Range: 1 to 65000 A in steps of 1
	<div>▲</div>	<div>GROUND CT X1</div> <div>SECONDARY: 1 A</div>	Range: 1 A, 5 A

'X' = F, M, or U. 'F', 'M', and 'U' are module slot position letters. See also the section INTRODUCTION TO AC SOURCES.

Up to 6 banks of phase/ground CTs can be set.

These settings are critical for all features that have settings dependent on current measurements. When the relay is ordered, the CT module must be specified to include a standard or sensitive ground input. As the phase CTs are connected in Wye (star), the calculated phasor sum of the three phase currents ( $I_A + I_B + I_C = \text{Neutral Current} = 3I_o$ ) is used as the input for the neutral overcurrent elements. In addition, a zero sequence (core balance) CT which senses current in all of the circuit primary conductors, or a CT in a neutral grounding conductor may also be used. For this configuration, the ground CT primary rating must be entered. To detect low level ground fault currents, the sensitive ground input may be used. In this case, the sensitive ground CT primary rating must be entered. For more details on CT connections, refer to the HARDWARE chapter.

Enter the rated CT primary current values. For both 1000:5 and 1000:1 CTs, the entry would be 1000. For correct operation, the CT secondary rating must match the setting (which must also correspond to the specific CT connections used).

If CT inputs (banks of current) are to be summed as one source current, the following rule applies:

**EXAMPLE:**

$$\text{SRC1} = F1 + F5 + U1$$

Where  $F1$ ,  $F5$ , and  $U1$  are banks of CTs with ratios of 500:1, 1000:1 and 800:1 respectively.

1 pu is the highest primary current. In this case, 1000 is entered and the secondary current from the 500:1 and 800:1 ratio CTs will be adjusted to that which would be created by a 1000:1 CT before summation. If a protection element is set up to act on SRC1 currents, then PKP level of 1 pu will operate on 1000 A primary.

The same rule will apply for sums of currents from CTs with different secondary taps (5 A and 1 A).

## b) VOLTAGE BANKS

PATH: SETTINGS ⇒ SYSTEM SETUP ⇒ AC INPUTS ⇒ VOLTAGE BANK X1

<div>■ VOLTAGE BANK X5</div> <div>■</div>		<div>PHASE VT X5</div> <div>CONNECTION: Wye</div>	Range: Wye, Delta	
	MESSAGE	<div>▲</div> <div>▼</div>	<div>PHASE VT X5</div> <div>SECONDARY: 66.4 V</div>	Range: 50.0 to 240.0 V in steps of 0.1
	MESSAGE	<div>▲</div> <div>▼</div>	<div>PHASE VT X5</div> <div>RATIO: 1.00 :1</div>	Range: 1.00 to 24000.00 in steps of 1.00
	MESSAGE	<div>▲</div> <div>▼</div>	<div>AUXILIARY VT X5</div> <div>CONNECTION: Vag</div>	Range: Vn, Vag, Vbg, Vcg, Vab, Vbc, Vca
	MESSAGE	<div>▲</div> <div>▼</div>	<div>AUXILIARY VT X5</div> <div>SECONDARY: 66.4 V</div>	Range: 50.0 to 240.0 V in steps of 0.1
	MESSAGE	<div>▲</div>	<div>AUXILIARY VT X5</div> <div>RATIO: 1.00 :1</div>	Range: 1.00 to 24000.00 in steps of 1.00

'X' = F, M, or U. 'F', 'M', and 'U' are module slot position letters. See also the INTRODUCTION TO AC SOURCES section.

Up to 3 banks of phase/auxiliary VTs can be set.

With VTs installed, the relay can be used to perform voltage measurements as well as power calculations. Enter the **PHASE VT xx CONNECTION** made to the system as "Wye" or "Delta". An open-delta source VT connection would be entered as "Delta". See the typical wiring diagram in the HARDWARE chapter for details.

5



NOTE

The nominal Phase VT Secondary Voltage setting is the voltage across the relay input terminals when nominal voltage is applied to the VT primary.

For example, on a system with a 13.8 kV nominal primary voltage and with a 14400:120 Volt VT in a Delta connection, the secondary voltage would be 115, i.e.  $(13800 / 14400) \times 120$ . For a Wye connection, the voltage value entered must be the phase to neutral voltage which would be  $115 / \sqrt{3} = 66.4$ .

On a 14.4 kV system with a Delta connection and a VT primary to secondary turns ratio of 14400:120, the voltage value entered would be 120, i.e.  $14400 / 120$ .

## 5.3.2 POWER SYSTEM

PATH: SETTINGS ⇒ SYSTEM SETUP ⇒ POWER SYSTEM

<div>■ POWER SYSTEM</div> <div>■</div>		<div>NOMINAL FREQUENCY:</div> <div>60 Hz</div>	Range: 25 to 60 Hz in steps of 1	
	MESSAGE	<div>▲</div> <div>▼</div>	<div>PHASE ROTATION:</div> <div>ABC</div>	Range: ABC, ACB
	MESSAGE	<div>▲</div> <div>▼</div>	<div>FREQUENCY AND PHASE REFERENCE:</div> <div>SRC 1</div>	Range: SRC 1, SRC 2,..., SRC 6
	MESSAGE	<div>▲</div>	<div>FREQUENCY TRACKING:</div> <div>Enabled</div>	Range: Disabled, Enabled

The power system **NOMINAL FREQUENCY** value is used as a default to set the digital sampling rate if the system frequency cannot be measured from available signals. This may happen if the signals are not present or are heavily distorted. Before reverting to the nominal frequency, the frequency tracking algorithm holds the last valid frequency measurement for a safe period of time while waiting for the signals to reappear or for the distortions to decay.

The phase sequence of the power system is required to properly calculate sequence components and power parameters. The **PHASE ROTATION** setting matches the power system phase sequence. Note that this setting informs the relay of the actual system phase sequence, either ABC or ACB. CT and VT inputs on the relay, labeled as A, B, and C, must be connected to system phases A, B, and C for correct operation.

The **FREQUENCY AND PHASE REFERENCE** setting determines which signal source is used (and hence which AC signal) for phase angle reference. The AC signal used is prioritized based on the AC inputs that are configured for the signal source: phase voltages takes precedence, followed by auxiliary voltage, then phase currents, and finally ground current.

For three phase selection, phase A is used for angle referencing ( $V_{\text{ANGLE REF}} = V_A$ ), while Clarke transformation of the phase signals is used for frequency metering and tracking ( $V_{\text{FREQUENCY}} = (2V_A - V_B - V_C)/3$ ) for better performance during fault, open pole, and VT and CT fail conditions.

The phase reference and frequency tracking AC signals are selected based upon the Source configuration, regardless of whether or not a particular signal is actually applied to the relay.

Phase angle of the reference signal will always display zero degrees and all other phase angles will be relative to this signal. If the pre-selected reference signal is not measurable at a given time, the phase angles are not referenced.

The phase angle referencing is done via a phase locked loop, which can synchronize independent UR relays if they have the same AC signal reference. These results in very precise correlation of time tagging in the event recorder between different UR relays provided the relays have an IRIG-B connection.



**FREQUENCY TRACKING** should only be set to "Disabled" in very unusual circumstances; consult the factory for special variable-frequency applications.

### 5.3.3 SIGNAL SOURCES

**PATH: SETTINGS** ⇨ **SYSTEM SETUP** ⇨ **SIGNAL SOURCES** ⇨ **SOURCE 1(4)**

<div> <div>SOURCE 1</div> <div>MESSAGE</div> <div>MESSAGE</div> <div>MESSAGE</div> <div>MESSAGE</div> </div>	<div> <div>◀▶</div> <div>SOURCE 1 NAME:</div> <div>SRC 1</div> </div>	Range: up to 6 alphanumeric characters
	<div> <div>▲▼</div> <div>SOURCE 1 PHASE CT:</div> <div>None</div> </div>	Range: None, F1, F5, F1+F5,..., F1+F5+M1+M5+U1+U5 Only phase current inputs will be displayed.
	<div> <div>▲▼</div> <div>SOURCE 1 GROUND CT:</div> <div>None</div> </div>	Range: None, F1, F5, F1+F5,..., F1+F5+M1+M5+U1+U5 Only ground current inputs will be displayed.
	<div> <div>▲▼</div> <div>SOURCE 1 PHASE VT:</div> <div>None</div> </div>	Range: None, F1, F5, M1, M5, U1, U5 Only phase voltage inputs will be displayed.
	<div> <div>▲</div> <div>SOURCE 1 AUX VT:</div> <div>None</div> </div>	Range: None, F1, F5, M1, M5, U1, U5 Only auxiliary voltage inputs will be displayed.

There are up to 4 identical Source setting menus available, numbered from 1 to 4.

"SRC 1" can be replaced by whatever name is defined by the user for the associated source.

'F', 'U', and 'M' are module slot position letters. The number following the letter represents either the first bank of four channels (1, 2, 3, 4) called '1' or the second bank of four channels (5, 6, 7, 8) called '5' in a particular CT/VT module. Refer to the INTRODUCTION TO AC SOURCES section at the beginning of this chapter for additional details.

It is possible to select the sum of any combination of CTs. The first channel displayed is the CT to which all others will be referred. For example, the selection "F1+F5" indicates the sum of each phase from channels "F1" and "F5", scaled to whichever CT has the higher ratio. Selecting "None" hides the associated actual values.

The approach used to configure the AC Sources consists of several steps; first step is to specify the information about each CT and VT input. For CT inputs, this is the nominal primary and secondary current. For VTs, this is the connection type, ratio and nominal secondary voltage. Once the inputs have been specified, the configuration for each Source is entered, including specifying which CTs will be summed together.

#### USER SELECTION OF AC PARAMETERS FOR COMPARATOR ELEMENTS:

CT/VT modules automatically calculate all current and voltage parameters that can be calculated from the inputs available. Users will have to select the specific input parameters that are to be measured by every element, as selected in the element settings. The internal design of the element specifies which type of parameter to use and provides a setting for selection of the Source. In some elements where the parameter may be either fundamental or RMS magnitude, such as phase time overcurrent, two settings are provided. One setting specifies the Source, the second selects between fundamental phasor and RMS.

**AC INPUT ACTUAL VALUES:**

The calculated parameters associated with the configured voltage and current inputs are displayed in the current and voltage input sections of Actual Values. Only the phasor quantities associated with the actual AC physical input channels will be displayed here. All parameters contained within a configured Source are displayed in the Sources section of Actual Values.

**EXAMPLE USE OF SOURCES:**

An example of the use of Sources, with a relay with three CT/VT modules, is shown in the diagram below. A relay could have the following hardware configuration:

INCREASING SLOT POSITION LETTER -->		
CT/VT MODULE 1	CT/VT MODULE 2	CT/VT MODULE 3
CTs	CTs	VTs
CTs	VTs	---

This configuration could be used on a two winding transformer, with one winding connected into a breaker-and-a-half system. The following figure shows the arrangement of Sources used to provide the functions required in this application, and the CT/VT inputs that are used to provide the data.

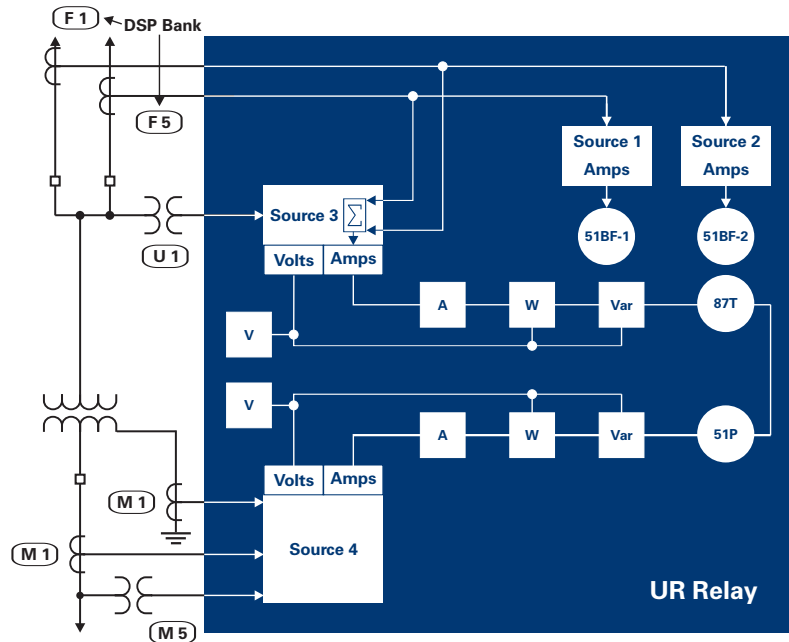


Figure 5-2: EXAMPLE USE OF SOURCES

## 5.3.4 FLEXCURVES™

PATH: SETTINGS ⇨ SYSTEM SETUP ⇨ FLEXCURVES ⇨ FLEXCURVE A

■ FLEXCURVE A

■



FLEXCURVE A TIME AT

0.00 xPKP: 0 ms

Range: 0 to 65535 ms in steps of 1

FlexCurves™ A and B have settings for entering times to Reset/Operate at the following pickup levels: 0.00 to 0.98 / 1.03 to 20.00. This data is converted into 2 continuous curves by linear interpolation between data points. To enter a custom FlexCurve™, enter the Reset/Operate time (using the ▲ VALUE ▼ keys) for each selected pickup point (using the ▲ MESSAGE ▼ keys) for the desired protection curve (A or B).

Table 5–9: FLEXCURVE™ TABLE

RESET	TIME MS	RESET	TIME MS	OPERATE	TIME MS	OPERATE	TIME MS	OPERATE	TIME MS	OPERATE	TIME MS
0.00		0.68		1.03		2.9		4.9		10.5	
0.05		0.70		1.05		3.0		5.0		11.0	
0.10		0.72		1.1		3.1		5.1		11.5	
0.15		0.74		1.2		3.2		5.2		12.0	
0.20		0.76		1.3		3.3		5.3		12.5	
0.25		0.78		1.4		3.4		5.4		13.0	
0.30		0.80		1.5		3.5		5.5		13.5	
0.35		0.82		1.6		3.6		5.6		14.0	
0.40		0.84		1.7		3.7		5.7		14.5	
0.45		0.86		1.8		3.8		5.8		15.0	
0.48		0.88		1.9		3.9		5.9		15.5	
0.50		0.90		2.0		4.0		6.0		16.0	
0.52		0.91		2.1		4.1		6.5		16.5	
0.54		0.92		2.2		4.2		7.0		17.0	
0.56		0.93		2.3		4.3		7.5		17.5	
0.58		0.94		2.4		4.4		8.0		18.0	
0.60		0.95		2.5		4.5		8.5		18.5	
0.62		0.96		2.6		4.6		9.0		19.0	
0.64		0.97		2.7		4.7		9.5		19.5	
0.66		0.98		2.8		4.8		10.0		20.0	



The relay using a given FlexCurve™ applies linear approximation for times between the user-entered points. Special care must be applied when setting the two points that are close to the multiple of pickup of 1, i.e. 0.98 pu and 1.03 pu. It is recommended to set the two times to a similar value; otherwise, the linear approximation may result in undesired behavior for the operating quantity the is close to 1.00 pu.

## 5.4.1 INTRODUCTION TO FLEXLOGIC™

To provide maximum flexibility to the user, the arrangement of internal digital logic combines fixed and user-programmed parameters. Logic upon which individual features are designed is fixed, and all other logic, from digital input signals through elements or combinations of elements to digital outputs, is variable. The user has complete control of all variable logic through FlexLogic™. In general, the system receives analog and digital inputs which it uses to produce analog and digital outputs. The major sub-systems of a generic UR relay involved in this process are shown below.

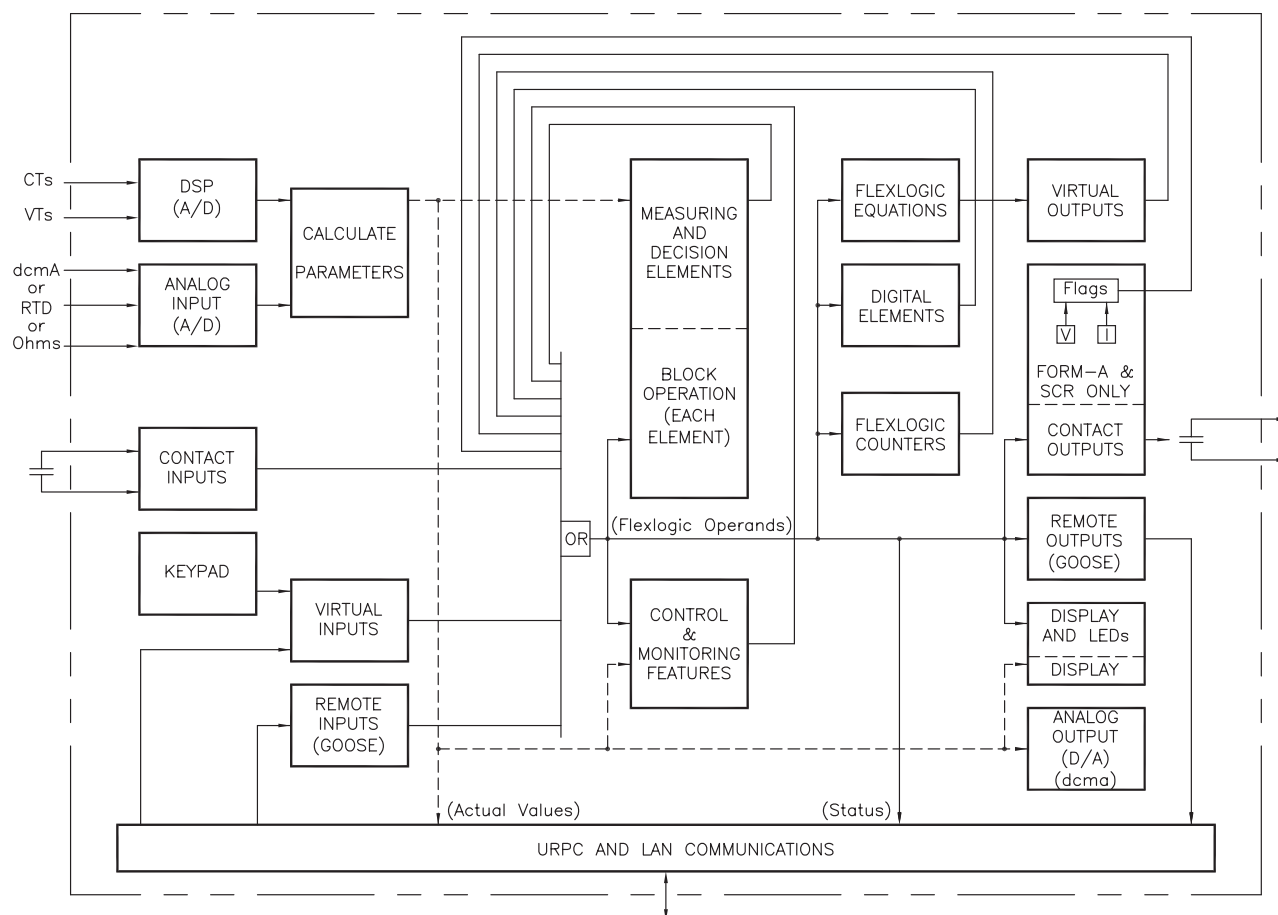


Figure 5-3: UR ARCHITECTURE OVERVIEW

The states of all digital signals used in the UR are represented by flags (or FlexLogic™ operands, which are described later in this section). A digital "1" is represented by a 'set' flag. Any external contact change-of-state can be used to block an element from operating, as an input to a control feature in a FlexLogic™ equation, or to operate a contact output. The state of the contact input can be displayed locally or viewed remotely via the communications facilities provided. If a simple scheme where a contact input is used to block an element is desired, this selection is made when programming the element. This capability also applies to the other features that set flags: elements, virtual inputs, remote inputs, schemes, and human operators.

If more complex logic than presented above is required, it is implemented via FlexLogic™. For example, if it is desired to have the closed state of contact input H7a and the operated state of the phase undervoltage element block the operation of the phase time overcurrent element, the two control input states are programmed in a FlexLogic™ equation. This equation ANDs the two control inputs to produce a "virtual output" which is then selected when programming the phase time overcurrent to be used as a blocking input. Virtual outputs can only be created by FlexLogic™ equations.

Traditionally, protective relay logic has been relatively limited. Any unusual applications involving interlocks, blocking, or supervisory functions had to be hard-wired using contact inputs and outputs. FlexLogic™ minimizes the requirement for auxiliary components and wiring while making more complex schemes possible.

The logic that determines the interaction of inputs, elements, schemes and outputs is field programmable through the use of logic equations that are sequentially processed. The use of virtual inputs and outputs in addition to hardware is available internally and on the communication ports for other relays to use (distributed FlexLogic™).

FlexLogic™ allows users to customize the relay through a series of equations that consist of operators and operands. The operands are the states of inputs, elements, schemes and outputs. The operators are logic gates, timers and latches (with set and reset inputs). A system of sequential operations allows any combination of specified operands to be assigned as inputs to specified operators to create an output. The final output of an equation is a numbered register called a virtual output. Virtual outputs can be used as an input operand in any equation, including the equation that generates the output, as a seal-in or other type of feedback.

A FlexLogic™ equation consists of parameters that are either operands or operators. Operands have a logic state of 1 or 0. Operators provide a defined function, such as an AND gate or a Timer. Each equation defines the combinations of parameters to be used to set a VIRTUAL OUTPUT flag. Evaluation of an equation results in either a 1 (= ON, i.e. flag set) or 0 (= OFF, i.e. flag not set). Each equation is evaluated at least 4 times every power system cycle.

Some types of operands are present in the relay in multiple instances; e.g. contact and remote inputs. These types of operands are grouped together (for presentation purposes only) on the faceplate display. The characteristics of the different types of operands are listed in the table below.

**Table 5–10: UR FLEXLOGIC™ OPERAND TYPES**

OPERAND TYPE	STATE	EXAMPLE FORMAT	CHARACTERISTICS [INPUT IS '1' (= ON) IF...]
Contact Input	On	Cont Ip On	Voltage is presently applied to the input (external contact closed).
	Off	Cont Ip Off	Voltage is presently not applied to the input (external contact open).
Contact Output (type Form-A contact only)	Voltage On	Cont Op 1 VOn	Voltage exists across the contact.
	Voltage Off	Cont Op 1 VOff	Voltage does not exist across the contact.
	Current On	Cont Op 1 IOn	Current is flowing through the contact.
	Current Off	Cont Op 1 IOff	Current is not flowing through the contact.
Element (Analog)	Pickup	PHASE TOC1 PKP	The tested parameter is presently above the pickup setting of an element which responds to rising values or below the pickup setting of an element which responds to falling values.
	Dropout	PHASE TOC1 DPO	This operand is the logical inverse of the above PKP operand.
	Operate	PHASE TOC1 OP	The tested parameter has been above/below the pickup setting of the element for the programmed delay time, or has been at logic 1 and is now at logic 0 but the reset timer has not finished timing.
	Block	PH DIR1 BLK	The output of the comparator is set to the block function.
Element (Digital)	Pickup	Dig Element 1 PKP	The input operand is at logic 1.
	Dropout	Dig Element 1 DPO	This operand is the logical inverse of the above PKP operand.
	Operate	Dig Element 1 OP	The input operand has been at logic 1 for the programmed pickup delay time, or has been at logic 1 for this period and is now at logic 0 but the reset timer has not finished timing.
Element (Digital Counter)	Higher than	Counter 1 HI	The number of pulses counted is above the set number.
	Equal to	Counter 1 EQL	The number of pulses counted is equal to the set number.
	Lower than	Counter 1 LO	The number of pulses counted is below the set number.
Fixed	On	On	Logic 1
	Off	Off	Logic 0
Remote Input	On	REMOTE INPUT 1 On	The remote input is presently in the ON state.
Virtual Input	On	Virt Ip 1 On	The virtual input is presently in the ON state.
Virtual Output	On	Virt Op 1 On	The virtual output is presently in the set state (i.e. evaluation of the equation which produces this virtual output results in a "1").

The operands available for this relay are listed alphabetically by types in the following table.

**Table 5–11: G60 FLEXLOGIC™ OPERANDS (Sheet 1 of 4)**

OPERAND TYPE	OPERAND SYNTAX	OPERAND DESCRIPTION
ELEMENT: 100% Stator Ground	100% STATOR STG1 PKP 100% STATOR STG1 OP 100% STATOR STG1 DPO 100% STATOR STG2 PKP 100% STATOR STG2 OP 100% STATOR STG2 DPO 100% STATOR PKP 100% STATOR OP 100% STATOR DPO	Stage 1 of the 100% Stator Ground element has picked up Stage 1 of the 100% Stator Ground element has operated Stage 1 of the 100% Stator Ground element has dropped out Stage 2 of the 100% Stator Ground element has picked up Stage 2 of the 100% Stator Ground element has operated Stage 2 of the 100% Stator Ground element has dropped out The 100% Stator Ground element has picked up The 100% Stator Ground element has operated The 100% Stator Ground element has dropped out
ELEMENT: 3rd Harmonic Neutral UV	3RD HARM NTRL UV PKP 3RD HARM NTRL UV OP 3RD HARM NTRL UV DPO	Third Harmonic Neutral Undervoltage element has picked up Third Harmonic Neutral Undervoltage element has operated Third Harmonic Neutral Undervoltage element has dropped out
ELEMENT: Accidental Energization	ACCDNT ENRG ARMED ACCDNT ENRG DPO ACCDNT ENRG OP	The Accidental Energization element is armed. The Accidental Energization element has dropped out. The Accidental Energization element has operated.
ELEMENT: Auxiliary OV	AUX OV1 PKP AUX OV1 DPO AUX OV1 OP	Auxiliary Overvoltage element has picked up Auxiliary Overvoltage element has dropped out Auxiliary Overvoltage element has operated
ELEMENT: Auxiliary UV	AUX UV1 PKP AUX UV1 DPO AUX UV1 OP	Auxiliary Undervoltage element has picked up Auxiliary Undervoltage element has dropped out Auxiliary Undervoltage element has operated
ELEMENT: Digital Counter	Counter 1 HI Counter 1 EQL Counter 1 LO ↓ Counter 8 HI Counter 8 EQL Counter 8 LO	Digital Counter 1 output is 'more than' comparison value Digital Counter 1 output is 'equal to' comparison value Digital Counter 1 output is 'less than' comparison value ↓ Digital Counter 8 output is 'more than' comparison value Digital Counter 8 output is 'equal to' comparison value Digital Counter 8 output is 'less than' comparison value
ELEMENT: Digital Element	Dig Element 1 PKP Dig Element 1 OP Dig Element 1 DPO ↓ Dig Element 16 PKP Dig Element 16 OP Dig Element 16 DPO	Digital Element 1 is picked up Digital Element 1 is operated Digital Element 1 is dropped out ↓ Digital Element 16 is picked up Digital Element 16 is operated Digital Element 16 is dropped out
ELEMENT: Sensitive Directional Power	DIR POWER 1 STG1 PKP DIR POWER 1 STG2 PKP DIR POWER 1 STG1 DPO DIR POWER 1 STG2 DPO DIR POWER 1 STG1 OP DIR POWER 1 STG2 OP DIR POWER 1 PKP DIR POWER 1 DPO DIR POWER 1 OP ↓ DIR POWER 2	Stage 1 of the Directional Power element 1 has picked up Stage 2 of the Directional Power element 1 has picked up Stage 1 of the Directional Power element 1 has dropped out Stage 2 of the Directional Power element 1 has dropped out Stage 1 of the Directional Power element 1 has operated Stage 2 of the Directional Power element 1 has operated The Directional Power element has picked up The Directional Power element has dropped out The Directional Power element has operated ↓ Same set of operands as DIR POWER 1
ELEMENT: FlexElements™	FLEXELEMENT 1 PKP FLEXELEMENT 1 OP FLEXELEMENT 1 DPO ↓ FLEXELEMENT 16 PKP FLEXELEMENT 16 OP FLEXELEMENT 16 DPO	FlexElement 1 has picked up FlexElement 1 has operated FlexElement 1 has dropped out ↓ FlexElement 16 has picked up FlexElement 16 has operated FlexElement 16 has dropped out
ELEMENT: Generator Unbalance	GEN UNBAL STG1 PKP GEN UNBAL STG1 DPO GEN UNBAL STG1 OP GEN UNBAL STG2 PKP GEN UNBAL STG2 DPO GEN UNBAL STG2 OP GEN UNBAL PKP GEN UNBAL DPO GEN UNBAL OP	The Generator Unbalance Stage 1 element has picked up The Generator Unbalance Stage 1 element has dropped out The Generator Unbalance Stage 1 element has operated The Generator Unbalance Stage 2 element has picked up The Generator Unbalance Stage 2 element has dropped out The Generator Unbalance Stage 2 element has operated The Generator Unbalance element has picked up The Generator Unbalance element has dropped out The Generator Unbalance element has operated
ELEMENT: Ground IOC	GROUND IOC1 PKP GROUND IOC1 OP GROUND IOC1 DPO ↓ GROUND IOC2	Ground Instantaneous Overcurrent 1 has picked up Ground Instantaneous Overcurrent 1 has operated Ground Instantaneous Overcurrent 1 has dropped out ↓ Same set of operands as shown for GROUND IOC 1



Table 5–11: G60 FLEXLOGIC™ OPERANDS (Sheet 2 of 4)

OPERAND TYPE	OPERAND SYNTAX	OPERAND DESCRIPTION
ELEMENT: Ground TOC	GROUND TOC1 PKP GROUND TOC1 OP GROUND TOC1 DPO	Ground Time Overcurrent 1 has picked up Ground Time Overcurrent 1 has operated Ground Time Overcurrent 1 has dropped out
	GROUND TOC2	Same set of operands as shown for GROUND TOC1
ELEMENT: Loss of Excitation	LOSS OF EXC STG 1 PKP LOSS OF EXC STG 2 PKP LOSS OF EXC STG 1 DPO LOSS OF EXC STG 2 DPO LOSS OF EXC STG 1 OP LOSS OF EXC STG 2 OP LOSS OF EXC PKP LOSS OF EXC DPO LOSS OF EXC OP	Stage 1 of the Loss of Excitation element has picked up Stage 2 of the Loss of Excitation element has picked up Stage 1 of the Loss of Excitation element has dropped out Stage 2 of the Loss of Excitation element has dropped out Stage 1 of the Loss of Excitation element has operated Stage 2 of the Loss of Excitation element has operated The Loss of Excitation element has picked up The Loss of Excitation element has dropped out The Loss of Excitation element has operated
	NEG SEQ OV PKP NEG SEQ OV DPO NEG SEQ OV OP	Negative Sequence Overvoltage element has picked up Negative Sequence Overvoltage element has dropped out Negative Sequence Overvoltage element has operated
ELEMENT: Neutral IOC	NEUTRAL IOC1 PKP NEUTRAL IOC1 OP NEUTRAL IOC1 DPO	Neutral Instantaneous Overcurrent 1 has picked up Neutral Instantaneous Overcurrent 1 has operated Neutral Instantaneous Overcurrent 1 has dropped out
	NEUTRAL IOC2	Same set of operands as shown for NEUTRAL IOC1
ELEMENT: Neutral OV	NEUTRAL OV1 PKP NEUTRAL OV1 DPO NEUTRAL OV1 OP	Neutral Overvoltage element has picked up Neutral Overvoltage element has dropped out Neutral Overvoltage element has operated
	NTRL DIR OC1 FWD NTRL DIR OC1 REV	Neutral Directional OC1 Forward has operated Neutral Directional OC1 Reverse has operated
ELEMENT: Neutral Directional	NTRL DIR OC2	Same set of operands as shown for NTRL DIR OC1
	OVERFREQ 1 PKP OVERFREQ 1 OP OVERFREQ 1 DPO	Overfrequency 1 has picked up Overfrequency 1 has operated Overfrequency 1 has dropped out
ELEMENT: Overfrequency	OVERFREQ 2	Same set of operands as shown for OVERFREQ 1
ELEMENT: Phase Directional	PH DIR1 BLK A PH DIR1 BLK B PH DIR1 BLK C PH DIR1 BLK	Phase A Directional 1 Block Phase B Directional 1 Block Phase C Directional 1 Block Phase Directional 1 Block
	PH DIR2	Same set of operands as shown for PH DIR1
ELEMENT: Phase IOC	PHASE IOC1 PKP PHASE IOC1 OP PHASE IOC1 DPO PHASE IOC1 PKP A PHASE IOC1 PKP B PHASE IOC1 PKP C PHASE IOC1 OP A PHASE IOC1 OP B PHASE IOC1 OP C PHASE IOC1 DPO A PHASE IOC1 DPO B PHASE IOC1 DPO C	At least one phase of PHASE IOC1 has picked up At least one phase of PHASE IOC1 has operated At least one phase of PHASE IOC1 has dropped out Phase A of PHASE IOC1 has picked up Phase B of PHASE IOC1 has picked up Phase C of PHASE IOC1 has picked up Phase A of PHASE IOC1 has operated Phase B of PHASE IOC1 has operated Phase C of PHASE IOC1 has operated Phase A of PHASE IOC1 has dropped out Phase B of PHASE IOC1 has dropped out Phase C of PHASE IOC1 has dropped out
	PHASE IOC2	Same set of operands as shown for PHASE IOC1
ELEMENT: Phase OV	PHASE OV1 PKP PHASE OV1 OP PHASE OV1 DPO PHASE OV1 PKP A PHASE OV1 PKP B PHASE OV1 PKP C PHASE OV1 OP A PHASE OV1 OP B PHASE OV1 OP C PHASE OV1 DPO A PHASE OV1 DPO B PHASE OV1 DPO C	At least one phase of OV1 has picked up At least one phase of OV1 has operated At least one phase of OV1 has dropped out Phase A of OV1 has picked up Phase B of OV1 has picked up Phase C of OV1 has picked up Phase A of OV1 has operated Phase B of OV1 has operated Phase C of OV1 has operated Phase A of OV1 has dropped out Phase B of OV1 has dropped out Phase C of OV1 has dropped out

Table 5–11: G60 FLEXLOGIC™ OPERANDS (Sheet 3 of 4)

OPERAND TYPE	OPERAND SYNTAX	OPERAND DESCRIPTION
ELEMENT: Phase TOC	PHASE TOC1 PKP PHASE TOC1 OP PHASE TOC1 DPO PHASE TOC1 PKP A PHASE TOC1 PKP B PHASE TOC1 PKP C PHASE TOC1 OP A PHASE TOC1 OP B PHASE TOC1 OP C PHASE TOC1 DPO A PHASE TOC1 DPO B PHASE TOC1 DPO C	At least one phase of PHASE TOC1 has picked up At least one phase of PHASE TOC1 has operated At least one phase of PHASE TOC1 has dropped out Phase A of PHASE TOC1 has picked up Phase B of PHASE TOC1 has picked up Phase C of PHASE TOC1 has picked up Phase A of PHASE TOC1 has operated Phase B of PHASE TOC1 has operated Phase C of PHASE TOC1 has operated Phase A of PHASE TOC1 has dropped out Phase B of PHASE TOC1 has dropped out Phase C of PHASE TOC1 has dropped out
	PHASE TOC2	Same set of operands as shown for PHASE TOC1
ELEMENT: Phase UV	PHASE UV1 PKP PHASE UV1 OP PHASE UV1 DPO PHASE UV1 PKP A PHASE UV1 PKP B PHASE UV1 PKP C PHASE UV1 OP A PHASE UV1 OP B PHASE UV1 OP C PHASE UV1 DPO A PHASE UV1 DPO B PHASE UV1 DPO C	At least one phase of UV1 has picked up At least one phase of UV1 has operated At least one phase of UV1 has dropped out Phase A of UV1 has picked up Phase B of UV1 has picked up Phase C of UV1 has picked up Phase A of UV1 has operated Phase B of UV1 has operated Phase C of UV1 has operated Phase A of UV1 has dropped out Phase B of UV1 has dropped out Phase C of UV1 has dropped out
	PHASE UV2	Same set of operands as shown for PHASE UV1
ELEMENT: Power Swing Detect	POWER SWING OUTER POWER SWING MIDDLE POWER SWING INNER POWER SWING BLOCK POWER SWING TMRX PKP POWER SWING TRIP	Positive Sequence impedance in outer characteristic Positive Sequence impedance in middle characteristic Positive Sequence impedance in inner characteristic Power Swing Blocking element operated Power Swing Timer X picked up Out-of-step Tripping operated
ELEMENT: Setting Group	SETTING GROUP ACT 1 ↓ SETTING GROUP ACT 8	Setting group 1 is active ↓ Setting group 8 is active
ELEMENT: Stator Differential	STATOR DIFF OP STATOR DIFF PKP A STATOR DIFF PKP B STATOR DIFF PKP C STATOR DIFF OP A STATOR DIFF OP B STATOR DIFF OP C STATOR DIFF DPO A STATOR DIFF DPO B STATOR DIFF DPO C STATOR DIFF SAT A STATOR DIFF SAT B STATOR DIFF SAT C STATOR DIFF DIR A STATOR DIFF DIR B STATOR DIFF DIR C	At least one phase of Stator Differential has operated Phase A of Stator Differential has picked up Phase B of Stator Differential has picked up Phase C of Stator Differential has picked up Phase A of Stator Differential has operated Phase B of Stator Differential has operated Phase C of Stator Differential has operated Phase A of Stator Differential has dropped out Phase B of Stator Differential has dropped out Phase C of Stator Differential has dropped out Phase A of Stator Differential is saturated Phase B of Stator Differential is saturated Phase C of Stator Differential is saturated Phase A of Stator Differential Phase Comparison has been satisfied Phase B of Stator Differential Phase Comparison has been satisfied Phase C of Stator Differential Phase Comparison has been satisfied
ELEMENT: Synchrocheck	SYNC 1 DEAD S OP SYNC 1 DEAD S DPO SYNC 1 SYNC OP SYNC 1 SYNC DPO SYNC 1 CLS OP SYNC 1 CLS DPO	Synchrocheck 1 dead source has operated Synchrocheck 1 dead source has dropped out Synchrocheck 1 in synchronization has operated Synchrocheck 1 in synchronization has dropped out Synchrocheck 1 close has operated Synchrocheck 1 close has dropped out
	SYNC 2	Same set of operands as shown for SYNC 1
ELEMENT: Underfrequency	UNDERFREQ 1 PKP UNDERFREQ 1 OP UNDERFREQ 1 DPO	Underfrequency 1 has picked up Underfrequency 1 has operated Underfrequency 1 has dropped out
	UNDERFREQ 2...	Same set of operands as shown for UNDERFREQ 1 above
ELEMENT: Volts per Hertz	VOLT PER HERTZ 1 PKP VOLT PER HERTZ 1 OP VOLT PER HERTZ 1 DPO	V/Hz element 1 has picked up V/Hz element 1 has operated V/Hz element 1 has dropped out
	VOLT PER HERTZ 2	Same set of operands as VOLT PER HERTZ 1 above
ELEMENT: VTFF	SRCx VT FUSE F OP SRCx VT FUSE F DPO	Source x VT Fuse Failure detector has operated Source x VT Fuse Failure detector has dropped out

Table 5–11: G60 FLEXLOGIC™ OPERANDS (Sheet 4 of 4)

OPERAND TYPE	OPERAND SYNTAX	OPERAND DESCRIPTION
FIXED OPERANDS	Off	Logic = 0. Does nothing and may be used as a delimiter in an equation list; used as 'Disable' by other features.
	On	Logic = 1. Can be used as a test setting.
INPUTS/OUTPUTS: Contact Inputs	Cont Ip 1 On ↓ Cont Ip 2 On	(will not appear unless ordered) (will not appear unless ordered)
	Cont Ip 1 Off ↓ Cont Ip 2 Off	(will not appear unless ordered) (will not appear unless ordered)
INPUTS/OUTPUTS: Contact Outputs, Current (from detector on Form-A output only)	Cont Op 1 IOn ↓ Cont Op 2 IOn	(will not appear unless ordered) (will not appear unless ordered)
	Cont Op 1 IOff ↓ Cont Op 2 IOff	(will not appear unless ordered) (will not appear unless ordered)
INPUTS/OUTPUTS: Contact Outputs, Voltage (from detector on Form-A output only)	Cont Op 1 VOn ↓ Cont Op 2 VOn	(will not appear unless ordered) (will not appear unless ordered)
	Cont Op 1 VOff ↓ Cont Op 2 VOff	(will not appear unless ordered) (will not appear unless ordered)
INPUTS/OUTPUTS: Remote Inputs	REMOTE INPUT 1 On ↓ REMOTE INPUT 32 On	Flag is set, logic=1 ↓ Flag is set, logic=1
INPUTS/OUTPUTS: Virtual Inputs	Virt Ip 1 On ↓ Virt Ip 32 On	Flag is set, logic=1 ↓ Flag is set, logic=1
INPUTS/OUTPUTS: Virtual Outputs	Virt Op 1 On ↓ Virt Op 64 On	Flag is set, logic=1 ↓ Flag is set, logic=1
REMOTE DEVICES	REMOTE DEVICE 1 On ↓ REMOTE DEVICE 16 On	Flag is set, logic=1 ↓ Flag is set, logic=1
	REMOTE DEVICE 1 Off ↓ REMOTE DEVICE 16 Off	Flag is set, logic=1 ↓ Flag is set, logic=1
RESETTING	RESET OP RESET OP (COMMS) RESET OP (OPERAND) RESET OP (PUSHBUTTON)	Reset command is operated (set by all 3 operands below) Communications source of the reset command Operand source of the reset command Reset key (pushbutton) source of the reset command
SELF-DIAGNOSTICS	ANY MAJOR ERROR ANY MINOR ERROR ANY SELF-TEST LOW ON MEMORY WATCHDOG ERROR PROGRAM ERROR EEPROM DATA ERROR PRI ETHERNET FAIL SEC ETHERNET FAIL BATTERY FAIL SYSTEM EXCEPTION UNIT NOT PROGRAMMED EQUIPMENT MISMATCH FLEXLGC ERROR TOKEN PROTOTYPE FIRMWARE UNIT NOT CALIBRATED NO DSP INTERRUPTS DSP ERROR IRIG-B FAILURE REMOTE DEVICE OFFLINE	Any of the major self-test errors generated (major error) Any of the minor self-test errors generated (minor error) Any self-test errors generated (generic, any error) See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter. See description in the COMMANDS chapter.

Some operands can be re-named by the user. These are the names of the breakers in the breaker control feature, the ID (identification) of contact inputs, the ID of virtual inputs, and the ID of virtual outputs. If the user changes the default name/ID of any of these operands, the assigned name will appear in the relay list of operands. The default names are shown in the FLEXLOGIC™ OPERANDS table above.

The characteristics of the logic gates are tabulated below, and the operators available in FlexLogic™ are listed in the FLEX-LOGIC™ OPERATORS table.

**Table 5–12: FLEXLOGIC™ GATE CHARACTERISTICS**

GATES	NUMBER OF INPUTS	OUTPUT IS '1' (= ON) IF...
NOT	1	input is '0'
OR	2 to 16	any input is '1'
AND	2 to 16	all inputs are '1'
NOR	2 to 16	all inputs are '0'
NAND	2 to 16	any input is '0'
XOR	2	only one input is '1'

**Table 5–13: FLEXLOGIC™ OPERATORS**

OPERATOR TYPE	OPERATOR SYNTAX	DESCRIPTION	NOTES
Editor	INSERT	Insert a parameter in an equation list.	
	DELETE	Delete a parameter from an equation list.	
End	END	The first END encountered signifies the last entry in the list of FlexLogic™ parameters that is processed.	
One Shot	POSITIVE ONE SHOT	One shot that responds to a positive going edge.	A 'one shot' refers to a single input gate that generates a pulse in response to an edge on the input. The output from a 'one shot' is True (positive) for only one pass through the FlexLogic™ equation. There is a maximum of 32 'one shots'.
	NEGATIVE ONE SHOT	One shot that responds to a negative going edge.	
	DUAL ONE SHOT	One shot that responds to both the positive and negative going edges.	
Logic Gate	NOT	Logical Not	Operates on the previous parameter.
	OR(2)	2 input OR gate	Operates on the 2 previous parameters.
	↓ OR(16)	↓ 16 input OR gate	↓ Operates on the 16 previous parameters.
	AND(2)	2 input AND gate	Operates on the 2 previous parameters.
	↓ AND(16)	↓ 16 input AND gate	↓ Operates on the 16 previous parameters.
	NOR(2)	2 input NOR gate	Operates on the 2 previous parameters.
	↓ NOR(16)	↓ 16 input NOR gate	↓ Operates on the 16 previous parameters.
	NAND(2)	2 input NAND gate	Operates on the 2 previous parameters.
	↓ NAND(16)	↓ 16 input NAND gate	↓ Operates on the 16 previous parameters.
	XOR(2)	2 input Exclusive OR gate	Operates on the 2 previous parameters.
	LATCH (S,R)	Latch (Set, Reset) - reset-dominant	The parameter preceding LATCH(S,R) is the Reset input. The parameter preceding the Reset input is the Set input.
Timer	TIMER 1 ↓ TIMER 32	Timer as configured with FlexLogic™ Timer 1 settings. ↓ Timer as configured with FlexLogic™ Timer 32 settings.	The timer is started by the preceding parameter. The output of the timer is TIMER #.
Assign Virtual Output	= Virt Op 1 ↓ = Virt Op 64	Assigns previous FlexLogic™ parameter to Virtual Output 1. ↓ Assigns previous FlexLogic™ parameter to Virtual Output 64.	The virtual output is set by the preceding parameter

## 5.4.2 FLEXLOGIC™ RULES

When forming a FlexLogic™ equation, the sequence in the linear array of parameters must follow these general rules:

1. Operands must precede the operator which uses the operands as inputs.
2. Operators have only one output. The output of an operator must be used to create a virtual output if it is to be used as an input to two or more operators.
3. Assigning the output of an operator to a Virtual Output terminates the equation.
4. A timer operator (e.g. "TIMER 1") or virtual output assignment (e.g. " = Virt Op 1") may only be used once. If this rule is broken, a syntax error will be declared.

## 5.4.3 FLEXLOGIC™ EVALUATION

Each equation is evaluated in the order in which the parameters have been entered.



**FLEXLOGIC™ PROVIDES LATCHES WHICH BY DEFINITION HAVE A MEMORY ACTION, REMAINING IN THE SET STATE AFTER THE SET INPUT HAS BEEN ASSERTED. HOWEVER, THEY ARE VOLATILE; I.E. THEY RESET ON THE RE-APPLICATION OF CONTROL POWER.**

**WHEN MAKING CHANGES TO PROGRAMMING, ALL FLEXLOGIC™ EQUATIONS ARE RE-COMPILED WHEN ANY NEW SETTING IS ENTERED, SO ALL LATCHES ARE AUTOMATICALLY RESET. IF IT IS REQUIRED TO RE-INITIALIZE FLEXLOGIC™ DURING TESTING, FOR EXAMPLE, IT IS SUGGESTED TO POWER THE UNIT DOWN AND THEN BACK UP.**

## 5.4.4 FLEXLOGIC™ PROCEDURE EXAMPLE

5

This section provides an example of implementing logic for a typical application. The sequence of the steps is quite important as it should minimize the work necessary to develop the relay settings. Note that the example presented in the figure below is intended to demonstrate the procedure, not to solve a specific application situation.

In the example below, it is assumed that logic has already been programmed to produce Virtual Outputs 1 and 2, and is only a part of the full set of equations used. When using FlexLogic™, it is important to make a note of each Virtual Output used – a Virtual Output designation (1 to 64) can only be properly assigned once.

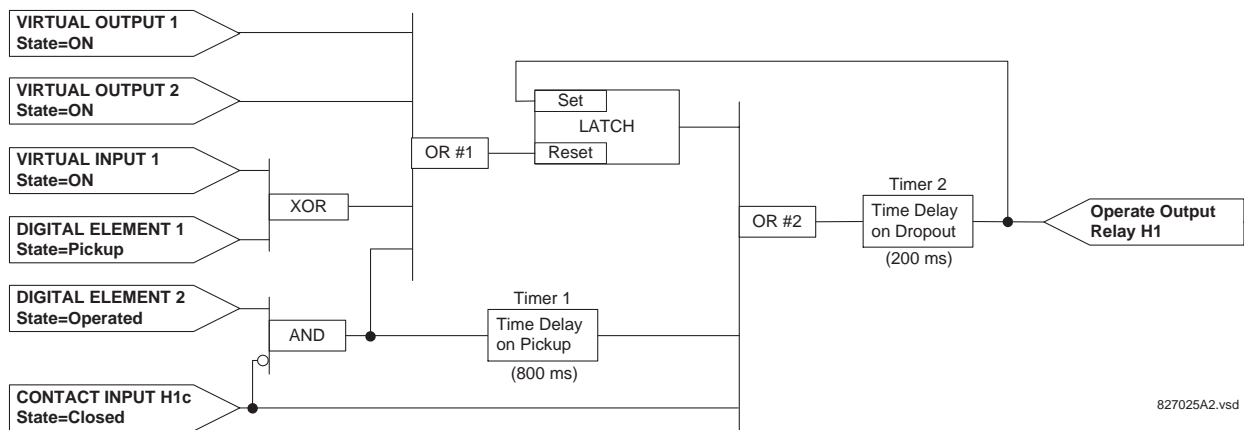



Figure 5-4: EXAMPLE LOGIC SCHEME

1. Inspect the example logic diagram to determine if the required logic can be implemented with the FlexLogic™ operators. If this is not possible, the logic must be altered until this condition is satisfied. Once this is done, count the inputs to each gate to verify that the number of inputs does not exceed the FlexLogic™ limits, which is unlikely but possible. If the number of inputs is too high, subdivide the inputs into multiple gates to produce an equivalent. For example, if 25 inputs to an AND gate are required, connect inputs 1 through 16 to one AND(16), 17 through 25 to another AND(9), and the outputs from these two gates to a third AND(2).

Inspect each operator between the initial operands and final virtual outputs to determine if the output from the operator is used as an input to more than one following operator. If so, the operator output must be assigned as a Virtual Output.


For the example shown above, the output of the AND gate is used as an input to both OR#1 and Timer 1, and must therefore be made a Virtual Output and assigned the next available number (i.e. Virtual Output 3). The final output must also be assigned to a Virtual Output as Virtual Output 4, which will be programmed in the contact output section to operate relay H1 (i.e. Output Contact H1).

Therefore, the required logic can be implemented with two FlexLogic™ equations with outputs of Virtual Output 3 and Virtual Output 4 as shown below.

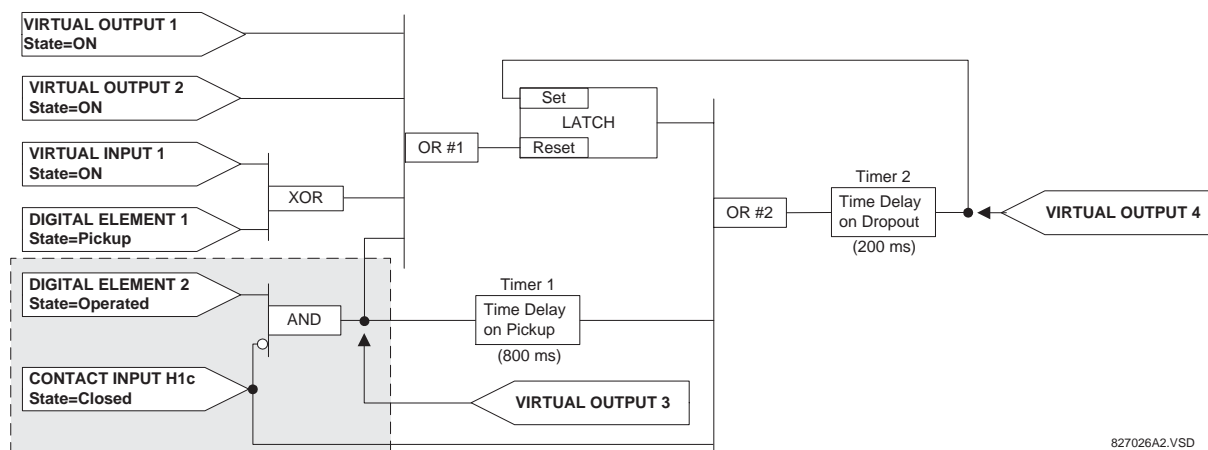

**Figure 5-5: LOGIC EXAMPLE WITH VIRTUAL OUTPUTS**

2. Prepare a logic diagram for the equation to produce Virtual Output 3, as this output will be used as an operand in the Virtual Output 4 equation (create the equation for every output that will be used as an operand first, so that when these operands are required they will already have been evaluated and assigned to a specific Virtual Output). The logic for Virtual Output 3 is shown below with the final output assigned.

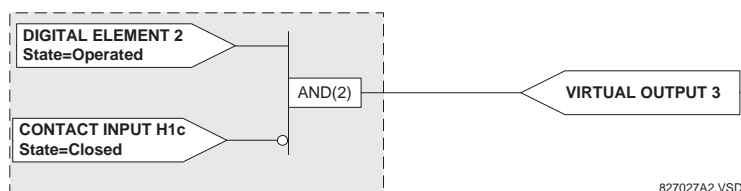

**Figure 5-6: LOGIC FOR VIRTUAL OUTPUT 3**

3. Prepare a logic diagram for Virtual Output 4, replacing the logic ahead of Virtual Output 3 with a symbol identified as Virtual Output 3, as shown below.

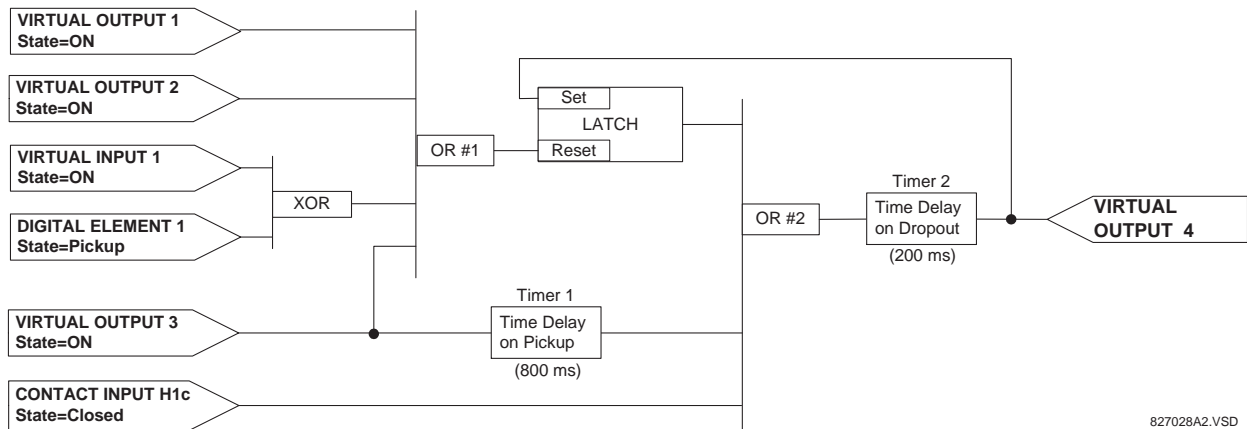


Figure 5-7: LOGIC FOR VIRTUAL OUTPUT 4

4. Program the FlexLogic™ equation for Virtual Output 3 by translating the logic into available FlexLogic™ parameters. The equation is formed one parameter at a time until the required logic is complete. It is generally easier to start at the output end of the equation and work back towards the input, as shown in the following steps. It is also recommended to list operator inputs from bottom to top. For demonstration, the final output will be arbitrarily identified as parameter 99, and each preceding parameter decremented by one in turn. Until accustomed to using FlexLogic™, it is suggested that a worksheet with a series of cells marked with the arbitrary parameter numbers be prepared, as shown below.

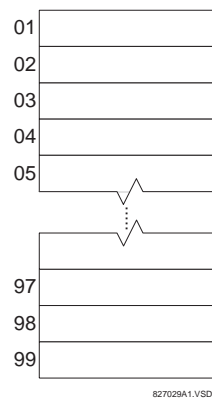


Figure 5-8: FLEXLOGIC™ WORKSHEET

5. Following the procedure outlined, start with parameter 99, as follows:
  - 99: The final output of the equation is Virtual Output 3, which is created by the operator "= Virt Op n". This parameter is therefore "= Virt Op 3."
  - 98: The gate preceding the output is an AND, which in this case requires two inputs. The operator for this gate is a 2-input AND so the parameter is "AND(2)". Note that FlexLogic™ rules require that the number of inputs to most types of operators must be specified to identify the operands for the gate. As the 2-input AND will operate on the two operands preceding it, these inputs must be specified, starting with the lower.
  - 97: This lower input to the AND gate must be passed through an inverter (the NOT operator) so the next parameter is "NOT". The NOT operator acts upon the operand immediately preceding it, so specify the inverter input next.
  - 96: The input to the NOT gate is to be contact input H1c. The ON state of a contact input can be programmed to be set when the contact is either open or closed. Assume for this example the state is to be ON for a closed contact. The operand is therefore "Cont Ip H1c On".
  - 95: The last step in the procedure is to specify the upper input to the AND gate, the operated state of digital element 2. This operand is "DIG ELEM 2 OP".

Writing the parameters in numerical order can now form the equation for VIRTUAL OUTPUT 3:




```

[95] DIG ELEM 2 OP
[96] Cont Ip H1c On
[97] NOT
[98] AND(2)
[99] = Virt Op 3

```

It is now possible to check that this selection of parameters will produce the required logic by converting the set of parameters into a logic diagram. The result of this process is shown below, which is compared to figure: LOGIC FOR VIRTUAL OUTPUT 3 as a check.

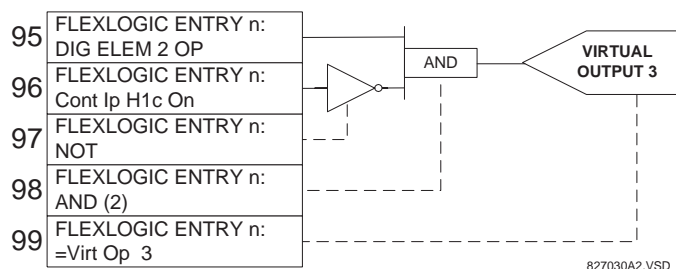

**Figure 5–9: FLEXLOGIC™ EQUATION & LOGIC FOR VIRTUAL OUTPUT 3**

6. Repeating the process described for VIRTUAL OUTPUT 3, select the FlexLogic™ parameters for Virtual Output 4.
  - 99: The final output of the equation is VIRTUAL OUTPUT 4 which is parameter “= Virt Op 4”.
  - 98: The operator preceding the output is Timer 2, which is operand “TIMER 2”. Note that the settings required for the timer are established in the timer programming section.
  - 97: The operator preceding Timer 2 is OR #2, a 3-input OR, which is parameter “OR(3)”.
  - 96: The lowest input to OR #2 is operand “Cont Ip H1c On”.
  - 95: The center input to OR #2 is operand “TIMER 1”.
  - 94: The input to Timer 1 is operand “Virt Op 3 On”.
  - 93: The upper input to OR #2 is operand “LATCH (S,R)”.
  - 92: There are two inputs to a latch, and the input immediately preceding the latch reset is OR #1, a 4-input OR, which is parameter “OR(4)”.
  - 91: The lowest input to OR #1 is operand “Virt Op 3 On”.
  - 90: The input just above the lowest input to OR #1 is operand “XOR(2)”.
  - 89: The lower input to the XOR is operand “DIG ELEM 1 PKP”.
  - 88: The upper input to the XOR is operand “Virt Ip 1 On”.
  - 87: The input just below the upper input to OR #1 is operand “Virt Op 2 On”.
  - 86: The upper input to OR #1 is operand “Virt Op 1 On”.
  - 85: The last parameter is used to set the latch, and is operand “Virt Op 4 On”.

The equation for VIRTUAL OUTPUT 4 is:

```


[85] Virt Op 4 On
[86] Virt Op 1 On
[87] Virt Op 2 On
[88] Virt Ip 1 On
[89] DIG ELEM 1 PKP
[90] XOR(2)
[91] Virt Op 3 On
[92] OR(4)
[93] LATCH (S,R)
[94] Virt Op 3 On

```



```
[95] TIMER 1
[96] Cont Ip H1c On
[97] OR(3)
[98] TIMER 2
[99] = Virt Op 4
```

It is now possible to check that the selection of parameters will produce the required logic by converting the set of parameters into a logic diagram. The result of this process is shown below, which is compared to figure: LOGIC FOR VIRTUAL OUTPUT 4, as a check.

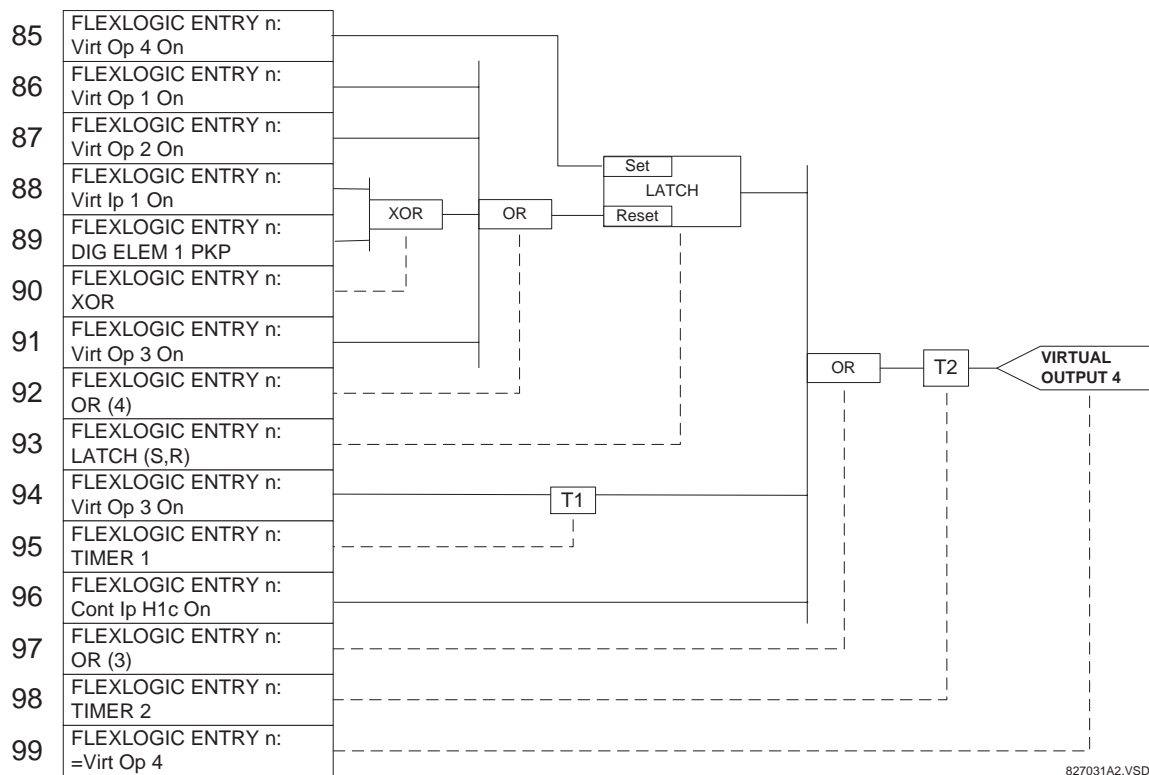

**Figure 5–10: FLEXLOGIC™ EQUATION & LOGIC FOR VIRTUAL OUTPUT 4**

7. Now write the complete FlexLogic™ expression required to implement the required logic, making an effort to assemble the equation in an order where Virtual Outputs that will be used as inputs to operators are created before needed. In cases where a lot of processing is required to perform considerable logic, this may be difficult to achieve, but in most cases will not cause problems because all of the logic is calculated at least 4 times per power frequency cycle. The possibility of a problem caused by sequential processing emphasizes the necessity to test the performance of FlexLogic™ before it is placed in service.

In the following equation, Virtual Output 3 is used as an input to both Latch 1 and Timer 1 as arranged in the order shown below:

```
DIG ELEM 2 OP
Cont Ip Hlc On
NOT
AND(2)
= Virt Op 3
Virt Op 4 On
Virt Op 1 On
Virt Op 2 On
Virt Ip 1 On
DIG ELEM 1 PKP
XOR(2)
```

```

Virt Op 3 On
OR(4)
LATCH (S,R)
Virt Op 3 On
TIMER 1
Cont Ip H1c On
OR(3)
TIMER 2
= Virt Op 4
END

```


In the expression above, the Virtual Output 4 input to the 4-input OR is listed before it is created. This is typical of a form of feedback, in this case, used to create a seal-in effect with the latch, and is correct.

8. The logic should always be tested after it is loaded into the relay, in the same fashion as has been used in the past. Testing can be simplified by placing an "END" operator within the overall set of FlexLogic™ equations. The equations will then only be evaluated up to the first "END" operator.

The "On" and "Off" operands can be placed in an equation to establish a known set of conditions for test purposes, and the "INSERT" and "DELETE" commands can be used to modify equations.

### 5.4.5 FLEXLOGIC™ EQUATION EDITOR


PATH: SETTINGS ⇌ FLEXLOGIC ⇌ FLEXLOGIC EQUATION EDITOR

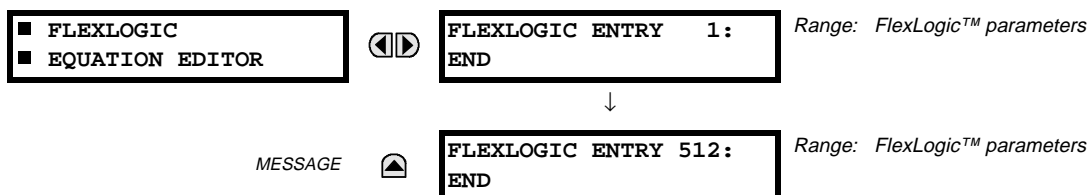

There are 512 FlexLogic™ entries available, numbered from 1 to 512, with default 'END' entry settings. If a "Disabled" Element is selected as a FlexLogic™ entry, the associated state flag will never be set to '1'. The '+/-' key may be used when editing FlexLogic™ equations from the keypad to quickly scan through the major parameter types.

### 5.4.6 FLEXLOGIC™ TIMERS

PATH: SETTINGS ⇌ FLEXLOGIC ⇌ FLEXLOGIC TIMERS ⇌ FLEXLOGIC TIMER 1(32)

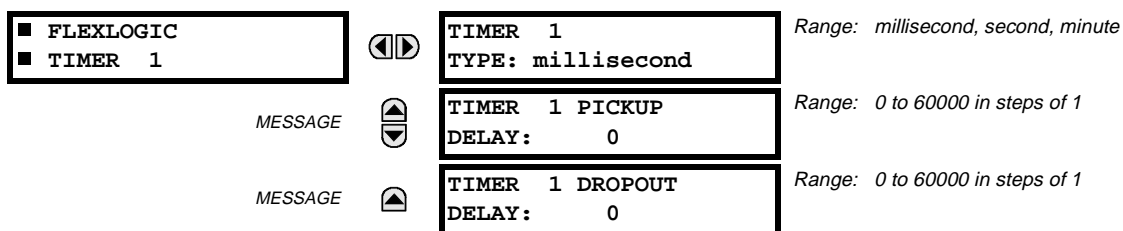

There are 32 identical FlexLogic™ timers available, numbered from 1 to 32. These timers can be used as operators for FlexLogic™ equations.

#### TIMER 1 TYPE:

This setting is used to select the time measuring unit.

#### TIMER 1 PICKUP DELAY:

This setting is used to set the time delay to pickup. If a pickup delay is not required, set this function to "0".

#### TIMER 1 DROPOUT DELAY:

This setting is used to set the time delay to dropout. If a dropout delay is not required, set this function to "0".

## 5.4.7 FLEXELEMENTS™

PATH: SETTING ⇒ FLEXLOGIC ⇒ FLEXELEMENTS ⇒ FLEXELEMENT 1(16)

■ FLEXELEMENT 1	◀▶	FLEXELEMENT 1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	FLEXELEMENT 1 NAME: FxEl	Range: up to 6 alphanumeric characters
MESSAGE	▲▼	FLEXELEMENT 1 +IN Off	Range: Off, any analog actual value parameter
MESSAGE	▲▼	FLEXELEMENT 1 -IN Off	Range: Off, any analog actual value parameter
MESSAGE	▲▼	FLEXELEMENT 1 INPUT MODE: Signed	Range: Signed, Absolute
MESSAGE	▲▼	FLEXELEMENT 1 COMP MODE: Level	Range: Level, Delta
MESSAGE	▲▼	FLEXELEMENT 1 DIRECTION: Over	Range: Over, Under
MESSAGE	▲▼	FLEXELEMENT 1 PICKUP: 1.000 pu	Range: -90.000 to 90.000 pu in steps of 0.001
MESSAGE	▲▼	FLEXELEMENT 1 HYSTERESIS: 3.0%	Range: 0.1 to 50.0% in steps of 0.1
MESSAGE	▲▼	FLEXELEMENT 1 dt UNIT: milliseconds	Range: milliseconds, seconds, minutes
MESSAGE	▲▼	FLEXELEMENT 1 dt: 20	Range: 20 to 86400 in steps of 1
MESSAGE	▲▼	FLEXELEMENT 1 PKP DELAY: 0.000 s	Range: 0.000 to 65.535 sec. in steps of 0.001
MESSAGE	▲▼	FLEXELEMENT 1 RST DELAY: 0.000 s	Range: 0.000 to 65.535 sec. in steps of 0.001
MESSAGE	▲▼	FLEXELEMENT 1 BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	FLEXELEMENT 1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	FLEXELEMENT 1 EVENTS: Disabled	Range: Disabled, Enabled

A FlexElement™ is a universal comparator that can be used to monitor any analog actual value calculated by the relay or a net difference of any two analog actual values of the same type. The effective operating signal could be treated as a signed number or its absolute value could be used as per user's choice.

The element can be programmed to respond either to a signal level or to a rate-of-change (delta) over a pre-defined period of time. The output operand is asserted when the operating signal is higher than a threshold or lower than a threshold as per user's choice.

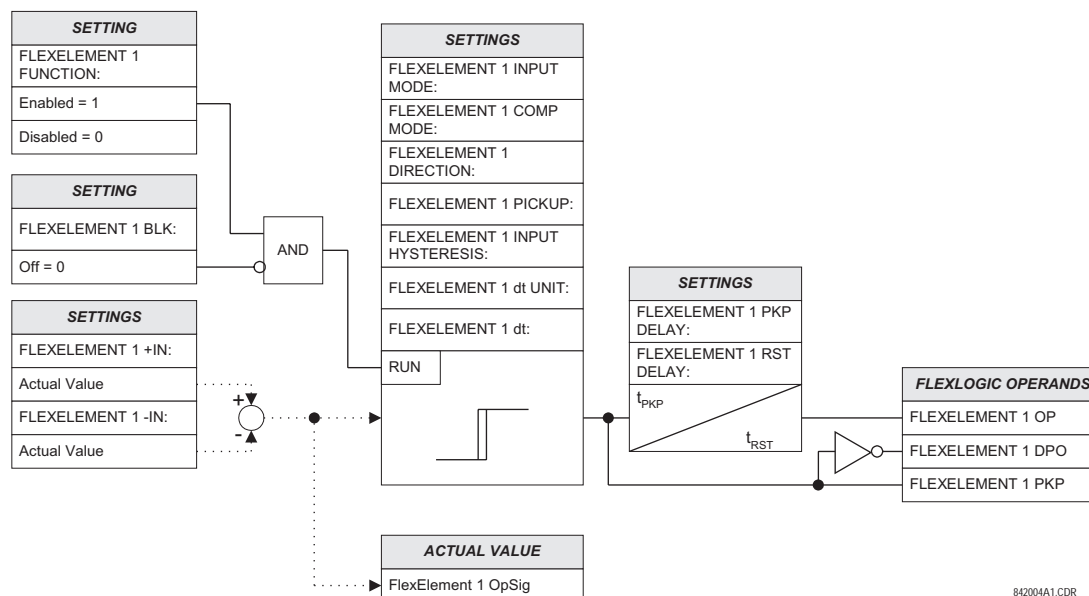


Figure 5-11: FLEXELEMENT™ SCHEME LOGIC

5


The **FLEXELEMENT 1 +IN** setting specifies the first (non-inverted) input to the FlexElement™. Zero is assumed as the input if this setting is set to "Off". For proper operation of the element at least one input must be selected. Otherwise, the element will not assert its output operands.

This **FLEXELEMENT 1 -IN** setting specifies the second (inverted) input to the FlexElement™. Zero is assumed as the input if this setting is set to "Off". For proper operation of the element at least one input must be selected. Otherwise, the element will not assert its output operands. This input should be used to invert the signal if needed for convenience, or to make the element respond to a differential signal such as for a top-bottom oil temperature differential alarm. The element will not operate if the two input signals are of different types, for example if one tries to use active power and phase angle to build the effective operating signal.

The element responds directly to the differential signal if the **FLEXELEMENT 1 INPUT MODE** setting is set to "Signed". The element responds to the absolute value of the differential signal if this setting is set to "Absolute". Sample applications for the "Absolute" setting include monitoring the angular difference between two phasors with a symmetrical limit angle in both directions; monitoring power regardless of its direction, or monitoring a trend regardless of whether the signal increases or decreases.


The element responds directly to its operating signal – as defined by the **FLEXELEMENT 1 +IN**, **FLEXELEMENT 1 -IN** and **FLEXELEMENT 1 INPUT MODE** settings – if the **FLEXELEMENT 1 COMP MODE** setting is set to "Threshold". The element responds to the rate of change of its operating signal if the **FLEXELEMENT 1 COMP MODE** setting is set to "Delta". In this case the **FLEXELEMENT 1 dt UNIT** and **FLEXELEMENT 1 dt** settings specify how the rate of change is derived.

The **FLEXELEMENT 1 DIRECTION** setting enables the relay to respond to either high or low values of the operating signal. The following figure explains the application of the **FLEXELEMENT 1 DIRECTION**, **FLEXELEMENT 1 PICKUP** and **FLEXELEMENT 1 HYSTERESIS** settings.

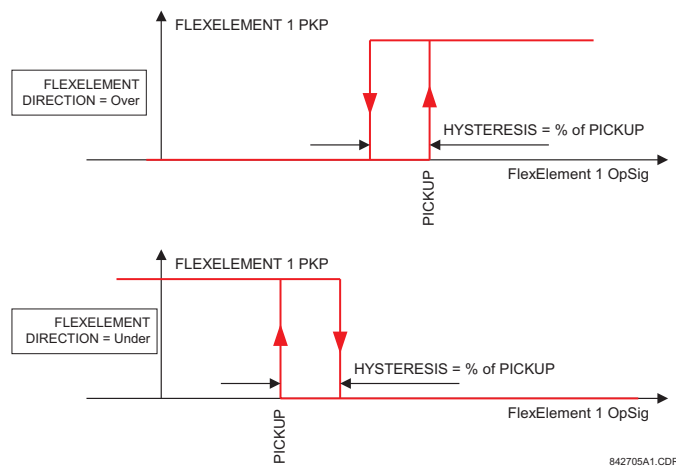

**Figure 5-12: FLEXELEMENT™ DIRECTION, PICKUP, AND HYSTERESIS**

In conjunction with the **FLEXELEMENT 1 INPUT MODE** setting the element could be programmed to provide two extra characteristics as shown in the figure below.

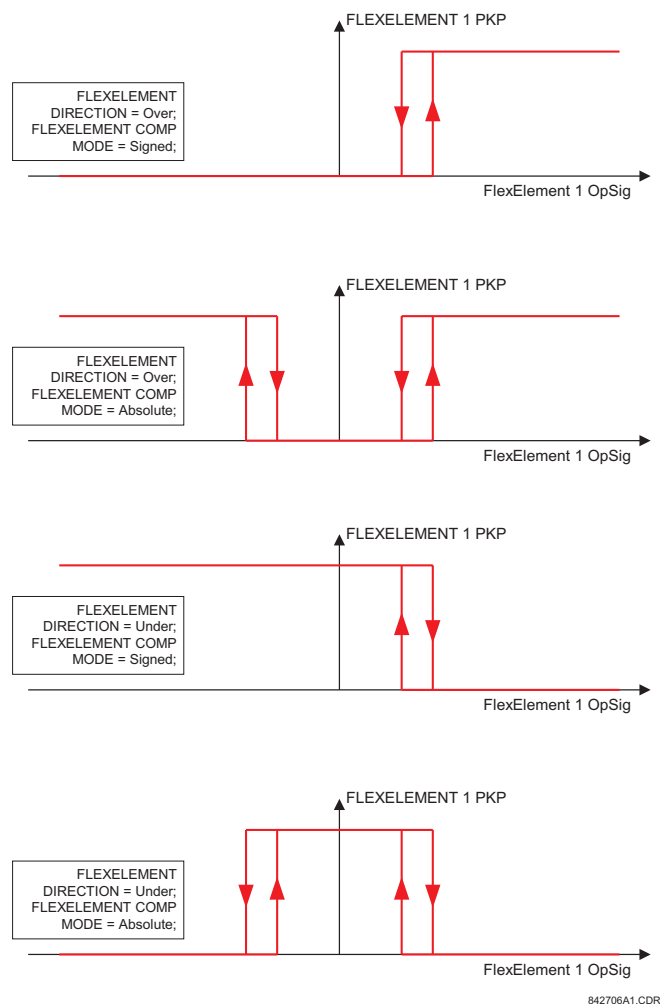

**Figure 5-13: FLEXELEMENT™ INPUT MODE SETTING**

The **FLEXELEMENT 1 PICKUP** setting specifies the operating threshold for the effective operating signal of the element. If set to "Over", the element picks up when the operating signal exceeds the **FLEXELEMENT 1 PICKUP** value. If set to "Under", the element picks up when the operating signal falls below the **FLEXELEMENT 1 PICKUP** value.

The **FLEXELEMENT 1 HYSTERESIS** setting controls the element dropout. It should be noticed that both the operating signal and the pickup threshold can be negative facilitating applications such as reverse power alarm protection. The FlexElement™ can be programmed to work with all analog actual values measured by the relay. The **FLEXELEMENT 1 PICKUP** setting is entered in pu values using the following definitions of the base units:

**Table 5–14: FLEXELEMENT™ BASE UNITS**

dcmA	BASE = maximum value of the <b>DCMA INPUT MAX</b> setting for the two transducers configured under the +IN and –IN inputs.
FREQUENCY	$f_{BASE} = 1 \text{ Hz}$
PHASE ANGLE	$\phi_{BASE} = 360 \text{ degrees}$ (see the UR angle referencing convention)
POWER FACTOR	$PF_{BASE} = 1.00$
RTDs	BASE = 100°C
SENSITIVE DIR POWER (Sns Dir Power)	$P_{BASE} = \text{maximum value of } 3 \times V_{BASE} \times I_{BASE} \text{ for the +IN and –IN inputs of the sources configured for the Sensitive Power Directional element(s).}$
SOURCE CURRENT	$I_{BASE} = \text{maximum nominal primary RMS value of the +IN and –IN inputs}$
SOURCE ENERGY (SRC X Positive Watthours) (SRC X Negative Watthours) (SRC X Positive Varhours) (SRC X Negative Varhours)	$E_{BASE} = 10000 \text{ MWh or MVAh, respectively}$
SOURCE POWER	$P_{BASE} = \text{maximum value of } V_{BASE} \times I_{BASE} \text{ for the +IN and –IN inputs}$
SOURCE VOLTAGE	$V_{BASE} = \text{maximum nominal primary RMS value of the +IN and –IN inputs}$
STATOR DIFFERENTIAL CURRENT (Stator Diff Iar, Ibr, and Icr)	$I_{BASE} = \text{maximum primary RMS value of the +IN and –IN inputs}$ (CT primary for source currents, and bus reference primary current for bus differential currents)
STATOR GROUND 3RD HARMONIC VOLTAGES (Stator Gnd Vn/V0 3rd)	$V_{BASE} = \text{Primary auxiliary voltage of the STATOR GROUND SOURCE}$
STATOR RESTRAINING CURRENT (Stator Diff Iad, Ibd, and Icd)	$I_{BASE} = \text{maximum primary RMS value of the +IN and –IN inputs}$ (CT primary for source currents, and bus reference primary current for bus differential currents)
SYNCHROCHECK (Max Delta Volts)	$V_{BASE} = \text{maximum primary RMS value of all the sources related to the +IN and –IN inputs}$
VOLTS PER HERTZ	BASE = 1.00 pu

The **FLEXELEMENT 1 HYSTERESIS** setting defines the pickup–dropout relation of the element by specifying the width of the hysteresis loop as a percentage of the pickup value as shown in the FLEXELEMENT DIRECTION, PICKUP, AND HYSTERESIS diagram.

The **FLEXELEMENT 1 DT UNIT** setting specifies the time unit for the setting **FLEXELEMENT 1 dt**. This setting is applicable only if **FLEXELEMENT 1 COMP MODE** is set to "Delta". The **FLEXELEMENT 1 DT** setting specifies duration of the time interval for the rate of change mode of operation. This setting is applicable only if **FLEXELEMENT 1 COMP MODE** is set to "Delta".

This **FLEXELEMENT 1 PKP DELAY** setting specifies the pickup delay of the element. The **FLEXELEMENT 1 RST DELAY** setting specifies the reset delay of the element.

## 5.5.1 OVERVIEW

Each protection element can be assigned up to 8 different sets of settings according to SETTING GROUP designations 1 to 8. The performance of these elements is defined by the active SETTING GROUP at a given time. Multiple setting groups allow the user to conveniently change protection settings for different operating situations (e.g. altered power system configuration, season of the year). The active setting group can be preset or selected via the SETTING GROUPS menu (see the CONTROL ELEMENTS section). See also the INTRODUCTION TO ELEMENTS section at the front of this chapter.

## 5.5.2 SETTING GROUP

**PATH: SETTINGS ↓ GROUPED ELEMENTS ⇨ SETTING GROUP 1(8)**

■ SETTING GROUP 1	◀▶	■ POWER SWING ■ DETECT	See page 5-46.
MESSAGE	▲▼	■ STATOR ■ DIFFERENTIAL	See page 5-52.
MESSAGE	▲▼	■ PHASE CURRENT ■	See page 5-61.
MESSAGE	▲▼	■ NEUTRAL CURRENT ■	See page 5-67.
MESSAGE	▲▼	■ GROUND CURRENT ■	See page 5-74.
MESSAGE	▲▼	■ GENERATOR ■ UNBALANCE	See page 5-76.
MESSAGE	▲▼	■ VOLTAGE ELEMENTS ■	See page 5-78.
MESSAGE	▲▼	■ LOSS OF ■ EXCITATION	See page 5-88.
MESSAGE	▲▼	■ ACCIDENTAL ■ ENERGIZATION	See page 5-90.
MESSAGE	▲▼	■ SENSITIVE ■ DIRECTIONAL POWER	See page 5-92.
MESSAGE	▲	■ STATOR ■ GROUND	See page 5-95.

Each of the 8 SETTING GROUP menus is identical. SETTING GROUP 1 (the default active group) automatically becomes active if no other group is active (see the CONTROL ELEMENTS section for additional details).

## 5.5.3 POWER SWING DETECT

PATH: SETTINGS ⇒ ↓ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ ↓ POWER SWING DETECT

■ POWER SWING ■ DETECT		POWER SWING FUNCTION: Disabled	Range: Disabled, Enabled
	MESSAGE	POWER SWING SOURCE: SRC 1	Range: SRC 1,..., SRC 6
	MESSAGE	POWER SWING MODE: Two Step	Range: Two Step, Three Step
	MESSAGE	POWER SWING SUPV: 0.600 pu	Range: 0.050 to 30.000 pu in steps of 0.001
	MESSAGE	POWER SWING FWD REACH: 50.00 ohms	Range: 0.10 to 500.00 ohms in steps of 0.01
	MESSAGE	POWER SWING FWD RCA: 75°	Range: 40 to 90° in steps of 1
	MESSAGE	POWER SWING REV REACH: 50.00 ohms	Range: 0.10 to 500.00 ohms in steps of 0.01
	MESSAGE	POWER SWING REV RCA: 75°	Range: 40 to 90° in steps of 1
	MESSAGE	POWER SWING OUTER LIMIT ANGLE: 120°	Range: 40 to 140° in steps of 1
	MESSAGE	POWER SWING MIDDLE LIMIT ANGLE: 90°	Range: 40 to 140° in steps of 1
	MESSAGE	POWER SWING INNER LIMIT ANGLE: 60°	Range: 40 to 140° in steps of 1
	MESSAGE	POWER SWING PICKUP DELAY 1: 0.030 s	Range: 0.000 to 65.535 s in steps of 0.001
	MESSAGE	POWER SWING RESET DELAY 1: 0.050 s	Range: 0.000 to 65.535 s in steps of 0.001
	MESSAGE	POWER SWING PICKUP DELAY 2: 0.017 s	Range: 0.000 to 65.535 s in steps of 0.001
	MESSAGE	POWER SWING PICKUP DELAY 3: 0.009 s	Range: 0.000 to 65.535 s in steps of 0.001
	MESSAGE	POWER SWING PICKUP DELAY 4: 0.017 s	Range: 0.000 to 65.535 s in steps of 0.001
	MESSAGE	POWER SWING SEAL-IN DELAY 1: 0.400 s	Range: 0.000 to 65.535 s in steps of 0.001
	MESSAGE	POWER SWING TRIP MODE: Delayed	Range: Early, Delayed
	MESSAGE	POWER SWING BLK: Off	Range: Flexlogic™ operand
	MESSAGE	POWER SWING TARGET: Self-Reset	Range: Self-Reset, Latched, Disabled
	MESSAGE	POWER SWING EVENTS: Disabled	Range: Disabled, Enabled



The Power Swing Detect element provides both power swing blocking and out-of-step tripping functions. The element measures the positive-sequence apparent impedance and traces its locus with respect to either two or three user-selectable operating characteristic boundaries as per user choice. Upon detecting appropriate timing relations, the blocking and/or tripping indication is given through FlexLogic™ operands. The POWER SWING OPERATING CHARACTERISTICS and POWER SWING LOGIC figures should be viewed along with the following discussion to develop an understanding of the operation of the element.

#### a) POWER SWING BLOCKING

##### Three-step operation:

The power swing blocking sequence essentially times the passage of the locus of the positive-sequence impedance between the outer and the middle characteristic boundaries. If the locus enters the outer characteristic (as indicated by setting of the POWER SWING OUTER FlexLogic™ operand) but stays outside the middle characteristic (as indicated by setting of the POWER SWING MIDDLE FlexLogic™ operand) for an interval longer than **POWER SWING PICKUP DELAY 1** the power swing blocking signal (POWER SWING BLOCK FlexLogic™ operand) is established and sealed-in. The blocking signal resets when the locus leaves the outer characteristic, but not sooner than after **POWER SWING RESET DELAY 1** time.

##### Two-step operation:

If the 2-step mode is selected, the sequence is identical, but it is the outer and inner characteristics that are used to time the power swing locus.

#### b) OUT-OF-STEP TRIPPING

##### Three-step operation:

The out-of-step trip sequence identifies unstable power swings by determining if the impedance locus spends a finite time between the outer and middle characteristics and then a finite time between the middle and inner characteristics.

The first step is similar to the power swing blocking sequence. After timer **POWER SWING PICKUP DELAY 1** times out, Latch 1 is set as long as the impedance stays within the outer characteristic.

If afterwards, at any time (given the impedance stays within the outer characteristic), the locus enters the middle characteristic but stays outside the inner characteristic for a period of time defined as **POWER SWING PICKUP DELAY 2**, Latch 2 is set as long as the impedance stays inside the outer characteristic.

If afterwards, at any time (given the impedance stays within the outer characteristic), the locus enters the inner characteristic and stays there for a period of time defined as **POWER SWING PICKUP DELAY 3**, Latch 2 is set as long as the impedance stays inside the outer characteristic - the element is now ready to trip.


If the "Early" trip mode is selected, operand POWER SWING TRIP is set immediately and is sealed-in for the interval established by setting **POWER SWING SEAL-IN DELAY**.

If the "Delayed" trip mode is selected, the element waits until the impedance locus leaves the inner characteristic, then times out the **POWER SWING PICKUP DELAY 2** delay, and sets Latch 4 - the element is now ready to trip. The trip operand will be set later, when the impedance locus leaves the outer characteristic.

##### Two-step operation:

The 2-step mode of operation is similar to the 3-step mode with two exceptions. First, the initial stage monitors the time spent by the impedance locus between the outer and inner characteristics. Second, the stage involving timer POWER SWING PICKUP DELAY 2 is bypassed.


It is up to the user to integrate the blocking (POWER SWING BLOCK) and tripping (POWER SWING TRIP) FlexLogic™ operands with other protection functions and output contacts in order to make this element fully operational.

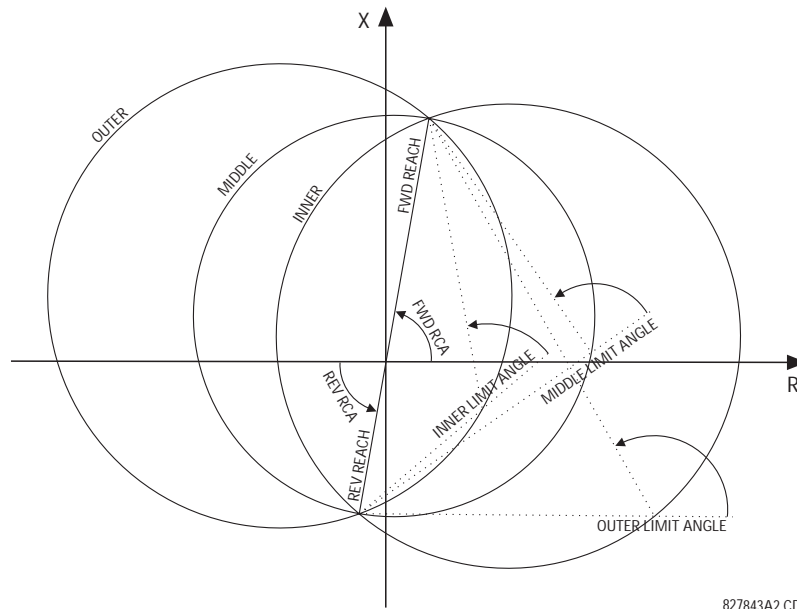

827843A2.CDR


Figure 5-14: POWER SWING DETECT ELEMENT OPERATING CHARACTERISTICS

5

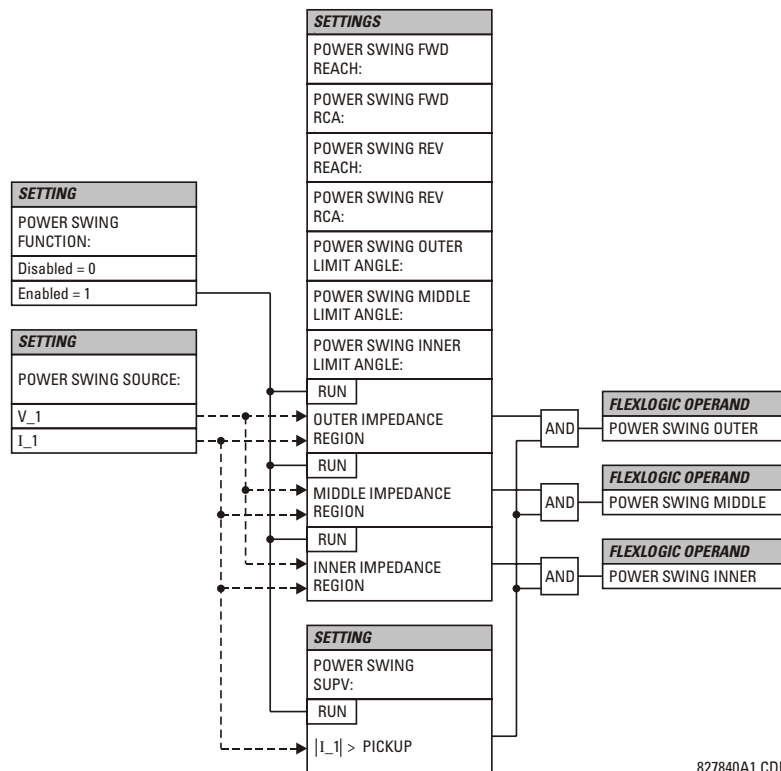

827840A1.CDR

Figure 5-15: POWER SWING DETECT LOGIC (1 of 2)

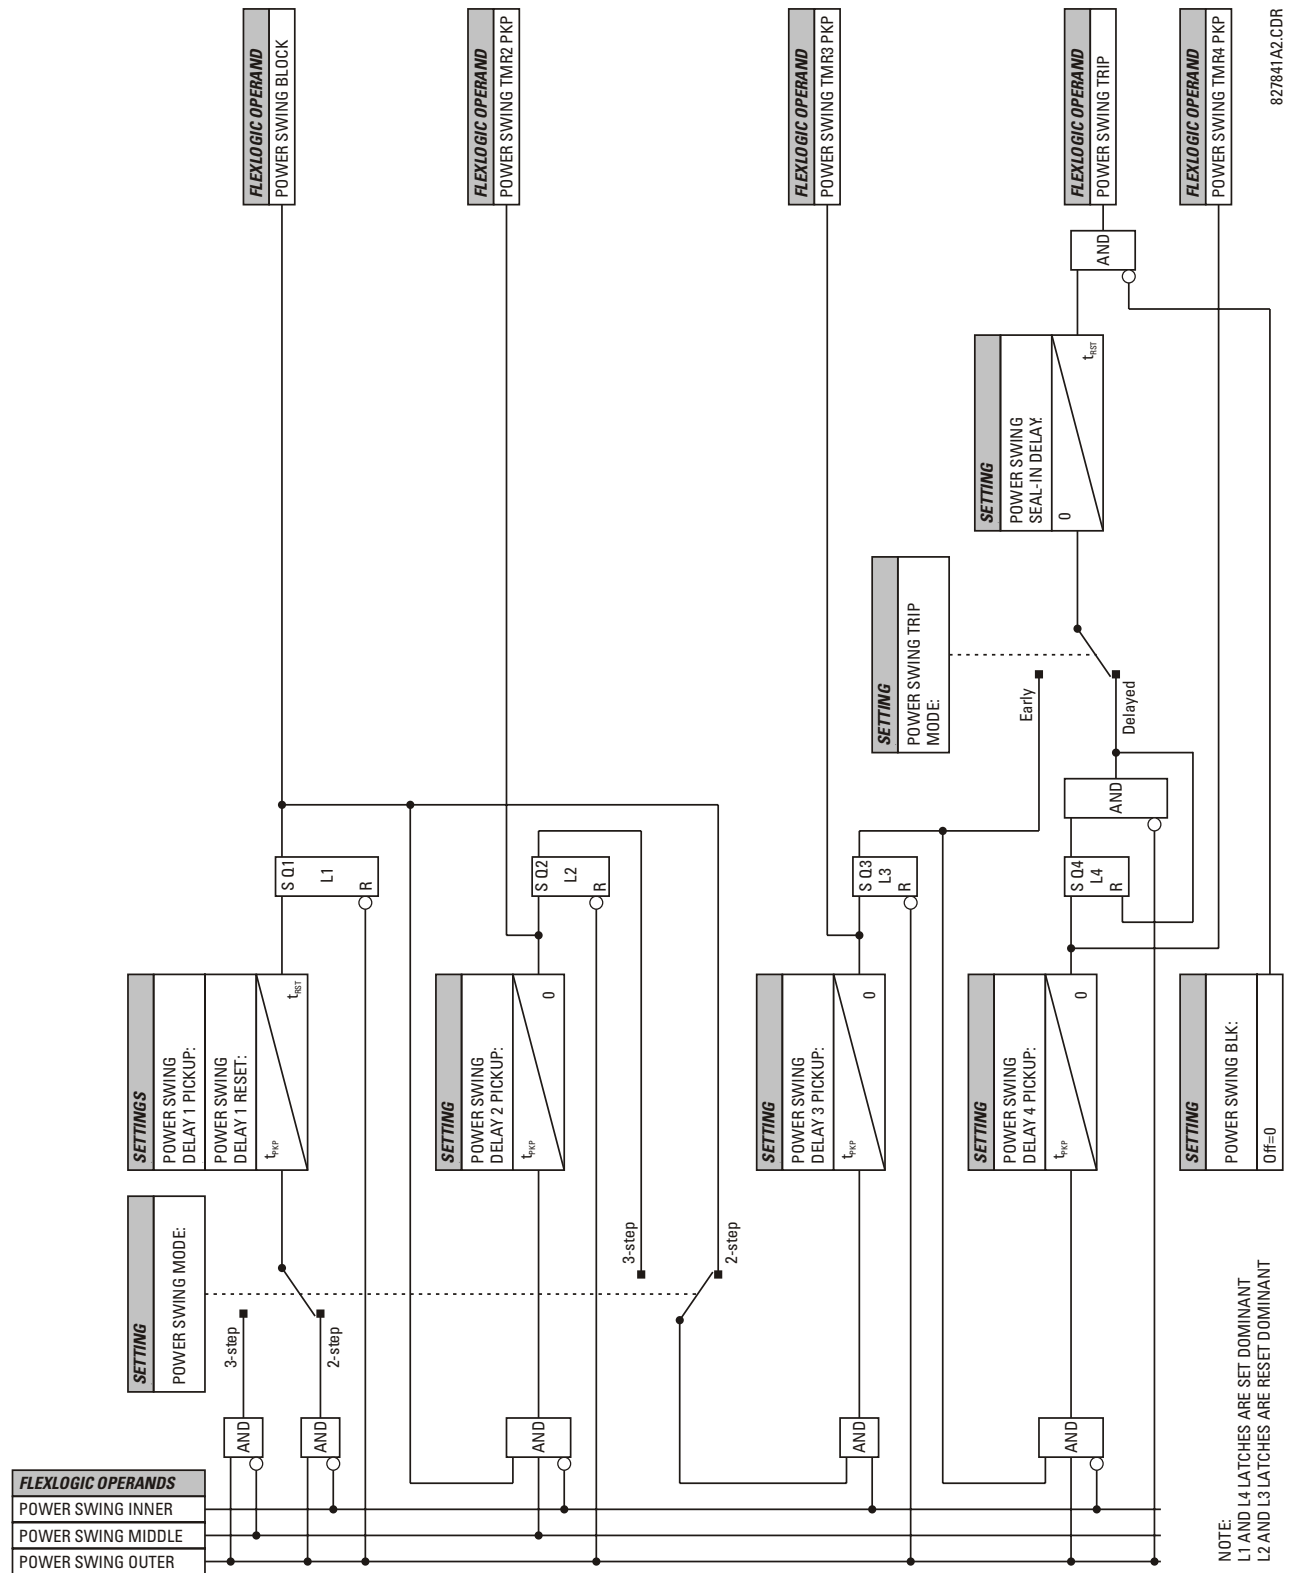

**c) SETTINGS****POWER SWING FUNCTION:**

This setting enables/disables the entire POWER SWING DETECT protection element. The setting applies to both power swing blocking and out-of-step tripping functions.

**POWER SWING SOURCE:**

The source setting identifies the Signal Source for both blocking and tripping functions.

**POWER SWING MODE:**

This setting selects between the 2-step and 3-step operating modes and applies to both power swing blocking and out-of-step tripping functions.

The 3-step mode applies if there is enough space between the maximum load impedances and distance characteristics of the relay that all three (outer, middle, and inner) characteristics can be placed between the load and the distance characteristics. Whether the spans between the outer and middle as well as the middle and inner characteristics are sufficient should be determined by analysis of the fastest power swings expected in correlation with settings of the power swing timers.

The 2-step mode uses only the outer and inner characteristics for both blocking and tripping functions. This leaves more space in heavily loaded systems to place two power swing characteristics between the distance characteristics and the maximum load, but allows for only one determination of the impedance trajectory.

**POWER SWING SUPV:**

A common overcurrent pickup level supervises all three power swing characteristics. The supervision responds to the positive sequence current.

**POWER SWING FWD REACH:**

This setting specifies the forward reach of all three characteristics. For a simple system consisting of a line and two equivalent sources, this reach should be higher than the sum of the line and remote source positive-sequence impedances. Detailed transient stability studies may be needed for complex systems in order to determine this setting.

**POWER SWING FWD RCA:**

This setting specifies the angle of the forward reach impedance. The angle is measured as shown in the POWER SWING DETECT ELEMENT OPERATING CHARACTERISTICS diagram.

**POWER SWING REV REACH:**

This setting specifies the reverse reach of all three power detect characteristics. For a simple system consisting of a line and two equivalent sources, this reach should be higher than the positive-sequence impedance of the local source. Detailed transient stability studies may be needed for complex systems in order to determine this setting.

**POWER SWING REV RCA:**

This setting specifies the angle of the reverse reach impedance. The angle is measured as shown in the POWER SWING DETECT ELEMENT OPERATING CHARACTERISTICS diagram.

**POWER SWING OUTER LIMIT ANGLE:**

This setting defines the outer power swing detect characteristic. The convention depicted in the POWER SWING DETECT ELEMENT OPERATING CHARACTERISTICS diagram should be observed: values greater than 90° result in an "apple" shaped characteristic, values lower than 90° result in a lens shaped characteristic. This angle must be selected in consideration of the maximum expected load. If the "maximum load angle" is known, the outer limit angle should be coordinated with some 20° security margin. Detailed studies may be needed for complex systems in order to determine this setting.

**POWER SWING MIDDLE LIMIT ANGLE:**

This setting defines the middle power swing detect characteristic. This setting is relevant only if the 3-step mode is selected. A typical value would be close to the average of the outer and inner limit angles.

**POWER SWING INNER LIMIT ANGLE:**

This setting defines the inner power swing detect characteristic.

The inner characteristic is used by the out-of-step tripping function: beyond the inner characteristic out-of-step trip action is definite (the actual trip may be delayed as per the **TRIP MODE** setting). Therefore, this angle must be selected in consideration to the power swing angle beyond which the system becomes unstable and cannot recover.

The inner characteristic is also used by the power swing blocking function in the 2-step mode. Therefore, this angle must be set large enough so that the characteristics of the distance elements are safely enclosed by the inner characteristic.

#### **POWER SWING PICKUP DELAY 1:**

All the coordinating timers are related to each other and should be set to detect the fastest expected power swing and produce out-of-step tripping in a secure manner. The timers should be set in consideration to the power swing detect characteristics, mode of power swing detect operation and mode of out-of-step tripping.

This timer defines the interval that the impedance locus must spend between the outer and inner characteristics (2-step operating mode), or between the outer and middle characteristics (3-step operating mode) before the power swing blocking signal is established. This time delay must be set shorter than the time required for the impedance locus to travel between the two selected characteristics during the fastest expected power swing.

This setting is relevant for both power swing blocking and out-of-step tripping.

#### **POWER SWING RESET DELAY 1:**

This setting defines the dropout delay for the power swing blocking signal. Detection of a condition requiring a Block output sets Latch 1 after **PICKUP DELAY 1** time. When the impedance locus leaves the outer characteristic, timer **POWER SWING RESET DELAY 1** is started. When the timer times-out the latch is reset.

This setting should be selected to give extra security for the power swing blocking action.

#### **POWER SWING PICKUP DELAY 2:**

This setting controls the out-of-step tripping function in the 3-step mode only. This timer defines the interval the impedance locus must spend between the middle and inner characteristics before the second step of the out-of-step tripping sequence is completed. This time delay must be set shorter than the time required for the impedance locus to travel between the two characteristics during the fastest expected power swing.

#### **POWER SWING PICKUP DELAY 3:**

This setting controls the out-of-step tripping function only. This timer defines the interval the impedance locus must spend within the inner characteristic before the last step of the out-of-step tripping sequence is completed and the element is armed to trip. The actual moment of tripping is controlled by the **TRIP MODE** setting.

This time delay is provided for extra security before the out-of-step trip action is executed.

#### **POWER SWING PICKUP DELAY 4:**

This setting controls the out-of-step tripping function in the Delayed trip mode only. This timer defines the interval the impedance locus must spend outside the inner characteristic but within the outer characteristic before the element gets armed for the Delayed trip. The delayed trip will take place when the impedance leaves the outer characteristic.

This time delay is provided for extra security and should be set considering the fastest expected power swing.

#### **POWER SWING SEAL-IN DELAY:**

The out-of-step trip FlexLogic™ operand (**POWER SWING TRIP**) is sealed-in for the specified period of time. The sealing-in is crucial in the delayed trip mode, as the original trip signal is a very short pulse occurring when the impedance locus leaves the outer characteristic after the out-of-step sequence is completed.

#### **POWER SWING TRIP MODE:**

Selection of the "Early" trip mode results in an instantaneous trip after the last step in the out-of-step tripping sequence is completed. The Early trip mode will stress the circuit breakers as the currents at that moment are high (the electromotive forces of the two equivalent systems are approximately 180° apart).

Selection of the "Delayed" trip mode results in a trip at the moment when the impedance locus leaves the outer characteristic. Delayed trip mode will relax the operating conditions for the breakers as the currents at that moment are low.

The selection should be made considering the capability of the breakers in the system.

#### **POWER SWING BLK:**

This setting specifies the FlexLogic™ operand used for blocking the out-of-step function only. The power swing blocking function is operational all the time as long as the element is enabled.

The blocking signal resets the output **POWER SWING TRIP** operand but does not stop the out-of-step tripping sequence.

## 5.5.4 STATOR DIFFERENTIAL

PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ GENERATOR ⇒ STATOR DIFFERENTIAL

■ STATOR	STATOR DIFF	Range: Disabled, Enabled
■ DIFFERENTIAL	FUNCTION: Disabled	
MESSAGE	STATOR DIFF LINE END SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	STATOR DIFF NEUTRAL END SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	STATOR DIFF PICKUP: 0.100 pu	Range: 0.050 to 1.000 pu in steps of 0.001
MESSAGE	STATOR DIFF SLOPE 1: 10 %	Range: 1 to 100% in steps of 1
MESSAGE	STATOR DIFF BREAK 1: 1.15 pu	Range: 1.00 to 1.50 pu in steps of 0.01
MESSAGE	STATOR DIFF SLOPE 2: 80 %	Range: 1 to 100% in steps of 1
MESSAGE	STATOR DIFF BREAK 2: 8.00 pu	Range: 1.50 to 30.00 pu in steps of 0.01
MESSAGE	STATOR DIFF BLK: Off	Range: FlexLogic™ operand
MESSAGE	STATOR DIFF TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	STATOR DIFF EVENTS: Disabled	Range: Disabled, Enabled

## a) SETTINGS

The stator differential protection element is intended for use on the stator windings of rotating machinery.

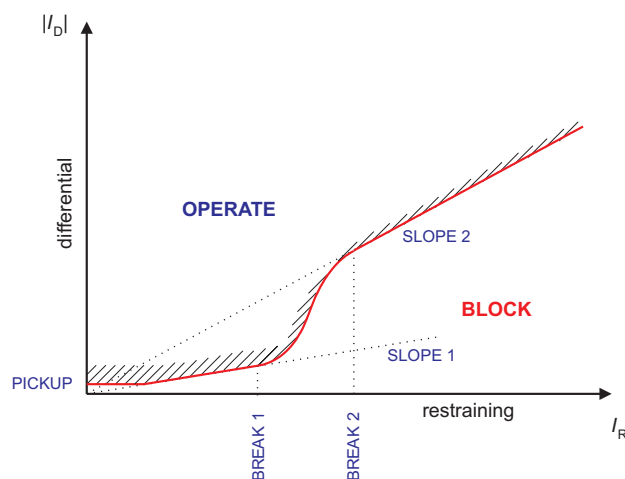


Figure 5-17: STATOR DIFFERENTIAL CHARACTERISTIC

This element has a dual slope characteristic. The main purpose of the percent-slope characteristic is to prevent a maloperation caused by unbalances between CTs during external faults. CT unbalances arise as a result of the following factors:

1. CT accuracy errors
2. CT saturation

The characteristic allows for very sensitive settings when fault current is low and less sensitive settings when fault current is high and CT performance may produce incorrect operate signals.

#### STATOR DIFF LINE END SOURCE:

This setting selects the Source connected to CTs in the end of the machine stator winding closest to the load and furthest from the winding neutral point. Both line and neutral-side CTs should be wired to measure their currents in the same direction with respect to the neutral point of the winding.

#### STATOR DIFF NEUTRAL END SOURCE:

This setting selects the Source connected to CTs in the end of the machine stator winding furthest from the load and closest to the winding neutral point. Both line and neutral-side CTs should be wired to measure their currents in the same direction with respect to the neutral point of the winding.

#### STATOR DIFF PICKUP:

This setting defines the minimum differential current required for operation. This setting is based on the amount of differential current that might be seen under normal operating conditions. A setting of 0.1 to 0.3 pu is generally recommended.

#### STATOR DIFF SLOPE 1:

This setting is applicable for restraint currents from zero to BREAK 1, and defines the ratio of differential to restraint current above which the element will operate. This slope is set to ensure sensitivity to internal faults at normal operating current levels. The criteria for setting this slope is to allow for maximum expected CT mismatch error when operating at the maximum permitted current. This maximum error is generally in the range of 5 to 10% of CT rating.

#### STATOR DIFF BREAK 1:

This setting defines the end of the SLOPE 1 region and the start of the transition region. It should be set just above the maximum normal operating current level of the machine.

#### STATOR DIFF SLOPE 2:

This setting is applicable for restraint currents above the BREAK 2 setting when the element is applied to generator stator windings. This slope is set to ensure stability under heavy external fault conditions that could lead to high differential currents as a result of CT saturation. A setting of 80 to 100% is recommended. The transition region (as shown on the characteristic plot) is a cubic spline, automatically calculated by the relay to result in a smooth transition between SLOPE 1 and SLOPE 2 with no discontinuities.

#### STATOR DIFF BREAK 2:

This setting defines the end of the transition region and the start of the SLOPE 2 region. It should be set to the level at which any of the protection CTs are expected to begin to saturate.

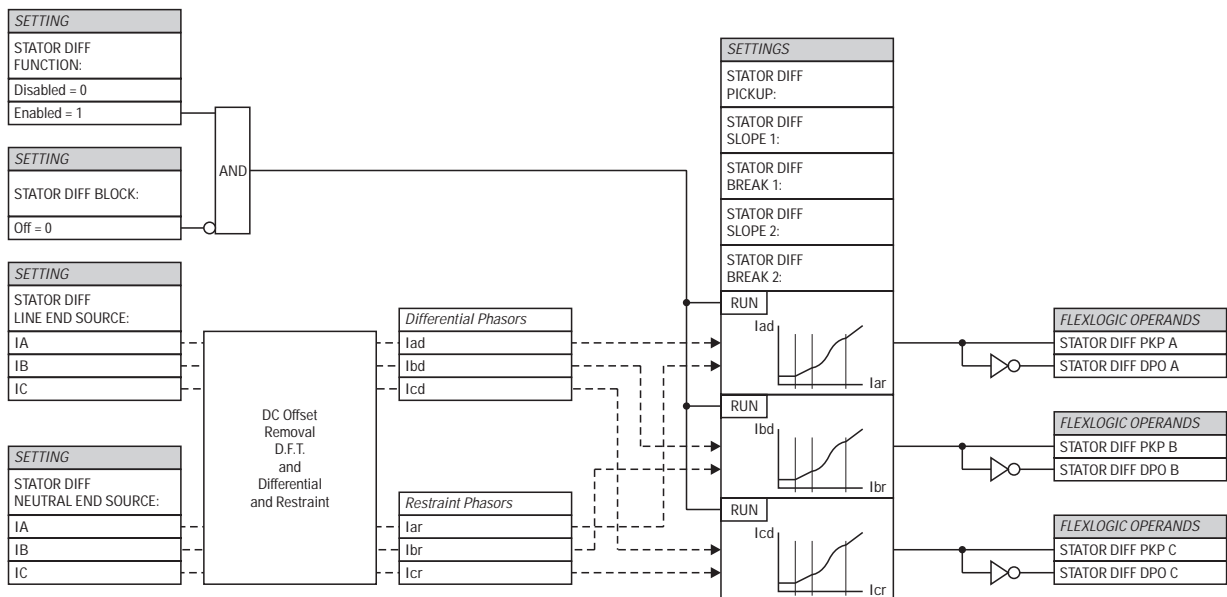


Figure 5-18: STATOR DIFFERENTIAL LOGIC

## b) SATURATION DETECTION

External faults near generators typically result in very large time constants of DC components in the fault currents. Also, when energizing a step-up transformer, the inrush current being limited only by the machine impedance may be significant and may last for a very long time. In order to provide additional security against maloperations during these events, the G60 incorporates saturation detection logic. When saturation is detected the element will make an additional check on the angle between the neutral and output current. If this angle indicates an internal fault then tripping is permitted.

## STATE MACHINE:

The saturation detector is implemented as a state machine (see below). "NORMAL" is the initial state of the machine. When in "NORMAL" state, the saturation flag is not set (SAT = 0). The algorithm calculates the saturation condition, SC. If SC = 1 while the state machine is "NORMAL", the saturation detector goes into the "EXTERNAL FAULT" state and sets the saturation flag (SAT = 1). The algorithm returns to the "NORMAL" state if the differential current is below the first slope, SL, for more than 200 ms. When in the "EXTERNAL FAULT" state, the algorithm goes into the "EXTERNAL FAULT & CT SATURATION" state if the differential flag is set (DIF = 1). When in the "EXTERNAL FAULT & CT SATURATION" state, the algorithm keeps the saturation flag set (SAT = 1). The state machine returns to the "EXTERNAL FAULT" state if the differential flag is reset (DIF = 0) for 100 ms.

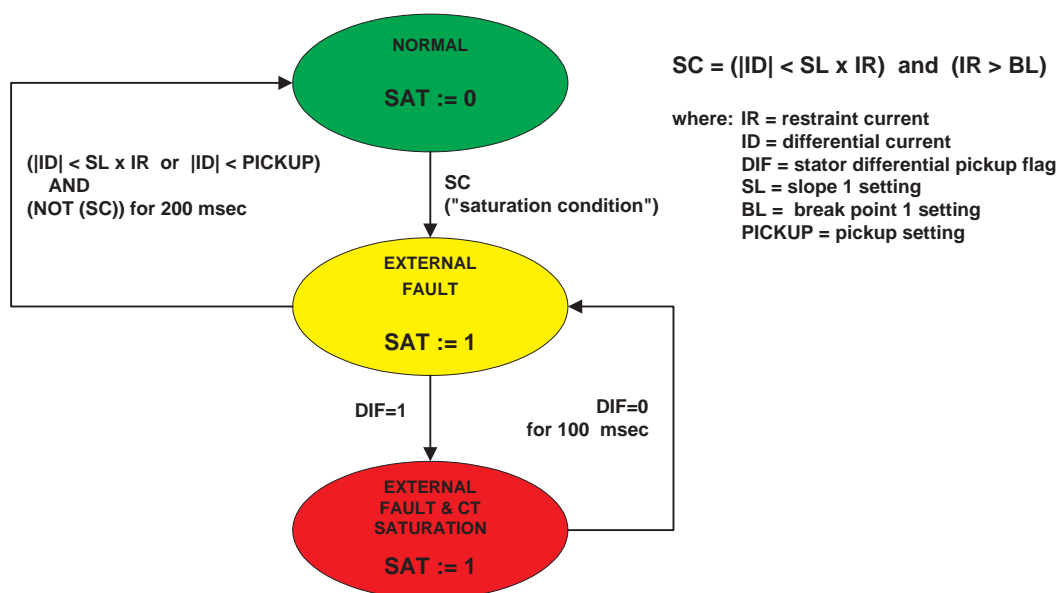


Figure 5-19: SATURATION DETECTOR STATE MACHINE

## PHASE COMPARISON PRINCIPLE:

The test for direction can be summarized by the following equation:

If ( $|I_{TS}| > B_L$  or ( $|I_{TS}| > K \cdot I_R$  and  $|I_{TS}| > 0.1 \text{ pu}$ )) and ( $|I_{NS}| > B_L$  or ( $|I_{NS}| > K \cdot I_R$  and  $|I_{NS}| > 0.1 \text{ pu}$ ))  
then  $DIR = \text{abs}(\angle I_{TS} - \angle I_{NS}) > 90^\circ$   
else  $DIR = 1$

where:  $I_R$  = restraining current  
 $DIR$  = flag indicating that the phase comparison principle is satisfied  
 $B_L$  = breakpoint 1 setting  
 $I_{TS}$ ,  $I_{NS}$  = current at the terminal and neutral sources, respectively  
 $K$  = factory constant of 0.5



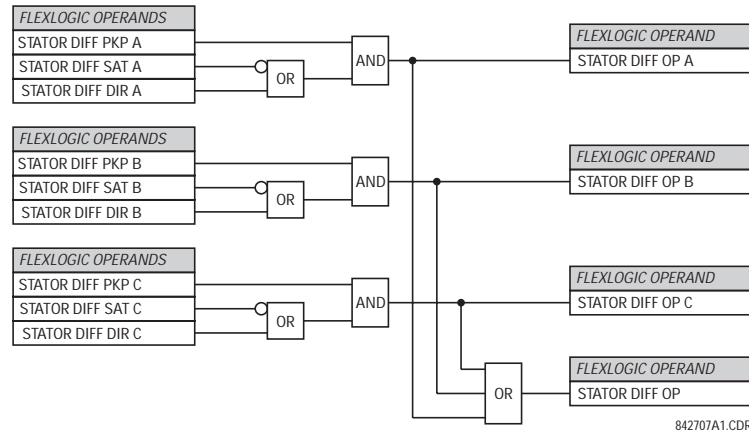


Figure 5-20: STATOR DIFFERENTIAL FINAL OUTPUT LOGIC

## 5.5.5 CURRENT ELEMENTS

PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒

■ PHASE CURRENT	◀▶	■ PHASE TOC1
■		■
MESSAGE	▲▼	■ PHASE TOC2
		■
MESSAGE	▲▼	■ PHASE IOC1
		■
MESSAGE	▲▼	■ PHASE IOC2
		■
■ NEUTRAL CURRENT	◀▶	■ NEUTRAL TOC1
■		■
MESSAGE	▲▼	■ NEUTRAL TOC2
		■
MESSAGE	▲▼	■ NEUTRAL IOC2
		■
■ GROUND CURRENT	◀▶	■ GROUND TOC1
■		■
MESSAGE	▲▼	■ GROUND TOC2
		■
MESSAGE	▲▼	■ GROUND IOC1
		■
MESSAGE	▲▼	■ GROUND IOC2
		■

The relay current elements menu consists of time overcurrent (TOC), instantaneous overcurrent (IOC), and directional current elements. These elements can be used for tripping, alarming, or other functions.

## 5.5.6 INVERSE TIME OVERCURRENT CURVE CHARACTERISTICS

The inverse time overcurrent curves used by the TOC (time overcurrent) Current Elements are the IEEE, IEC, GE Type IAC, and  $I^2t$  standard curve shapes. This allows for simplified coordination with downstream devices. If however, none of these curve shapes is adequate, the FlexCurve™ may be used to customize the inverse time curve characteristics. The Definite Time curve is also an option that may be appropriate if only simple protection is required.

Table 5–15: OVERCURRENT CURVE TYPES

IEEE	IEC	GE TYPE IAC	OTHER
IEEE Extremely Inv.	IEC Curve A (BS142)	IAC Extremely Inv.	$I^2t$
IEEE Very Inverse	IEC Curve B (BS142)	IAC Very Inverse	FlexCurve A
IEEE Moderately Inv.	IEC Curve C (BS142)	IAC Inverse	FlexCurve B
	IEC Short Inverse	IAC Short Inverse	Definite Time

A time dial multiplier setting allows selection of a multiple of the base curve shape (where the time dial multiplier = 1) with the curve shape (**CURVE**) setting. Unlike the electromechanical time dial equivalent, operate times are directly proportional to the time multiplier (**TD MULTIPLIER**) setting value. For example, all times for a multiplier of 10 are 10 times the multiplier 1 or base curve values. Setting the multiplier to zero results in an instantaneous response to all current levels above pickup.

Time overcurrent time calculations are made with an internal “energy capacity” memory variable. When this variable indicates that the energy capacity has reached 100%, a time overcurrent element will operate. If less than 100% energy capacity is accumulated in this variable and the current falls below the dropout threshold of 97 to 98% of the pickup value, the variable must be reduced. Two methods of this resetting operation are available: “Instantaneous” and “Timed”. The Instantaneous selection is intended for applications with other relays, such as most static relays, which set the energy capacity directly to zero when the current falls below the reset threshold. The Timed selection can be used where the relay must coordinate with electromechanical relays. With this setting, the energy capacity variable is decremented according to the equation provided.



**Graphs of standard time-current curves on 11" × 17" log-log graph paper are available upon request from the GE Power Management literature department. The original files are also available in PDF format on the UR Software Installation CD and the GE Power Management Web Page.**

**IEEE CURVES:**

The IEEE time overcurrent curve shapes conform to industry standards and the IEEE C37.112-1996 curve classifications for extremely, very, and moderately inverse. The IEEE curves are derived from the formulae:

$$T = TDM \times \left[ \frac{A}{\left( \frac{I}{I_{pickup}} \right)^p - 1} + B \right] \quad T_{RESET} = TDM \times \left[ \frac{t_r}{\left( \frac{I}{I_{pickup}} \right)^2 - 1} \right]$$

where:  $T$  = Operate Time (sec.)

$TDM$  = Multiplier Setting

$I$  = Input Current

$I_{pickup}$  = Pickup Current Setting

$A, B, p$  = Constants

$T_{RESET}$  = reset time in sec. (assuming energy capacity is 100% and RESET: Timed)

$t_r$  = characteristic constant

**Table 5-16: IEEE INVERSE TIME CURVE CONSTANTS**

IEEE CURVE SHAPE	A	B	P	T <sub>R</sub>
IEEE EXTREMELY INVERSE	28.2	0.1217	2.0000	29.1
IEEE VERY INVERSE	19.61	0.491	2.0000	21.6
IEEE MODERATELY INVERSE	0.0515	0.1140	0.02000	4.85

**Table 5-17: IEEE CURVE TRIP TIMES (IN SECONDS)**

MULTIPLIER (TDM)	CURRENT ( $I / I_{pickup}$ )									
	1.5	2.0	3.0	4.0	5.0	6.0	7.0	8.0	9.0	10.0
<b>IEEE EXTREMELY INVERSE</b>										
0.5	11.341	4.761	1.823	1.001	0.648	0.464	0.355	0.285	0.237	0.203
1.0	22.682	9.522	3.647	2.002	1.297	0.927	0.709	0.569	0.474	0.407
2.0	45.363	19.043	7.293	4.003	2.593	1.855	1.418	1.139	0.948	0.813
4.0	90.727	38.087	14.587	8.007	5.187	3.710	2.837	2.277	1.897	1.626
6.0	136.090	57.130	21.880	12.010	7.780	5.564	4.255	3.416	2.845	2.439
8.0	181.454	76.174	29.174	16.014	10.374	7.419	5.674	4.555	3.794	3.252
10.0	226.817	95.217	36.467	20.017	12.967	9.274	7.092	5.693	4.742	4.065
<b>IEEE VERY INVERSE</b>										
0.5	8.090	3.514	1.471	0.899	0.654	0.526	0.450	0.401	0.368	0.345
1.0	16.179	7.028	2.942	1.798	1.308	1.051	0.900	0.802	0.736	0.689
2.0	32.358	14.055	5.885	3.597	2.616	2.103	1.799	1.605	1.472	1.378
4.0	64.716	28.111	11.769	7.193	5.232	4.205	3.598	3.209	2.945	2.756
6.0	97.074	42.166	17.654	10.790	7.849	6.308	5.397	4.814	4.417	4.134
8.0	129.432	56.221	23.538	14.387	10.465	8.410	7.196	6.418	5.889	5.513
10.0	161.790	70.277	29.423	17.983	13.081	10.513	8.995	8.023	7.361	6.891
<b>IEEE MODERATELY INVERSE</b>										
0.5	3.220	1.902	1.216	0.973	0.844	0.763	0.706	0.663	0.630	0.603
1.0	6.439	3.803	2.432	1.946	1.688	1.526	1.412	1.327	1.260	1.207
2.0	12.878	7.606	4.864	3.892	3.377	3.051	2.823	2.653	2.521	2.414
4.0	25.756	15.213	9.729	7.783	6.753	6.102	5.647	5.307	5.041	4.827
6.0	38.634	22.819	14.593	11.675	10.130	9.153	8.470	7.960	7.562	7.241
8.0	51.512	30.426	19.458	15.567	13.507	12.204	11.294	10.614	10.083	9.654
10.0	64.390	38.032	24.322	19.458	16.883	15.255	14.117	13.267	12.604	12.068

## IEC CURVES

For European applications, the relay offers three standard curves defined in IEC 255-4 and British standard BS142. These are defined as IEC Curve A, IEC Curve B, and IEC Curve C. The formulae for these curves are:

$$T = TDM \times \left[ \frac{K}{\left( \frac{I}{I_{pickup}} \right)^E - 1} \right] \quad T_{RESET} = TDM \times \left[ \frac{t_r}{\left( \frac{I}{I_{pickup}} \right)^2 - 1} \right]$$

where:  $T$  = Operate Time (sec.)  $TDM$  = Multiplier Setting  $I$  = Input Current  
 $I_{pickup}$  = Pickup Current Setting  $K, E$  = Constants  $t_r$  = Characteristic Constant  
 $T_{RESET}$  = Reset Time in sec. (assuming energy capacity is 100% and RESET: Timed)

Table 5-18: IEC (BS) INVERSE TIME CURVE CONSTANTS

IEC (BS) CURVE SHAPE	K	E	T <sub>R</sub>
IEC CURVE A (BS142)	0.140	0.020	9.7
IEC CURVE B (BS142)	13.500	1.000	43.2
IEC CURVE C (BS142)	80.000	2.000	58.2
IEC SHORT INVERSE	0.050	0.040	0.500

Table 5-19: IEC CURVE TRIP TIMES (IN SECONDS)

MULTIPLIER (TDM)	CURRENT ( $I / I_{pickup}$ )									
	1.5	2.0	3.0	4.0	5.0	6.0	7.0	8.0	9.0	10.0
<b>IEC CURVE A</b>										
0.05	0.860	0.501	0.315	0.249	0.214	0.192	0.176	0.165	0.156	0.149
0.10	1.719	1.003	0.630	0.498	0.428	0.384	0.353	0.330	0.312	0.297
0.20	3.439	2.006	1.260	0.996	0.856	0.767	0.706	0.659	0.623	0.594
0.40	6.878	4.012	2.521	1.992	1.712	1.535	1.411	1.319	1.247	1.188
0.60	10.317	6.017	3.781	2.988	2.568	2.302	2.117	1.978	1.870	1.782
0.80	13.755	8.023	5.042	3.984	3.424	3.070	2.822	2.637	2.493	2.376
1.00	17.194	10.029	6.302	4.980	4.280	3.837	3.528	3.297	3.116	2.971
<b>IEC CURVE B</b>										
0.05	1.350	0.675	0.338	0.225	0.169	0.135	0.113	0.096	0.084	0.075
0.10	2.700	1.350	0.675	0.450	0.338	0.270	0.225	0.193	0.169	0.150
0.20	5.400	2.700	1.350	0.900	0.675	0.540	0.450	0.386	0.338	0.300
0.40	10.800	5.400	2.700	1.800	1.350	1.080	0.900	0.771	0.675	0.600
0.60	16.200	8.100	4.050	2.700	2.025	1.620	1.350	1.157	1.013	0.900
0.80	21.600	10.800	5.400	3.600	2.700	2.160	1.800	1.543	1.350	1.200
1.00	27.000	13.500	6.750	4.500	3.375	2.700	2.250	1.929	1.688	1.500
<b>IEC CURVE C</b>										
0.05	3.200	1.333	0.500	0.267	0.167	0.114	0.083	0.063	0.050	0.040
0.10	6.400	2.667	1.000	0.533	0.333	0.229	0.167	0.127	0.100	0.081
0.20	12.800	5.333	2.000	1.067	0.667	0.457	0.333	0.254	0.200	0.162
0.40	25.600	10.667	4.000	2.133	1.333	0.914	0.667	0.508	0.400	0.323
0.60	38.400	16.000	6.000	3.200	2.000	1.371	1.000	0.762	0.600	0.485
0.80	51.200	21.333	8.000	4.267	2.667	1.829	1.333	1.016	0.800	0.646
1.00	64.000	26.667	10.000	5.333	3.333	2.286	1.667	1.270	1.000	0.808
<b>IEC SHORT TIME</b>										
0.05	0.153	0.089	0.056	0.044	0.038	0.034	0.031	0.029	0.027	0.026
0.10	0.306	0.178	0.111	0.088	0.075	0.067	0.062	0.058	0.054	0.052
0.20	0.612	0.356	0.223	0.175	0.150	0.135	0.124	0.115	0.109	0.104
0.40	1.223	0.711	0.445	0.351	0.301	0.269	0.247	0.231	0.218	0.207
0.60	1.835	1.067	0.668	0.526	0.451	0.404	0.371	0.346	0.327	0.311
0.80	2.446	1.423	0.890	0.702	0.602	0.538	0.494	0.461	0.435	0.415
1.00	3.058	1.778	1.113	0.877	0.752	0.673	0.618	0.576	0.544	0.518

**IAC CURVES:**

The curves for the General Electric type IAC relay family are derived from the formulae:

$$T = TDM \times \left[ A + \frac{B}{\left(\frac{I}{I_{pickup}} - C\right)} + \frac{D}{\left(\frac{I}{I_{pickup}} - C\right)^2} + \frac{E}{\left(\frac{I}{I_{pickup}} - C\right)^3} \right] \quad T_{RESET} = TDM \times \left[ \frac{t_r}{\left(\frac{I}{I_{pickup}}\right)^2} - 1 \right]$$

where:  $T$  = Operate Time (sec.)       $TDM$  = Multiplier Setting       $I$  = Input Current  
 $I_{pickup}$  = Pickup Current Setting       $A$  to  $E$  = Constants       $t_r$  = Characteristic Constant  
 $T_{RESET}$  = Reset Time in sec. (assuming energy capacity is 100% and RESET: Timed)

**Table 5-20: GE TYPE IAC INVERSE TIME CURVE CONSTANTS**

IAC CURVE SHAPE	A	B	C	D	E	T <sub>R</sub>
IAC EXTREME INVERSE	0.0040	0.6379	0.6200	1.7872	0.2461	6.008
IAC VERY INVERSE	0.0900	0.7955	0.1000	-1.2885	7.9586	4.678
IAC INVERSE	0.2078	0.8630	0.8000	-0.4180	0.1947	0.990
IAC SHORT INVERSE	0.0428	0.0609	0.6200	-0.0010	0.0221	0.222

**Table 5-21: IAC CURVE TRIP TIMES**

MULTIPLIER (TDM)	CURRENT ( $I / I_{pickup}$ )									
	1.5	2.0	3.0	4.0	5.0	6.0	7.0	8.0	9.0	10.0
<b>IAC EXTREMELY INVERSE</b>										
0.5	1.699	0.749	0.303	0.178	0.123	0.093	0.074	0.062	0.053	0.046
1.0	3.398	1.498	0.606	0.356	0.246	0.186	0.149	0.124	0.106	0.093
2.0	6.796	2.997	1.212	0.711	0.491	0.372	0.298	0.248	0.212	0.185
4.0	13.591	5.993	2.423	1.422	0.983	0.744	0.595	0.495	0.424	0.370
6.0	20.387	8.990	3.635	2.133	1.474	1.115	0.893	0.743	0.636	0.556
8.0	27.183	11.987	4.846	2.844	1.966	1.487	1.191	0.991	0.848	0.741
10.0	33.979	14.983	6.058	3.555	2.457	1.859	1.488	1.239	1.060	0.926
<b>IAC VERY INVERSE</b>										
0.5	1.451	0.656	0.269	0.172	0.133	0.113	0.101	0.093	0.087	0.083
1.0	2.901	1.312	0.537	0.343	0.266	0.227	0.202	0.186	0.174	0.165
2.0	5.802	2.624	1.075	0.687	0.533	0.453	0.405	0.372	0.349	0.331
4.0	11.605	5.248	2.150	1.374	1.065	0.906	0.810	0.745	0.698	0.662
6.0	17.407	7.872	3.225	2.061	1.598	1.359	1.215	1.117	1.046	0.992
8.0	23.209	10.497	4.299	2.747	2.131	1.813	1.620	1.490	1.395	1.323
10.0	29.012	13.121	5.374	3.434	2.663	2.266	2.025	1.862	1.744	1.654
<b>IAC INVERSE</b>										
0.5	0.578	0.375	0.266	0.221	0.196	0.180	0.168	0.160	0.154	0.148
1.0	1.155	0.749	0.532	0.443	0.392	0.360	0.337	0.320	0.307	0.297
2.0	2.310	1.499	1.064	0.885	0.784	0.719	0.674	0.640	0.614	0.594
4.0	4.621	2.997	2.128	1.770	1.569	1.439	1.348	1.280	1.229	1.188
6.0	6.931	4.496	3.192	2.656	2.353	2.158	2.022	1.921	1.843	1.781
8.0	9.242	5.995	4.256	3.541	3.138	2.878	2.695	2.561	2.457	2.375
10.0	11.552	7.494	5.320	4.426	3.922	3.597	3.369	3.201	3.072	2.969
<b>IAC SHORT INVERSE</b>										
0.5	0.072	0.047	0.035	0.031	0.028	0.027	0.026	0.026	0.025	0.025
1.0	0.143	0.095	0.070	0.061	0.057	0.054	0.052	0.051	0.050	0.049
2.0	0.286	0.190	0.140	0.123	0.114	0.108	0.105	0.102	0.100	0.099
4.0	0.573	0.379	0.279	0.245	0.228	0.217	0.210	0.204	0.200	0.197
6.0	0.859	0.569	0.419	0.368	0.341	0.325	0.314	0.307	0.301	0.296
8.0	1.145	0.759	0.559	0.490	0.455	0.434	0.419	0.409	0.401	0.394
10.0	1.431	0.948	0.699	0.613	0.569	0.542	0.524	0.511	0.501	0.493

**I<sup>2</sup>t CURVES:**

The curves for the I<sup>2</sup>t are derived from the formulae:

$$T = \text{TDM} \times \left[ \frac{100}{\left( \frac{I}{I_{pickup}} \right)^2} \right] \quad T_{RESET} = \text{TDM} \times \left[ \frac{100}{\left( \frac{I}{I_{pickup}} \right)^2} \right]$$

where:  $T$  = Operate Time (sec.)

TDM = Multiplier Setting

$I$  = Input Current

$I_{pickup}$  = Pickup Current Setting

$T_{RESET}$  = Reset Time in sec. (assuming energy capacity is 100% and RESET: Timed)

**Table 5-22: I<sup>2</sup>t CURVE TRIP TIMES**

MULTIPLIER (TDM)	CURRENT ( $I / I_{pickup}$ )									
	1.5	2.0	3.0	4.0	5.0	6.0	7.0	8.0	9.0	10.0
0.01	0.44	0.25	0.11	0.06	0.04	0.03	0.02	0.02	0.01	0.01
0.10	4.44	2.50	1.11	0.63	0.40	0.28	0.20	0.16	0.12	0.10
1.00	44.44	25.00	11.11	6.25	4.00	2.78	2.04	1.56	1.23	1.00
10.00	444.44	250.00	111.11	62.50	40.00	27.78	20.41	15.63	12.35	10.00
100.00	4444.4	2500.0	1111.1	625.00	400.00	277.78	204.08	156.25	123.46	100.00
600.00	26666.7	15000.0	6666.7	3750.0	2400.0	1666.7	1224.5	937.50	740.74	600.00

**FLEXCURVE™:**

The custom FlexCurve™ is described in detail in the FLEXCURVE™ section of this chapter. The curve shapes for the Flex-Curves™ are derived from the formulae:

$$T = \text{TDM} \times \left[ \text{FlexcurveTime} @ \left( \frac{I}{I_{pickup}} \right) \right] \quad \text{When } \left( \frac{I}{I_{pickup}} \right) \geq 1.00$$

$$T_{RESET} = \text{TDM} \times \left[ \text{FlexcurveTime} @ \left( \frac{I}{I_{pickup}} \right) \right] \quad \text{When } \left( \frac{I}{I_{pickup}} \right) \leq 0.98$$

where:  $T$  = Operate Time (sec.)

TDM = Multiplier Setting

$I$  = Input Current

$I_{pickup}$  = Pickup Current Setting

$T_{RESET}$  = Reset Time in seconds (assuming energy capacity is 100% and RESET: Timed)

**DEFINITE TIME CURVE:**

The Definite Time curve shape operates as soon as the pickup level is exceeded for a specified period of time. The base definite time curve delay is in seconds. The curve multiplier of 0.00 to 600.00 makes this delay adjustable from instantaneous to 600.00 seconds in steps of 10 ms.

$$T = \text{TDM in seconds, when } I > I_{pickup}$$

$$T_{RESET} = -\text{TDM in seconds}$$

where:  $T$  = Operate Time (sec.)

TDM = Multiplier Setting

$I$  = Input Current

$I_{pickup}$  = Pickup Current Setting

$T_{RESET}$  = Reset Time in seconds (assuming energy capacity is 100% and RESET: Timed)

## 5.5.7 PHASE CURRENT

## a) PHASE TOC1 (PHASE TIME OVERCURRENT: ANSI 51P)

PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ PHASE CURRENT ⇒ PHASE TOC1

■ PHASE TOC1	◀▶	PHASE TOC1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	PHASE TOC1 SIGNAL SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	PHASE TOC1 INPUT: Phasor	Range: Phasor, RMS
MESSAGE	▲▼	PHASE TOC1 PICKUP: 1.000 pu	Range: 0.000 to 30.000 pu in steps of 0.001
MESSAGE	▲▼	PHASE TOC1 CURVE: IEEE Mod Inv	Range: See OVERCURRENT CURVE TYPES table
MESSAGE	▲▼	PHASE TOC1 TD MULTIPLIER: 1.00	Range: 0.00 to 600.00 in steps of 0.01
MESSAGE	▲▼	PHASE TOC1 RESET: Instantaneous	Range: Instantaneous, Timed
MESSAGE	▲▼	PHASE TOC1 VOLTAGE RESTRAINT: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	PHASE TOC1 BLOCK A: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	PHASE TOC1 BLOCK B: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	PHASE TOC1 BLOCK C: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	PHASE TOC1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	PHASE TOC1 EVENTS: Disabled	Range: Disabled, Enabled

The phase time overcurrent element can provide a desired time-delay operating characteristic versus the applied current or be used as a simple Definite Time element. The phase current input quantities may be programmed as fundamental phasor magnitude or total waveform RMS magnitude as required by the application.

Two methods of resetting operation are available: "Timed" and "Instantaneous" (refer to the INVERSE TOC CURVE CHARACTERISTICS section for details on curve setup, trip times and reset operation). When the element is blocked, the time accumulator will reset according to the reset characteristic. For example, if the element reset characteristic is set to "Instantaneous" and the element is blocked, the time accumulator will be cleared immediately.

The **PHASE TOC1 PICKUP** setting can be dynamically reduced by a voltage restraint feature (when enabled). This is accomplished via the multipliers (Mvr) corresponding to the phase-phase voltages of the voltage restraint characteristic curve (see the figure below); the pickup level is calculated as 'Mvr' times the PICKUP setting. If the voltage restraint feature is disabled, the pickup level always remains at the setting value.

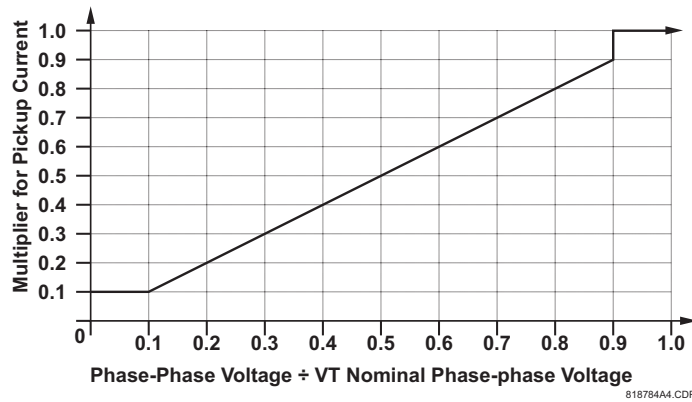


Figure 5-21: VOLTAGE RESTRAINT CHARACTERISTIC FOR PHASE TOC


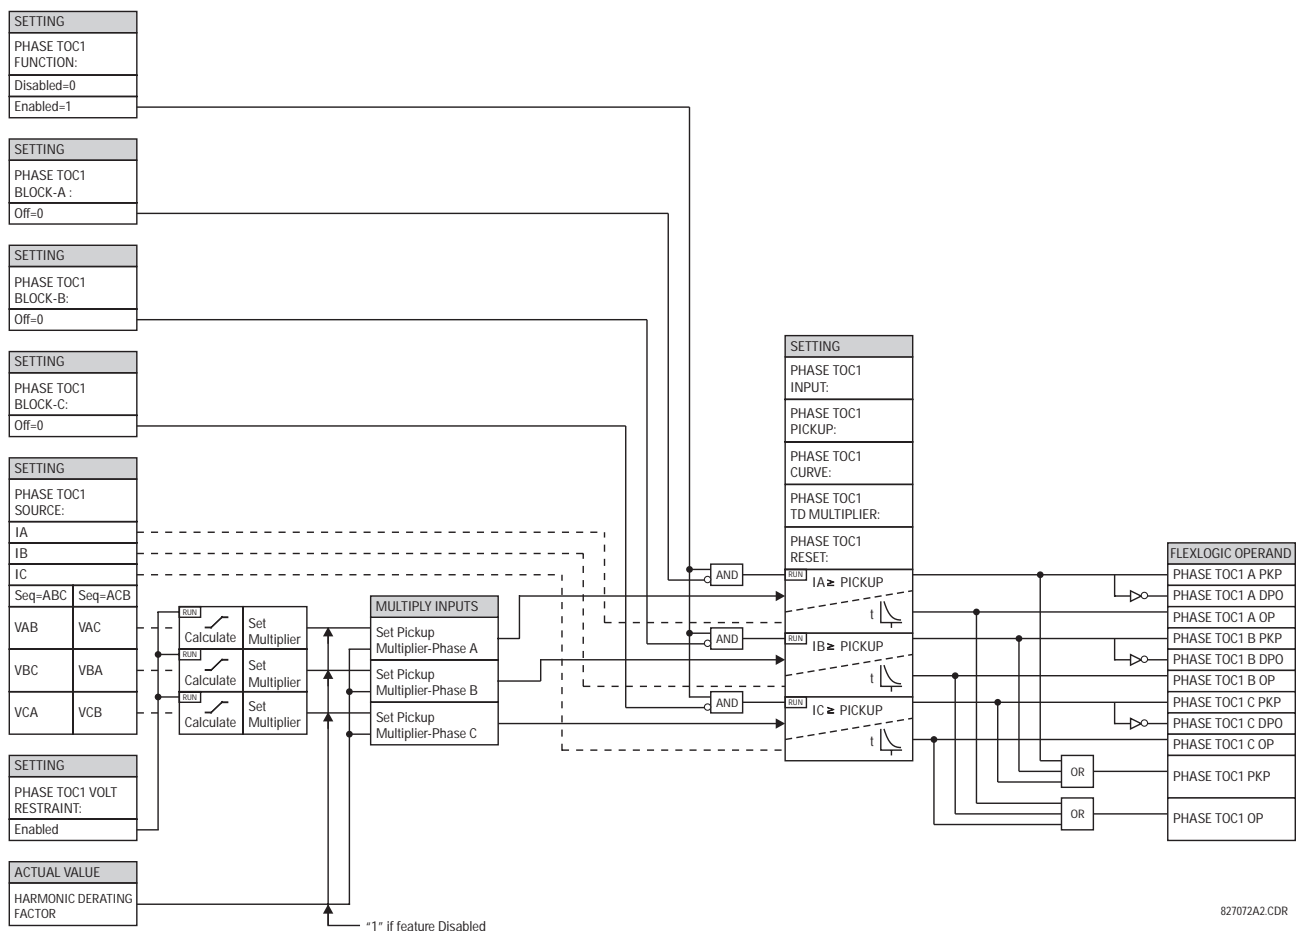


Figure 5-22: PHASE TOC1 SCHEME LOGIC




**b) PHASE IOC1** (PHASE INSTANTANEOUS OVERCURRENT: ANSI 50P)

**PATH: SETTINGS ⇨ GROUPED ELEMENTS ⇨ SETTING GROUP 1(8) ⇨ PHASE CURRENT ⇨ PHASE IOC 1**

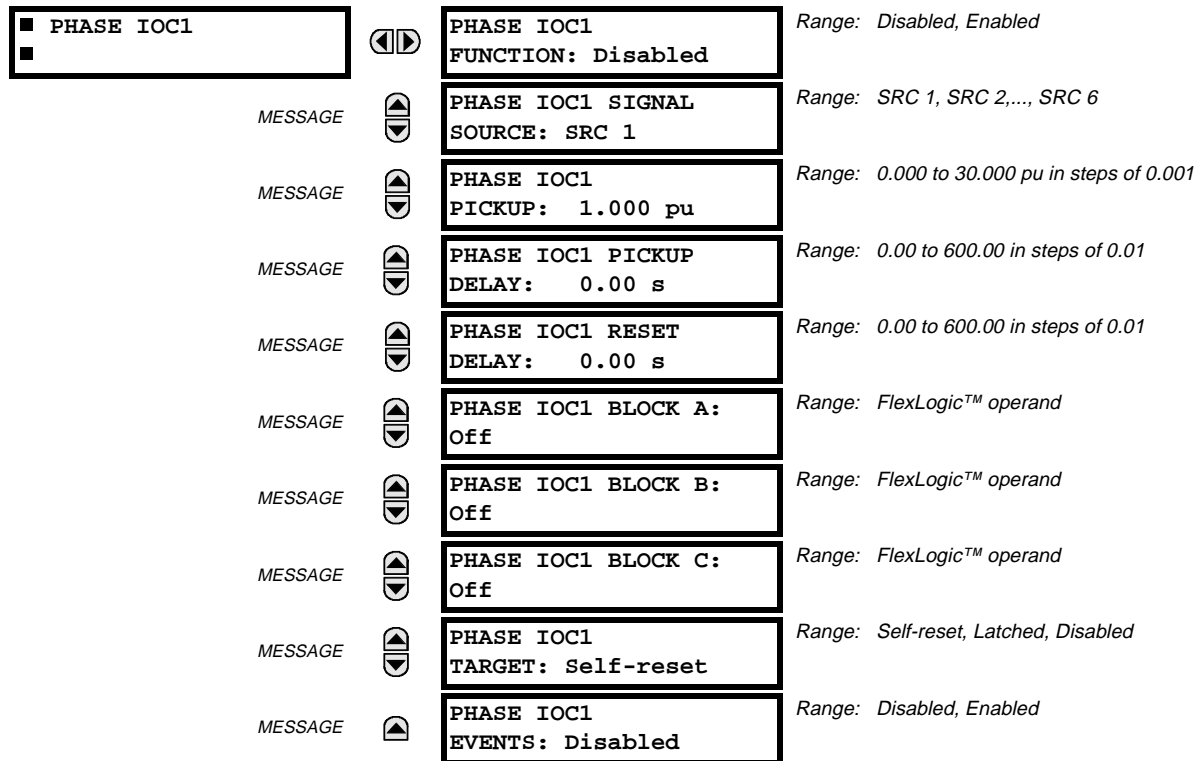

The phase instantaneous overcurrent element may be used as an instantaneous element with no intentional delay or as a Definite Time element. The input current is the fundamental phasor magnitude.

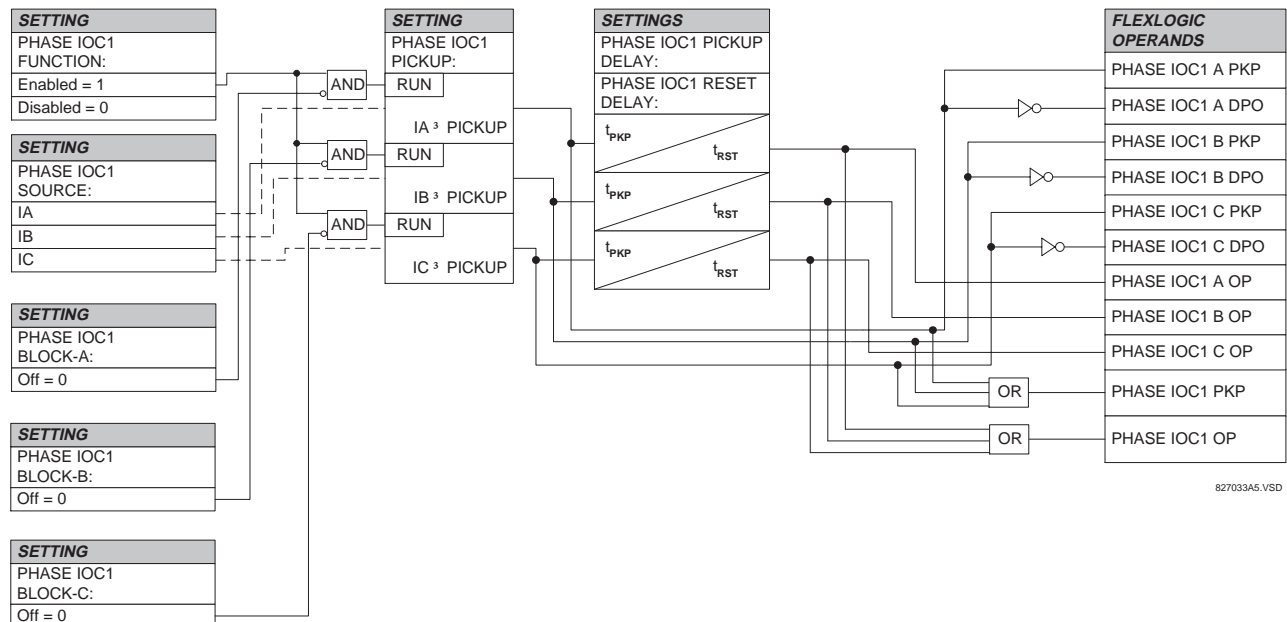

**Figure 5–23: PHASE IOC1 SCHEME LOGIC**

## c) PHASE DIRECTIONAL 1(2) (PHASE DIRECTIONAL OVERCURRENT: ANSI 67P)

PATH: SETTINGS ⇨ GROUPED ELEMENTS ⇨ SETTING GROUP 1(8) ⇨ PHASE CURRENT ⇨ PHASE DIRECTIONAL 1

■ PHASE		PHASE DIR 1	Range: Disabled, Enabled
■ DIRECTIONAL 1		FUNCTION: Disabled	
MESSAGE	▲▼	PHASE DIR 1 SIGNAL	Range: SRC 1, SRC 2,..., SRC 6
		SOURCE: SRC 1	
MESSAGE	▲▼	PHASE DIR 1 BLOCK:	Range: FlexLogic™ operand
		Off	
MESSAGE	▲▼	PHASE DIR 1	Range: 0 to 359° in steps of 1
		ECA: 30	
MESSAGE	▲▼	PHASE DIR POL V1	Range: 0.000 to 3.000 pu in steps of 0.001
		THRESHOLD:0.050 pu	
MESSAGE	▲▼	PHASE DIR 1 BLOCK	Range: No, Yes
		WHEN V MEM EXP: No	
MESSAGE	▲▼	PHASE DIR 1	Range: Self-reset, Latched, Disabled
		TARGET: Self-reset	
MESSAGE	▲	PHASE DIR 1	Range: Disabled, Enabled
		EVENTS: Disabled	

5

The phase directional elements (one for each of phases A, B, and C) determine the phase current flow direction for steady state and fault conditions and can be used to control the operation of the phase overcurrent elements via the BLOCK inputs of these elements.

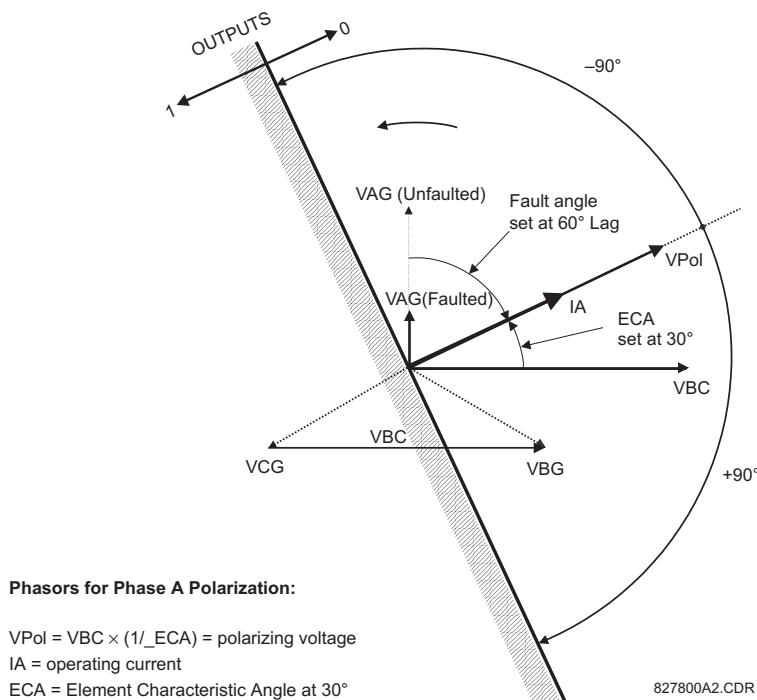


Figure 5–24: PHASE A DIRECTIONAL POLARIZATION

This element is intended to apply a block signal to an overcurrent element to prevent an operation when current is flowing in a particular direction. The direction of current flow is determined by measuring the phase angle between the current from the phase CTs and the line-line voltage from the VTs, based on the 90° or "quadrature" connection. If there is a requirement to supervise overcurrent elements for flows in opposite directions, such as can happen through a bus-tie breaker, two phase directional elements should be programmed with opposite ECA settings.

To increase security for three phase faults very close to the location of the VTs used to measure the polarizing voltage, a 'voltage memory' feature is incorporated. This feature remembers the measurement of the polarizing voltage the moment before the voltage collapses, and uses it to determine direction. The voltage memory remains valid for one second after the voltage has collapsed.

The main component of the phase directional element is the phase angle comparator with two inputs: the operating signal (phase current) and the polarizing signal (the line voltage, shifted in the leading direction by the characteristic angle, ECA).

The following table shows the operating and polarizing signals used for phase directional control:

PHASE	OPERATING SIGNAL	POLARIZING SIGNAL VPOL	
		ABC PHASE SEQUENCE	ACB PHASE SEQUENCE
A	Angle of IA	Angle of VBC $\times (1\angle ECA)$	Angle of VCB $\times (1\angle ECA)$
B	Angle of IB	Angle of VCA $\times (1\angle ECA)$	Angle of VAC $\times 1\angle ECA)$
C	Angle of IC	Angle of VAB $\times (1\angle ECA)$	Angle of VBA $\times (1\angle ECA)$

#### MODE OF OPERATION:

- When the Phase Directional function is "Disabled", or the operating current is below  $5\% \times \text{CT Nominal}$ , the element output is "0".
- When the Phase Directional function is "Enabled", the operating current is above  $5\% \times \text{CT Nominal}$  and the polarizing voltage is above the set threshold, the element output depends on the phase angle between the operating and polarizing signals as follows:
  - The element output is logic "0" when the operating current is within polarizing voltage  $\pm 90^\circ$ .
  - For all other angles, the element output is logic "1".
- Once the voltage memory has expired, the phase overcurrent elements under directional control can be set to block or trip on overcurrent as follows:
  - When **BLOCK WHEN V MEM EXP** is set to "Yes", the directional element will block the operation of any phase overcurrent element under directional control when voltage memory expires. When set to "No", the directional element allows tripping of phase overcurrent elements under directional control when voltage memory expires.

In all cases, directional blocking will be permitted to resume when the polarizing voltage becomes greater than the "polarizing voltage threshold".

#### SETTINGS:

##### PHASE DIR 1 SIGNAL SOURCE:

This setting is used to select the source for the operating and polarizing signals.

The operating current for the phase directional element is the phase current for the selected current source. The polarizing voltage is the line voltage from the phase VTs, based on the  $90^\circ$  or "quadrature" connection and shifted in the leading direction by the Element Characteristic Angle (ECA).

##### PHASE DIR 1 ECA:

This setting is used to select the Element Characteristic Angle, i.e. the angle by which the polarizing voltage is shifted in the leading direction to achieve dependable operation. In the design of UR elements, a block is applied to an element by asserting logic 1 at the blocking input. This element should be programmed via the ECA setting so that the output is **logic 1 for current in the non-tripping direction**.

##### PHASE DIR 1 POL V THRESHOLD:

This setting is used to establish the minimum level of voltage for which the phase angle measurement is reliable. The setting is based on VT accuracy. The default value is 0.05 pu.

##### PHASE DIR 1 BLOCK WHEN V MEM EXP:

This setting is used to select the required operation upon expiration of voltage memory. When set to "Yes", the directional element blocks the operation of any phase overcurrent element under directional control, when voltage memory expires; when set to "No", the directional element allows tripping of phase overcurrent elements under directional control.



The Phase Directional element would respond to the forward load current. In the case of a following reverse fault, the element needs some time – in the order of 8 msec – to establish a blocking signal. Some protection elements such as instantaneous overcurrent may respond to reverse faults before the blocking signal is established. Therefore, a coordination time of at least 10 msec must be added to all the instantaneous protection elements under the supervision of the Phase Directional element. If current reversal is of a concern, a longer delay – in the order of 20 msec – may be needed.

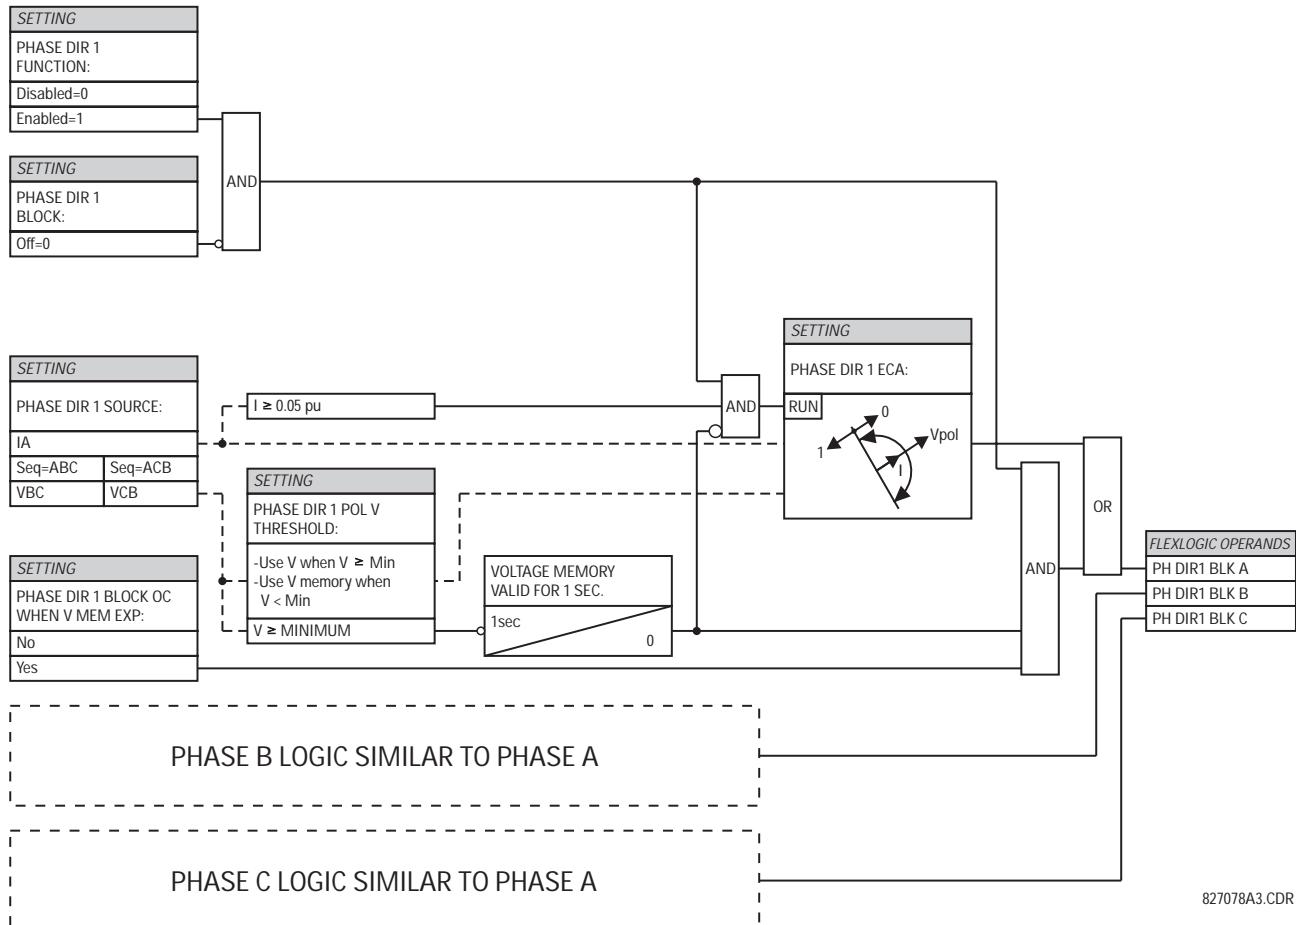


Figure 5-25: PHASE DIRECTIONAL SCHEME LOGIC

## 5.5.8 NEUTRAL CURRENT

## a) NEUTRAL TOC1 (NEUTRAL TIME OVERCURRENT: ANSI 51N)

PATH: SETTINGS ⇌ GROUPED ELEMENTS ⇌ SETTING GROUP 1(8) ⇌ NEUTRAL CURRENT ⇌ NEUTRAL TOC1

■ NEUTRAL TOC1	◀▶	NEUTRAL TOC1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	NEUTRAL TOC1 SIGNAL SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	NEUTRAL TOC1 INPUT: Phasor	Range: Phasor, RMS
MESSAGE	▲▼	NEUTRAL TOC1 PICKUP: 1.000 pu	Range: 0.000 to 30.000 pu in steps of 0.001
MESSAGE	▲▼	NEUTRAL TOC1 CURVE: IEEE Mod Inv	Range: See OVERCURRENT CURE TYPES table
MESSAGE	▲▼	NEUTRAL TOC1 TD MULTIPLIER: 1.00	Range: 0.00 to 600.00 in steps of 0.01
MESSAGE	▲▼	NEUTRAL TOC1 RESET: Instantaneous	Range: Instantaneous, Timed
MESSAGE	▲▼	NEUTRAL TOC1 BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	NEUTRAL TOC1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	NEUTRAL TOC1 EVENTS: Disabled	Range: Disabled, Enabled

The neutral time overcurrent element can provide a desired time-delay operating characteristic versus the applied current or be used as a simple Definite Time element. The neutral current input value is a quantity calculated as  $3I_0$  from the phase currents and may be programmed as fundamental phasor magnitude or total waveform RMS magnitude as required by the application.

Two methods of resetting operation are available: "Timed" and "Instantaneous" (refer to the INVERSE TOC CURVE CHARACTERISTICS section for details on curve setup, trip times and reset operation). When the element is blocked, the time accumulator will reset according to the reset characteristic. For example, if the element reset characteristic is set to "Instantaneous" and the element is blocked, the time accumulator will be cleared immediately.

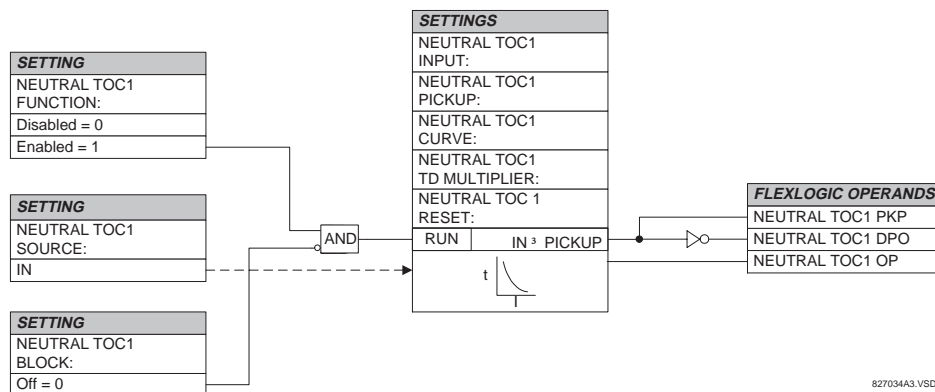


Figure 5-26: NEUTRAL TOC1 SCHEME LOGIC



Once picked up, the NEUTRAL TOCx PKP output operand remains picked up until the thermal memory of the element resets completely. The PKP operand will not reset immediately after the operating current drops below the pickup threshold unless NEUTRL TOCx RESET is set to "Instantaneous".

## b) NEUTRAL IOC1 (NEUTRAL INSTANTANEOUS OVERCURRENT: ANSI 50N)

PATH: SETTINGS ⇌ GROUPED ELEMENTS ⇌ SETTING GROUP 1(8) ⇌ NEUTRAL CURRENT ⇌ NEUTRAL IOC1

■ NEUTRAL IOC1	◀▶	NEUTRAL IOC1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	NEUTRAL IOC1 SIGNAL SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	NEUTRAL IOC1 PICKUP: 1.000 pu	Range: 0.000 to 30.000 pu in steps of 0.001
MESSAGE	▲▼	NEUTRAL IOC1 PICKUP DELAY: 0.00 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE	▲▼	NEUTRAL IOC1 RESET DELAY: 0.00 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE	▲▼	NEUTRAL IOC1 BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	NEUTRAL IOC1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	NEUTRAL IOC1 EVENTS: Disabled	Range: Disabled, Enabled

5


The Neutral Instantaneous Overcurrent element may be used as an instantaneous function with no intentional delay or as a Definite Time function. The element essentially responds to the magnitude of a neutral current fundamental frequency phasor calculated from the phase currents. A “positive-sequence restraint” is applied for better performance. A small portion (6.25%) of the positive-sequence current magnitude is subtracted from the zero-sequence current magnitude when forming the operating quantity of the element as follows:

$$I_{op} = 3 \times (|I_0| - K \cdot |I_1|) \quad , \text{ where } K = 1/16.$$

The positive-sequence restraint allows for more sensitive settings by counterbalancing spurious zero-sequence currents resulting from:

- system unbalances under heavy load conditions
- transformation errors of current transformers (CTs) during double-line and three-phase faults
- switch-off transients during double-line and three-phase faults

The positive-sequence restraint must be considered when testing for pickup accuracy and response time (multiple of pickup). The operating quantity depends on how test currents are injected into the relay (single-phase injection:  $I_{op} = 0.9375 \cdot I_{injected}$ ; three-phase pure zero-sequence injection:  $I_{op} = 3 \times I_{injected}$ ).

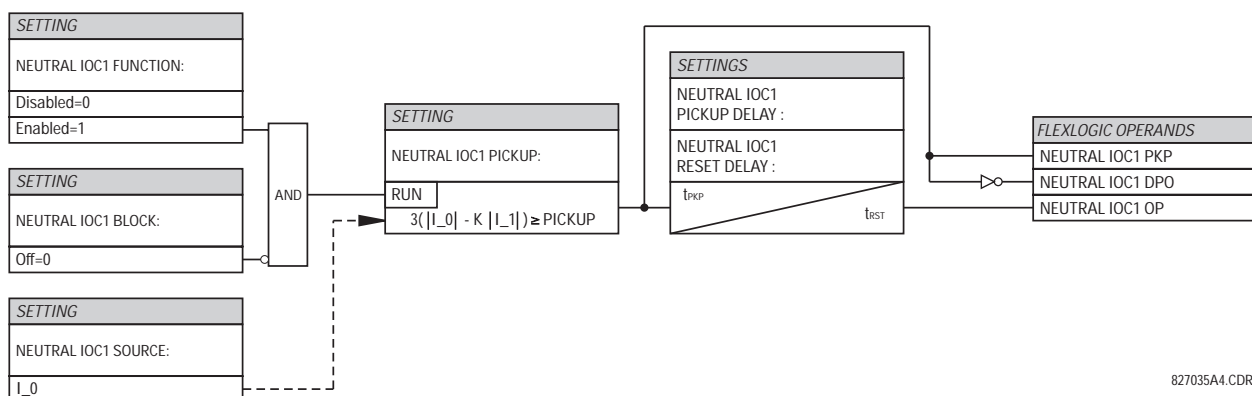

827035A4.CDR

Figure 5-27: NEUTRAL IOC1 SCHEME LOGIC

## c) NEUTRAL DIRECTIONAL 1(2) (NEUTRAL DIRECTIONAL OVERCURRENT: ANSI 67N)

PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ NEUTRAL CURRENT ⇒ NEUTRAL DIRECTIONAL OC1

■ NEUTRAL ■ DIRECTIONAL OC1		NEUTRAL DIR OC1 FUNCTION: Disabled	Range: Disabled, Enabled
		MESSAGE	
		NEUTRAL DIR OC1 SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
		NEUTRAL DIR OC1 POLARIZING: Voltage	Range: Voltage, Current, Dual
		NEUTRAL DIR OC1 POL VOLT: Calculated V0	Range: Calculated V0, Measured VX
		NEUTRAL DIR OC1 OP CURR: Calculated 3I0	Range: Calculated 3I0, Measured IG
		NEUTRAL DIR OC1 OFFSET: 0.00 Ω	Range: 0.00 to 250.00 Ω in steps of 0.01
		NEUTRAL DIR OC1 FWD ECA: 75° Lag	Range: -90 to 90° in steps of 1
		NEUTRAL DIR OC1 FWD LIMIT ANGLE: 90°	Range: 40 to 90° in steps of 1
		NEUTRAL DIR OC1 FWD PICKUP: 0.050 pu	Range: 0.002 to 30.000 pu in steps of 0.001
		NEUTRAL DIR OC1 REV LIMIT ANGLE: 90°	Range: 40 to 90° in steps of 1
		NEUTRAL DIR OC1 REV PICKUP: 0.050 pu	Range: 0.002 to 30.000 pu in steps of 0.001
		NEUTRAL DIR OC1 BLK: Off	Range: FlexLogic™ operand
		NEUTRAL DIR OC1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
		NEUTRAL DIR OC1 EVENTS: Disabled	Range: Disabled, Enabled

There are two Neutral Directional Overcurrent protection elements available. The element provides both forward and reverse fault direction indications the NEUTRAL DIR OC1 FWD and NEUTRAL DIR OC1 REV operands, respectively. The output operand is asserted if the magnitude of the operating current is above a pickup level (overcurrent unit) and the fault direction is seen as “forward or “reverse”, respectively (directional unit).

The **overcurrent unit** responds to the magnitude of a fundamental frequency phasor of the either the neutral current calculated from the phase currents or the ground current. There are two separate pickup settings for the forward- and reverse-looking functions, respectively. If set to use the calculated 3I<sub>0</sub>, the element applies a “positive-sequence restraint” for better performance: a small portion (6.25%) of the positive-sequence current magnitude is subtracted from the zero-sequence current magnitude when forming the operating quantity.

$$I_{op} = 3 \times (|I_0| - K \times |I_1|) \quad , \text{ where } K \text{ is } 1/16.$$

The positive-sequence restraint allows for more sensitive settings by counterbalancing spurious zero-sequence currents resulting from:

- System unbalances under heavy load conditions.
- Transformation errors of Current Transformers (CTs) during double-line and three-phase faults.
- Switch-off transients during double-line and three-phase faults.

The positive-sequence restraint must be considered when testing for pickup accuracy and response time (multiple of pickup). The operating quantity depends on the way the test currents are injected into the relay (single-phase injection:  $I_{op} = 0.9375 \times I_{injected}$ ; three-phase pure zero-sequence injection:  $I_{op} = 3 \times I_{injected}$ ).

The **directional unit** uses the zero-sequence current ( $I_0$ ) or ground current (IG) for fault direction discrimination and may be programmed to use either zero-sequence voltage ("Calculated V0" or "Measured VX"), ground current (IG), or both for polarizing. The following tables define the Neutral Directional Overcurrent element.

**Table 5–23: QUANTITIES FOR "CALCULATED 3I0" CONFIGURATION**

DIRECTIONAL UNIT				OVERCURRENT UNIT
POLARIZING MODE	DIRECTION	COMPARED PHASORS		
Voltage	Forward	$-V\_0 + Z\_offset \times I\_0$	$I\_0 \times 1 \angle ECA$	$I_{op} = 3 \times ( I\_0  - K \times  I\_1 )$
	Reverse	$-V\_0 + Z\_offset \times I\_0$	$-I\_0 \times 1 \angle ECA$	
Current	Forward	IG	I_0	
	Reverse	IG	-I_0	
Dual	Forward	$-V\_0 + Z\_offset \times I\_0$	$I\_0 \times 1 \angle ECA$	
		or		
		IG	I_0	
	Reverse	$-V\_0 + Z\_offset \times I\_0$	$-I\_0 \times 1 \angle ECA$	
		or		
		IG	-I_0	

**Table 5–24: QUANTITIES FOR "MEASURED IG" CONFIGURATION**

DIRECTIONAL UNIT				OVERCURRENT UNIT
POLARIZING MODE	DIRECTION	COMPARED PHASORS		
Voltage	Forward	$-V\_0 + Z\_offset \times IG/3$	$IG \times 1 \angle ECA$	$I_{op} =  IG $
	Reverse	$-V\_0 + Z\_offset \times IG/3$	$-IG \times 1 \angle ECA$	

where:  $V_0 = \frac{1}{3}(V_{AG} + V_{BG} + V_{CG})$  = zero sequence voltage

$I_0 = \frac{1}{3}I_N = \frac{1}{3}(I_A + I_B + I_C)$  = zero sequence current


ECA = element characteristic angle

IG = ground current

When **NEUTRAL DIR OC1 POL VOLT** is set to "Measured VX", one-third of this voltage is used in place of  $V_0$ .

The following figure explains the usage of the voltage polarized directional unit of the element.



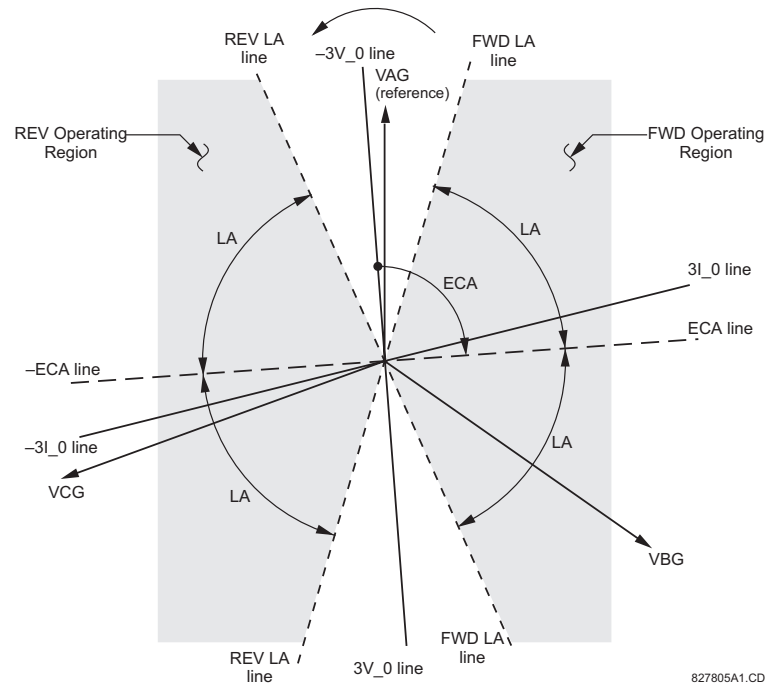

**Figure 5-28: NEUTRAL DIRECTIONAL VOLTAGE-POLARIZED CHARACTERISTICS**

The above figure shows the voltage-polarized phase angle comparator characteristics for a phase-A to ground fault, with:

- ECA =  $90^\circ$  (Element Characteristic Angle = centerline of operating characteristic)
- FWD LA =  $80^\circ$  (Forward Limit Angle = the  $\pm$  angular limit with the ECA for operation)
- REV LA =  $80^\circ$  (Reverse Limit Angle = the  $\pm$  angular limit with the ECA for operation)

The element incorporates a current reversal logic: if the reverse direction is indicated for at least 1.25 of a power system cycle, the prospective forward indication will be delayed by 1.5 of a power system cycle. The element is designed to emulate an electromechanical directional device. Larger operating and polarizing signals will result in faster directional discrimination bringing more security to the element operation.

The forward-looking function is designed to be more secure as compared to the reverse-looking function, and therefore, should be used for the tripping direction. The reverse-looking function is designed to be faster as compared to the forward-looking function and should be used for the blocking direction. This allows for better protection coordination.

The above bias should be taken into account when using the Neutral Directional Overcurrent element to 'directionalize' other protection elements.

#### NEUTRAL DIR OC1 POLARIZING:

This setting selects the polarizing mode for the directional unit.

- If "Voltage" polarizing is selected, the element uses the zero-sequence voltage angle for polarization. The user can use either the zero-sequence voltage  $V_0$  calculated from the phase voltages, or the zero-sequence voltage supplied externally as the auxiliary voltage  $V_x$ , both from the **NEUTRAL DIR OC1 SOURCE**.

The calculated  $V_0$  can be used as polarizing voltage only if the voltage transformers are connected in Wye. The auxiliary voltage can be used as the polarizing voltage provided **SYSTEM SETUP**  $\Rightarrow$  **AC INPUTS**  $\Rightarrow$  **VOLTAGE BANK**  $\Rightarrow$  **AUXILIARY VT CONNECTION** is set to "Vn" and the auxiliary voltage is connected to a zero-sequence voltage source (such as open delta connected secondary of VTs).

The zero-sequence voltage ( $V_0$ ) or auxiliary voltage ( $V_x$ ), accordingly, must be higher than 1 V secondary to be validated for use as a polarizing signal. If the polarizing signal is not valid, neither forward nor reverse indication is given.

- If "Current" polarizing is selected, the element uses the ground current angle connected externally and configured under **NEUTRAL OC1 SOURCE** for polarization. The ground current transformer must be connected between the ground and neutral point of an adequate local source of ground current. The ground current must be higher than 0.05 pu to be

validated for use as a polarizing signal. If the polarizing signal is not valid neither forward nor reverse indication is given.

For a choice of current polarizing, it is recommended that the polarizing signal be analyzed to ensure that a known direction is maintained irrespective of the fault location. For example, if using an autotransformer neutral current as a polarizing source, it should be ensured that a reversal of the ground current does not occur for a high-side fault. The low-side system impedance should be assumed minimal when checking for this condition. A similar situation arises for a WYE/DELTA/WYE transformer, where current in one transformer winding neutral may reverse when faults on both sides of the transformer are considered.

- If "Dual" polarizing is selected, the element performs both directional comparisons as described above. A given direction is confirmed if either voltage or current comparators indicate so. If a conflicting (simultaneous forward and reverse) indication occurs, the forward direction overrides the reverse direction.

#### **NEUTRAL DIR OC1 POL VOLT:**

Selects the polarizing voltage used by the directional unit when "Voltage" or "Dual" polarizing mode is set. The polarizing voltage can be programmed to be either the zero-sequence voltage calculated from the phase voltages ("Calculated V0") or supplied externally as an auxiliary voltage ("Measured VX").

#### **NEUTRAL DIR OC1 OP CURR:**

This setting indicates whether the 3I<sub>0</sub> current calculated from the phase currents, or the ground current shall be used by this protection. This setting acts as a switch between the neutral and ground modes of operation (67N and 67G). If set to "Calculated 3I0" the element uses the phase currents and applies the positive-sequence restraint; if set to "Measured IG" the element uses ground current supplied to the ground CT of the CT bank configured as **NEUTRAL DIR OC1 SOURCE**. Naturally, it is not possible to use the ground current as an operating and polarizing signal simultaneously. Therefore, "Voltage" is the only applicable selection for the polarizing mode under the "Measured IG" selection of this setting.

#### **NEUTRAL DIR OC1 OFFSET:**

This setting specifies the offset impedance used by this protection. The primary application for the offset impedance is to guarantee correct identification of fault direction on series compensated lines. See the APPLICATION OF SETTINGS chapter for information on how to calculate this setting.

In regular applications, the offset impedance ensures proper operation even if the zero-sequence voltage at the relaying point is very small. If this is the intent, the offset impedance shall not be larger than the zero-sequence impedance of the protected circuit. Practically, it shall be several times smaller. See the THEORY OF OPERATION chapter for more details. The offset impedance shall be entered in secondary ohms.

#### **NEUTRAL DIR OC1 FWD ECA:**

This setting defines the characteristic angle (ECA) for the forward direction in the "Voltage" polarizing mode. The "Current" polarizing mode uses a fixed ECA of 0°.

The ECA in the reverse direction is the angle set for the forward direction shifted by 180°.

#### **NEUTRAL DIR OC1 FWD LIMIT ANGLE:**

This setting defines a symmetrical (in both directions from the ECA) limit angle for the forward direction.

#### **NEUTRAL DIR OC1 FWD PICKUP:**


This setting defines the pickup level for the overcurrent unit of the element in the forward direction. When selecting this setting it must be kept in mind that the design uses a "positive-sequence restraint" technique for the "Calculated 3I0" mode of operation.

#### **NEUTRAL DIR OC1 REV LIMIT ANGLE:**

This setting defines a symmetrical (in both directions from the ECA) limit angle for the reverse direction.

#### **NEUTRAL DIR OC1 REV PICKUP:**

This setting defines the pickup level for the overcurrent unit of the element in the reverse direction. When selecting this setting it must be kept in mind that the design uses a "positive-sequence restraint" technique for the "Calculated 3I0" mode of operation.

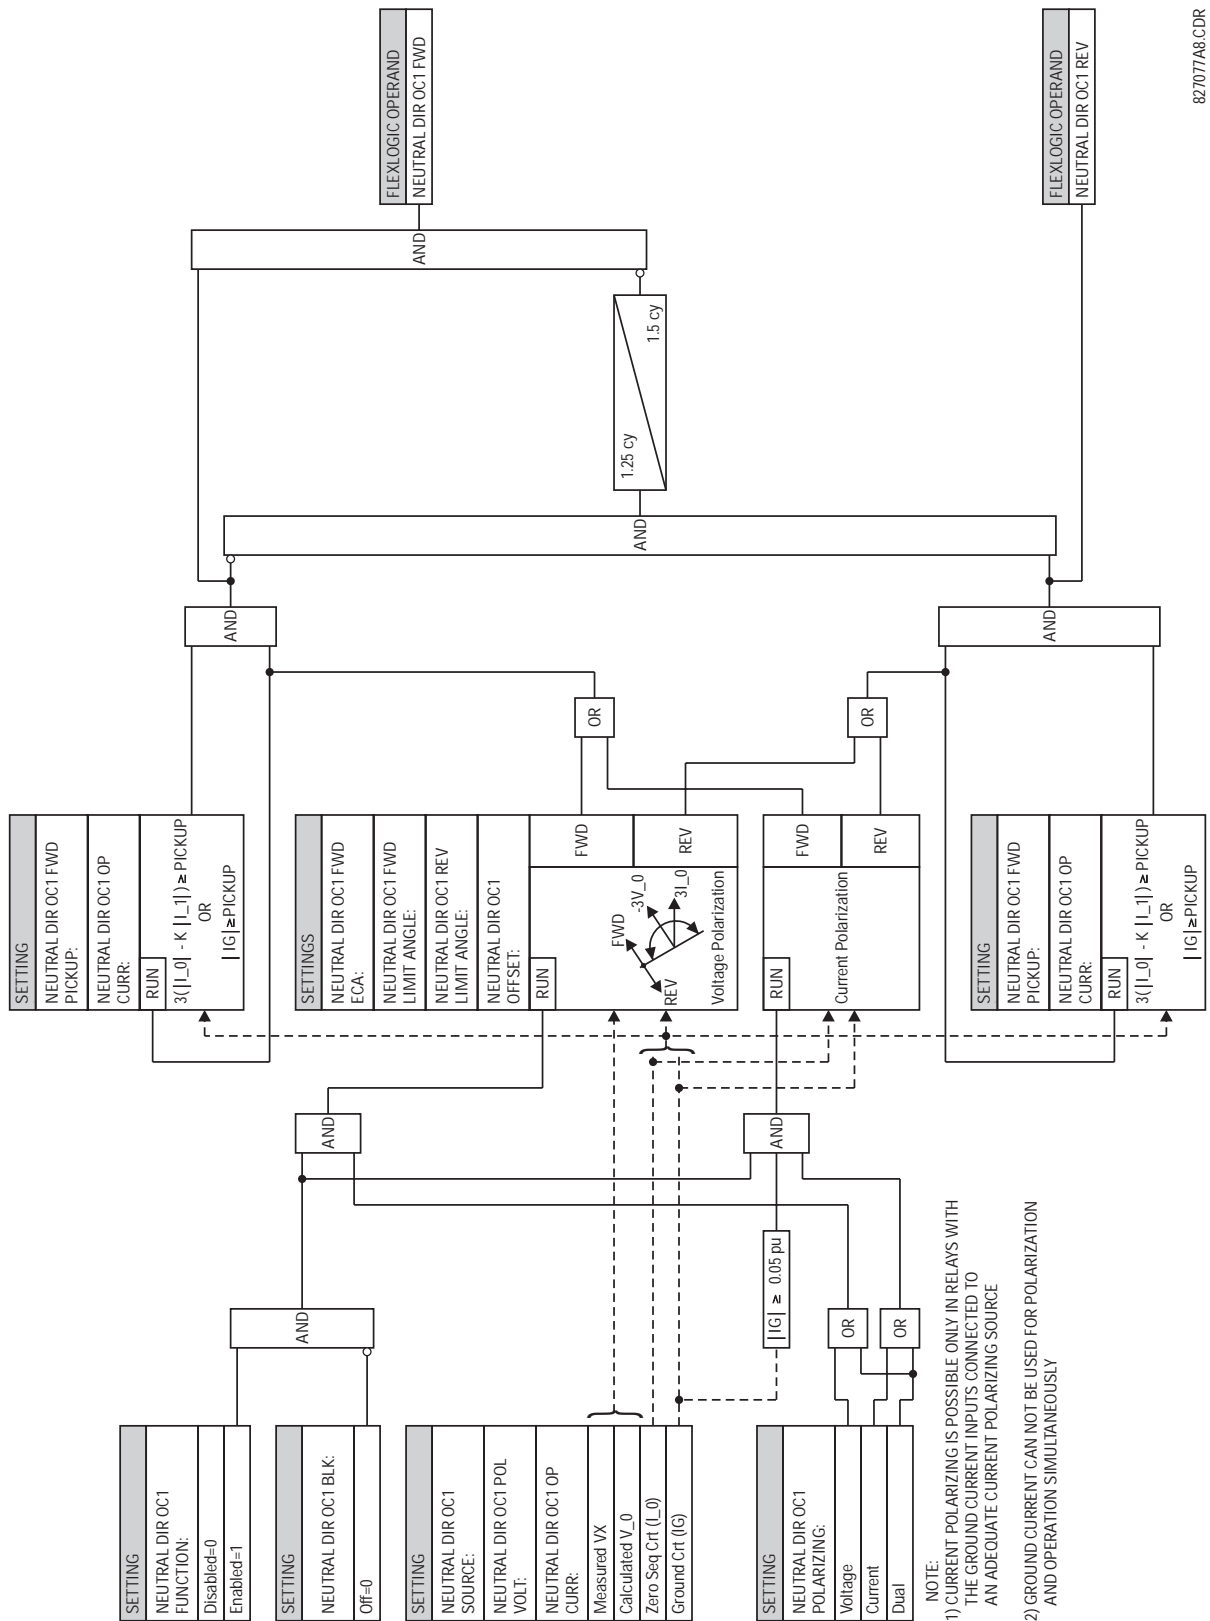

## 5.5.9 GROUND CURRENT

## a) GROUND TOC1 (GROUND TIME OVERCURRENT: ANSI 51G)

PATH: SETTINGS ⇨ GROUPED ELEMENTS ⇨ SETTING GROUP 1(8) ⇨ GROUND CURRENT ⇨ GROUND TOC1

■ GROUND TOC1	GROUND TOC1	Range: Disabled, Enabled
■	FUNCTION: Disabled	
MESSAGE	GROUND TOC1 SIGNAL	Range: SRC 1, SRC 2,..., SRC 6
	SOURCE: SRC 1	
MESSAGE	GROUND TOC1	Range: Phasor, RMS
	INPUT: Phasor	
MESSAGE	GROUND TOC1	Range: 0.000 to 30.000 pu in steps of 0.001
	PICKUP: 1.000 pu	
MESSAGE	GROUND TOC1	Range: see OVERCURRENT CURVE TYPES table
	CURVE: IEEE Mod Inv	
MESSAGE	GROUND TOC1	Range: 0.00 to 600.00 in steps of 0.01
	TD MULTIPLIER: 1.00	
MESSAGE	GROUND TOC1	Range: Instantaneous, Timed
	RESET: Instantaneous	
MESSAGE	GROUND TOC1 BLOCK:	Range: FlexLogic™ operand
	Off	
MESSAGE	GROUND TOC1	Range: Self-reset, Latched, Disabled
	TARGET: Self-reset	
MESSAGE	GROUND TOC1	Range: Disabled, Enabled
	EVENTS: Disabled	

This element can provide a desired time-delay operating characteristic versus the applied current or be used as a simple Definite Time element. The ground current input value is the quantity measured by the ground input CT and is the fundamental phasor or RMS magnitude. Two methods of resetting operation are available; "Timed" and "Instantaneous" (refer to the INVERSE TIME OVERCURRENT CURVE CHARACTERISTICS section for details). When the element is blocked, the time accumulator will reset according to the reset characteristic. For example, if the element reset characteristic is set to "Instantaneous" and the element is blocked, the time accumulator will be cleared immediately.

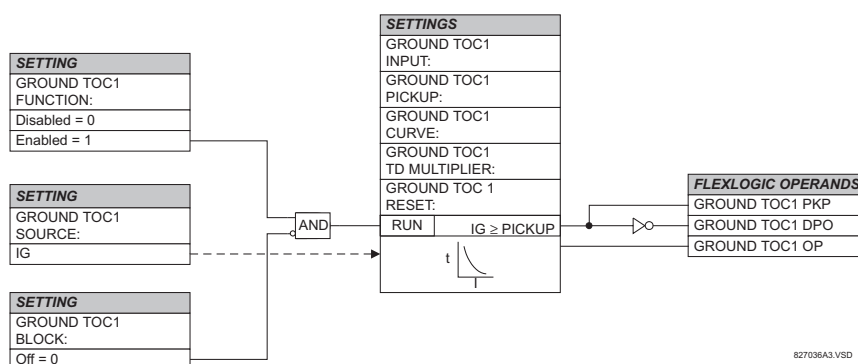


Figure 5-30: GROUND TOC1 SCHEME LOGIC



These elements measure the current that is connected to the ground channel of a CT/VT module. This channel may be equipped with a standard or sensitive input. The conversion range of a standard channel is from 0.02 to 46 times the CT rating. The conversion range of a sensitive channel is from 0.002 to 4.6 times the CT rating.



Once picked up, the GROUND TOCx PKP output operand remains picked up until the thermal memory of the element resets completely. The PKP operand will not reset immediately after the operating current drops below the pickup threshold unless GROUND TOCx RESET is set to "Instantaneous".

## b) GROUND IOC1 (GROUND INSTANTANEOUS OVERCURRENT: ANSI 50G)

PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ GROUND CURRENT ⇒ GROUND IOC1

■ GROUND IOC1	◀▶	GROUND IOC1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	GROUND IOC1 SIGNAL SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	GROUND IOC1 PICKUP: 1.000 pu	Range: 0.000 to 30.000 pu in steps of 0.001
MESSAGE	▲▼	GROUND IOC1 PICKUP DELAY: 0.00 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE	▲▼	GROUND IOC1 RESET DELAY: 0.00 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE	▲▼	GROUND IOC1 BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	GROUND IOC1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	GROUND IOC1 EVENTS: Disabled	Range: Disabled, Enabled

The ground instantaneous overcurrent element may be used as an instantaneous element with no intentional delay or as a Definite Time element. The ground current input value is the quantity measured by the ground input CT and is the fundamental phasor magnitude.

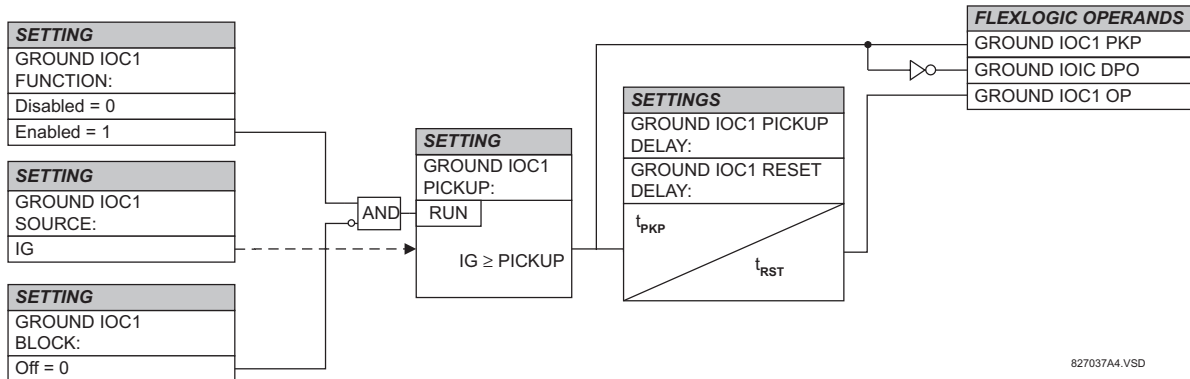


Figure 5-31: GROUND IOC1 SCHEME LOGIC



These elements measure the current that is connected to the ground channel of a CT/VT module. This channel may be equipped with a standard or sensitive input. The conversion range of a standard channel is from 0.02 to 46 times the CT rating. The conversion range of a sensitive channel is from 0.002 to 4.6 times the CT rating.

## 5.5.10 GENERATOR UNBALANCE

PATH: SETTINGS ⇨ ↓ GROUPED ELEMENTS ⇨ SETTING GROUP 1(8) ⇨ ↓ GENERATOR UNBALANCE

■ GENERATOR ■ UNBALANCE	GENERATOR UNBAL FUNCTION: Disabled		Range: Disabled, Enabled
MESSAGE	▲▼	GEN UNBAL SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	GEN UNBAL INOM: 0.800 pu	Range: 0.000 to 1.250 pu in steps of 0.001
MESSAGE	▲▼	GEN UNBAL STG1 PICKUP: 8.00%	Range: 0.00 to 100.00% in steps of 0.01
MESSAGE	▲▼	GEN UNBAL STG1 K-VALUE: 1.00	Range: 0.00 to 100.00 in steps of 0.01
MESSAGE	▲▼	GEN UNBAL STG1 TMIN: 0.25 s	Range: 0.0 to 1000.0 s in steps of 0.1
MESSAGE	▲▼	GEN UNBAL STG1 TMAX: 600.00 s	Range: 0.0 to 1000.0 s in steps of 0.1
MESSAGE	▲▼	GEN UNBAL STG1 K-RESET: 240.00 s	Range: 0.0 to 1000.0 s in steps of 0.1
MESSAGE	▲▼	GEN UNBAL STG2 PICKUP: 3.0%	Range: 0.00 to 100.00% in steps of 0.01
MESSAGE	▲▼	GEN UNBAL STG2 PKP DELAY: 5.0 s	Range: 0.0 to 1000.0 s in steps of 0.1
MESSAGE	▲▼	GEN UNBAL BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	GEN UNBAL TARGET: Self-Reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	GEN UNBAL EVENTS: Disabled	Range: Enabled, Disabled

The generator unbalance element protects the machine from rotor damage due to excessive negative sequence current. The element has an inverse time stage which is typically used for tripping and a definite time stage typically used for alarm purposes. The inverse time stage operating characteristic is defined by the following equation:

$$T = \frac{K}{(I_2/I_{nom})} \quad \text{where } I_{nom} \text{ is the generator rated current and } K \text{ is the negative-sequence capability constant normally provided by the generator manufacturer.}$$

**GEN UNBAL INOM:** This setting is the rated full load current of the machine.

**GEN UNBAL STG1 PICKUP:** This setting defines the pickup of the stage 1 element expressed as a percentage of the nominal current as specified by **GEN UNBAL INOM** setting. It is typically set at the maximum continuous negative sequence current rating of the machine.

**GEN UNBAL STG1 K-VALUE:** This setting is the negative sequence capability constant. This value is normally provided by the generator manufacturer (see ANSI C50.13 for details).

**GEN UNBAL STG1 TMIN:** This is the minimum operate time of the stage 1 element. The stage will not operate before this time expires. This is set to prevent false trips for faults that would be cleared normally by system protections.

**GEN UNBAL STG1 TMAX:** This is the maximum operate time of the stage 1 element. The stage will operate regardless of the magnitude of the negative-sequence current while picked up for this period of time. This setting can be applied to limit the maximum tripping time for low level unbalances.

**GEN UNBAL STG1 K-RESET:** This setting defines the linear reset rate of the stage 1 element. It is the maximum reset time from the threshold of tripping. This feature provides a thermal memory of previous unbalance conditions.

**GEN UNBAL STG2 PICKUP:** This setting defines the pickup of the stage 2 element expressed as a percentage of the nominal current as specified by **GEN UNBAL INOM** setting. The definite time element would normally be used to generate an alarm to prompt an operator to take some corrective action. The stage 2 element would typically be set at a safe margin below the stage 1 pickup setting.

**GEN UNBAL STG2 PKP DELAY:** This is the minimum operate time of the stage 2 element. This is set to prevent nuisance alarms during system faults.

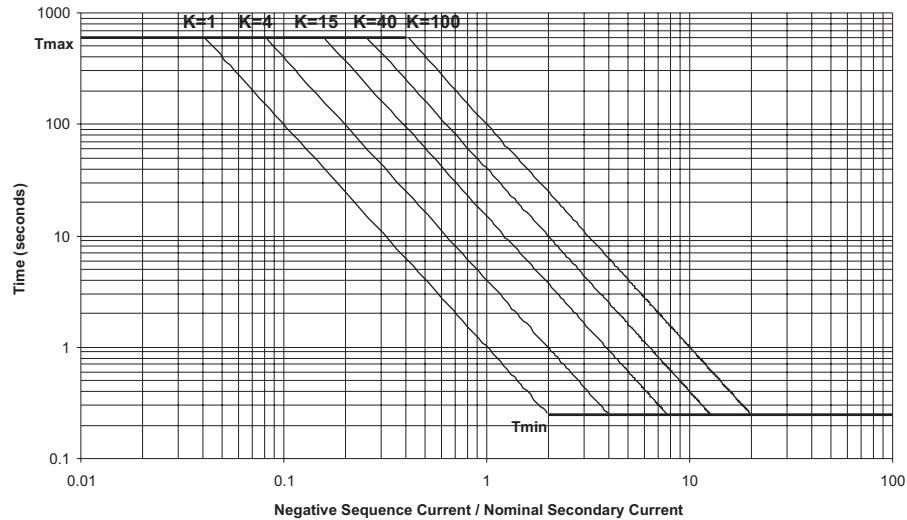


Figure 5-32: GENERATOR UNBALANCE INVERSE TIME CURVES

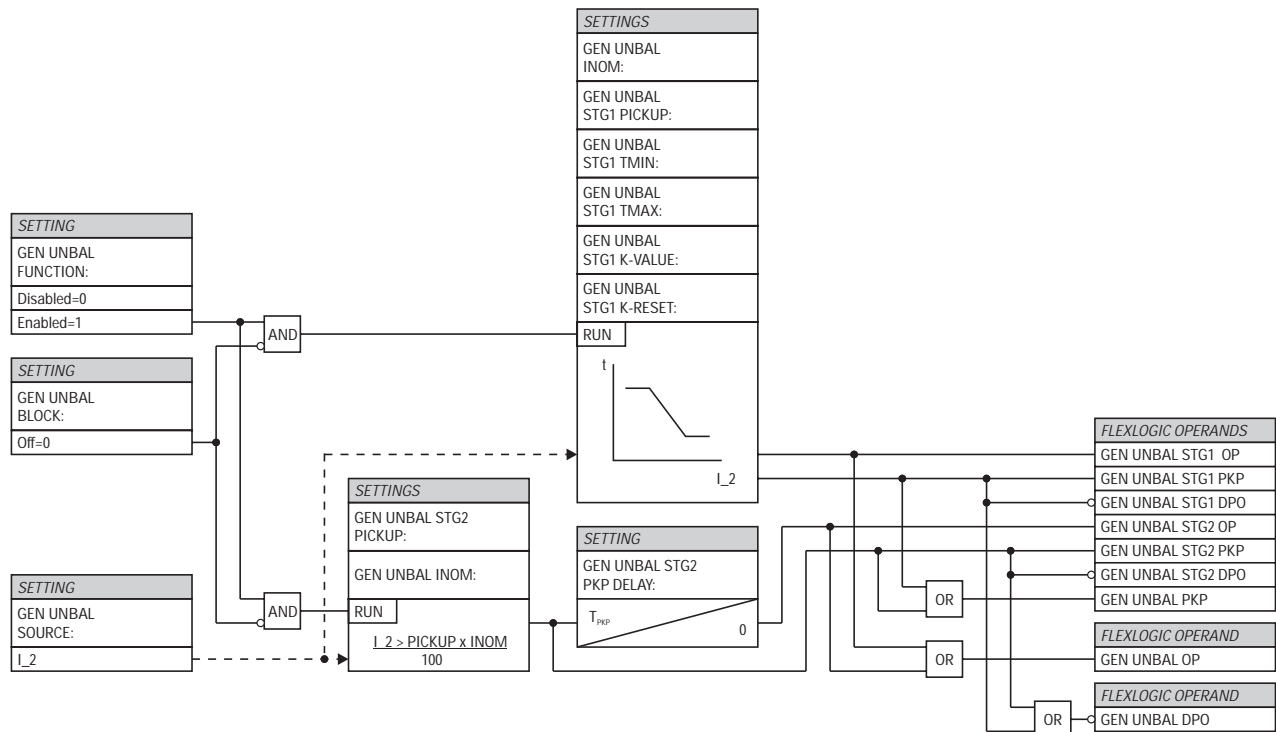


Figure 5-33: GENERATOR UNBALANCE SCHEME LOGIC

## 5.5.11 VOLTAGE ELEMENTS

PATH: SETTINGS ⇌ GROUPED ELEMENTS ⇌ SETTING GROUP 1(8) ⇌ VOLTAGE ELEMENTS

■ VOLTAGE ELEMENTS	◀▶	■ PHASE
■		■ UNDERVOLTAGE1
MESSAGE	▲▼	■ PHASE
		■ UNDERVOLTAGE2
MESSAGE	▲▼	■ PHASE
		■ OVERVOLTAGE1
MESSAGE	▲▼	■ NEUTRAL OV1
		■
MESSAGE	▲▼	■ NEG SEQ OV
		■
MESSAGE	▲▼	■ AUXILIARY UV1
		■
MESSAGE	▲▼	■ AUXILIARY OV1
		■
MESSAGE	▲▼	■ VOLTS/HZ 1
		■
MESSAGE	▲	■ VOLTS/HZ 2
		■

These protection elements can be used for a variety of applications such as:

**Undervoltage Protection:** For voltage sensitive loads, such as induction motors, a drop in voltage increases the drawn current which may cause dangerous overheating in the motor. The undervoltage protection feature can be used to either cause a trip or generate an alarm when the voltage drops below a specified voltage setting for a specified time delay.

**Permissive Functions:** The undervoltage feature may be used to block the functioning of external devices by operating an output relay when the voltage falls below the specified voltage setting. The undervoltage feature may also be used to block the functioning of other elements through the block feature of those elements.

**Source Transfer Schemes:** In the event of an undervoltage, a transfer signal may be generated to transfer a load from its normal source to a standby or emergency power source.

The undervoltage elements can be programmed to have a Definite Time delay characteristic. The Definite Time curve operates when the voltage drops below the pickup level for a specified period of time. The time delay is adjustable from 0 to 600.00 seconds in steps of 10 ms. The undervoltage elements can also be programmed to have an inverse time delay characteristic. The undervoltage delay setting defines the family of curves shown below.

$$T = \frac{D}{\left(1 - \frac{V}{V_{pickup}}\right)}$$

where:  $T$  = Operating Time  
 $D$  = Undervoltage Delay Setting  
 ( $D = 0.00$  operates instantaneously)  
 $V$  = Secondary Voltage applied to the relay  
 $V_{pickup}$  = Pickup Level



**At 0% of pickup, the operating time equals the UNDERVOLTAGE DELAY setting.**

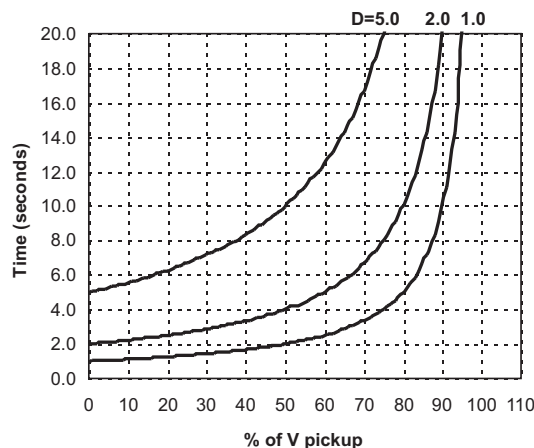


Figure 5-34: INVERSE TIME UNDERVOLTAGE CURVES



## 5.5.12 PHASE VOLTAGE

## a) PHASE UV1 / UV2 (PHASE UNDERVOLTAGE: ANSI 27P)

PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ VOLTAGE ELEMENTS ⇒ PHASE UNDERVOLTAGE1

■ PHASE	◀▶	PHASE UV1	Range: Disabled, Enabled
■ UNDERVOLTAGE1		FUNCTION: Disabled	
MESSAGE	▲▼	PHASE UV1 SIGNAL	Range: SRC 1, SRC 2,..., SRC 6
		SOURCE: SRC 1	
MESSAGE	▲▼	PHASE UV1 MODE:	Range: Phase to Ground, Phase to Phase
		Phase to Ground	
MESSAGE	▲▼	PHASE UV1	Range: 0.000 to 3.000 pu in steps of 0.001
		PICKUP: 1.000 pu	
MESSAGE	▲▼	PHASE UV1	Range: Definite Time, Inverse Time
		CURVE: Definite Time	
MESSAGE	▲▼	PHASE UV1	Range: 0.00 to 600.00 s in steps of 0.01
		DELAY: 1.00 s	
MESSAGE	▲▼	PHASE UV1 MINIMUM	Range: 0.000 to 3.000 pu in steps of 0.001
		VOLTAGE: 0.100 pu	
MESSAGE	▲▼	PHASE UV1 BLOCK:	Range: FlexLogic™ operand
		Off	
MESSAGE	▲▼	PHASE UV1	Range: Self-reset, Latched, Disabled
		TARGET: Self-reset	
MESSAGE	▲	PHASE UV1	Range: Disabled, Enabled
		EVENTS: Disabled	

The phase undervoltage element may be used to give a desired time-delay operating characteristic versus the applied fundamental voltage (phase to ground or phase to phase for Wye VT connection, or phase to phase only for Delta VT connection) or as a simple Definite Time element. The element resets instantaneously if the applied voltage exceeds the dropout voltage. The delay setting selects the minimum operating time of the phase undervoltage element. The minimum voltage setting selects the operating voltage below which the element is blocked (a setting of '0' will allow a dead source to be considered a fault condition).

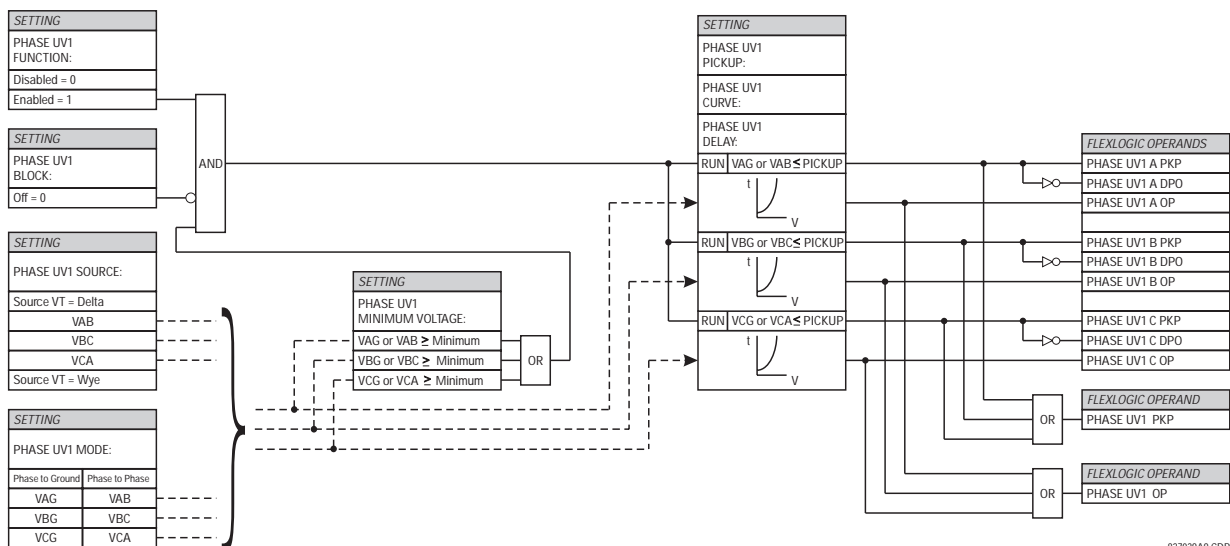


Figure 5-35: PHASE UV1 SCHEME LOGIC


## b) PHASE OV1 (PHASE OVERVOLTAGE: ANSI 59P)

PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ VOLTAGE ELEMENTS ⇒ PHASE OVERVOLTAGE1

<div> <div>■ PHASE</div> <div>■ OVERVOLTAGE1</div> </div>		<div> <div>◀▶</div> <div>PHASE OV1</div> <div>FUNCTION: Disabled</div> </div>	Range: Disabled, Enabled
	MESSAGE	<div> <div>▲▼</div> <div>PHASE OV1 SIGNAL</div> <div>SOURCE: SRC 1</div> </div>	Range: SRC 1, SRC 2,..., SRC 6
	MESSAGE	<div> <div>▲▼</div> <div>PHASE OV1</div> <div>PICKUP: 1.000 pu</div> </div>	Range: 0.000 to 3.000 pu in steps of 0.001
	MESSAGE	<div> <div>▲▼</div> <div>PHASE OV1 PICKUP</div> <div>DELAY: 1.00 s</div> </div>	Range: 0.00 to 600.00 s in steps of 0.01
	MESSAGE	<div> <div>▲▼</div> <div>PHASE OV1 RESET</div> <div>DELAY: 1.00 s</div> </div>	Range: 0.00 to 600.00 s in steps of 0.01
	MESSAGE	<div> <div>▲▼</div> <div>PHASE OV1 BLOCK:</div> <div>Off</div> </div>	Range: FlexLogic™ Operand
	MESSAGE	<div> <div>▲▼</div> <div>PHASE OV1</div> <div>TARGET: Self-reset</div> </div>	Range: Self-reset, Latched, Disabled
	MESSAGE	<div> <div>▲</div> <div>PHASE OV1</div> <div>EVENTS: Disabled</div> </div>	Range: Disabled, Enabled

5

The phase overvoltage element may be used as an instantaneous element with no intentional time delay or as a Definite Time element. The input voltage is the phase-to-phase voltage, either measured directly from Delta-connected VTs or as calculated from phase-to-ground (Wye) connected VTs. The specific voltages to be used for each phase are shown on the logic diagram.

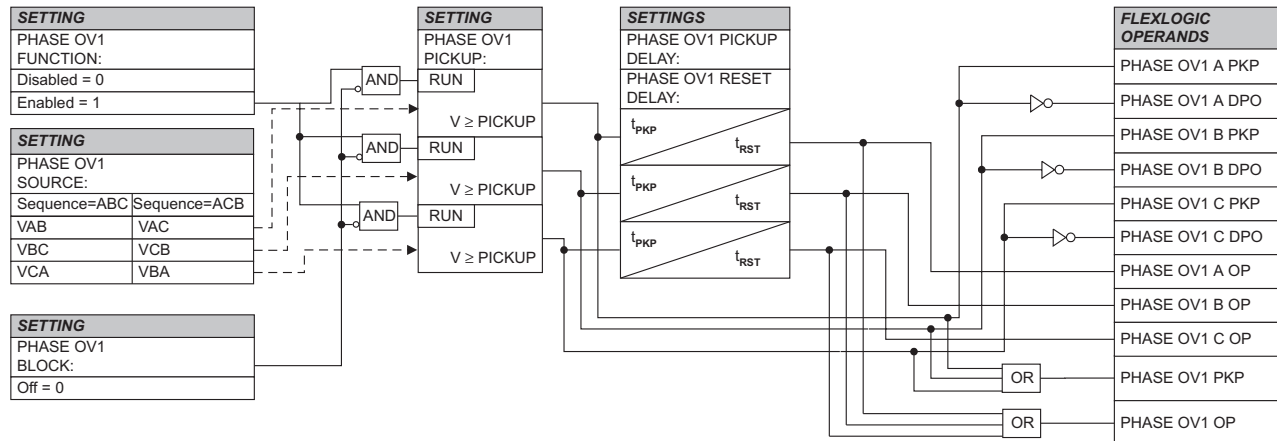

827066A2.VSD

Figure 5-36: PHASE OV1 SCHEME LOGIC

## 5.5.13 NEUTRAL VOLTAGE

## a) NEUTRAL OV1 (NEUTRAL OVERVOLTAGE: ANSI 59N)


PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ VOLTAGE ELEMENTS ⇒ NEUTRAL OV1

■ NEUTRAL OV1	◀▶	NEUTRAL OV1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	NEUTRAL OV1 SIGNAL SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	NEUTRAL OV1 PICKUP: 0.300 pu	Range: 0.000 to 1.250 pu in steps of 0.001
MESSAGE	▲▼	NEUTRAL OV1 PICKUP: DELAY: 1.00 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE	▲▼	NEUTRAL OV1 RESET: DELAY: 1.00 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE	▲▼	NEUTRAL OV1 BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	NEUTRAL OV1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	NEUTRAL OV1 EVENTS: Disabled	Range: Disabled, Enabled

The Neutral Overvoltage element can be used to detect asymmetrical system voltage condition due to a ground fault or to the loss of one or two phases of the source.

The element responds to the system neutral voltage (3V\_0), calculated from the phase voltages. The nominal secondary voltage of the phase voltage channels entered under **SETTINGS ⇒ SYSTEM SETUP ⇒ AC INPUTS ⇒ VOLTAGE BANK ⇒ PHASE VT SECONDARY** is the p.u. base used when setting the pickup level.

VT errors and normal voltage unbalance must be considered when setting this element. This function requires the VTs to be Wye connected.

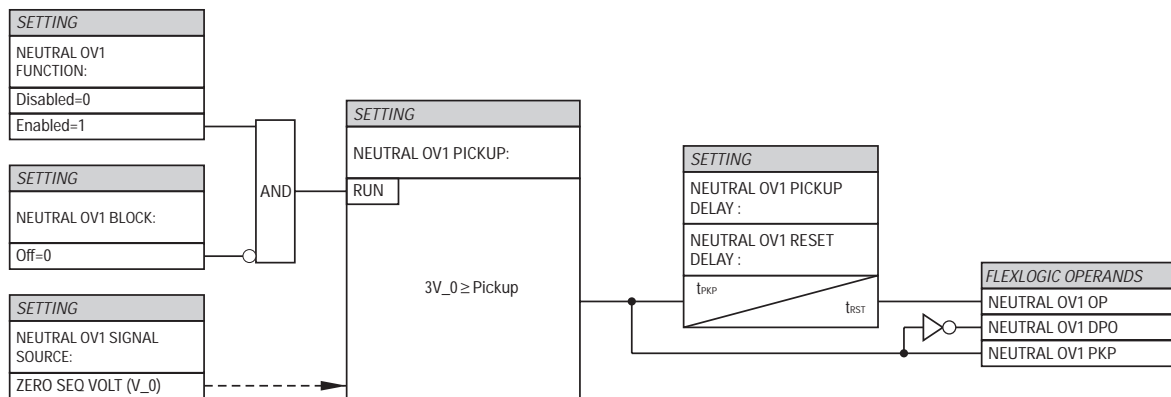

827848A1.CDR

Figure 5-37: NEUTRAL OVERVOLTAGE SCHEME LOGIC

## 5.5.14 NEGATIVE SEQUENCE VOLTAGE


## a) NEG SEQ OV (NEGATIVE SEQUENCE OVERVOLTAGE: ANSI 59\_2)

PATH: SETTINGS ⇨ GROUPED ELEMENTS ⇨ SETTING GROUP 1(8) ⇨ VOLTAGE ELEMENTS ⇨ NEG SEQ OV

■ NEG SEQ OV		NEG SEQ OV FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	NEG SEQ OV SIGNAL SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	NEG SEQ OV PICKUP: 0.300 pu	Range: 0.000 to 1.250 pu in steps of 0.001
MESSAGE	▲▼	NEG SEQ OV PICKUP DELAY: 0.50 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE	▲▼	NEG SEQ OV RESET DELAY: 0.50 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE	▲▼	NEG SEQ OV BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	NEG SEQ OV TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	NEG SEQ OV EVENTS: Disabled	Range: Disabled, Enabled

5

The negative sequence overvoltage element may be used to detect loss of one or two phases of the source, a reversed phase sequence of voltage, or a non-symmetrical system voltage condition.

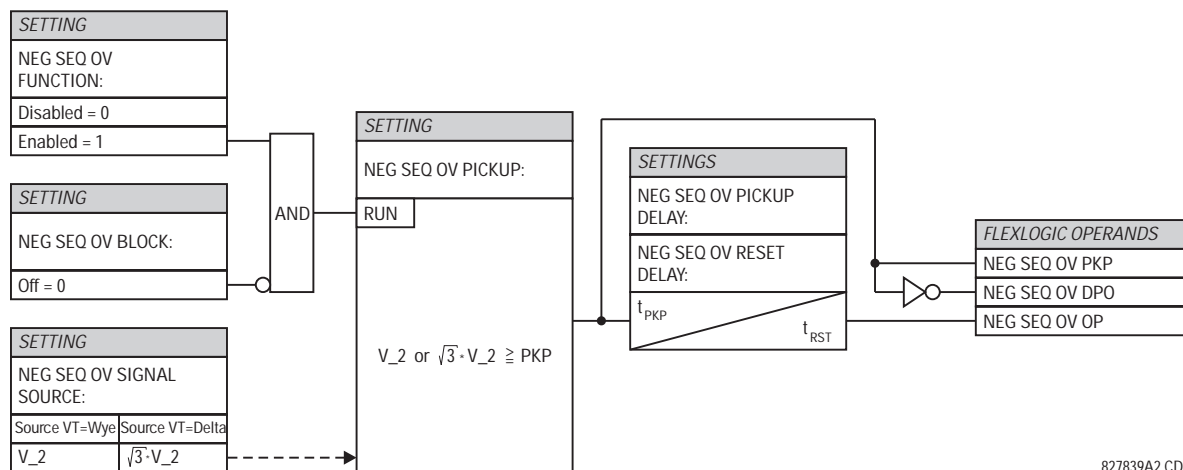

827839A2.CDR

Figure 5-38: NEG SEQ OV SCHEME LOGIC

## 5.5.15 AUXILIARY VOLTAGE

## a) AUXILIARY UV1 (AUXILIARY UNDERVOLTAGE: ANSI 27X)

PATH: SETTINGS ⇄ GROUPED ELEMENTS ⇄ SETTING GROUP 1(8) ⇄ VOLTAGE ELEMENTS ⇄ AUXILIARY UV1

■ AUXILIARY UV1	◀▶	AUX UV1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	AUX UV1 SIGNAL SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	AUX UV1 PICKUP: 0.700 pu	Range: 0.000 to 3.000 pu in steps of 0.001
MESSAGE	▲▼	AUX UV1 CURVE: Definite Time	Range: Definite Time, Inverse Time
MESSAGE	▲▼	AUX UV1 DELAY: 1.00 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE	▲▼	AUX UV1 MINIMUM: VOLTAGE: 0.100 pu	Range: 0.000 to 3.000 pu in steps of 0.001
MESSAGE	▲▼	AUX UV1 BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	AUX UV1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	AUX UV1 EVENTS: Disabled	Range: Disabled, Enabled

This element is intended for monitoring undervoltage conditions of the auxiliary voltage. The **PICKUP** selects the voltage level at which the time undervoltage element starts timing. The nominal secondary voltage of the auxiliary voltage channel entered under **SETTINGS** ⇄ **SYSTEM SETUP** ⇄ **AC INPUTS** ⇄ **VOLTAGE BANK X5 / AUXILIARY VT X5 SECONDARY** is the p.u. base used when setting the pickup level.

The **DELAY** setting selects the minimum operating time of the phase undervoltage element. Both **PICKUP** and **DELAY** settings establish the operating curve of the undervoltage element. The auxiliary undervoltage element can be programmed to use either Definite Time Delay or Inverse Time Delay characteristics. The operating characteristics and equations for both Definite and Inverse Time Delay are as for the Phase Undervoltage Element.

The element resets instantaneously. The minimum voltage setting selects the operating voltage below which the element is blocked.

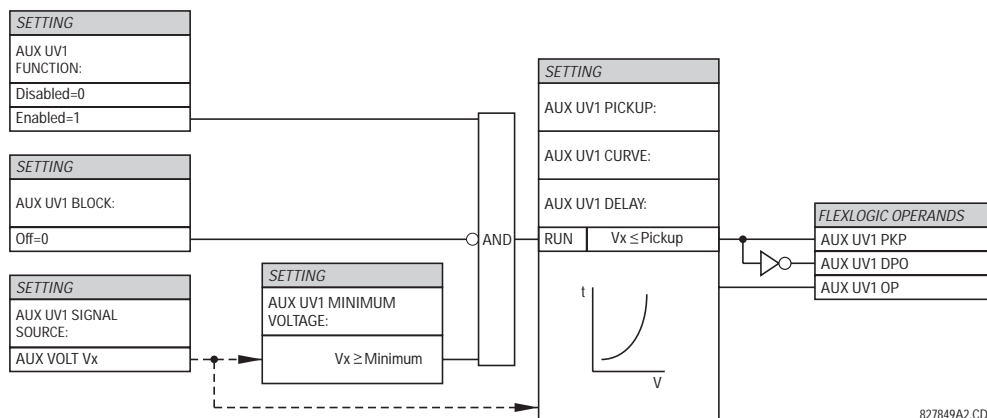


Figure 5-39: AUXILIARY UNDERVOLTAGE SCHEME LOGIC


## b) AUXILIARY OV1 (AUXILIARY OVERVOLTAGE: ANSI 59X)

PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ VOLTAGE ELEMENTS ⇒ AUXILIARY OV1

■ AUXILIARY OV1		AUX OV1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	AUX OV1 SIGNAL SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	AUX OV1 PICKUP: 0.300 pu	Range: 0.000 to 3.000 pu in steps of 0.001
MESSAGE	▲▼	AUX OV1 PICKUP DELAY: 1.00 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE	▲▼	AUX OV1 RESET DELAY: 1.00 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE	▲▼	AUX OV1 BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	AUX OV1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	AUX OV1 EVENTS: Disabled	Range: Disabled, Enabled

5

This element is intended for monitoring overvoltage conditions of the auxiliary voltage. In the G60, this element is used to detect stator ground faults by measuring the voltage across the neutral resistor. The nominal secondary voltage of the auxiliary voltage channel entered under **SETTINGS** ⇒ **SYSTEM SETUP** ⇒ **AC INPUTS** ⇒ **VOLTAGE BANK X5** ⇒ **AUXILIARY VT X5 SECONDARY** is the p.u. base used when setting the pickup level.

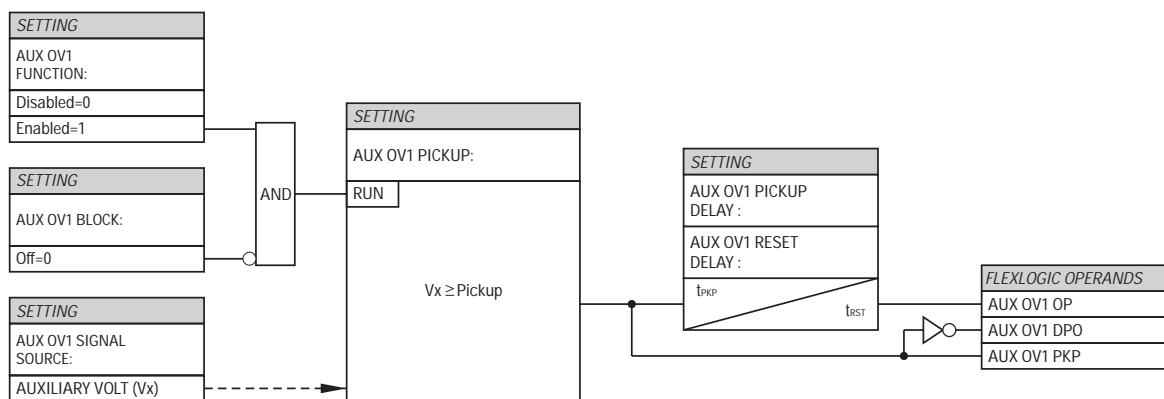

827836A2.CDR

Figure 5-40: AUXILIARY OVERVOLTAGE SCHEME LOGIC

## 5.5.16 VOLTS PER HERTZ

PATH: SETTINGS ⇨ ↓ GROUPED ELEMENTS ⇨ SETTING GROUP 1(8) ⇨ ↓ VOLTAGE ELEMENTS ⇨ ↓ VOLTS/HZ 1(2)

■ VOLTS/HZ 1		⏮ ⏭ ⏭ ⏮	VOLTS/HZ 1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	⏮ ⏭ ⏭ ⏮	VOLTS/HZ 1 SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6	
MESSAGE	⏮ ⏭ ⏭ ⏮	VOLTS/HZ 1 PICKUP: 1.00 pu	Range: 0.80 to 4.00 pu in steps of 0.01	
MESSAGE	⏮ ⏭ ⏭ ⏮	VOLTS/HZ 1 CURVE: Definite Time	Range: Definite Time, Inverse A, Inverse B, Inverse C, FlexCurve A, FlexCurve B	
MESSAGE	⏮ ⏭ ⏭ ⏮	VOLTS/HZ 1 TD MULTIPLIER: 1.00	Range: 0.00 to 600.00 in steps of 0.01	
MESSAGE	⏮ ⏭ ⏭ ⏮	VOLTS/HZ 1 T-RESET: 1.0 s	Range: 0.0 to 1000.0 s in steps of 0.1	
MESSAGE	⏮ ⏭ ⏭ ⏮	VOLTS/HZ 1 BLOCK: Off	Range: FlexLogic™ operand	
MESSAGE	⏮ ⏭ ⏭ ⏮	VOLTS/HZ 1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled	
MESSAGE	⏮ ⏭ ⏭ ⏮	VOLTS/HZ 1 EVENTS: Disabled	Range: Disabled, Enabled	

There are two V/Hz elements numbered 1 through 2.

A per-unit V/Hz calculation is made using the maximum value of the three phase voltage inputs or using the auxiliary voltage channel Vx input, if the Source is not configured with phase voltages. To use the V/Hz element with auxiliary voltage, set **SETTINGS** ↓ **SYSTEM SETUP** ⇨ ↓ **SIGNAL SOURCES** ⇨ **SOURCE 1(6)** ⇨ ↓ **SOURCE 1(6) PHASE VT** to "None" and **SOURCE 1(6) AUX VT** to the corresponding voltage input bank. If there is no voltage on the relay terminals in either case, the p.u. V/Hz value is automatically set to 0. The per unit value is established as per voltage and nominal frequency power system settings as follows:

1. If the phase voltage inputs defined in the source configuration are to be used for V/Hz element operation, then 1 pu is the selected **SETTINGS / POWER SYSTEM / VOLTAGE BANK N / PHASE** setting, divided by the **NOMINAL FREQUENCY** setting.
2. When the auxiliary voltage Vx is to be used (regarding the condition for "None" phase voltage setting mentioned above), then the 1 pu value is the **SETTINGS / POWER SYSTEM / VOLTAGE BANK / AUXILIARY VT SECONDARY** setting divided by the **SETTINGS / POWER SYSTEM / NOMINAL FREQUENCY** setting.
3. If V/Hz source is configured with both phase and auxiliary voltages, the maximum phase among the three voltage channels at any given point in time will be the input voltage signal for element operation, and therefore the p.u. value will be calculated as described in Step 1 above. If the measured voltage of all three phase voltages is 0, then the pu value becomes automatically 0 regardless of the presence of auxiliary voltage.

The element has a linear reset characteristic. The reset time can be programmed to match the cooling characteristics of the protected equipment. The element will fully reset from the trip threshold in **VOLTS/HZ T-RESET** seconds.

The V/Hz element may be used as an instantaneous element with no intentional time delay or as a Definite or Inverse timed element. The characteristics of the inverse curves are shown below.

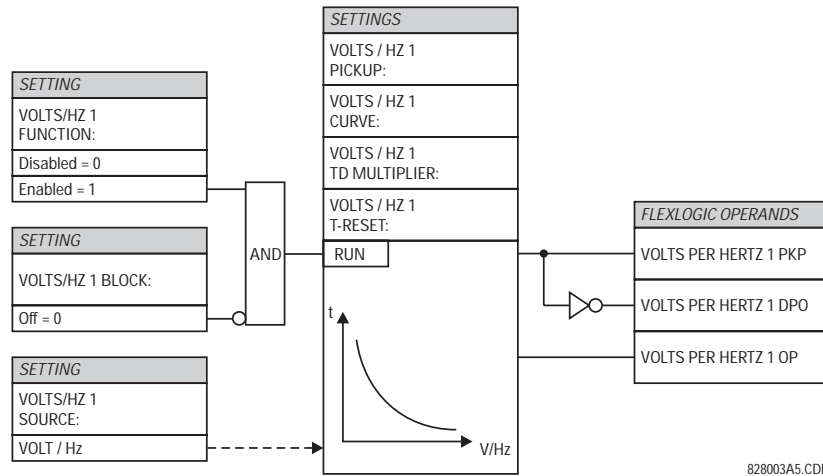


Figure 5-41: VOLTS PER HERTZ LOGIC



**VOLTS-PER-HERTZ CURVES****DEFINITE TIME:**

$T(\text{sec.}) = \text{TD Multiplier}$


For example, setting the TD Multiplier set to 20 means a time delay of 20 seconds to operate, when above the Volts/Hz PKP setting. In the same manner instantaneous operation can be obtained by setting the TD Multiplier to "0".

**INVERSE CURVE A:**

The curve for the inverse curve 1 shape is derived from the formula:

$$T = \frac{\text{TDM}}{\left[\left(\frac{V}{F}\right)/\text{Pickup}\right]^2 - 1} \text{ when } \frac{V}{F} > \text{Pickup}$$


where:  $T$  = Operating Time  
 $\text{TDM}$  = Time Delay Multiplier (delay in seconds)  
 $V$  = fundamental RMS value of voltage (V)  
 $F$  = frequency of voltage signal  
 $\text{Pickup}$  = volts-per-hertz pickup setpoint (V/Hz)

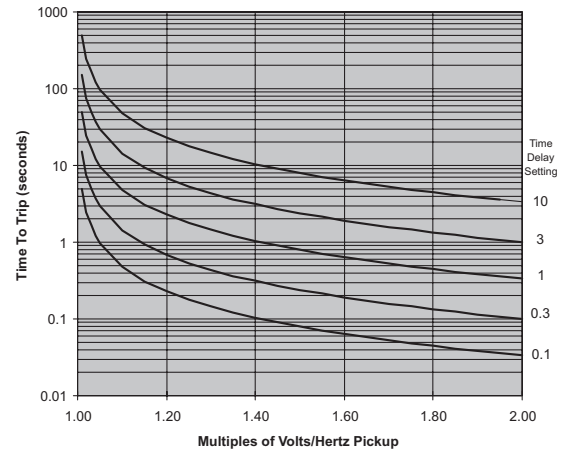**INVERSE CURVE B:**

The curve for the inverse curve 2 shape is derived from the formula:

$$T = \frac{\text{TDM}}{\left[\left(\frac{V}{F}\right)/\text{Pickup}\right] - 1} \text{ when } \frac{V}{F} > \text{Pickup}$$


where:  $T$  = Operating Time  
 $\text{TDM}$  = Time Delay Multiplier (delay in seconds)  
 $V$  = fundamental RMS value of voltage (V)  
 $F$  = frequency of voltage signal  
 $\text{Pickup}$  = volts-per-hertz pickup setpoint (V/Hz)

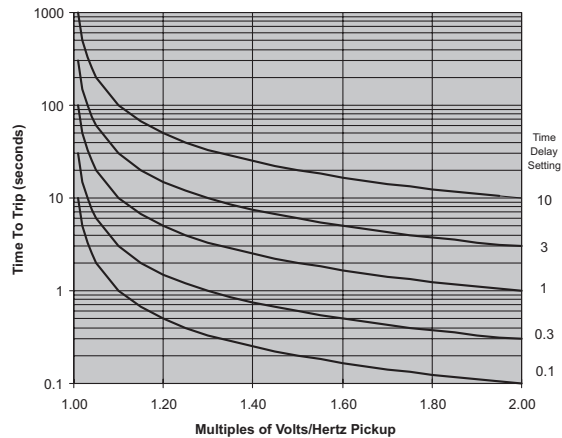**INVERSE CURVE C:**

The curve for the inverse curve 3 shape is derived from the formula:

$$T = \frac{\text{TDM}}{\left[\left(\frac{V}{F}\right)/\text{Pickup}\right]^{0.5} - 1} \text{ when } \frac{V}{F} > \text{Pickup}$$

where:  $T$  = Operating Time  
 $\text{TDM}$  = Time Delay Multiplier (delay in seconds)  
 $V$  = fundamental RMS value of voltage (V)  
 $F$  = frequency of voltage signal  
 $\text{Pickup}$  = volts-per-hertz pickup setpoint (V/Hz)

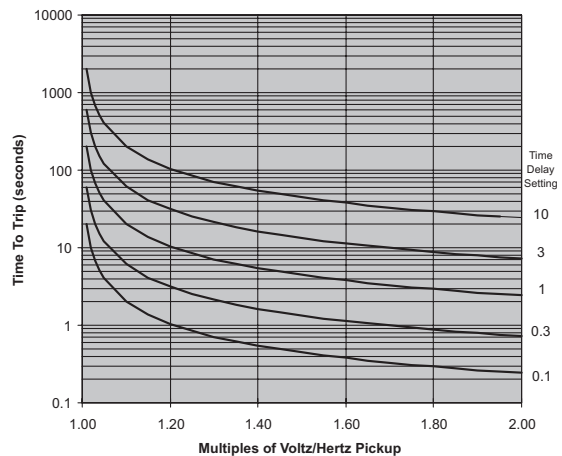

## 5.5.17 LOSS OF EXCITATION

PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ LOSS OF EXCITATION

■ LOSS OF ■ EXCITATION	◀▶	LOSS OF EXCITATION FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	LOSS OF EXCITATION SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	LOSS OF EXCITATION CENTER 1: 10.00 ohm	Range: 0.10 to 300.00 ohms in steps of 0.01
MESSAGE	▲▼	LOSS OF EXCITATION RADIUS 1: 8.00 ohm	Range: 0.10 to 300.00 ohms in steps of 0.01
MESSAGE	▲▼	LOSS OF EXCITATION UV SUPV 1: Enabled	Range: Disabled, Enabled
MESSAGE	▲▼	LOSS OF EXCITATION PKP DELAY1: 0.050 s	Range: 0.000 to 65.535 s in steps of 0.01
MESSAGE	▲▼	LOSS OF EXCITATION CENTER 2: 12.00 ohm	Range: 0.10 to 300.00 ohms in steps of 0.01
MESSAGE	▲▼	LOSS OF EXCITATION RADIUS 2: 10.00 ohm	Range: 0.10 to 300.00 ohms in steps of 0.01
MESSAGE	▲▼	LOSS OF EXCITATION UV SUPV 2: Enabled	Range: Disabled, Enabled
MESSAGE	▲▼	LOSS OF EXCITATION PKP DELAY2: 0.500 s	Range: 0.000 to 65.535 s in steps of 0.01
MESSAGE	▲▼	LOSS OF EXCITATION UV SUPV: 0.700 pu	Range: 0.000 to 1.250 pu in steps of 0.001
MESSAGE	▲▼	LOSS OF EXCIT BLK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	LOSS OF EXCITATION TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	LOSS OF EXCITATION EVENTS: Disabled	Range: Disabled, Enabled

The operating characteristic is shaped out of two offset mho circles shifted down along the imaginary axis as shown below.

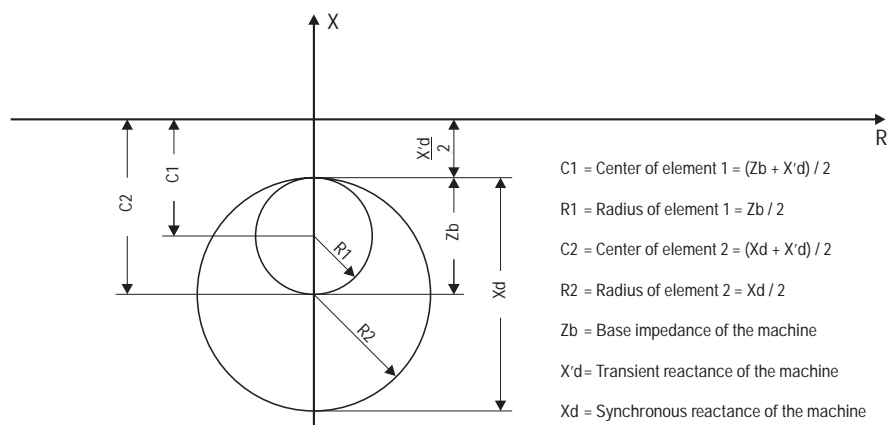


Figure 5-42: LOSS OF EXCITATION OPERATING CHARACTERISTICS

**STAGE 1 SETTINGS:**

The stage 1 characteristic is typically set to detect a loss of excitation for load conditions of 30% of the nominal or higher. This is achieved with a mho element with a diameter equal to the base impedance of the machine and an offset equal to half the machine transient reactance ( $X'd$ ).

$$\text{CENTER 1} = \frac{Z_b + X'd}{2}, \quad \text{RADIUS 1} = \frac{Z_b}{2}$$

The stage 1 element should be time delayed to allow for blocking by the VT fuse failure element (50 ms).


**STAGE 2 SETTINGS:**

The stage 2 characteristic is typically set to detect a loss of excitation for all load conditions. This is achieved with a mho element with a diameter equal to the synchronous reactance of the machine and an offset equal to half the machine transient reactance ( $X'd$ ).

$$\text{CENTER 2} = \frac{Xd + X'd}{2}, \quad \text{RADIUS 1} = \frac{Xd}{2}$$

During stable power swing conditions the positive-sequence impedance may momentarily enter the stage 2 characteristic. For security of the function under such conditions, it is recommended to delay stage 2 by a minimum of 0.5 seconds.

The element responds to the positive sequence impedance as shown below.

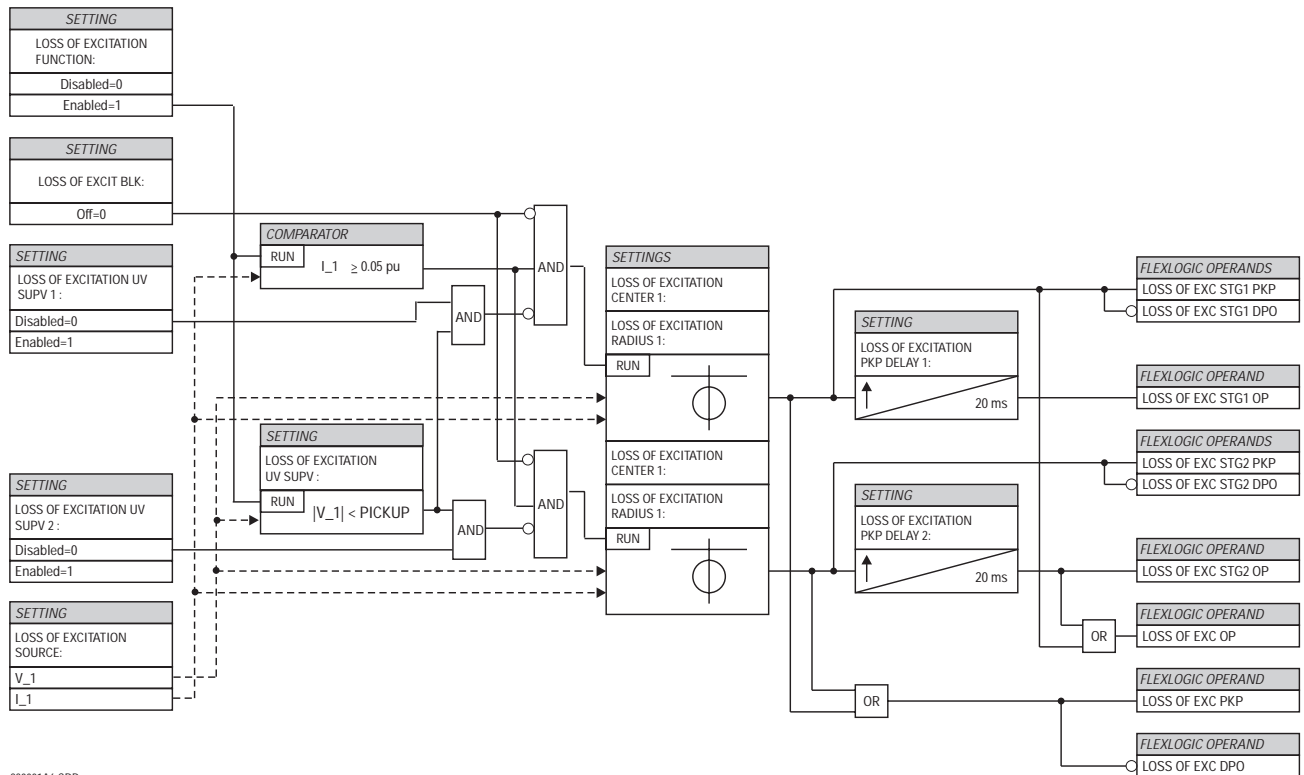

830001A6.CDR

**Figure 5-43: LOSS OF EXCITATION SCHEME LOGIC**

## 5.5.18 ACCIDENTAL ENERGIZATION

PATH: SETTINGS ↓ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ ↓ ACCIDENTAL ENERGIZATION

<div> <div>■ ACCIDENTAL</div> <div>■ ENERGIZATION</div> </div>		<div> <div>◀▶</div> <div>ACCDNT ENRG</div> <div>FUNCTION: Disabled</div> </div>	Range: Disabled, Enabled
	MESSAGE	<div> <div>▲▼</div> <div>ACCDNT ENRG SOURCE:</div> <div>SRC 1</div> </div>	Range: SRC 1, SRC 2,..., SRC 6
	MESSAGE	<div> <div>▲▼</div> <div>ACCDNT ENRG ARMING</div> <div>MODE: UV and Offline</div> </div>	Range: UV and Offline, UV or Offline
	MESSAGE	<div> <div>▲▼</div> <div>ACCDNT ENRG OC</div> <div>PICKUP: 0.300 pu</div> </div>	Range: 0.000 to 3.000 pu in steps of 0.001
	MESSAGE	<div> <div>▲▼</div> <div>ACCDNT ENRG UV</div> <div>PICKUP: 0.500 pu</div> </div>	Range: 0.000 to 3.000 pu in steps of 0.001
	MESSAGE	<div> <div>▲▼</div> <div>ACCDNT ENRG OFFLINE:</div> <div>Off</div> </div>	Range: FlexLogic™ operand
	MESSAGE	<div> <div>▲▼</div> <div>ACCDNT ENRG BLOCK:</div> <div>Off</div> </div>	Range: FlexLogic™ operand
	MESSAGE	<div> <div>▲▼</div> <div>ACCDNT ENRG TARGET:</div> <div>Self-reset</div> </div>	Range: Self-reset, Latched, Disabled
	MESSAGE	<div> <div>▲</div> <div>ACCDNT ENRG EVENTS:</div> <div>Disabled</div> </div>	Range: Disabled, Enabled

This element provides protection against energization while the generator is at standstill or reduced speed. The feature gets armed using either the AND or OR combination of the undervoltage and machine off-line conditions, as per user's choice. The undervoltage condition is determined based on the measured voltages. The machine off-line status is indicated by a dedicated FlexLogic™ operand. Once armed, the feature operates upon detecting an overcurrent condition in any of the stator phases.

This feature can also provide protection against poor synchronization.

**ACCDNT ENRG ARMING MODE:**

This setting specifies whether the feature gets armed by either of the undervoltage or machine off-line conditions ("UV or Off-line" value); or by both the conditions ("UV and Off-line" value). In any case, the element gets armed after 5 seconds of the appropriate condition and de-armed 250 msec after the arming condition (UV and/or Off-line) ceases.

- The "UV or Off-line" selection shall be made when the VTs are on the power system side of the disconnecting device. If this is the case, the measured voltages may be normal regardless of the status of the protected machine, thus the need for an OR condition.

The "UV or Off-line" value allows to provide protection against poor synchronization. During normal synchronization, there should be relatively low current measured. If however, synchronization is attempted when conditions are not appropriate, a large current would be measured shortly after closing the breaker. As the feature does not de-arm immediately, but after a 250 ms time delay, this will result in operation under imprecise synchronization. The **ACCDNT ENRG OC PICKUP** setting can control the required precision of synchronization.

- The "UV and Off-line" value shall be made when the VTs are on the generator side of the disconnecting device. If this is the case, both the undervoltage and machine off-line conditions are required to indicate that the protected generator is not energized.

**ACCDNT ENRG OC PICKUP:**


This setting specifies the current level required to operate the armed Accidental Energization element. If any of the phase current is above the **ACCDNT ENRG OC PICKUP** level, the feature operates.

**ACCDNT ENRG UV PICKUP:**

This setting specifies the voltage level required to arm the Accidental Energization element. All of the line-to-line voltages must drop below the **ACCDNT ENRG UV PICKUP** level in order to detect the undervoltage condition. The setting is entered in voltage pu values. As the element always responds to the line-to-line voltages, care must be applied in picking up the value depending on the VT connection.

**ACCDNT ENRG OFFLINE:**

This setting specifies the FlexLogic™ operand indicating that the protected generator is off-line.

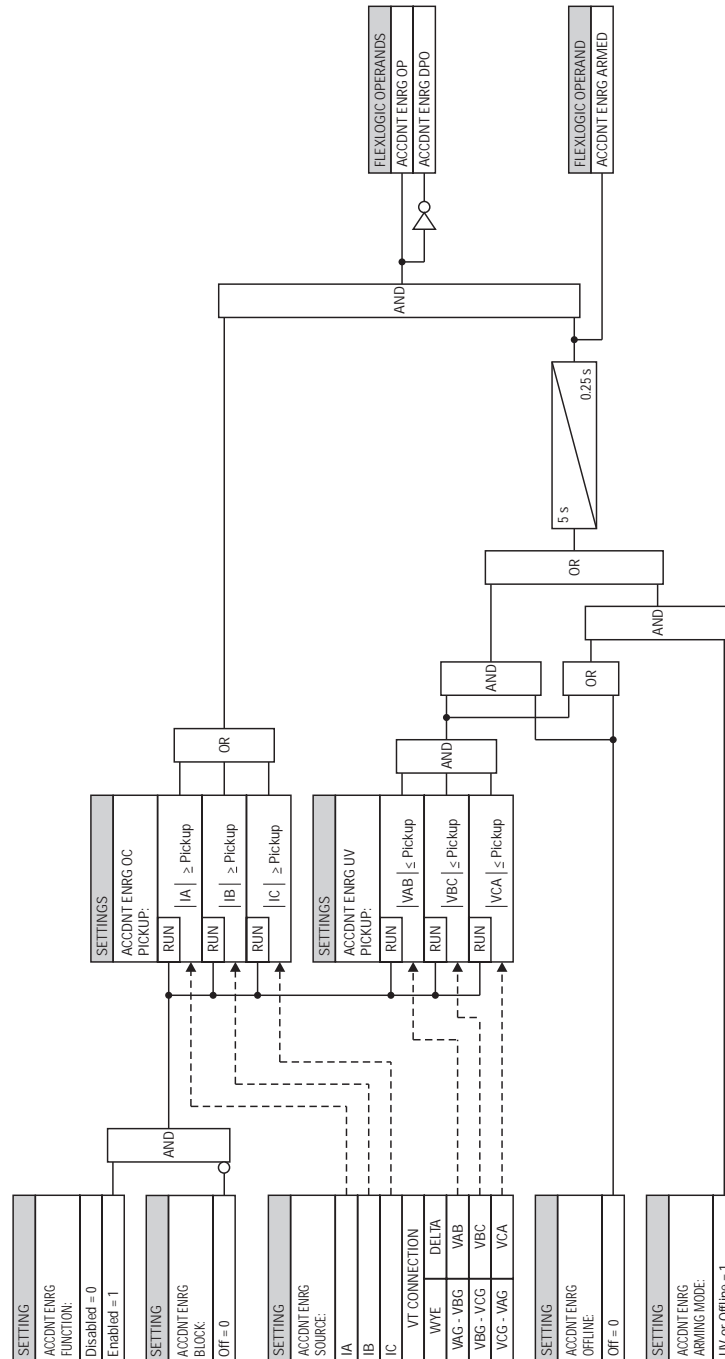

8300043.CDR

**Figure 5-44: ACCIDENTAL ENERGIZATION SCHEME LOGIC**

### 5.5.19 SENSITIVE DIRECTIONAL POWER

PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ SENSITIVE DIRECTIONAL POWER

<input checked="" type="checkbox"/> SENSITIVE			
<input checked="" type="checkbox"/> DIRECTIONAL POWER			
		<input checked="" type="checkbox"/> DIRECTIONAL <input checked="" type="checkbox"/> POWER 1	
MESSAGE		DIR POWER 1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE		DIR POWER 1 SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE		DIR POWER 1 RCA: 0°	Range: 0 to 359° in steps of 1
MESSAGE		DIR POWER 1 CALIBRATION: 0.00°	Range: 0 to 0.95° in steps of 0.05
MESSAGE		DIR POWER 1 STG1 SMIN: 0.100 pu	Range: -1.200 to 1.200 pu in steps of 0.001
MESSAGE		DIR POWER 1 STG1 DELAY: 0.50 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE		DIR POWER 1 STG2 SMIN: 0.100 pu	Range: -1.200 to 1.200 pu in steps of 0.001
MESSAGE		DIR POWER 1 STG2 DELAY: 20.00 s	Range: 0.00 to 600.00 s in steps of 0.01
MESSAGE		DIR POWER 1 BLK: Off	Range: FlexLogic™ operand
MESSAGE		DIR POWER 1 TARGET: Self-Reset	Range: Self-Reset, Latched, Disabled
MESSAGE		DIR POWER 1 EVENTS: Disabled	Range: Disabled, Enabled
		<input checked="" type="checkbox"/> DIRECTIONAL <input checked="" type="checkbox"/> POWER 2	

The Directional Power element responds to three-phase active power and is designed for reverse power and low forward power applications for synchronous machines or interconnections involving co-generation. The relay measures the three-phase power from either full set of wye-connected VTs or full-set of delta-connected VTs. In the latter case, the two-wattmeter method is used. Refer to the UR METERING CONVENTIONS section in Chapter 6 for conventions regarding the active and reactive powers used by the Directional Power element.

The element has an adjustable characteristic angle and minimum operating power as shown in the DIRECTIONAL POWER CHARACTERISTIC diagram.


The element responds to the following condition:

$$P\cos\theta + Q\sin\theta > S_{MIN}$$

where:  $P$  and  $Q$  are active and reactive powers as measured per the UR convention,  
 $\theta$  is a sum of the element characteristic (RCA) and calibration (CALIBRATION) angles, and  
 $SMIN$  is the minimum operating power


The operating quantity is available for display as under **ACTUAL VALUES** ⇒ **METERING** ⇒ **SENSITIVE POWER 1(2)**.

The element has two independent (as to the pickup and delay settings) stages for alarm and trip, respectively.

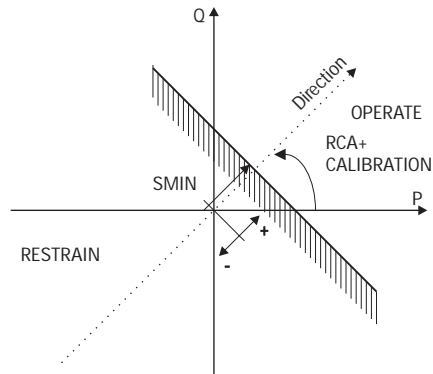

**Figure 5-45: DIRECTIONAL POWER CHARACTERISTIC**

By making the characteristic angle adjustable and providing for both negative and positive values of the minimum operating power a variety of operating characteristics can be achieved as presented in the figure below. For example, Figure (a) below shows settings for reverse power application, while Figure (b) shows settings for low forward power application.

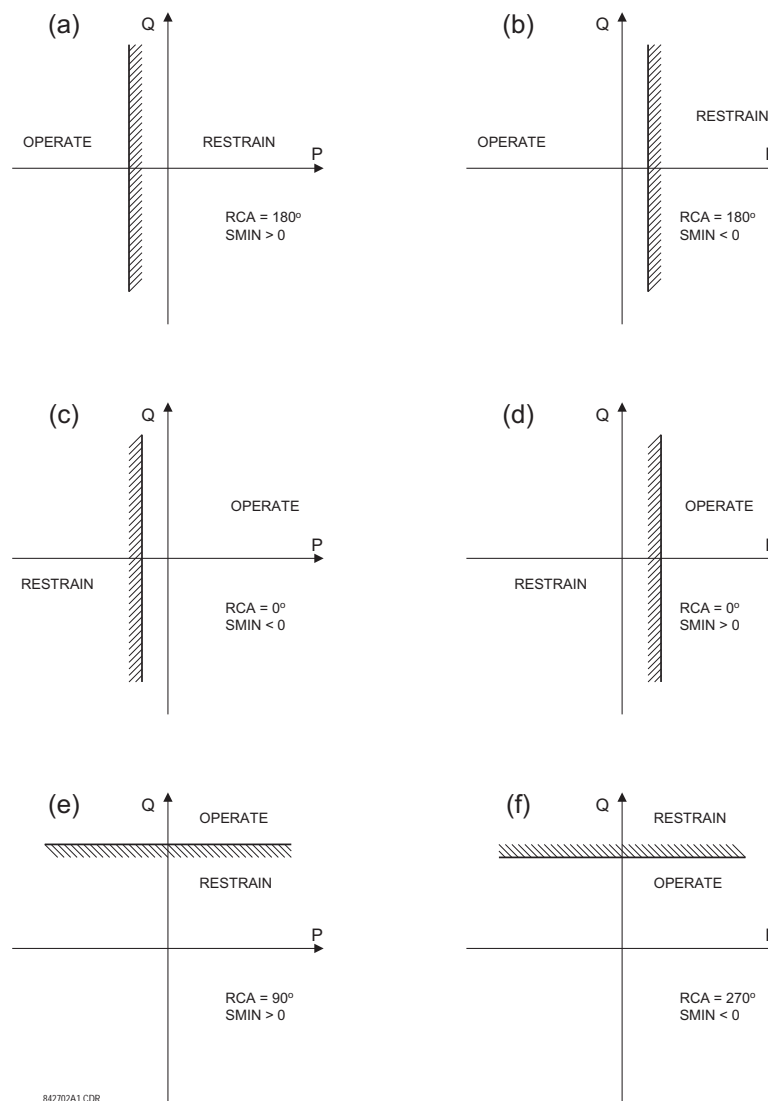

**Figure 5-46: DIRECTIONAL POWER ELEMENT SAMPLE APPLICATIONS**

**DIR POWER 1 RCA:**

Specifies the relay characteristic angle (RCA) for the directional power function. Application of this setting is threefold:

- It allows the element to respond to active or reactive power in any direction (active overpower, active underpower, etc.)
- Together with a precise calibration angle, it allows compensation for any CT and VT angular errors to permit more sensitive settings.
- It allows for required direction in situations when the voltage signal is taken from behind a delta-wye connected power transformer and the phase angle compensation is required.

For example, the active overpower characteristic is achieved by setting **DIR POWER X RCA** = 0°, reactive overpower by setting **DIR POWER X RCA** = 90°, active underpower by setting **DIR POWER X RCA** = 180°, and reactive underpower by settings **DIR POWER X RCA** = 270°.

**DIR POWER 1 CALIBRATION:**

This setting allows the RCA to change in small steps of 0.05°. This may be useful when a small difference in VT and CT angular errors is to be compensated to permit more sensitive settings. This setting virtually enables calibration of the Directional Power function in terms of the angular error of applied VTs and CTs.

The element responds to the sum of the **DIR POWER X RCA** and **DIR POWER X CALIBRATION** settings.

**DIR POWER 1 STG1 SMIN:**


This setting specifies the minimum power as defined along the RCA angle for the stage 1 of the element. The positive values imply a shift towards the operate region along the RCA line. The negative values imply a shift towards the restrain region along the RCA line. Refer to the **DIRECTIONAL POWER SAMPLE APPLICATIONS** figure for an illustration. Together with the RCA, this setting enables a wide range of operating characteristics. This setting applies to three-phase power and is entered in pu. The base quantity is  $3 \times \text{VT pu base} \times \text{CT pu base}$ .

For example, a setting of 2% for a 200 MW machine, is  $0.02 \times 200 \text{ MW} = 4 \text{ MW}$ . If 7.967 kV is a primary VT voltage and 10 kA is a primary CT current, the source pu quantity is 239 MVA, and thus, SMIN should be set at  $4 \text{ MW} / 239 \text{ MVA} = 0.0167 \text{ pu} \approx 0.017 \text{ pu}$ . If the reverse power application is considered, RCA = 180° and SMIN = 0.017 pu.

The element drops out if the magnitude of the positive-sequence current becomes virtually zero, that is, it drops below the cutoff level.

**DIR POWER 1 STG1 DELAY:**

This setting specifies a time delay for the stage 1 of the element. For reverse power or low forward power applications for a synchronous machine, stage 1 is typically applied for alarming and stage 2 for tripping.

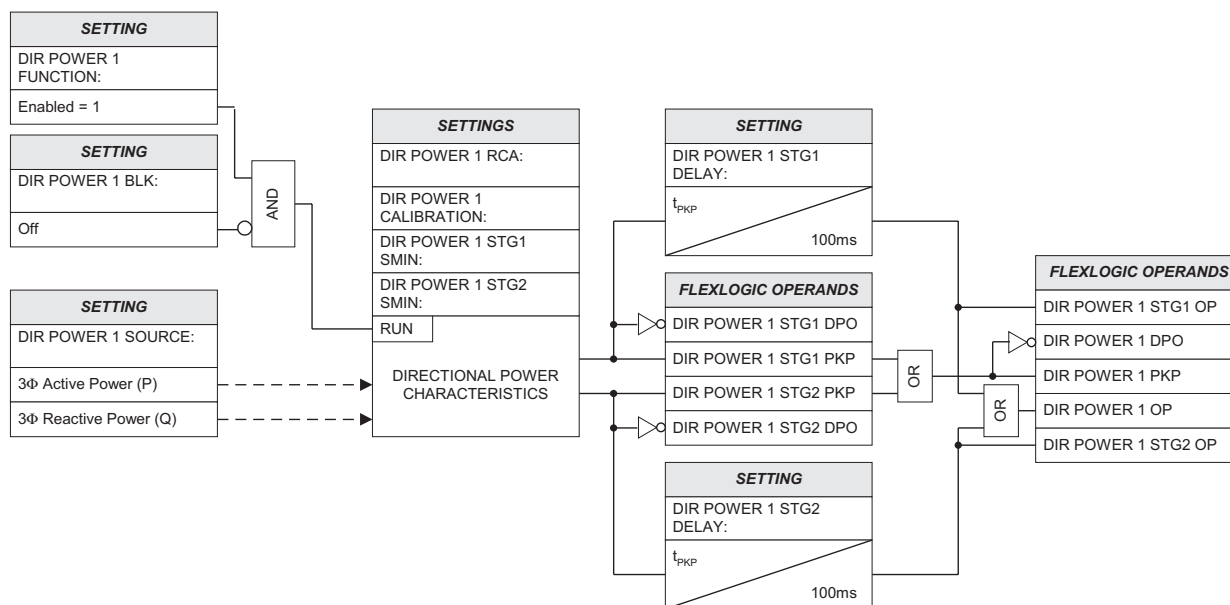

842003A2.CDR

Figure 5-47: DIRECTIONAL POWER SCHEME LOGIC



## 5.5.20 STATOR GROUND

PATH: SETTINGS ⇒ GROUPED ELEMENTS ⇒ SETTING GROUP 1(8) ⇒ STATOR GROUND

<input checked="" type="checkbox"/> STATOR <input checked="" type="checkbox"/> GROUND		<b>STATOR GROUND</b> SOURCE: SRC1	Range: SRC1, SRC2,..., SRC6
MESSAGE		<input checked="" type="checkbox"/> 100% STATOR <input checked="" type="checkbox"/> GROUND	See page 5-96.
MESSAGE		<input checked="" type="checkbox"/> 3RD HARM NTRL <input checked="" type="checkbox"/> UNDERVOLTAGE	See page 5-98.

Two means of stator ground fault protection are provided:

- 100% Stator Ground protection that uses third harmonic signals at the neutral of the machine and in the zero-sequence voltage of the machine terminals.
- Third Harmonic Neutral Undervoltage protection that responds to the 3rd harmonic in the voltage at the machine neutral point.

The two protection elements are configured through their individual setting menus. They share the **STATOR GROUND SOURCE** setting.

**STATOR GROUND SOURCE:**

This setting specifies a signal source used to provide current and voltage signals for stator ground fault protection. For the 100% Stator Ground protection function, the source shall be configured as follows:

- Phase voltages measured at the terminal of the machine shall be configured as phase VT banks. The element extracts the 3rd harmonic of the zero-sequence voltage from the phase voltages in order to operate. The VTs must be connected in WYE.
- Voltage measured at the neutral of the machine shall be configured as the Aux VT bank. The element extracts the 3rd harmonic of the auxiliary voltage from the source in order to operate.

For the Third Harmonic Neutral Undervoltage protection function, the source shall be configured as follows:

- Phase voltages measured at the terminal of the machine shall be configured as phase VT banks. The element uses the voltages to measure the power at the machine terminals for power supervision.
- Phase currents measured at the terminal of the machine shall be configured as phase CT banks. The element uses the currents to measure the power at the machine terminals for power supervision.
- Voltage measured at the neutral of the machine shall be configured as the Aux VT bank. The element extracts the 3rd harmonic of the auxiliary voltage from the source in order to operate.

## 5.5.21 100% STATOR GROUND

PATH: SETTINGS ⇨ GROUPED ELEMENTS ⇨ SETTING GROUP 1(8) ⇨ STATOR GROUND ⇨ 100% STATOR GROUND

<div> <div>100% STATOR</div> <div>GROUND</div> </div>		100% STATOR GROUND FUNCTION: Disabled	Range: Disabled, Enabled
	MESSAGE	100% STATOR GND STG1 PICKUP: 0.150 pu	Range: 0.000 to 0.250 pu in steps of 0.001
	MESSAGE	100% STATOR GND STG1 DELAY: 1.00 s	Range: 0.00 to 600.00 s in steps of 0.01
	MESSAGE	100% STATOR GND STG1 SUPV: 0.0075 pu	Range: 0.0010 to 0.1000 pu in steps of 0.0001
	MESSAGE	100% STATOR GND STG2 PICKUP: 0.150 pu	Range: 0.000 to 0.250 pu in steps of 0.001
	MESSAGE	100% STATOR GND STG2 DELAY: 1.00 s	Range: 0.00 to 600.00 s in steps of 0.01
	MESSAGE	100% STATOR GND STG2 SUPV: 0.0075 pu	Range: 0.0010 to 0.1000 pu in steps of 0.0001
	MESSAGE	100% STATOR GND BLK: Off	Range: FlexLogic™ operand
	MESSAGE	100% STATOR GROUND TARGET: Self-reset	Range: Self-reset, Latched, Disabled
	MESSAGE	100% STATOR GROUND EVENTS: Disabled	Range: Disabled, Enabled

The 100% Stator Ground function responds to 3rd harmonic voltage measured at the generator neutral and output terminals. When used in conjunction with the Neutral Overvoltage (fundamental frequency) function, it provides 100% ground fault protection of the stator windings. Since the amount of third harmonic voltage that appears in the neutral is both load and machine dependent, the protection method of choice is an adaptive method. The following formula is used to create an adaptive operating quantity based on the amount of third harmonic that appears at the generator terminals.

$$\frac{|V_{N(3rd)}|}{|V_{N(3rd)} + V_{0(3rd)}|} < \text{Pickup} \quad \text{and} \quad \frac{|V_{0(3rd)}|}{|V_{N(3rd)} + V_{0(3rd)}|} > 1 - \text{Pickup} \quad \text{and} \quad |V_{N(3rd)} + V_{0(3rd)}| > \text{Supervision}$$

where:  $V_{N(3rd)}$  is a magnitude of the 3rd harmonic in the voltage measured at the machine neutral point measured via an auxiliary channel of the VT bank, and

$V_{0(3rd)}$  is a magnitude of the 3rd harmonic in the zero-sequence voltage measured at the machine terminals.



**This element requires WYE connected VTs for measurement of the 3rd harmonic in the zero-sequence voltage at the generator output terminals.**

**100% STATOR GND STG1(2) PICKUP:**


This setting specifies a pickup level for the operating quantity. It may be beneficial to measure the operating quantity under various load conditions for a particular machine in order to optimize this setting. This can be achieved using the Actual Values menu of the G60.

**100% STATOR GND STG1(2) DELAY:**

This setting specifies a time delay required to operate after the pickup condition is established.

**100% STATOR GND STG1(2) SUPV:**

This setting specifies a signal level supervision for the vectorial sum of the 3rd harmonic at the machine neutral and in the zero-sequence terminal voltage. The setting is entered as a pu of the terminal voltages. Different settings may be considered for stages 1 and 2 as one of them could be used for alarm and the other for trip. The safe value of this setting could be established after putting a given machine into service and reading the quantity from the relay under **ACTUAL VALUE** menu.

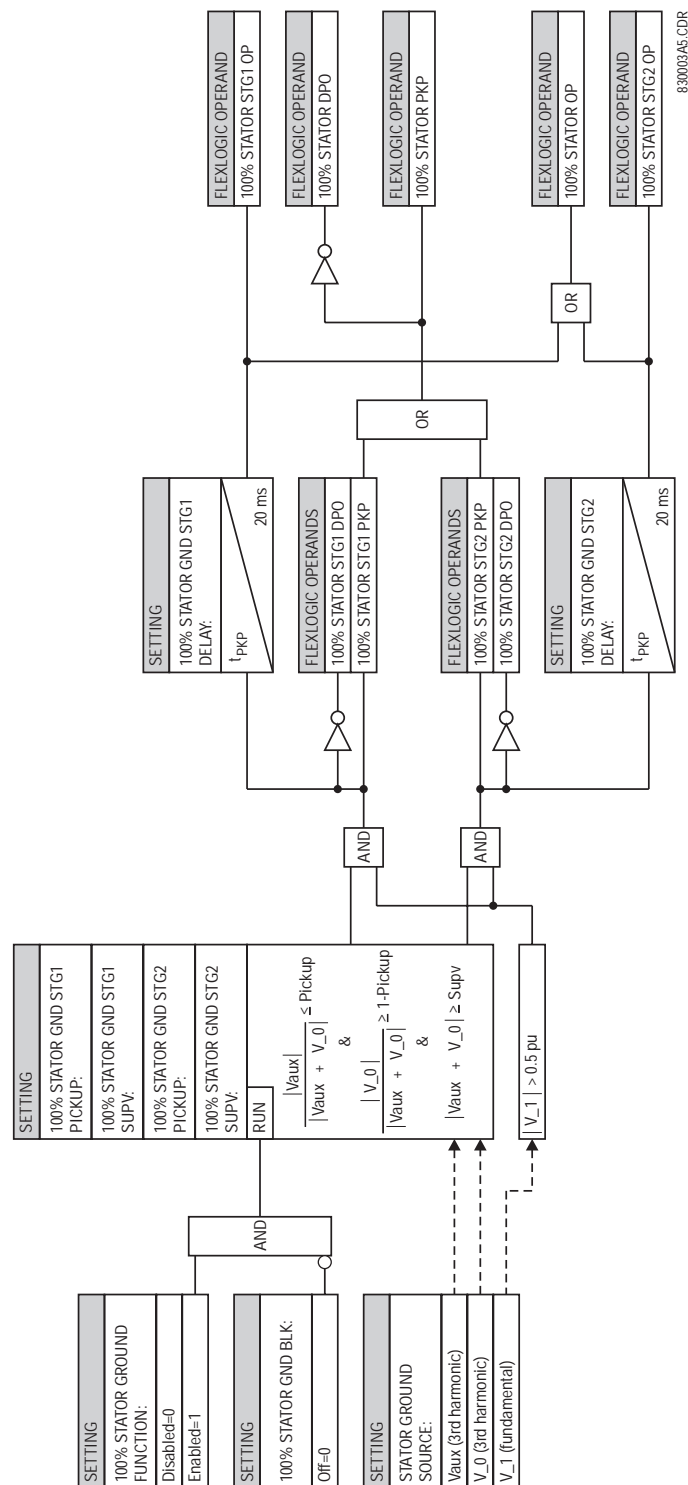

### Figure 5–48: 100% STATOR GROUND SCHEME LOGIC

## 5.5.22 THIRD HARMONIC NEUTRAL UNDERVOLTAGE

PATH: SETTINGS ⇨ GROUPED ELEMENTS ⇨ SETTING GROUP 1(8) ⇨ STATOR GROUND ⇨ 3RD HARM NTRL UNDERVOLTAGE

<div><div>■ 3RD HARM NTRL</div><div>■ UNDERVOLTAGE</div></div>		<div><div>◀▶</div><div>3RD HARM NTRL UV FUNCTION: Disabled</div></div>	Range: Disabled, Enabled
MESSAGE	<div><div>▲▼</div><div>3RD HARM NTRL UV TERMINAL SRC: SRC1</div></div>	Range: SRC1, SRC2,..., SRC6	
MESSAGE	<div><div>▲▼</div><div>3RD HARM NTRL UV NEUTRAL SRC: SRC1</div></div>	Range: SRC1, SRC2,..., SRC6	
MESSAGE	<div><div>▲▼</div><div>3RD HARM NTRL UV PICKUP: 0.300 pu</div></div>	Range: 0.000 to 3.000 pu in steps of 0.001	
MESSAGE	<div><div>▲▼</div><div>3RD HARM NTRL UV PKP DELAY: 0.00 s</div></div>	Range: 0.00 to 600.00 s in steps of 0.01	
MESSAGE	<div><div>▲▼</div><div>3RD HARM NTRL UV MAX POWER: 0.200 pu</div></div>	Range: 0.000 to 1.250 pu in steps of 0.001	
MESSAGE	<div><div>▲▼</div><div>3RD HARM NTRL UV MIN POWER: 0.200 pu</div></div>	Range: 0.000 to 1.250 pu in steps of 0.001	
MESSAGE	<div><div>▲▼</div><div>3RD HARM NTRL UV VOLT SUPV: 0.500 pu</div></div>	Range: 0.000 to 1.250 pu in steps of 0.001	
MESSAGE	<div><div>▲▼</div><div>3RD HARM NTRL UV BLK: Off</div></div>	Range: FlexLogic™ operand	
MESSAGE	<div><div>▲▼</div><div>3RD HARM NTRL UV TARGET: Self-reset</div></div>	Range: Self-reset, Latched, Disabled	
MESSAGE	<div><div>▲</div><div>3RD HARM NTRL UV EVENTS: Disabled</div></div>	Range: Disabled, Enabled	

The Third Harmonic Neutral Undervoltage function detects a loss of 3rd harmonic voltage at the generator neutral. The percentage of stator winding covered by this function depends on the pickup setting and the amount of third harmonic generated by the machine at the time of the fault. A settable window of forward power can supervise this element for enhanced security. The element is also supervised by positive sequence voltage measured at the generator output terminals. This element can be used with either wye or delta connected VTs on the terminal side and requires the machine neutral voltage to be connected via an auxiliary voltage channel of a relay VT bank.

**3RD HARM NTRL UV TERMINAL SRC:**

This setting specifies the signal source that includes current and voltage signals at the machine terminals. The minimum and maximum power supervising functions use the active power as measured by this source.

**3RD HARM NTRL UV NEUTRAL SRC:**

This setting specifies the signal source that includes the voltage at the machine neutral. This voltage is to be connected to the auxiliary channel of the VT bank. The element responds to the magnitude of the 3rd harmonic of this signal.

**3RD HARM NTRL UV PICKUP:**

This setting specifies the pickup level for the magnitude of the 3rd harmonic of the neutral voltage. The voltage is to be connected as the auxiliary voltage of the source indicated by the **3RD HARM NTRL UV NEUTRAL SRC** setting. This setting is entered in pu of the nominal auxiliary voltage.

The magnitude of the 3rd harmonic voltage at the neutral point is monitored in **ACTUAL VALUES ⇨ 100% STATOR GROUND**. Measuring the actual value of the operating quantity for a specific machine under variety of load conditions may be helpful when selecting the pickup threshold for this feature.

**3RD HARM NTRL UV MAX POWER:**

This setting specifies the maximum active power, as measured at the source indicated by the **3RD HARM NTRL UV TERMINAL SRC** setting, that inhibits this protection function. If the measured power is below this setting but above the **3RD HARM NTRL UV MIN POWER** setting the element shall not operate.


This setting applies to three-phase power and is entered in pu. The base quantity is  $3 \times V_T \text{ pu base} \times CT \text{ pu base}$ .

For example, a setting of 20% for a 200 MW machine, is  $0.20 \times 200 \text{ MW} = 40 \text{ MW}$ . If 7.967 kV is a primary VT voltage and 10 kA is a primary CT current, the source pu quantity is 239 MVA, and thus, the pu power setting is  $40 \text{ MW} / 239 \text{ MVA} = 0.167 \text{ pu}$ .

**3RD HARM NTRL UV MIN POWER:**

This setting specifies the minimum active power, as measured at the source indicated by the **3RD HARM NTRL UV TERMINAL SRC** setting, that inhibits this protection function. If the measured power is above this setting but below the **3RD HARM NTRL UV MAX POWER** setting the element shall not operate.

This setting applies to three-phase power and is entered in pu. The base quantity is  $3 \times V_T \text{ pu base} \times CT \text{ pu base}$ .

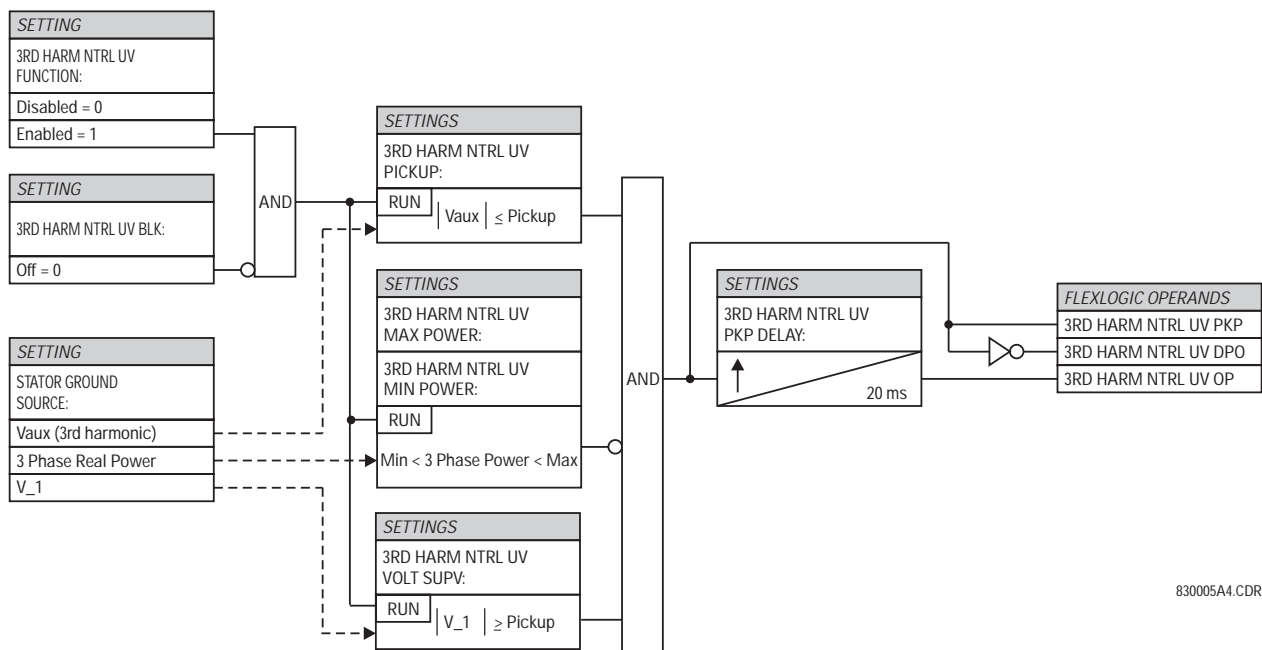


**Figure 5-49: THIRD HARMONIC NEUTRAL UNDERVOLTAGE SCHEME LOGIC**

## 5.6.1 OVERVIEW

CONTROL elements are generally used for control rather than protection. See the INTRODUCTION TO ELEMENTS section at the front of this chapter for further information.

## 5.6.2 SETTING GROUPS

PATH: SETTINGS ⇌ CONTROL ELEMENTS ⇌ SETTINGS GROUPS

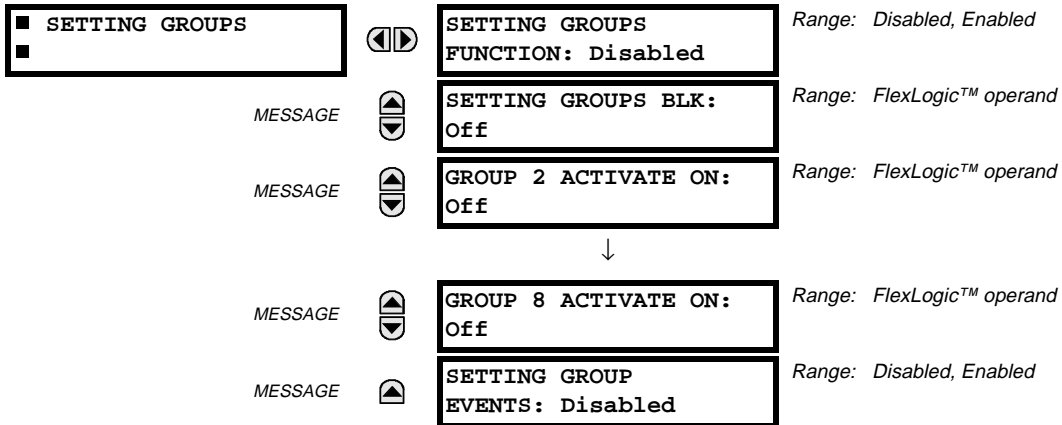

5

The Setting Groups menu controls the activation/deactivation of up to eight possible groups of settings in the **GROUPED ELEMENTS** settings menu. The faceplate 'SETTINGS IN USE' LEDs indicate which active group (with a non-flashing energized LED) is in service.

The **SETTING GROUPS BLK** setting prevents the active setting group from changing when the FlexLogic™ parameter is set to "On". This can be useful in applications where it is undesirable to change the settings under certain conditions, such as the breaker being open.

Each **GROUP ~ ACTIVATE ON** setting selects a FlexLogic™ operand which, when set, will make the particular setting group active for use by any grouped element. A priority scheme ensures that only one group is active at a given time – the highest-numbered group which is activated by its ACTIVATE ON parameter takes priority over the lower-numbered groups. There is no "activate on" setting for group 1 (the default active group), because group 1 automatically becomes active if no other group is active.

The relay can be set up via a FlexLogic™ equation to receive requests to activate or de-activate a particular non-default settings group. The following FlexLogic™ equation (see the figure below) illustrates requests via remote communications (e.g. VIRTUAL INPUT 1) or from a local contact input (e.g. H7a) to initiate the use of a particular settings group, and requests from several overcurrent pickup measuring elements to inhibit the use of the particular settings group. The assigned VIRTUAL OUTPUT 1 operand is used to control the ON state of a particular settings group.

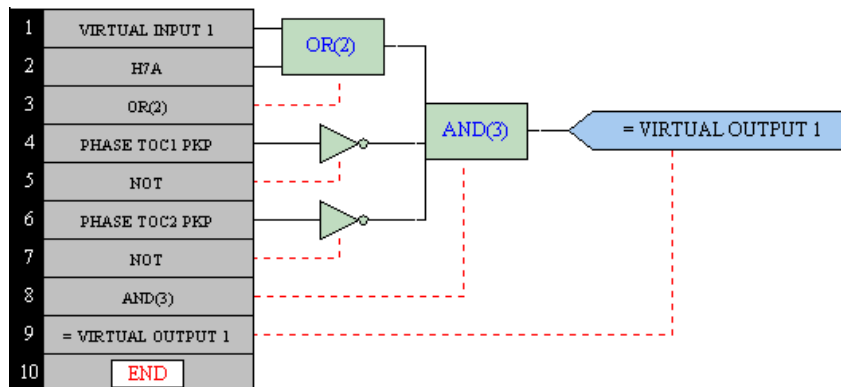


Figure 5-50: EXAMPLE FLEXLOGIC™ CONTROL OF A SETTINGS GROUP

## 5.6.3 UNDERFREQUENCY

PATH: SETTINGS ⇌ CONTROL ELEMENTS ⇌ UNDERFREQUENCY ⇌ UNDERFREQUENCY 1(6)

■ UNDERFREQUENCY 1	◀▶	UNDFREQ 1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	UNDFREQ 1 BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	UNDFREQ 1 SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	UNDFREQ 1 MIN VOLT/AMP: 0.10 pu	Range: 0.10 to 1.25 pu in steps of 0.01
MESSAGE	▲▼	UNDFREQ 1 PICKUP: 59.50 Hz	Range: 20.00 to 65.00 Hz in steps of 0.01
MESSAGE	▲▼	UNDFREQ 1 PICKUP DELAY: 2.000 s	Range: 0.000 to 65.535 s in steps of 0.001
MESSAGE	▲▼	UNDFREQ 1 RESET DELAY : 2.000 s	Range: 0.000 to 65.535 s in steps of 0.001
MESSAGE	▲▼	UNDFREQ 1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲	UNDFREQ 1 EVENTS: Disabled	Range: Disabled, Enabled

There are six identical underfrequency elements, numbered from 1 through 6 inclusive.

The steady-state frequency of a power system is a certain indicator of the existing balance between the generated power and the load. Whenever this balance is disrupted through the loss of an important generating unit or the isolation of part of the system from the rest of the system, the effect will be a reduction in frequency. If the control systems of the system generators do not respond fast enough, the system may collapse. A reliable method to quickly restore the balance between load and generation is to automatically disconnect selected loads, based on the actual system frequency. This technique, called "load-shedding", maintains system integrity and minimize widespread outages. After the frequency returns to normal, the load may be automatically or manually restored.

The **UNDFREQ 1 SOURCE** setting is used to select the source for the signal to be measured. The element first checks for a live phase voltage available from the selected Source. If voltage is not available, the element attempts to use a phase current. If neither voltage nor current is available, the element will not operate, as it will not measure a parameter above the minimum voltage/current setting.

The **UNDFREQ 1 MIN VOLT/AMP** setting selects the minimum per unit voltage or current level required to allow the underfrequency element to operate. This threshold is used to prevent an incorrect operation because there is no signal to measure.

This **UNDFREQ 1 PICKUP** setting is used to select the level at which the underfrequency element is to pickup. For example, if the system frequency is 60 Hz and the load shedding is required at 59.5 Hz, the setting will be 59.50 Hz.

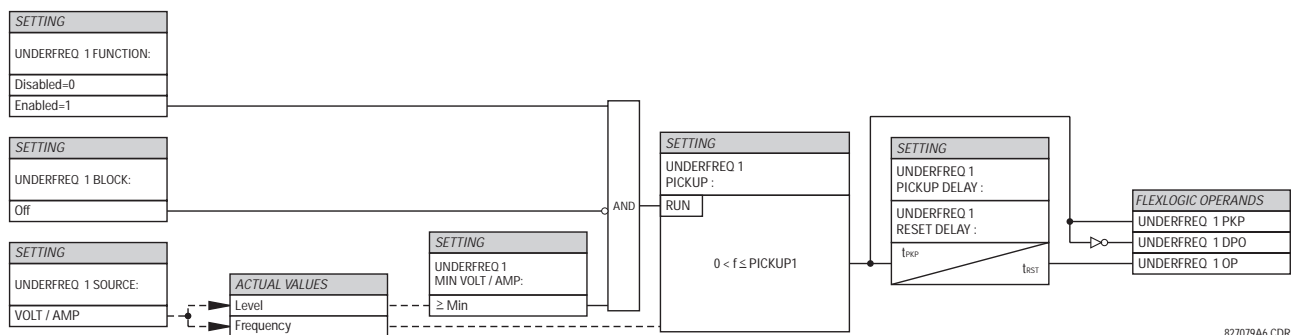


Figure 5-51: UNDERFREQUENCY SCHEME LOGIC

## 5.6.4 OVERFREQUENCY

PATH: SETTINGS ⇌ CONTROL ELEMENTS ⇌ OVERFREQUENCY ⇌ OVERFREQUENCY 1(4)

<div>OVERFREQUENCY 1</div> <div>MESSAGE</div> <div>MESSAGE</div> <div>MESSAGE</div> <div>MESSAGE</div> <div>MESSAGE</div> <div>MESSAGE</div>	<div>◀▶</div> <div>▲▼</div> <div>▲▼</div> <div>▲▼</div> <div>▲▼</div> <div>▲▼</div> <div>▲</div>	OVERFREQ 1 FUNCTION: Disabled	Range: Disabled, Enabled
		OVERFREQ 1 BLOCK: Off	Range: FlexLogic™ operand
		OVERFREQ 1 SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
		OVERFREQ 1 PICKUP: 60.50 Hz	Range: 20.00 to 65.00 Hz in steps of 0.01
		OVERFREQ 1 PICKUP DELAY: 0.500 s	Range: 0.000 to 65.535 s in steps of 0.001
		OVERFREQ 1 RESET DELAY : 0.500 s	Range: 0.000 to 65.535 s in steps of 0.001
		OVERFREQ 1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
		OVERFREQ 1 EVENTS: Disabled	Range: Disabled, Enabled


5

There are four overfrequency elements, numbered 1 through 4.

A frequency calculation for a given source is made on the input of a voltage or current channel, depending on which is available. The channels are searched for the signal input in the following order: voltage channel A, auxiliary voltage channel, current channel A, ground current channel. The first available signal is used for frequency calculation.

The steady-state frequency of a power system is an indicator of the existing balance between the generated power and the load. Whenever this balance is disrupted through the disconnection of significant load or the isolation of a part of the system that has a surplus of generation, the effect will be an increase in frequency. If the control systems of the generators do not respond fast enough, to quickly ramp the turbine speed back to normal, the overspeed can lead to the turbine trip. The overfrequency element can be used to control the turbine frequency ramp down at a generating location.

The **OVERFREQ 1 SOURCE** setting selects the source for the signal to be measured. The **OVERFREQ 1 PICKUP** setting selects the level at which the overfrequency element is to pickup.

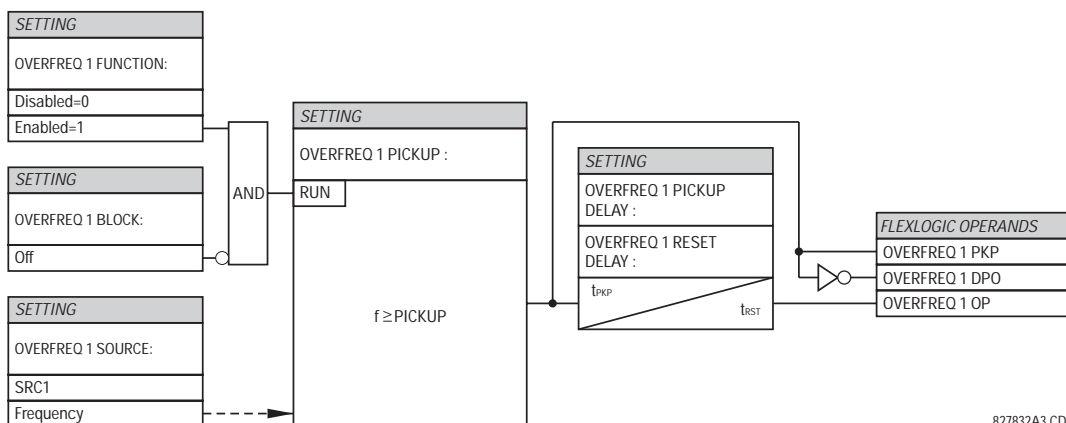

827832A3.CDR

Figure 5-52: OVERFREQUENCY SCHEME LOGIC



## 5.6.5 SYNCHROCHECK

PATH: SETTINGS ⇌ CONTROL ELEMENTS ⇌ SYNCHROCHECK ⇌ SYNCHROCHECK 1(2)

■ SYNCHROCHECK 1		SYNCHK1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	SYNCHK1 BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	SYNCHK1 V1 SOURCE: SRC 1	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	SYNCHK1 V2 SOURCE: SRC 2	Range: SRC 1, SRC 2,..., SRC 6
MESSAGE	▲▼	SYNCHK1 MAX VOLT DIFF: 10000 V	Range: 0 to 100000 V in steps of 1
MESSAGE	▲▼	SYNCHK1 MAX ANGLE DIFF: 30°	Range: 0 to 100° in steps of 1
MESSAGE	▲▼	SYNCHK1 MAX FREQ DIFF: 1.00 Hz	Range: 0.00 to 2.00 Hz in steps of 0.01
MESSAGE	▲▼	SYNCHK1 DEAD SOURCE SELECT: LV1 and DV2	Range: None, LV1 and DV2, DV1 and LV2, DV1 or DV2, DV1 Xor DV2, DV1 and DV2
MESSAGE	▲▼	SYNCHK1 DEAD V1 MAX VOLT: 0.30 pu	Range: 0.00 to 1.25 pu in steps of 0.01
MESSAGE	▲▼	SYNCHK1 DEAD V2 MAX VOLT: 0.30 pu	Range: 0.00 to 1.25 pu in steps of 0.01
MESSAGE	▲▼	SYNCHK1 LIVE V1 MIN VOLT: 0.70 pu	Range: 0.00 to 1.25 pu in steps of 0.01
MESSAGE	▲▼	SYNCHK1 LIVE V2 MIN VOLT: 0.70 pu	Range: 0.00 to 1.25 pu in steps of 0.01
MESSAGE	▲▼	SYNCHK1 TARGET: Self-reset	Range: Self-reset, Latched, Disabled
MESSAGE	▲▼	SYNCHK1 EVENTS: Disabled	Range: Disabled, Enabled

**SYNCHK1 V1 SOURCE:**

This setting selects the source for voltage V1 (see **NOTES** below).

**SYNCHK1 V2 SOURCE:**

This setting selects the source for voltage V2, which must not be the same as used for the V1 (see **NOTES** below).

**SYNCHK1 MAX VOLT DIFF:**

This setting selects the maximum voltage difference in 'kV' between the two sources. A voltage magnitude difference between the two input voltages below this value is within the permissible limit for synchronism.

**SYNCHK1 MAX ANGLE DIFF:**

This setting selects the maximum angular difference in degrees between the two sources. An angular difference between the two input voltage phasors below this value is within the permissible limit for synchronism.

**SYNCHK1 MAX FREQ DIFF:**

This setting selects the maximum frequency difference in 'Hz' between the two sources. A frequency difference between the two input voltage systems below this value is within the permissible limit for synchronism.

**SYNCHK1 DEAD SOURCE SELECT:**

This setting selects the combination of dead and live sources that will by-pass synchronism check function and permit the breaker to be closed when one or both of the two voltages (V1 or/and V2) are below the maximum voltage threshold. A dead or live source is declared by monitoring the voltage level.

Six options are available:

None:	Dead Source function is disabled
LV1 and DV2:	Live V1 and Dead V2
DV1 and LV2:	Dead V1 and Live V2
DV1 or DV2:	Dead V1 or Dead V2
DV1 Xor DV2:	Dead V1 exclusive-or Dead V2 (one source is Dead and the other is Live)
DV1 and DV2:	Dead V1 and Dead V2

**SYNCHK1 DEAD V1 MAX VOLT:**

This setting establishes a maximum voltage magnitude for V1 in 'pu'. Below this magnitude, the V1 voltage input used for synchrocheck will be considered "Dead" or de-energized.

**SYNCHK1 DEAD V2 MAX VOLT:**

This setting establishes a maximum voltage magnitude for V2 in 'pu'. Below this magnitude, the V2 voltage input used for synchrocheck will be considered "Dead" or de-energized.

**SYNCHK1 LIVE V1 MIN VOLT:**

This setting establishes a minimum voltage magnitude for V1 in 'pu'. Above this magnitude, the V1 voltage input used for synchrocheck will be considered "Live" or energized.

**SYNCHK1 LIVE V2 MIN VOLT:**

This setting establishes a minimum voltage magnitude for V2 in 'pu'. Above this magnitude, the V2 voltage input used for synchrocheck will be considered "Live" or energized.

**NOTES:**

1. The selected Sources for synchrocheck inputs V1 and V2 (which must not be the same Source) may include both a three-phase and an auxiliary voltage. The relay will automatically select the specific voltages to be used by the synchrocheck element in accordance with the following table.

NO.	V1 OR V2 (SOURCE Y)	V2 OR V1 (SOURCE Z)	AUTO-SELECTED COMBINATION		AUTO-SELECTED VOLTAGE
			SOURCE Y	SOURCE Z	
1	Phase VTs and Auxiliary VT	Phase VTs and Auxiliary VT	Phase	Phase	VAB
2	Phase VTs and Auxiliary VT	Phase VT	Phase	Phase	VAB
3	Phase VT	Phase VT	Phase	Phase	VAB
4	Phase VT and Auxiliary VT	Auxiliary VT	Phase	Auxiliary	V auxiliary (as set for Source z)
5	Auxiliary VT	Auxiliary VT	Auxiliary	Auxiliary	V auxiliary (as set for selected sources)

The voltages V1 and V2 will be matched automatically so that the corresponding voltages from the two Sources will be used to measure conditions. A phase to phase voltage will be used if available in both sources; if one or both of the Sources have only an auxiliary voltage, this voltage will be used. For example, if an auxiliary voltage is programmed to VAG, the synchrocheck element will automatically select VAG from the other Source. If the comparison is required on a specific voltage, the user can externally connect that specific voltage to auxiliary voltage terminals and then use this "Auxiliary Voltage" to check the synchronism conditions.

If using a single CT/VT module with both phase voltages and an auxiliary voltage, ensure that only the auxiliary voltage is programmed in one of the Sources to be used for synchrocheck.

**Exception:** Synchronism cannot be checked between Delta connected phase VTs and a Wye connected auxiliary voltage.

2. The relay measures frequency and Volts/Hz from an input on a given Source with priorities as established by the configuration of input channels to the Source. The relay will use the phase channel of a three-phase set of voltages if programmed as part of that Source. The relay will use the auxiliary voltage channel only if that channel is programmed as part of the Source and a three-phase set is not.

There are two identical synchrocheck elements available, numbered 1 and 2.

The synchronism check function is intended for supervising the paralleling of two parts of a system which are to be joined by the closure of a circuit breaker. The synchrocheck elements are typically used at locations where the two parts of the system are interconnected through at least one other point in the system.

Synchrocheck verifies that the voltages (V1 and V2) on the two sides of the supervised circuit breaker are within set limits of magnitude, angle and frequency differences.

The time while the two voltages remain within the admissible angle difference is determined by the setting of the phase angle difference  $\Delta\Phi$  and the frequency difference  $\Delta F$  (slip frequency). It can be defined as the time it would take the voltage phasor V1 or V2 to traverse an angle equal to  $2 \times \Delta\Phi$  at a frequency equal to the frequency difference  $\Delta F$ . This time can be calculated by:

$$T = \frac{1}{\frac{360^\circ}{2 \times \Delta\Phi} \times \Delta F}$$

where:  $\Delta\Phi$  = phase angle difference in degrees;  $\Delta F$  = frequency difference in Hz.

As an example; for the default values ( $\Delta\Phi = 30^\circ$ ,  $\Delta F = 0.1$  Hz), the time while the angle between the two voltages will be less than the set value is:

$$T = \frac{1}{\frac{360^\circ}{2 \times \Delta\Phi} \times \Delta F} = \frac{1}{\frac{360^\circ}{2 \times 30^\circ} \times 0.1 \text{ Hz}} = 1.66 \text{ sec.}$$

If one or both sources are de-energized, the synchrocheck programming can allow for closing of the circuit breaker using undervoltage control to by-pass the synchrocheck measurements (Dead Source function).


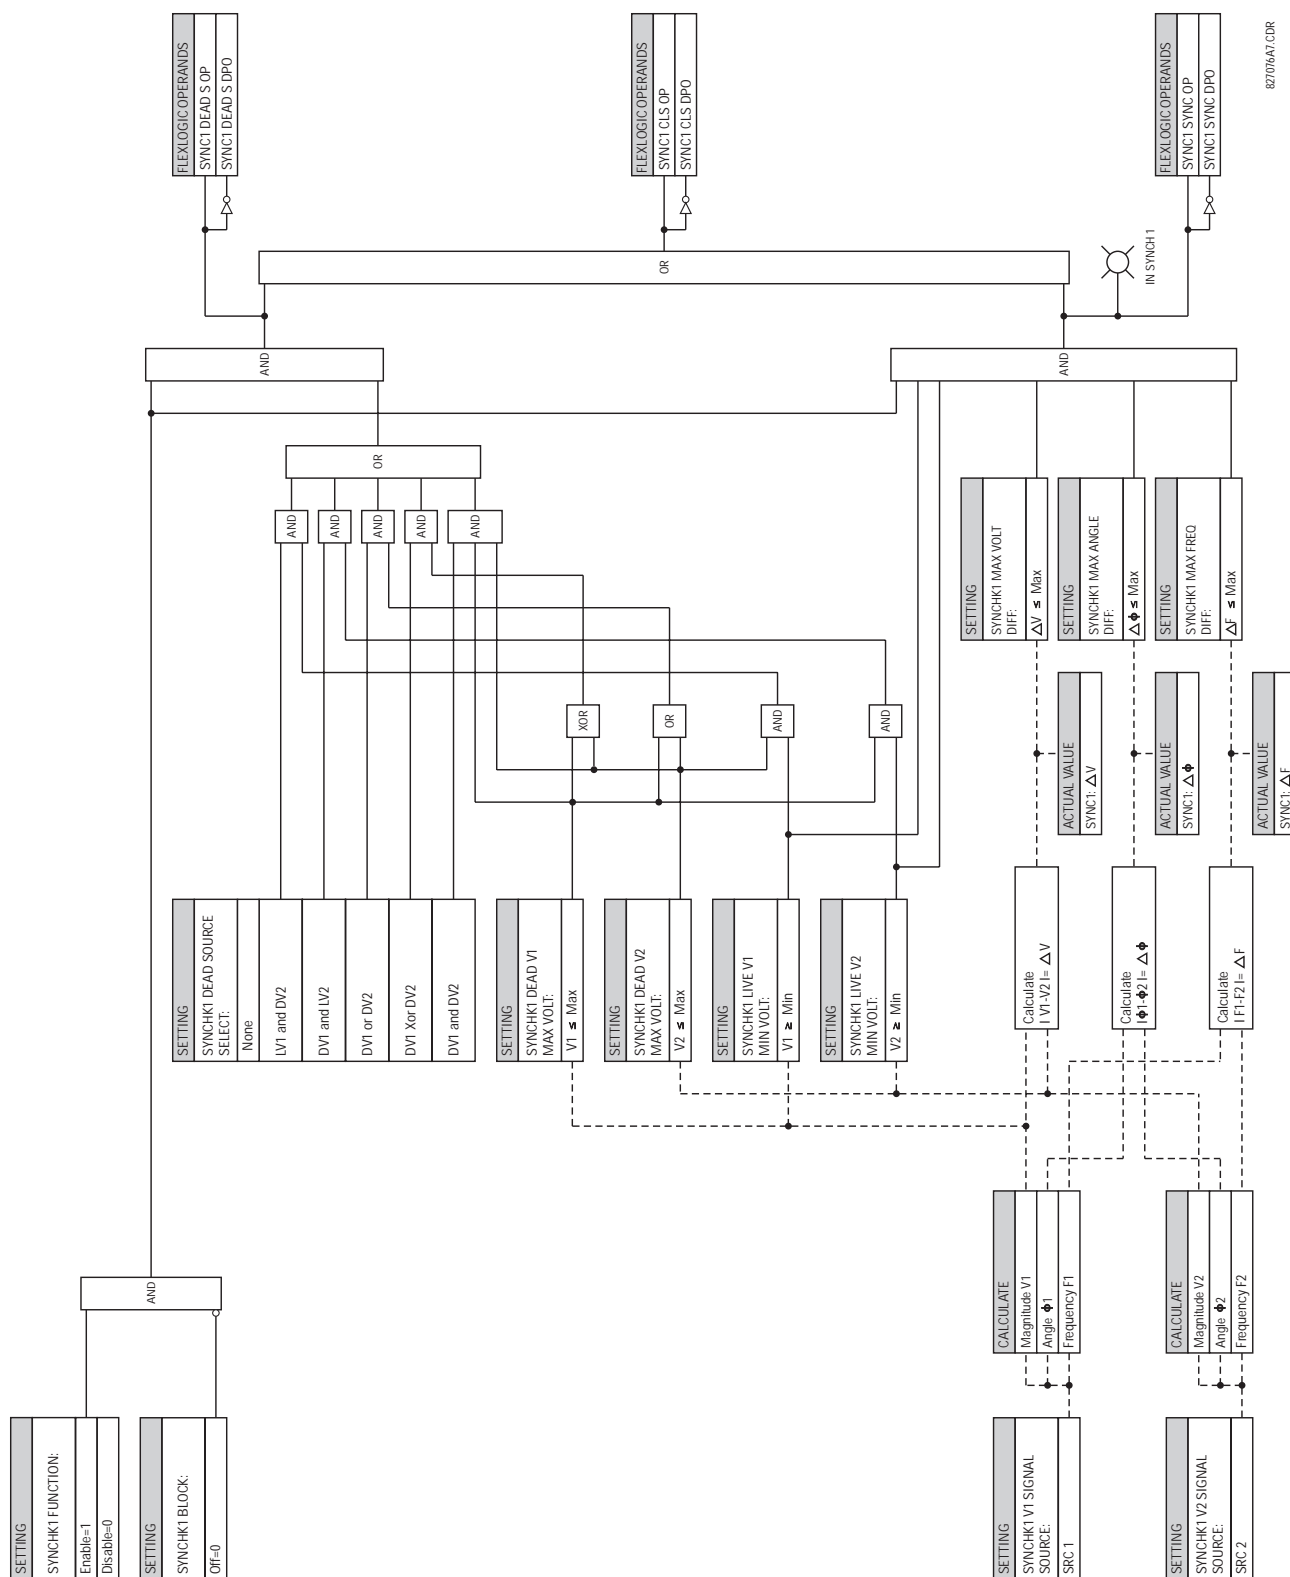


Figure 5-53: SYNCHROCHECK SCHEME LOGIC

## 5.6.6 DIGITAL ELEMENTS

PATH: SETTINGS ⇌ CONTROL ELEMENTS ⇌ DIGITAL ELEMENTS

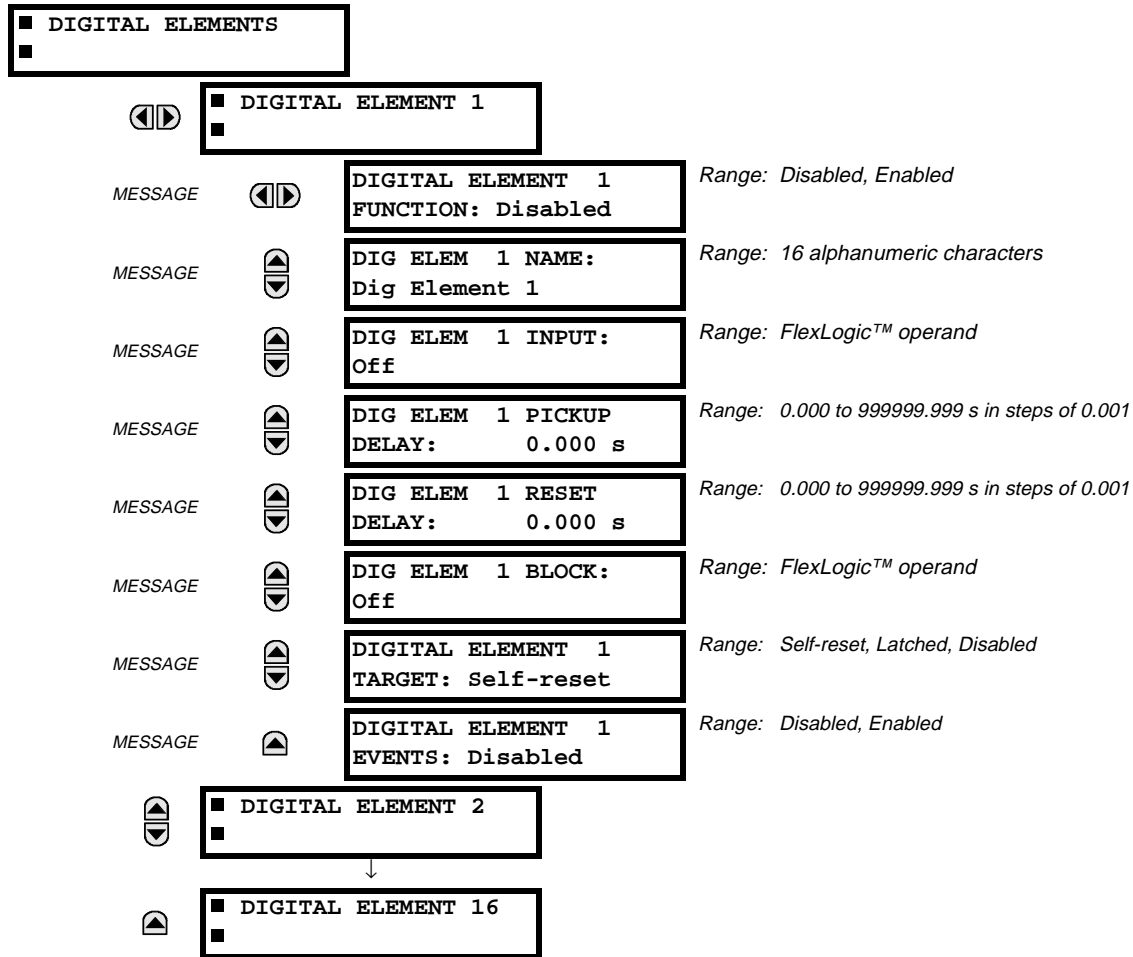

There are 16 identical Digital Elements available, numbered 1 to 16. A Digital Element can monitor any FlexLogic™ operand and present a target message and/or enable events recording depending on the output operand state. The digital element settings include a 'name' which will be referenced in any target message, a blocking input from any selected FlexLogic™ operand, and a timer for pickup and reset delays for the output operand.

**DIGITAL ELEMENT 1 INPUT:** Selects a FlexLogic™ operand to be monitored by the Digital Element.

**DIGITAL ELEMENT 1 PICKUP DELAY:** Sets the time delay to pickup. If a pickup delay is not required, set to "0".

**DIGITAL ELEMENT 1 RESET DELAY:** Sets the time delay to reset. If a reset delay is not required, set to "0".

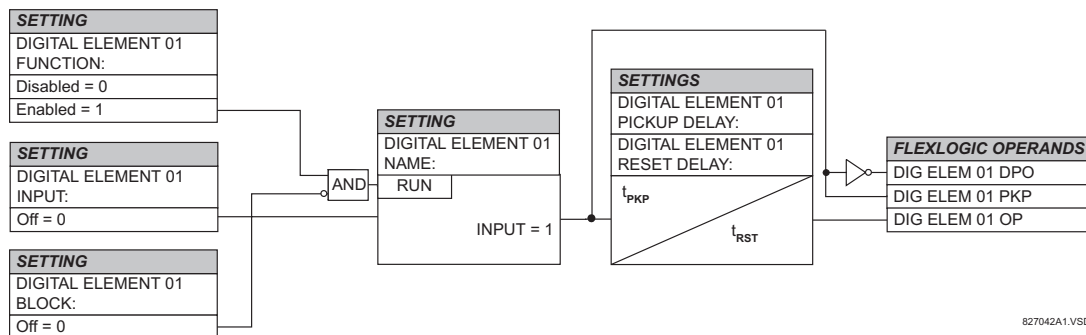


Figure 5-54: DIGITAL ELEMENT SCHEME LOGIC

### a) CIRCUIT MONITORING APPLICATIONS

Some versions of the digital input modules include an active Voltage Monitor circuit connected across Form-A contacts. The Voltage Monitor circuit limits the trickle current through the output circuit (see Technical Specifications for Form-A).

As long as the current through the Voltage Monitor is above a threshold (see Technical Specifications for Form-A), the FlexLogic™ operand "Cont Op # VOn" will be set. (# represents the output contact number). If the output circuit has a high resistance or the DC current is interrupted, the trickle current will drop below the threshold and the FlexLogic™ operand "Cont Op # VOff" will be set. Consequently, the state of these operands can be used as indicators of the integrity of the circuits in which Form-A contacts are inserted.

### b) BREAKER TRIP CIRCUIT INTEGRITY MONITORING – EXAMPLE 1

In many applications it is desired to monitor the breaker trip circuit integrity so problems can be detected before a trip operation is required. The circuit is considered to be healthy when the Voltage Monitor connected across the trip output contact detects a low level of current, well below the operating current of the breaker trip coil. If the circuit presents a high resistance, the trickle current will fall below the monitor threshold and an alarm would be declared.

In most breaker control circuits, the trip coil is connected in series with a breaker auxiliary contact which is open when the breaker is open (see diagram below). To prevent unwanted alarms in this situation, the trip circuit monitoring logic must include the breaker position.

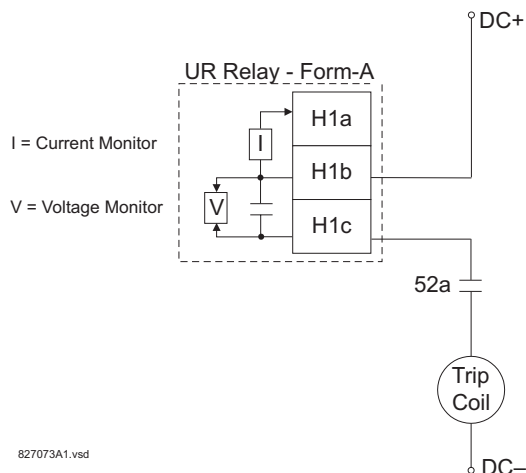


Figure 5-55: TRIP CIRCUIT EXAMPLE 1

Assume the output contact H1 is a trip contact. Using the contact output settings, this output will be given an ID name, e.g. "Cont Op 1". Assume a 52a breaker auxiliary contact is connected to contact input H7a to monitor breaker status. Using the contact input settings, this input will be given an ID name, e.g. "Cont Ip 1" and will be set "ON" when the breaker is closed. Using Digital Element 1 to monitor the breaker trip circuit, the settings will be:

<b>DIGITAL ELEMENT 1</b>	<b>DIGITAL ELEMENT 1</b> <b>FUNCTION: Enabled</b>
MESSAGE	<b>DIG ELEM 1 NAME:</b> <b>Bkr Trip Cct Out</b>
MESSAGE	<b>DIG ELEM 1 INPUT:</b> <b>Cont Op 1 Voff</b>
MESSAGE	<b>DIG ELEM 1 PICKUP</b> <b>DELAY: 0.200 s</b>
MESSAGE	<b>DIG ELEM 1 RESET</b> <b>DELAY: 0.100 s</b>
MESSAGE	<b>DIG ELEM 1 BLOCK:</b> <b>Cont Ip 1 Off</b>


MESSAGE	▲▼	DIGITAL ELEMENT 1 TARGET: Self-reset
MESSAGE	▲	DIGITAL ELEMENT 1 EVENTS: Enabled

**NOTE:** The PICKUP DELAY setting should be greater than the operating time of the breaker to avoid nuisance alarms.

### c) BREAKER TRIP CIRCUIT INTEGRITY MONITORING – EXAMPLE 2

If it is required to monitor the trip circuit continuously, independent of the breaker position (open or closed), a method to maintain the monitoring current flow through the trip circuit when the breaker is open must be provided (as shown in Figure: TRIP CIRCUIT - EXAMPLE 2). This can be achieved by connecting a suitable resistor (as listed in the VALUES OF RESISTOR 'R' table) across the auxiliary contact in the trip circuit. In this case, it is not required to supervise the monitoring circuit with the breaker position - the BLOCK setting is selected to Off. In this case, the settings will be:

■ DIGITAL ELEMENT 1	◀▶	DIGITAL ELEMENT 1 FUNCTION: Enabled
MESSAGE	▲▼	DIG ELEM 1 NAME: Bkr Trip Cct Out
MESSAGE	▲▼	DIG ELEM 1 INPUT: Cont Op 1 Voff
MESSAGE	▲▼	DIG ELEM 1 PICKUP DELAY: 0.200 s
MESSAGE	▲▼	DIG ELEM 1 RESET DELAY: 0.100 s
MESSAGE	▲▼	DIG ELEM 1 BLOCK: Off
MESSAGE	▲▼	DIGITAL ELEMENT 1 TARGET: Self-reset
MESSAGE	▲	DIGITAL ELEMENT 1 EVENTS: Enabled

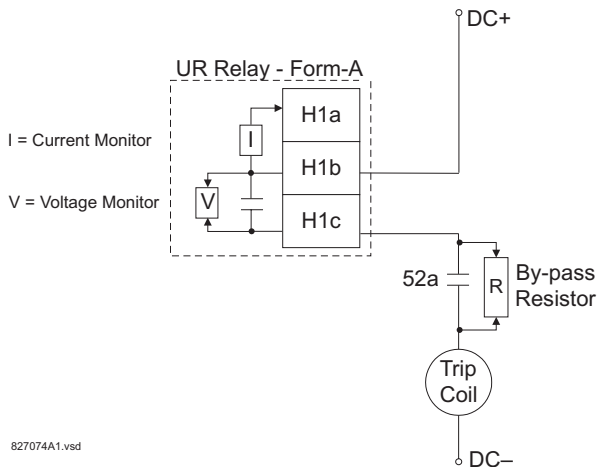

**Table 5–25: VALUES OF RESISTOR 'R'**

POWER SUPPLY (V DC)	RESISTANCE (OHMS)	POWER (WATTS)
24	1000	2
30	5000	2
48	10000	2
110	25000	5
125	25000	5
250	50000	5

**Figure 5–56: TRIP CIRCUIT EXAMPLE 2**

## 5.6.7 DIGITAL COUNTERS

PATH: SETTINGS ⇌ CONTROL ELEMENTS ⇌ DIGITAL COUNTERS ⇌ COUNTER 1(8)

■ COUNTER 1	◀▶	COUNTER 1 FUNCTION: Disabled	Range: Disabled, Enabled
MESSAGE	▲▼	COUNTER 1 NAME: Counter 1	Range: 12 alphanumeric characters
MESSAGE	▲▼	COUNTER 1 UNITS:	Range: 6 alphanumeric characters
MESSAGE	▲▼	COUNTER 1 PRESET: 0	Range: -2,147,483,647 to +2,147,483,647
MESSAGE	▲▼	COUNTER 1 COMPARE: 0	Range: -2,147,483,647 to +2,147,483,647
MESSAGE	▲▼	COUNTER 1 UP: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	COUNTER 1 DOWN: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	COUNTER 1 BLOCK: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	CNT1 SET TO PRESET: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	COUNTER 1 RESET: Off	Range: FlexLogic™ operand
MESSAGE	▲▼	COUNT1 FREEZE/RESET: Off	Range: FlexLogic™ operand
MESSAGE	▲	COUNT1 FREEZE/COUNT: Off	Range: FlexLogic™ operand

There are 8 identical digital counters, numbered from 1 to 8. A digital counter counts the number of state transitions from Logic 0 to Logic 1. The counter is used to count operations such as the pickups of an element, the changes of state of an external contact (e.g. breaker auxiliary switch), or pulses from a watt-hour meter.

**COUNTER 1 UNITS:**

Assigns a label to identify the unit of measure pertaining to the digital transitions to be counted. The units label will appear in the corresponding Actual Values status.

**COUNTER 1 PRESET:**

Sets the count to a required preset value before counting operations begin, as in the case where a substitute relay is to be installed in place of an in-service relay, or while the counter is running.

**COUNTER 1 COMPARE:**

Sets the value to which the accumulated count value is compared. Three FlexLogic™ output operands are provided to indicate if the present value is "more than (HI)", "equal to (EQL)", or "less than (LO)" the set value.

**COUNTER 1 UP:**

Selects the FlexLogic™ operand for incrementing the counter. If an enabled UP input is received when the accumulated value is at the limit of +2,147,483,647 counts, the counter will rollover to -2,147,483,647.

**COUNTER 1 DOWN:**

Selects the FlexLogic™ operand for decrementing the counter. If an enabled DOWN input is received when the accumulated value is at the limit of -2,147,483,647 counts, the counter will rollover to +2,147,483,647.



**COUNTER 1 BLOCK:**

Selects the FlexLogic™ operand for blocking the counting operation.

**CNT1 SET TO PRESET:**

Selects the FlexLogic™ operand used to set the count to the preset value. The counter will be set to the preset value in the following situations:

1. When the counter is enabled and the "CNT1 SET TO PRESET" operand has the value 1 (when the counter is enabled and "CNT1 SET TO PRESET" is 0, the counter will be set to 0.)
2. When the counter is running and the "CNT1 SET TO PRESET" operand changes the state from 0 to 1 ("CNT1 SET TO PRESET" changing from 1 to 0 while the counter is running has no effect on the count).
3. When a reset or reset/freeze command is sent to the counter and the "CNT1 SET TO PRESET" operand has the value 1 (when a reset or reset/freeze command is sent to the counter and the "CNT1 SET TO PRESET" operand has the value 0, the counter will be set to 0).

**COUNTER 1 RESET:**

Selects the FlexLogic™ operand for setting the count to either '0' or the preset value depending on the state of the "CNT1 SET TO PRESET" operand.

**COUNTER 1 FREEZE/RESET:**

Selects the FlexLogic™ operand for capturing (freezing) the accumulated count value into a separate register with the date and time of the operation, and resetting the count to '0' or the preset value.

**COUNTER 1 FREEZE/COUNT:**

Selects the FlexLogic™ operand for capturing (freezing) the accumulated count value into a separate register with the date and time of the operation, and continuing counting. The present accumulated value and captured frozen value with the associated date/time stamp are available as actual values. If control power is interrupted, the accumulated and frozen values are saved into non-volatile memory during the power down operation.


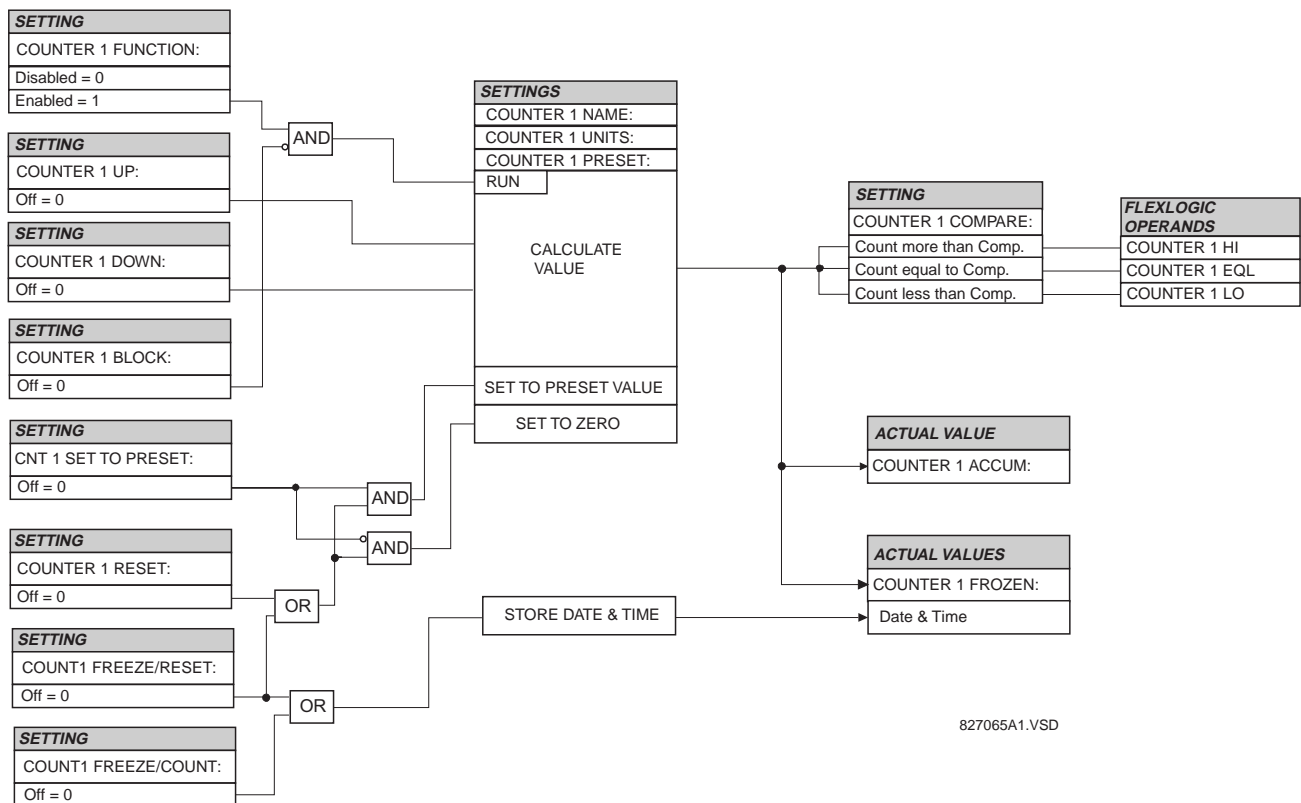


Figure 5-57: DIGITAL COUNTER SCHEME LOGIC

## 5.6.8 MONITORING ELEMENTS

## a) VT FUSE FAILURE

PATH: SETTINGS ⇌ CONTROL ELEMENTS ⇌ MONITORING ELEMENTS ⇌ VT FUSE FAILURE




Every signal source includes a fuse failure scheme.

The VT fuse failure detector can be used to raise an alarm and/or block elements that may operate incorrectly for a full or partial loss of AC potential caused by one or more blown fuses. Some elements that might be blocked (via the BLOCK input) are distance, voltage restrained overcurrent, and directional current.

There are two classes of fuse failure that may occur: (A) loss of one or two phases, and (B) loss of all three phases. A different means of detection is required for each class. An indication of class A failures is a significant level of negative sequence voltage, whereas an indication of class B failures is when positive sequence current is present and there is an insignificant amount of positive sequence voltage. These noted indications of fuse failure could also be present when faults are present on the system, so a means of detecting faults and inhibiting fuse failure declarations during these events is provided. Once the fuse failure condition is declared, it will be sealed-in until the cause that generated it disappears.

An additional condition is introduced to inhibit a fuse failure declaration when the monitored circuit is de-energized; positive sequence voltage and current are both below threshold levels.

The common FUNCTION setting will Enable/Disable the fuse failure feature for all 6 sources.

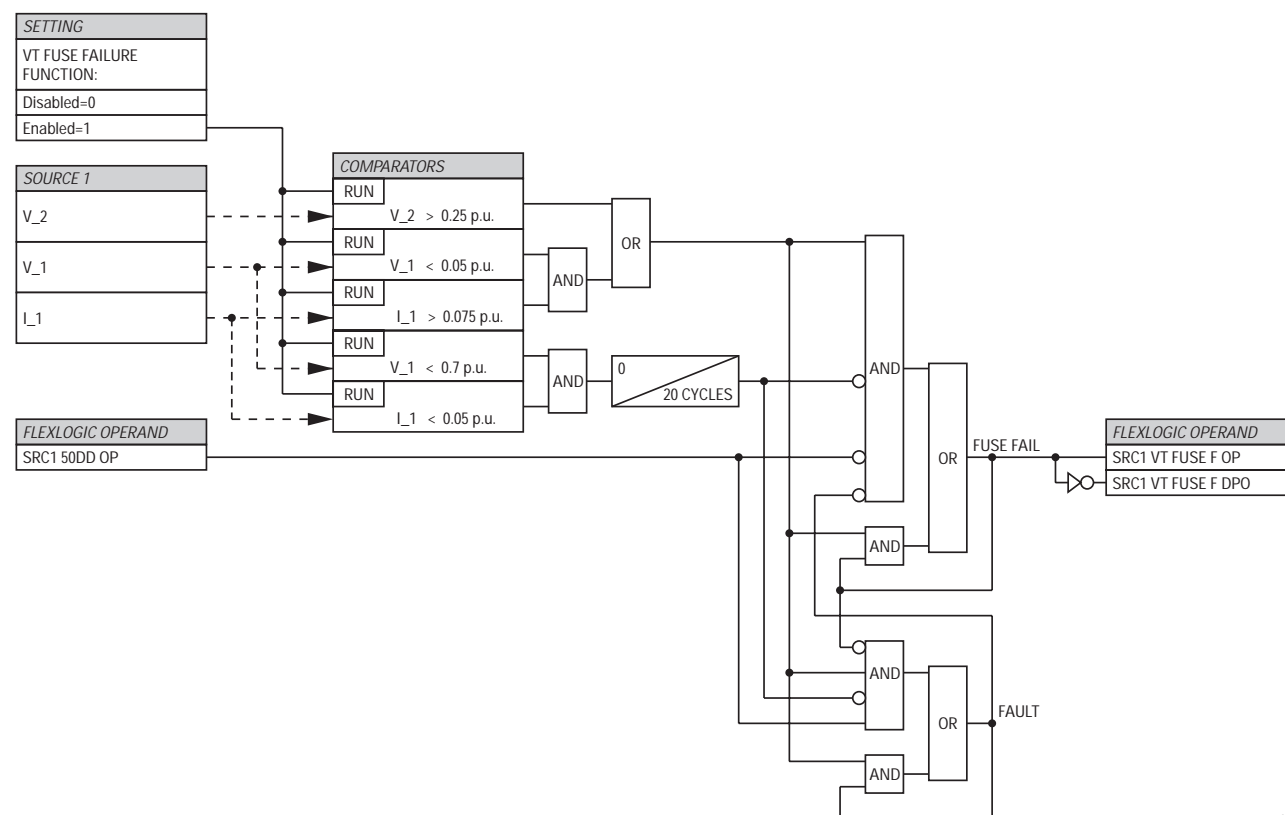


827093A5.CDR

Figure 5-58: VT FUSE FAIL SCHEME LOGIC

## 5.7.1 CONTACT INPUTS

PATH: SETTINGS ⇌ INPUTS/OUTPUTS ⇌ CONTACT INPUTS

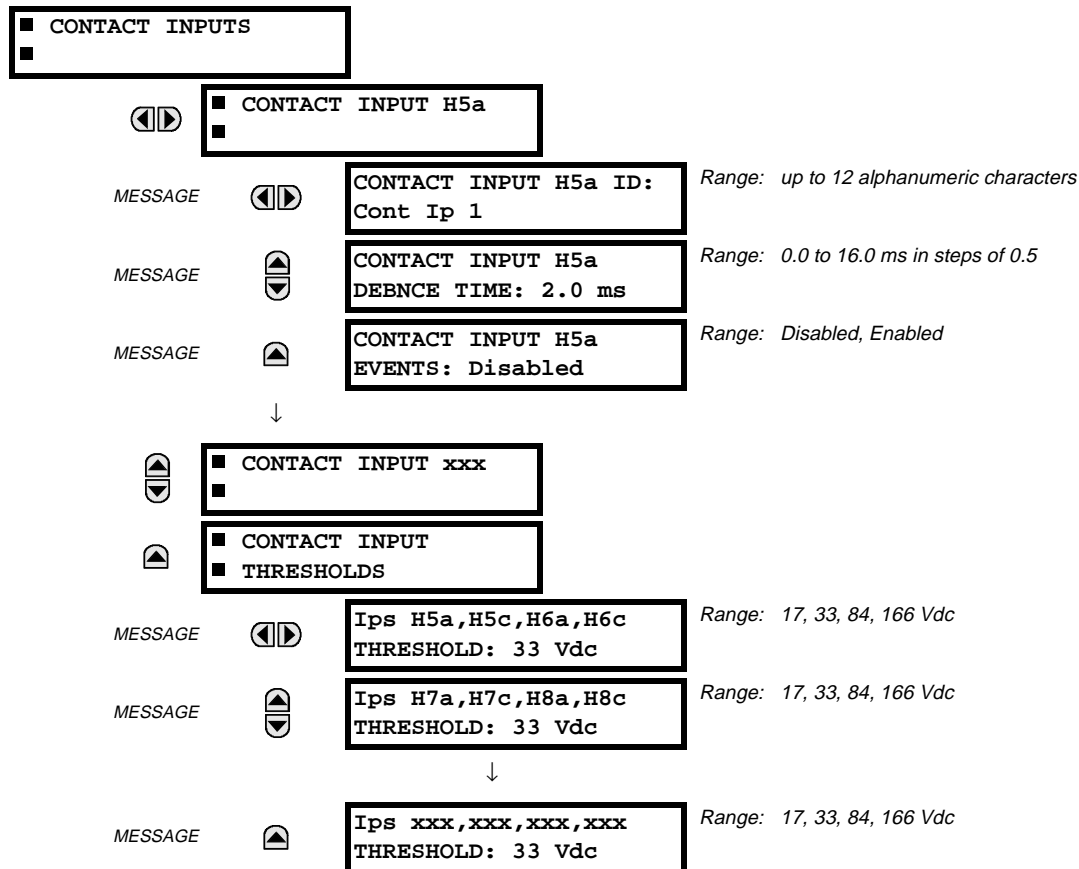

The contact inputs menu contains configuration settings for each contact input as well as voltage thresholds for each group of four contact inputs. Upon startup, the relay processor determines (from an assessment of the installed modules) which contact inputs are available and then display settings for only those inputs.

An alphanumeric ID may be assigned to a contact input for diagnostic, setting, and event recording purposes. The "Contact Ip X On" (Logic 1) FlexLogic™ operand corresponds to contact input "X" being closed, while "Contact Input X Off" corresponds to contact input "X" being open. The **CONTACT INPUT DEBNCE TIME** defines the time required for the contact to overcome 'contact bouncing' conditions. As this time differs for different contact types and manufacturers, set it as a maximum contact debounce time (per manufacturer specifications) plus some margin to ensure proper operation. If **CONTACT INPUT EVENTS** is set to "Enabled", every change in the contact input state will trigger an event.

A raw status is scanned for all Contact Inputs synchronously at the constant rate of 0.5 ms as shown in the figure below. The DC input voltage is compared to a user-settable threshold. A new contact input state must be maintained for a user-settable debounce time in order for the G60 to validate the new contact state. In the figure below, the debounce time is set at 2.5 ms; thus the 6th sample in a row validates the change of state (mark no.1 in the diagram). Once validated (debounced), the contact input asserts a corresponding FlexLogic™ operand and logs an event as per user setting.

A time stamp of the first sample in the sequence that validates the new state is used when logging the change of the contact input into the Event Recorder (mark no. 2 in the diagram).


Protection and control elements, as well as FlexLogic™ equations and timers, are executed eight times in a power system cycle. The protection pass duration is controlled by the frequency tracking mechanism. The FlexLogic™ operand reflecting the debounced state of the contact is updated at the protection pass following the validation (marks no. 3 and 4 on the figure below). The update is performed at the beginning of the protection pass so all protection and control functions, as well as FlexLogic™ equations, are fed with the updated states of the contact inputs.

The FlexLogic™ operand response time to the contact input change is equal to the debounce time setting plus up to one protection pass (variable and depending on system frequency if frequency tracking enabled). If the change of state occurs just after a protection pass, the recognition is delayed until the subsequent protection pass; that is, by the entire duration of the protection pass. If the change occurs just prior to a protection pass, the state is recognized immediately. Statistically a delay of half the protection pass is expected. Owing to the 0.5 ms scan rate, the time resolution for the input contact is below 1msec.

For example, 8 protection passes per cycle on a 60 Hz system correspond to a protection pass every 2.1 ms. With a contact debounce time setting of 3.0 ms, the FlexLogic™ operand-assert time limits are:  $3.0 + 0.0 = 3.0$  ms and  $3.0 + 2.1 = 5.1$  ms. These time limits depend on how soon the protection pass runs after the debouncing time.

Regardless of the contact debounce time setting, the contact input event is time-stamped with a 1  $\mu$ s accuracy using the time of the first scan corresponding to the new state (mark no. 2 below). Therefore, the time stamp reflects a change in the DC voltage across the contact input terminals that was not accidental as it was subsequently validated using the debounce timer. Keep in mind that the associated FlexLogic™ operand is asserted/de-asserted later, after validating the change.

The debounce algorithm is symmetrical: the same procedure and debounce time are used to filter the LOW-HIGH (marks no.1, 2, 3, and 4 in the figure below) and HIGH-LOW (marks no.5, 6, 7, and 8 below) transitions.

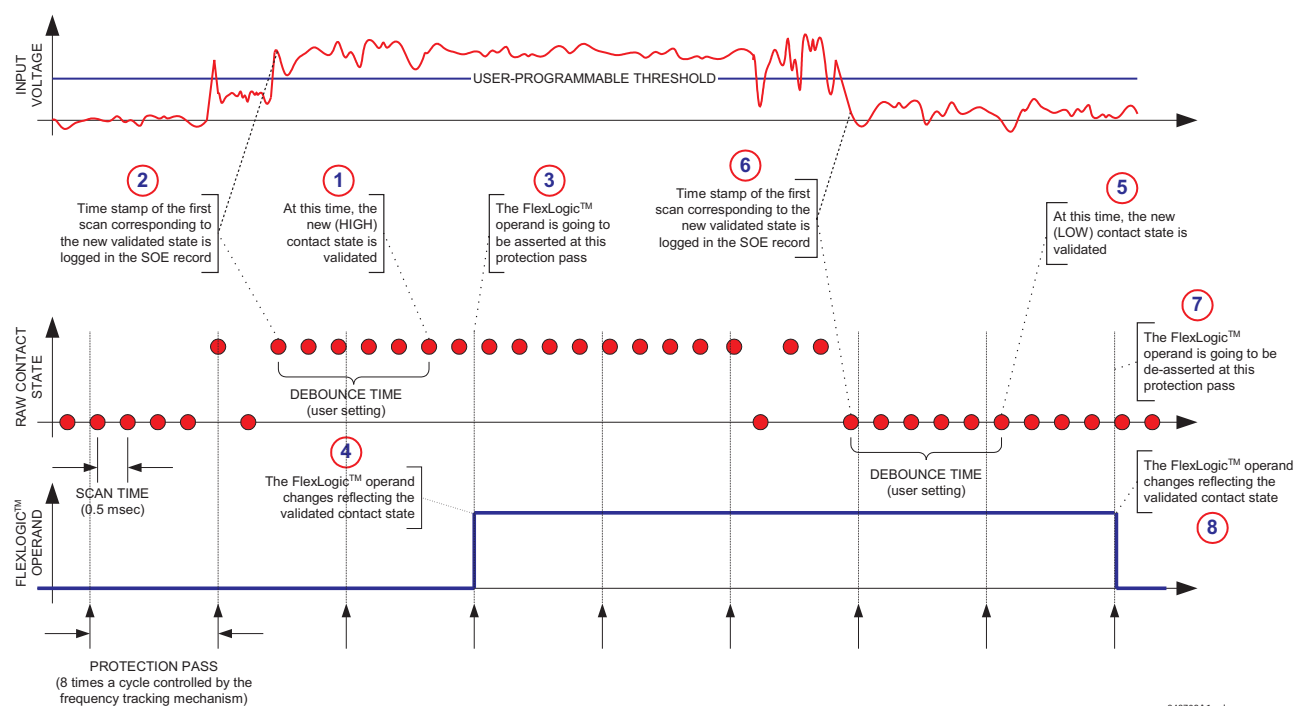

**Figure 5-59: INPUT CONTACT DEBOUNCING MECHANISM AND TIME-STAMPING SAMPLE TIMING**

Contact inputs are isolated in groups of four to allow connection of wet contacts from different voltage sources for each group. The **CONTACT INPUT THRESHOLDS** determine the minimum voltage required to detect a closed contact input. This value should be selected according to the following criteria: 16 for 24 V sources, 30 for 48 V sources, 80 for 110 to 125 V sources and 140 for 250 V sources.


For example, to use contact input H5a as a status input from the breaker 52b contact to seal-in the trip relay and record it in the Event Records menu, make the following settings changes:

**CONTACT INPUT H5A ID:** "Breaker Closed (52b)"  
**CONTACT INPUT H5A EVENTS:** "Enabled"

Note that the 52b contact is closed when the breaker is open and open when the breaker is closed.

## 5.7.2 VIRTUAL INPUTS

PATH: SETTINGS ⇌ INPUTS/OUTPUTS ⇌ VIRTUAL INPUTS ⇌

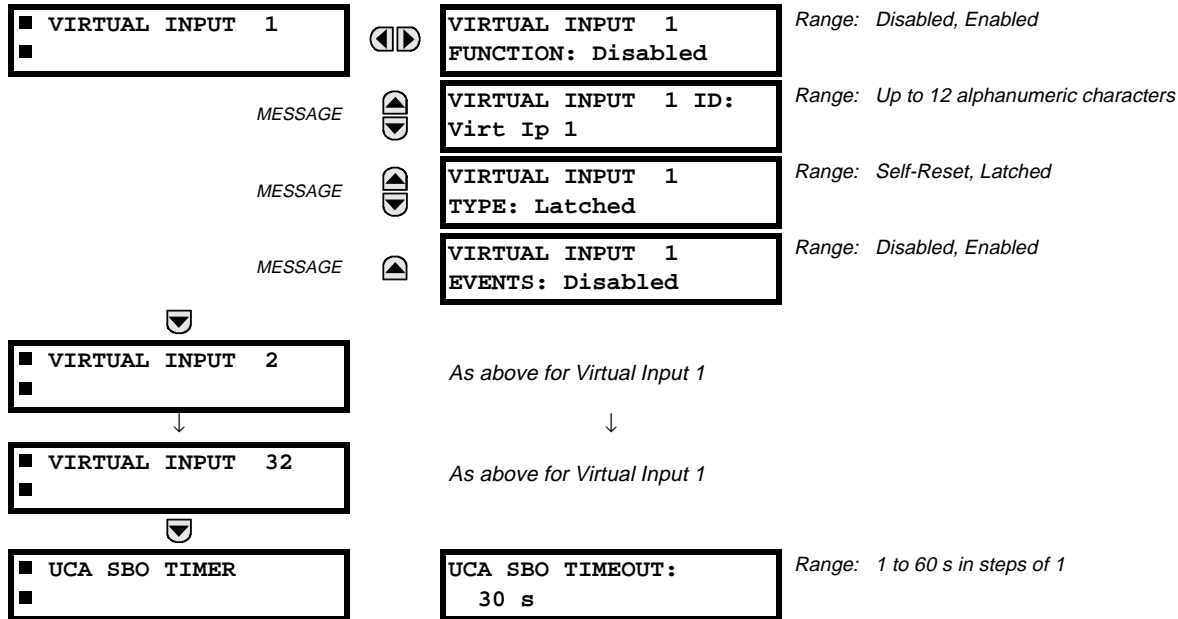

There are 32 virtual inputs that can be individually programmed to respond to input signals from the keypad (COMMANDS menu) and non-UCA2 communications protocols only. All virtual input operands are defaulted to OFF = 0 unless the appropriate input signal is received. **Virtual input states are preserved through a control power loss.**


If the **VIRTUAL INPUT x FUNCTION** is to "Disabled", the input will be forced to 'OFF' (Logic 0) regardless of any attempt to alter the input. If set to "Enabled", the input operates as shown on the logic diagram and generates output FlexLogic™ operands in response to received input signals and the applied settings.

There are two types of operation: Self-Reset and Latched. If **VIRTUAL INPUT x TYPE** is "Self-Reset", when the input signal transits from OFF = 0 to ON = 1, the output operand will be set to ON = 1 for only one evaluation of the FlexLogic™ equations and then return to OFF = 0. If set to "Latched", the virtual input sets the state of the output operand to the same state as the most recent received input, ON = 1 or OFF = 0.



**The "Self-Reset" operating mode generates the output operand for a single evaluation of the FlexLogic™ equations. If the operand is to be used anywhere other than internally in a FlexLogic™ equation, it will likely have to be lengthened in time. A FlexLogic™ timer with a delayed reset can perform this function.**

The Select-Before-Operate timer sets the interval from the receipt of an Operate signal to the automatic de-selection of the virtual input, so that an input does not remain selected indefinitely (used only with the UCA Select-Before-Operate feature).

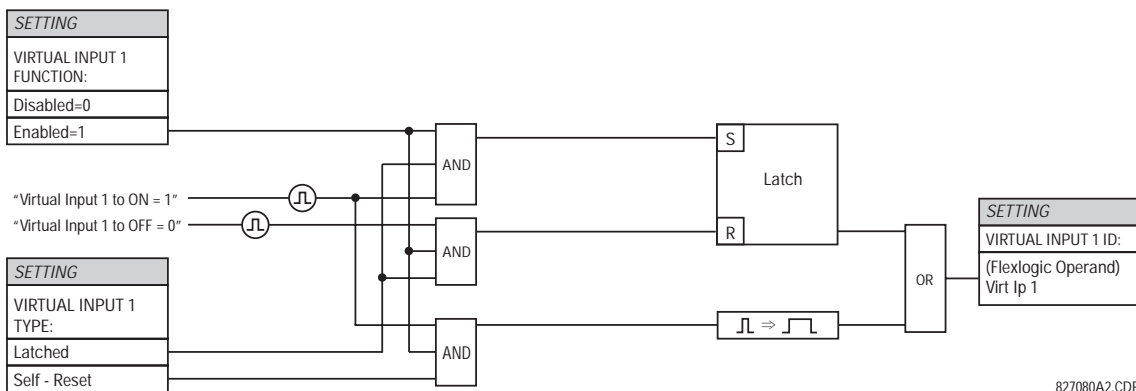

827080A2.CDR

Figure 5-60: VIRTUAL INPUTS SCHEME LOGIC

## 5.7.3 UCA SBO TIMER

PATH: SETTINGS ⇌ INPUTS/OUTPUTS ⇌ VIRTUAL INPUTS ⇌ UCA SBO TIMER

<div>■ UCA SBO TIMER</div> <div>■</div>	<div>UCA SBO TIMEOUT:</div> <div>30 s</div>	Range: 1 to 60 s in steps of 1
---	---	--------------------------------

The Select-Before-Operate timer sets the interval from the receipt of an Operate signal to the automatic de-selection of the virtual input, so that an input does not remain selected indefinitely (this is used only with the UCA Select-Before-Operate feature).

## 5.7.4 CONTACT OUTPUTS

PATH: SETTINGS ⇌ INPUTS/OUTPUTS ⇌ CONTACT OUTPUTS ⇌ CONTACT OUTPUT H1

<div>■ CONTACT OUTPUT H1</div> <div>■</div>	<div>CONTACT OUTPUT H1 ID</div> <div>Cont Op 1</div>	Range: Up to 12 alphanumeric characters
MESSAGE	<div>OUTPUT H1 OPERATE:</div> <div>Off</div>	Range: FlexLogic™ operand
MESSAGE	<div>OUTPUT H1 SEAL-IN:</div> <div>Off</div>	Range: FlexLogic™ operand
MESSAGE	<div>CONTACT OUTPUT H1 EVENTS:</div> <div>Enabled</div>	Range: Disabled, Enabled

5

Upon startup of the relay, the main processor will determine from an assessment of the modules installed in the chassis which contact outputs are available and present the settings for only these outputs.

An ID may be assigned to each contact output. The signal that can OPERATE a contact output may be any FlexLogic™ operand (virtual output, element state, contact input, or virtual input). An additional FlexLogic™ operand may be used to SEAL-IN the relay. Any change of state of a contact output can be logged as an Event if programmed to do so.

**EXAMPLE:**

The trip circuit current is monitored by providing a current threshold detector in series with some Form-A contacts (see the TRIP CIRCUIT EXAMPLE in the DIGITAL ELEMENTS section). The monitor will set a flag (see the Specifications for Form-A). The name of the FlexLogic™ operand set by the monitor, consists of the output relay designation, followed by the name of the flag; e.g. 'Cont Op 1 IOn' or 'Cont Op 1 IOff'.

In most breaker control circuits, the trip coil is connected in series with a breaker auxiliary contact used to interrupt current flow after the breaker has tripped, to prevent damage to the less robust initiating contact. This can be done by monitoring an auxiliary contact on the breaker which opens when the breaker has tripped, but this scheme is subject to incorrect operation caused by differences in timing between breaker auxiliary contact change-of-state and interruption of current in the trip circuit. The most dependable protection of the initiating contact is provided by directly measuring current in the tripping circuit, and using this parameter to control resetting of the initiating relay. This scheme is often called "trip seal-in".

This can be realized in the UR using the 'Cont Op 1 IOn' FlexLogic™ operand to seal-in the Contact Output as follows:

```
CONTACT OUTPUT H1 ID: "Cont Op 1"
OUTPUT H1 OPERATE: "Off"
OUTPUT H1 SEAL-IN: "Cont Op 1 IOn"
CONTACT OUTPUT H1 EVENTS: "Enabled"
```

## 5.7.5 VIRTUAL OUTPUTS

PATH: SETTINGS ⇌ INPUTS/OUTPUTS ⇌ VIRTUAL OUTPUTS ⇌ VIRTUAL OUTPUT 1

<div>■ VIRTUAL OUTPUT 1</div> <div>MESSAGE ▲</div>	<div>◀ ▶</div> <div> <div>VIRTUAL OUTPUT 1 ID</div> <div>Virt Op 1</div> </div> <div> <div>VIRTUAL OUTPUT 1</div> <div>EVENTS: Disabled</div> </div>	<div>Range: Up to 12 alphanumeric characters</div> <div>Range: Disabled, Enabled</div>
--	--	--

There are 64 virtual outputs that may be assigned via FlexLogic™. If not assigned, the output will be forced to 'OFF' (Logic 0). An ID may be assigned to each virtual output. Virtual outputs are resolved in each pass through the evaluation of the FlexLogic™ equations. Any change of state of a virtual output can be logged as an event if programmed to do so.

For example, if Virtual Output 1 is the trip signal from FlexLogic™ and the trip relay is used to signal events, the settings would be programmed as follows:

VIRTUAL OUTPUT 1 ID: "Trip"  
VIRTUAL OUTPUT 1 EVENTS: "Disabled"

## 5.7.6 REMOTE DEVICES

## a) REMOTE INPUTS / OUTPUTS - OVERVIEW

Remote inputs and outputs, which are a means of exchanging information regarding the state of digital points between remote devices, are provided in accordance with the Electric Power Research Institute's (EPRI) UCA2 "Generic Object Oriented Substation Event (GOOSE)" specifications.



**The UCA2 specification requires that communications between devices be implemented on Ethernet communications facilities. For UR relays, Ethernet communications is provided only on the type 9C and 9D versions of the CPU module.**

The sharing of digital point state information between GOOSE equipped relays is essentially an extension to FlexLogic™ to allow distributed FlexLogic™ by making operands available to/from devices on a common communications network. In addition to digital point states, GOOSE messages identify the originator of the message and provide other information required by the communication specification. All devices listen to network messages and capture data from only those messages that have originated in selected devices.

GOOSE messages are designed to be short, high priority and with a high level of reliability. The GOOSE message structure contains space for 128 bit pairs representing digital point state information. The UCA specification provides 32 "DNA" bit pairs, which are status bits representing pre-defined events. All remaining bit pairs are "UserSt" bit pairs, which are status bits representing user-definable events. The UR implementation provides 32 of the 96 available UserSt bit pairs.

The UCA2 specification includes features that are used to cope with the loss of communication between transmitting and receiving devices. Each transmitting device will send a GOOSE message upon a successful power-up, when the state of any included point changes, or after a specified interval (the "default update" time) if a change-of-state has not occurred. The transmitting device also sends a "hold time" which is set to three times the programmed default time, which is required by the receiving device.

Receiving devices are constantly monitoring the communications network for messages they require, as recognized by the identification of the originating device carried in the message. Messages received from remote devices include the message "hold" time for the device. The receiving relay sets a timer assigned to the originating device to the "hold" time interval, and if it has not received another message from this device at time-out, the remote device is declared to be non-communicating, so it will use the programmed default state for all points from that specific remote device. This mechanism allows a receiving device to fail to detect a single transmission from a remote device which is sending messages at the slowest possible rate, as set by its "default update" timer, without reverting to use of the programmed default states. If a message is received from a remote device before the "hold" time expires, all points for that device are updated to the states contained in the message and the hold timer is restarted. The status of a remote device, where 'Offline' indicates 'non-communicating', can be displayed.

The GOOSE facility provides for 64 remote inputs and 32 remote outputs.

### b) LOCAL DEVICES - ID of Device for Transmitting GOOSE Messages

In a UR relay, the device ID that identifies the originator of the message is programmed in the **SETTINGS** ⇒ **PRODUCT SETUP** ⇒ **INSTALLATION** ⇒ **RELAY NAME** setting.

### c) REMOTE DEVICES - ID of Device for Receiving GOOSE Messages

**PATH:** **SETTINGS** ⇒ **INPUTS/OUTPUTS** ⇒ **REMOTE DEVICES** ⇒ **REMOTE DEVICE 1(16)**

<div> <div>■ REMOTE DEVICE 1</div> <div>■</div> </div>	<div>◀▶</div> <div> <div>REMOTE DEVICE 1 ID:</div> <div>Remote Device 1</div> </div>	Range: up to 20 alphanumeric characters
--	--	---

Sixteen Remote Devices, numbered from 1 to 16, can be selected for setting purposes. A receiving relay must be programmed to capture messages from only those originating remote devices of interest. This setting is used to select specific remote devices by entering (bottom row) the exact identification (ID) assigned to those devices.

## 5.7.7 REMOTE INPUTS

**PATH:** **SETTINGS** ⇒ **INPUTS/OUTPUTS** ⇒ **REMOTE INPUTS** ⇒ **REMOTE INPUT 1(32)**

<div> <div>■ REMOTE INPUT 1</div> <div>■</div> </div>	<div>◀▶</div> <div> <div>REMOTE IN 1 DEVICE:</div> <div>Remote Device 1</div> </div>	Range: 1 to 16 inclusive
MESSAGE	<div>▲▼</div> <div> <div>REMOTE IN 1 BIT PAIR:</div> <div>None</div> </div>	Range: None, DNA-1 to DNA-32, UserSt-1 to UserSt-32
MESSAGE	<div>▲▼</div> <div> <div>REMOTE IN 1 DEFAULT STATE:</div> <div>Off</div> </div>	Range: On, Off
MESSAGE	<div>▲</div> <div> <div>REMOTE IN 1 EVENTS:</div> <div>Disabled</div> </div>	Range: Disabled, Enabled

Remote Inputs which create FlexLogic™ operands at the receiving relay, are extracted from GOOSE messages originating in remote devices. The relay provides 32 Remote Inputs, each of which can be selected from a list consisting of 64 selections: DNA-1 through DNA-32 and UserSt-1 through UserSt-32. The function of DNA inputs is defined in the UCA2 specifications and is presented in the UCA2 DNA ASSIGNMENTS table in the Remote Outputs section. The function of UserSt inputs is defined by the user selection of the FlexLogic™ operand whose state is represented in the GOOSE message. A user must program a DNA point from the appropriate operand.

Remote Input 1 must be programmed to replicate the logic state of a specific signal from a specific remote device for local use. This programming is performed via the three settings shown above.

**REMOTE IN 1 DEVICE** selects the number (1 to 16) of the Remote Device which originates the required signal, as previously assigned to the remote device via the setting **REMOTE DEVICE NN ID** (see REMOTE DEVICES section). **REMOTE IN 1 BIT PAIR** selects the specific bits of the GOOSE message required. **REMOTE IN 1 DEFAULT STATE** selects the logic state for this point if the local relay has just completed startup or the remote device sending the point is declared to be non-communicating.



**For more information on GOOSE specifications, see REMOTE INPUTS/OUTPUTS OVERVIEW in the REMOTE DEVICES section.**



## 5.7.8 REMOTE OUTPUTS: DNA BIT PAIRS

PATH: SETTINGS ⇒ INPUTS/OUTPUTS ⇒ REMOTE OUTPUTS DNA BIT PAIRS ⇒ REMOTE OUTPUTS DNA- 1 BIT PAIR

■ REMOTE OUTPUTS

■ DNA- 1 BIT PAIR

◀ ▶

MESSAGE ▲

DNA- 1 OPERAND:

Off

Range: FlexLogic™ Operand

DNA- 1 EVENTS:

Disabled

Range: Disabled, Enabled

Remote Outputs (1 to 32) are FlexLogic™ operands inserted into GOOSE messages that are transmitted to remote devices on a LAN. Each digital point in the message must be programmed to carry the state of a specific FlexLogic™ operand. The above operand setting represents a specific DNA function (as shown in the following table) to be transmitted.

**Table 5–26: UCA DNA2 ASSIGNMENTS**

DNA	DEFINITION	INTENDED FUNCTION	LOGIC 0	LOGIC 1
1	OperDev		Trip	Close
2	Lock Out		LockoutOff	LockoutOn
3	Initiate Reclosing	Initiate remote reclose sequence	InitRecloseOff	InitRecloseOn
4	Block Reclosing	Prevent/cancel remote reclose sequence	BlockOff	BlockOn
5	Breaker Failure Initiate	Initiate remote breaker failure scheme	BFIOff	BFION
6	Send Transfer Trip	Initiate remote trip operation	TxXfrTripOff	TxXfrTripOn
7	Receive Transfer Trip	Report receipt of remote transfer trip command	RxXfrTripOff	RxXfrTripOn
8	Send Perm	Report permissive affirmative	TxPermOff	TxPermOn
9	Receive Perm	Report receipt of permissive affirmative	RxPermOff	RxPermOn
10	Stop Perm	Override permissive affirmative	StopPermOff	StopPermOn
11	Send Block	Report block affirmative	TxBlockOff	TxBlockOn
12	Receive Block	Report receipt of block affirmative	RxBlockOff	RxBlockOn
13	Stop Block	Override block affirmative	StopBlockOff	StopBlockOn
14	BkrDS	Report breaker disconnect 3-phase state	Open	Closed
15	BkrPhsADS	Report breaker disconnect phase A state	Open	Closed
16	BkrPhsBDS	Report breaker disconnect phase B state	Open	Closed
17	BkrPhsCDS	Report breaker disconnect phase C state	Open	Closed
18	DiscSwDS		Open	Closed
19	Interlock DS		DSLCKOff	DSLCKOn
20	LineEndOpen	Report line open at local end	Open	Closed
21	Status	Report operating status of local GOOSE device	Offline	Available
22	Event		EventOff	EventOn
23	Fault Present		FaultOff	FaultOn
24	Sustained Arc	Report sustained arc	SustArcOff	SustArcOn
25	Downed Conductor	Report downed conductor	DownedOff	DownedOn
26	Sync Closing		SyncClsOff	SyncClsOn
27	Mode	Report mode status of local GOOSE device	Normal	Test
28→32	Reserved			



For more information on GOOSE specifications, see REMOTE INPUTS/OUTPUTS OVERVIEW in the REMOTE DEVICES section.

NOTE

## 5.7.9 REMOTE OUTPUTS: UserSt BIT PAIRS

PATH: SETTINGS ⇒ INPUTS/OUTPUTS ⇒ REMOTE OUTPUTS UserSt BIT PAIRS ⇒ REMOTE OUTPUTS UserSt- 1 BIT PAIR

<input checked="" type="checkbox"/> REMOTE OUTPUTS <input checked="" type="checkbox"/> UserSt- 1 BIT PAIR	<div>◀▶</div> <div>         UserSt- 1 OPERAND:          Off       </div> <div>         UserSt- 1 EVENTS:          Disabled       </div>	Range: FlexLogic™ operand Range: Disabled, Enabled
--	---	---

MESSAGE ▲

Remote Outputs 1 to 32 originate as GOOSE messages to be transmitted to remote devices. Each digital point in the message must be programmed to carry the state of a specific FlexLogic™ operand. The setting above is used to select the operand which represents a specific UserSt function (as selected by the user) to be transmitted.

The following setting represents the time between sending GOOSE messages when there has been no change of state of any selected digital point. This setting is located in the **PRODUCT SETUP** ⇒ **COMMUNICATIONS** ⇒ **UCA/MMS PROTOCOL** settings menu.

DEFAULT GOOSE UPDATE TIME: 60 s	Range: 1 to 60 s in steps of 1
------------------------------------	--------------------------------



For more information on GOOSE specifications, see REMOTE INPUTS/OUTPUTS – OVERVIEW in the REMOTE DEVICES section.

NOTE

## 5.7.10 RESETTING

PATH: SETTINGS ⇒ INPUTS/OUTPUTS ⇒ RESETTING


<input checked="" type="checkbox"/> RESETTING	<div>◀▶</div> <div>         RESET OPERAND:          Off       </div>	Range: FlexLogic™ operand
---	--	---------------------------

Some events can be programmed to latch the faceplate LED event indicators and the target message on the display. Once set, the latching mechanism will hold all of the latched indicators or messages in the set state after the initiating condition has cleared until a RESET command is received to return these latches (not including FlexLogic™ latches) to the reset state. The RESET command can be sent from the faceplate RESET button, a remote device via a communications channel, or any programmed operand.

When the RESET command is received by the relay, two FlexLogic™ operands are created. These operands, which are stored as events, reset the latches if the initiating condition has cleared. The three sources of RESET commands each create the FlexLogic™ operand "RESET OP". Each individual source of a RESET command also creates its individual operand RESET OP (PUSHBUTTON), RESET OP (COMMS) or RESET OP (OPERAND) to identify the source of the command. The setting shown above selects the operand that will create the RESET OP (OPERAND) operand.

## 5.8.1 DCMA INPUTS

PATH: SETTINGS ⇒ TRANSDUCER I/O ⇒ DCMA INPUTS

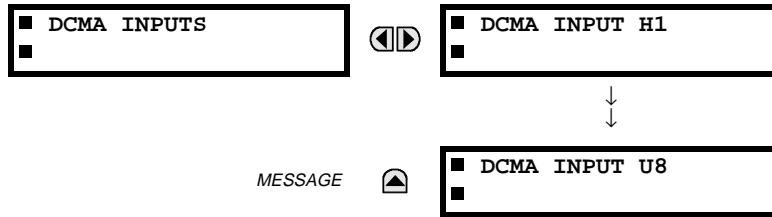


Hardware and software is provided to receive signals from external transducers and convert these signals into a digital format for use as required. The relay will accept inputs in the range of  $-1$  to  $+20$  mA DC, suitable for use with most common transducer output ranges; all inputs are assumed to be linear over the complete range. Specific hardware details are contained in the **HARDWARE** chapter.

Before the DCMA input signal can be used, the value of the signal measured by the relay must be converted to the range and quantity of the external transducer primary input parameter, such as DC voltage or temperature. The relay simplifies this process by internally scaling the output from the external transducer and displaying the actual primary parameter.

DCMA input channels are arranged in a manner similar to CT and VT channels. The user configures individual channels with the settings shown here.

The channels are arranged in sub-modules of two channels, numbered from 1 through 8 from top to bottom. On power-up, the relay will automatically generate configuration settings for every channel, based on the order code, in the same general manner that is used for CTs and VTs. Each channel is assigned a slot letter followed by the row number, 1 through 8 inclusive, which is used as the channel number. The relay generates an actual value for each available input channel.

Settings are automatically generated for every channel available in the specific relay as shown below for the first channel of a type 5F transducer module installed in slot M.

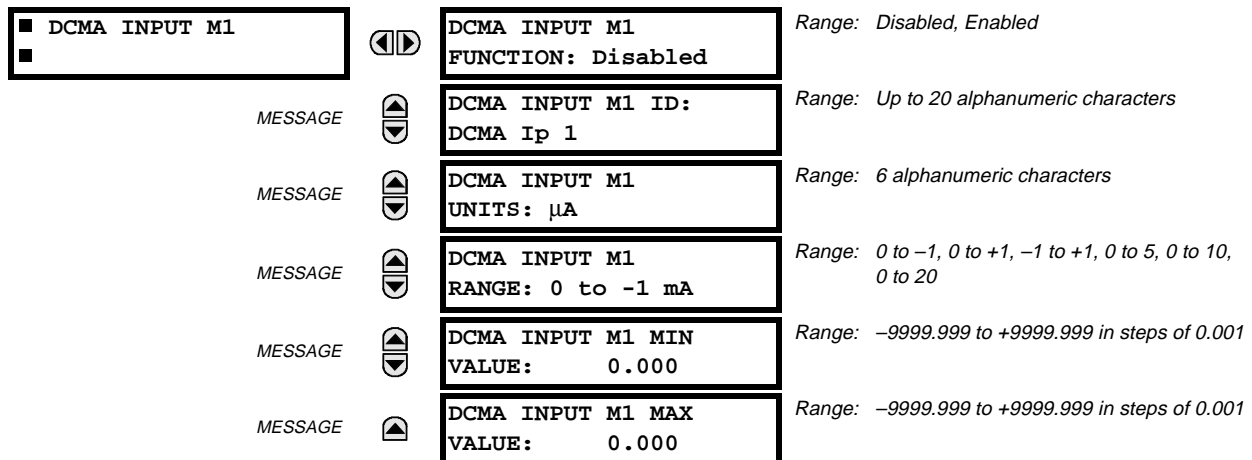


The function of the channel may be either "Enabled" or "Disabled." If Disabled, there will not be an actual value created for the channel. An alphanumeric "ID" is assigned to the channel - this ID will be included in the display of the channel actual value, along with the programmed "UNITS" associated with the parameter measured by the transducer, such as Volt,  $^{\circ}$ C, MegaWatts, etc. This ID is also used to reference the channel as the input parameter to features designed to measure this type of parameter. The RANGE setting is used to select the specific mA DC range of the transducer connected to the input channel.

The MIN VALUE and MAX VALUE settings are used to program the span of the transducer in primary units. For example, a temperature transducer might have a span from 0 to  $250^{\circ}$ C; in this case the MIN value would be 0 and the MAX value 250. Another example would be a Watt transducer with a span from  $-20$  to  $+180$  MW; in this case the MIN value would be  $-20$  and the MAX value 180. Intermediate values between the MIN and MAX are scaled linearly.

## 5.8.2 RTD INPUTS

PATH: SETTINGS ⇌ ⌵ TRANSDUCER I/O ⇌ ⌵ RTD INPUTS

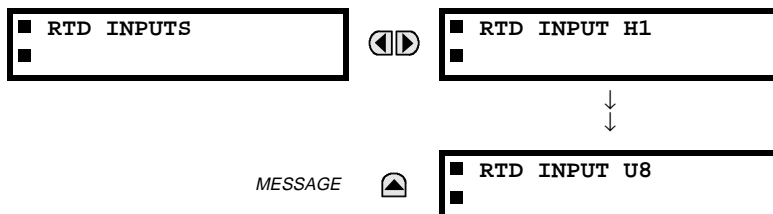


Hardware and software is provided to receive signals from external Resistance Temperature Detectors and convert these signals into a digital format for use as required. These channels are intended to be connected to any of the RTD types in common use. Specific hardware details are contained in the **HARDWARE** chapter.

RTD input channels are arranged in a manner similar to CT and VT channels. The user configures individual channels with the settings shown here.

The channels are arranged in sub-modules of two channels, numbered from 1 through 8 from top to bottom. On power-up, the relay will automatically generate configuration settings for every channel, based on the order code, in the same general manner that is used for CTs and VTs. Each channel is assigned a slot letter followed by the row number, 1 through 8 inclusive, which is used as the channel number. The relay generates an actual value for each available input channel.

Settings are automatically generated for every channel available in the specific relay as shown below for the first channel of a type 5C transducer module installed in slot M.


5

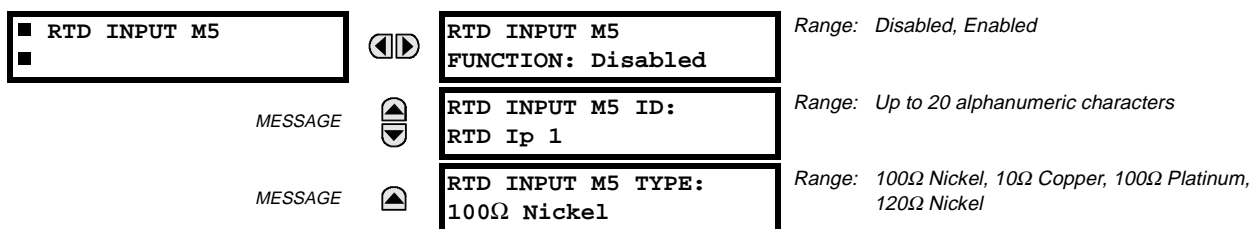

The function of the channel may be either "Enabled" or "Disabled." If Disabled, there will not be an actual value created for the channel. An alphanumeric "ID" is assigned to the channel - this ID will be included in the display of the channel actual value. This ID is also used to reference the channel as the input parameter to features designed to measure this type of parameter. Selecting the type of RTD connected to the channel configures the channel.

## 5.9.1 TEST MODE


PATH: SETTINGS ⇌ TESTING ⇌ TEST MODE



The relay provides test settings to verify that the relay is functional using simulated conditions to test all contact inputs and outputs. While the relay is in Test Mode (**TEST MODE FUNCTION**: "Enabled"), the feature being tested overrides normal functioning of the relay. During this time the Test Mode LED will remain on. Once out of Test Mode (**TEST MODE FUNCTION**: "Disabled"), the normal functioning of the relay will be restored.

## 5.9.2 FORCE CONTACT INPUTS


PATH: SETTINGS ⇌ TESTING ⇌ FORCE CONTACT INPUTS

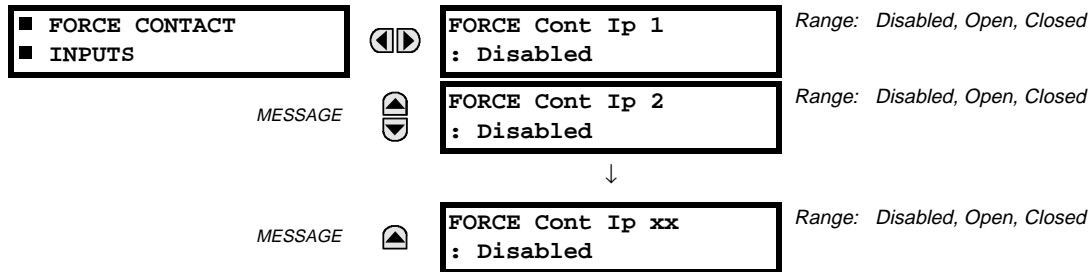

The Force Contact Inputs feature provides a method of performing checks on the function of all contact inputs. Once enabled, the relay is placed into Test Mode, allowing this feature to override the normal function of contact inputs. The Test Mode LED will be ON indicating that the relay is in test mode. The state of each contact input may be programmed as Disabled, Open, or Closed. All contact input operations return to normal when all settings for this feature are disabled.

## 5.9.3 FORCE CONTACT OUTPUTS

PATH: SETTINGS ⇌ TESTING ⇌ FORCE CONTACT OUTPUTS

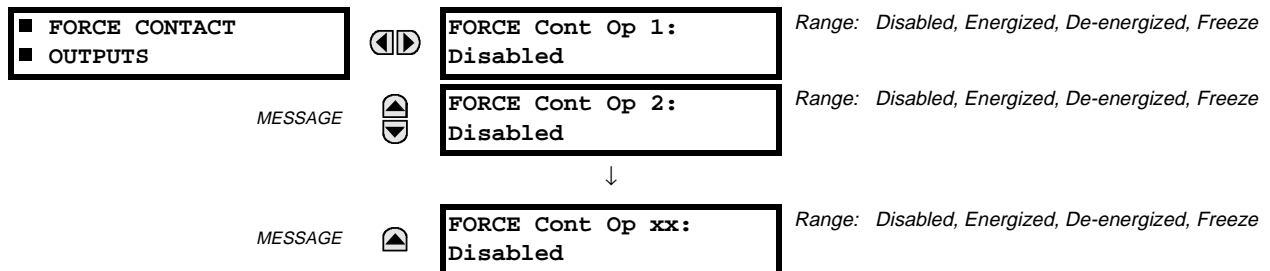

The Force Contact Output feature provides a method of performing checks on all contact outputs. Once enabled, the relay is placed into Test Mode, allowing this feature to override the normal contact outputs functions. The TEST MODE LED will be ON. The state of each contact output may be programmed as Disabled, Energized, De-energized, or Freeze. The Freeze option maintains the output contact in the state at which it was frozen. All contact output operations return to normal when all the settings for this feature are disabled.



## 6.1.1 ACTUAL VALUES MAIN MENU

<div> <div>■ ■ ACTUAL VALUES</div> <div>■ ■ STATUS</div> </div>	◀▶	<div>■ CONTACT INPUTS</div> <div>■</div>	See page 6-3.
▼	▲▼	<div>■ VIRTUAL INPUTS</div> <div>■</div>	See page 6-3.
	▲▼	<div>■ REMOTE INPUTS</div> <div>■</div>	See page 6-3.
	▲▼	<div>■ CONTACT OUTPUTS</div> <div>■</div>	See page 6-4.
	▲▼	<div>■ VIRTUAL OUTPUTS</div> <div>■</div>	See page 6-4.
	▲▼	<div>■ REMOTE DEVICES</div> <div>■ STATUS</div>	See page 6-4.
	▲▼	<div>■ REMOTE DEVICES</div> <div>■ STATISTICS</div>	See page 6-5.
	▲▼	<div>■ DIGITAL COUNTERS</div> <div>■</div>	See page 6-5.
	▲▼	<div>■ FLEX STATES</div> <div>■</div>	See page 6-5.
	▲	<div>■ ETHERNET</div> <div>■</div>	See page 6-5.
▲	◀▶	<div>■ STATOR</div> <div>■ DIFFERENTIAL</div>	See page 6-9.
▼	▲▼	<div>■ SOURCE SRC 1</div> <div>■</div>	See page 6-9.
	▲▼	<div>■ SOURCE SRC 2</div> <div>■</div>	
	▲▼	<div>■ SOURCE SRC 3</div> <div>■</div>	
	▲▼	<div>■ SOURCE SRC 4</div> <div>■</div>	
	▲▼	<div>■ SOURCE SRC 5</div> <div>■</div>	
	▲▼	<div>■ SOURCE SRC 6</div> <div>■</div>	
	▲▼	<div>■ SYNCHROCHECK</div> <div>■</div>	See page 6-12.
	▲▼	<div>■ TRACKING FREQUENCY</div> <div>■</div>	See page 6-12.
	▲▼	<div>■ FLEXELEMENTS</div> <div>■</div>	See page 6-13.
	▲▼	<div>■ SENSITIVE</div> <div>■ DIRECTIONAL POWER</div>	See page 6-13.

	▲▼	■ STATOR ■ GROUND	See page 6-14.
	▲▼	■ VOLTS PER HERTZ 1 ■	See page 6-14.
	▲▼	■ VOLTS PER HERTZ 2 ■	See page 6-14.
	▲▼	■ TRANSDUCER I/O ■ DCMA INPUTS	See page 6-14.
	▲	■ TRANSDUCER I/O ■ RTD INPUTS	See page 6-14.
▲ ■ ■ ACTUAL VALUES ■ ■ RECORDS	◀▶	■ EVENT RECORDS ■	See page 6-15.
▼	▲▼	■ OSCILLOGRAPHY ■	See page 6-15.
	▲	■ DATA LOGGER ■	See page 6-15.
▲ ■ ■ ACTUAL VALUES ■ ■ PRODUCT INFO	◀▶	■ MODEL INFORMATION ■	See page 6-16.
	▲	■ FIRMWARE REVISIONS ■	See page 6-16.






For status reporting, 'On' represents Logic 1 and 'Off' represents Logic 0.

### 6.2.1 CONTACT INPUTS


PATH: ACTUAL VALUES ⇒ STATUS ⇒ CONTACT INPUTS

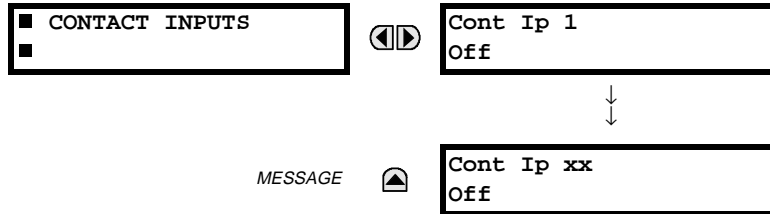

The present status of the contact inputs is shown here. The first line of a message display indicates the ID of the contact input. For example, 'Cont Ip 1' refers to the contact input in terms of the default name-array index. The second line of the display indicates the logic state of the contact input.

### 6.2.2 VIRTUAL INPUTS


PATH: ACTUAL VALUES ⇒ STATUS ⇒ VIRTUAL INPUTS

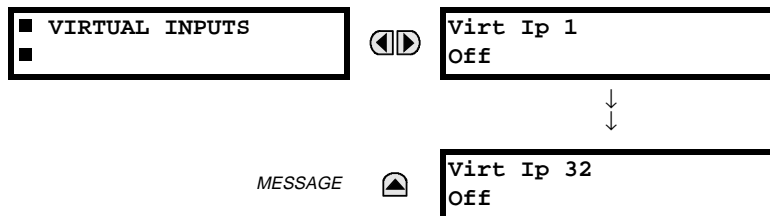

The present status of the 32 virtual inputs is shown here. The first line of a message display indicates the ID of the virtual input. For example, 'Virt Ip 1' refers to the virtual input in terms of the default name-array index. The second line of the display indicates the logic state of the virtual input.

### 6.2.3 REMOTE INPUTS

PATH: ACTUAL VALUES ⇒ STATUS ⇒ REMOTE INPUTS

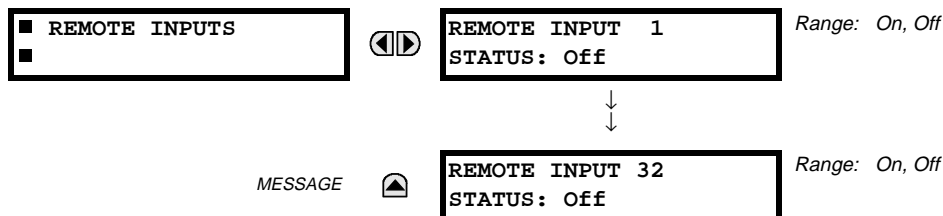


The present state of the 32 remote inputs is shown here.

The state displayed will be that of the remote point unless the remote device has been established to be "Offline" in which case the value shown is the programmed default state for the remote input.


6.2.4 CONTACT OUTPUTS

PATH: ACTUAL VALUES ⇒ STATUS ⇒ CONTACT OUTPUTS

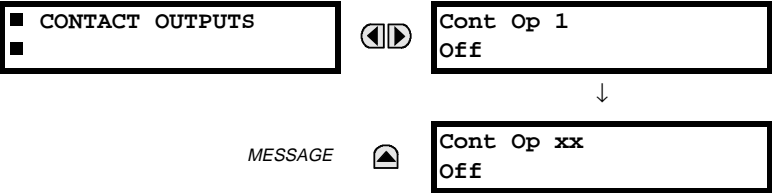

The present state of the contact outputs is shown here.

The first line of a message display indicates the ID of the contact output. For example, 'Cont Op 1' refers to the contact output in terms of the default name-array index. The second line of the display indicates the logic state of the contact output.

 **For Form-A outputs, the state of the voltage(V) and/or current(I) detectors will show as: Off, VOff, IOff, On, VOn, and/or IOn. For Form-C outputs, the state will show as Off or On.**

6.2.5 VIRTUAL OUTPUTS


PATH: ACTUAL VALUES ⇒ STATUS ⇒ VIRTUAL OUTPUTS



The present state of up to 64 virtual outputs is shown here. The first line of a message display indicates the ID of the virtual output. For example, 'Virt Op 1' refers to the virtual output in terms of the default name-array index. The second line of the display indicates the logic state of the virtual output, as calculated by the FlexLogic™ equation for that output.

6.2.6 REMOTE DEVICES STATUS

PATH: ACTUAL VALUES ⇒ STATUS ⇒ REMOTE DEVICES STATUS

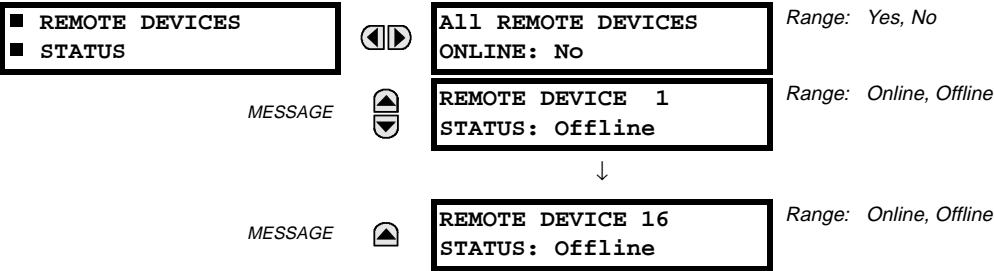

The present state of up to 16 programmed Remote Devices is shown here. The **ALL REMOTE DEVICES ONLINE** message indicates whether or not all programmed Remote Devices are online. If the corresponding state is "No", then at least one required Remote Device is not online.

## 6.2.7 REMOTE DEVICES STATISTICS

PATH: ACTUAL VALUES ⇒ STATUS ⇒ REMOTE DEVICES STATISTICS ⇒ REMOTE DEVICE 1(16)

■ REMOTE DEVICE 1	◀▶	REMOTE DEVICE 1 StNum: 0
MESSAGE ▲		REMOTE DEVICE 1 SqNum: 0

Statistical data (2 types) for up to 16 programmed Remote Devices is shown here.

- The **StNum** number is obtained from the indicated Remote Device and is incremented whenever a change of state of at least one DNA or UserSt bit occurs.
- The **SqNum** number is obtained from the indicated Remote Device and is incremented whenever a GOOSE message is sent. This number will rollover to zero when a count of 4,294,967,295 is incremented.

## 6.2.8 DIGITAL COUNTERS

PATH: ACTUAL VALUES ⇒ DIGITAL COUNTERS ⇒ DIGITAL COUNTERS ⇒ DIGITAL COUNTERS Counter 1(8)

■ DIGITAL COUNTERS	◀▶	Counter 1 ACCUM: 0
■ Counter 1	MESSAGE ▲	Counter 1 FROZEN: 0
MESSAGE ▲	▼	Counter 1 FROZEN: YYYY/MM/DD HH:MM:SS
MESSAGE ▲	▲	Counter 1 MICROS: 0

The present status of the 8 digital counters is shown here. The status of each counter, with the user-defined counter name, includes the accumulated and frozen counts (the count units label will also appear). Also included, is the date/time stamp for the frozen count. The **Counter n MICROS** value refers to the microsecond portion of the time stamp.

## 6.2.9 FLEX STATES

PATH: ACTUAL VALUES ⇒ STATUS ⇒ FLEX STATES

■ FLEX STATES	◀▶	PARAM 1: Off Off	Range: Off, On
		↓	
MESSAGE ▲	▲	PARAM 256: Off Off	Range: Off, On

There are 256 FlexState bits available. The second line value indicates the state of the given FlexState bit.

## 6.2.10 ETHERNET

PATH: ACTUAL VALUES ⇒ STATUS ⇒ ETHERNET

■ ETHERNET	◀▶	ETHERNET PRI LINK STATUS: OK	Range: Fail, OK
MESSAGE ▲	▲	ETHERNET SEC LINK STATUS: OK	Range: Fail, OK

## 6.3.1 METERING CONVENTIONS

## a) UR CONVENTION FOR MEASURING POWER AND ENERGY

The following figure illustrates the conventions established for use in UR relays.

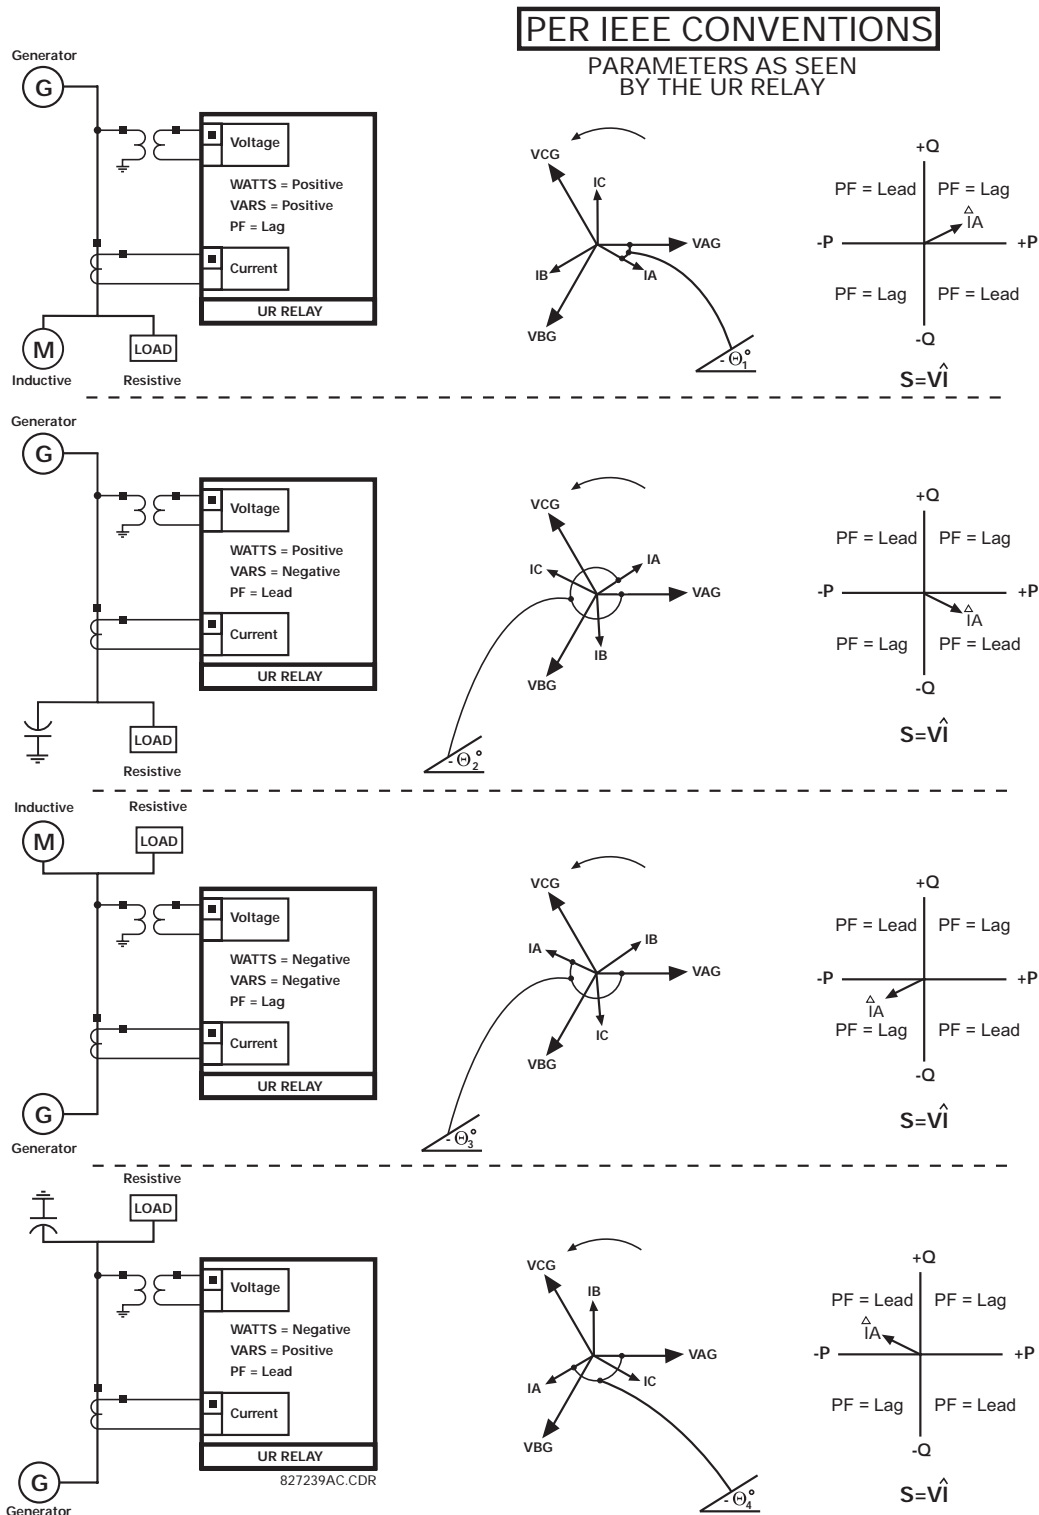


Figure 6-1: FLOW DIRECTION OF SIGNED VALUES FOR WATTS AND VARS

### b) UR CONVENTION FOR MEASURING SYMMETRICAL COMPONENTS

All phasors calculated by UR relays and used for protection, control and metering functions are rotating phasors that maintain the correct phase angle relationships with each other at all times.

For display and oscillography purposes, all phasor angles in a given relay are referred to an AC input channel pre-selected by the **SETTINGS** ⇒ **SYSTEM SETUP** ⇒ **POWER SYSTEM** ⇒ **FREQUENCY AND PHASE REFERENCE** setting. This setting defines a particular Source to be used as the reference.

The relay will first determine if any "Phase VT" bank is indicated in the Source. If it is, voltage channel VA of that bank is used as the angle reference. Otherwise, the relay determines if any "Aux VT" bank is indicated; if it is, the auxiliary voltage channel of that bank is used as the angle reference. If neither of the two conditions is satisfied, then two more steps of this hierarchical procedure to determine the reference signal include "Phase CT" bank and "Ground CT" bank.

If the AC signal pre-selected by the relay upon configuration is not measurable, the phase angles are not referenced. The phase angles are assigned as positive in the leading direction, and are presented as negative in the lagging direction, to more closely align with power system metering conventions. This is illustrated below.

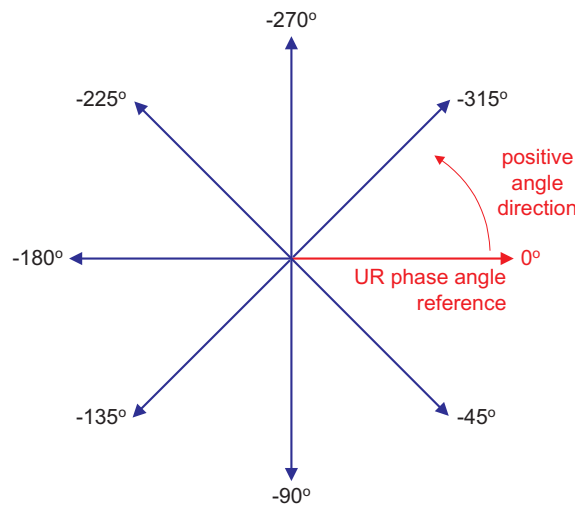


Figure 6-2: UR PHASE ANGLE MEASUREMENT CONVENTION

### c) UR CONVENTION FOR MEASURING SYMMETRICAL COMPONENTS

UR relays calculate voltage symmetrical components for the power system phase A line-to-neutral voltage, and symmetrical components of the currents for the power system phase A current. Owing to the above definition, phase angle relations between the symmetrical currents and voltages stay the same irrespective of the connection of instrument transformers. This is important for setting directional protection elements that use symmetrical voltages.

For display and oscillography purposes the phase angles of symmetrical components are referenced to a common reference as described in the previous sub-section.

#### WYE-Connected Instrument Transformers:

- ABC phase rotation:

$$V_{-0} = \frac{1}{3}(V_{AG} + V_{BG} + V_{CG})$$

$$V_{-1} = \frac{1}{3}(V_{AG} + aV_{BG} + a^2V_{CG})$$

$$V_{-2} = \frac{1}{3}(V_{AG} + a^2V_{BG} + aV_{CG})$$

- ACB phase rotation:

$$V_{-0} = \frac{1}{3}(V_{AG} + V_{BG} + V_{CG})$$

$$V_{-1} = \frac{1}{3}(V_{AG} + a^2V_{BG} + aV_{CG})$$

$$V_{-2} = \frac{1}{3}(V_{AG} + aV_{BG} + a^2V_{CG})$$

The above equations apply to currents as well.

**DELTA-Connected Instrument Transformers:**

- ABC phase rotation:

$$V_0 = N/A$$

$$V_1 = \frac{1\angle-30^\circ}{3\sqrt{3}}(V_{AB} + aV_{BC} + a^2V_{CA})$$

$$V_2 = \frac{1\angle30^\circ}{3\sqrt{3}}(V_{AB} + a^2V_{BC} + aV_{CA})$$

- ACB phase rotation:

$$V_0 = N/A$$

$$V_1 = \frac{1\angle30^\circ}{3\sqrt{3}}(V_{AB} + a^2V_{BC} + aV_{CA})$$

$$V_2 = \frac{1\angle-30^\circ}{3\sqrt{3}}(V_{AB} + aV_{BC} + a^2V_{CA})$$


The zero-sequence voltage is not measurable under the DELTA connection of instrument transformers and is defaulted to zero. The table below shows an example of symmetrical components calculations for the ABC phase rotation.

**Table 6–1: CALCULATING VOLTAGE SYMMETRICAL COMPONENTS EXAMPLE**

SYSTEM VOLTAGES, SEC. V *						VT CONN.	UR INPUTS, SEC. V			SYMM. COMP, SEC. V		
V <sub>AG</sub>	V <sub>BG</sub>	V <sub>CG</sub>	V <sub>AB</sub>	V <sub>BC</sub>	V <sub>CA</sub>		F5AC	F6AC	F7AC	V <sub>0</sub>	V <sub>1</sub>	V <sub>2</sub>
13.9 ∠0°	76.2 ∠-125°	79.7 ∠-250°	84.9 ∠-313°	138.3 ∠-97°	85.4 ∠-241°	WYE	13.9 ∠0°	76.2 ∠-125°	79.7 ∠-250°	19.5 ∠-192°	56.5 ∠-7°	23.3 ∠-187°
UNKNOWN (only V <sub>1</sub> and V <sub>2</sub> can be determined)			84.9 ∠0°	138.3 ∠-144°	85.4 ∠-288°	DELTA	84.9 ∠0°	138.3 ∠-144°	85.4 ∠-288°	N/A	56.5 ∠-54°	23.3 ∠-234°

- \* The power system voltages are phase-referenced – for simplicity – to V<sub>AG</sub> and V<sub>AB</sub>, respectively. This, however, is a relative matter. It is important to remember that the UR displays are always referenced as specified under **SETTINGS**  
⇒ **SYSTEM SETUP** ⇒ **POWER SYSTEM** ⇒ **FREQUENCY AND PHASE REFERENCE**.

The example above is illustrated in the following figure.

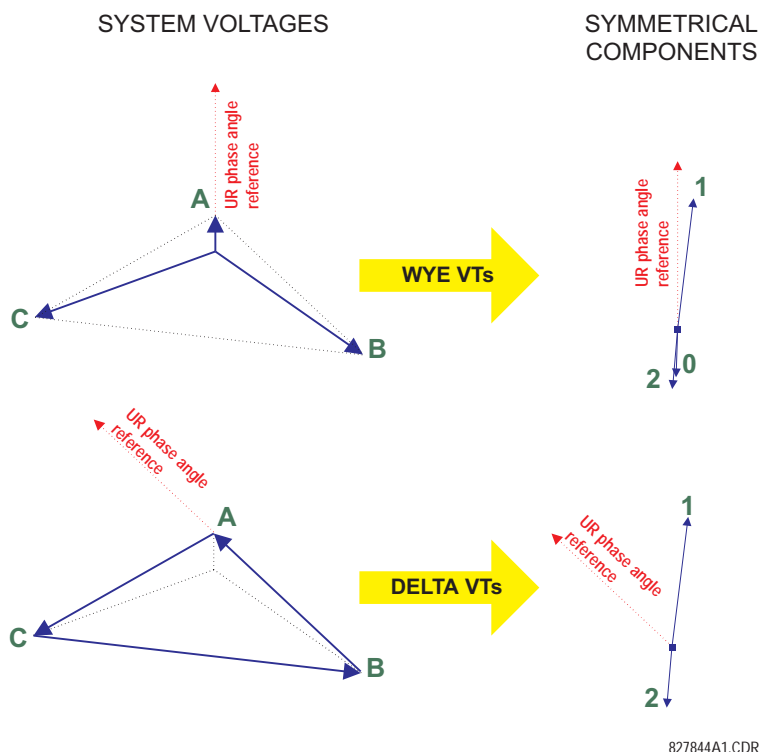

827844A1.CDR

**Figure 6–3: ILLUSTRATION OF THE UR CONVENTION FOR SYMMETRICAL COMPONENTS**

## 6.3.2 STATOR DIFFERENTIAL

PATH: ACTUAL VALUES ⇌ METERING ⇌ STATOR DIFFERENTIAL ⇌ STATOR DIFFERENTIAL

<div> <div>■ STATOR</div> <div>■ DIFFERENTIAL</div> </div>				STATOR DIFF OPERATE
				Iad: 0.00 A
MESSAGE				STATOR DIFF RESTRAIN
				Iar: 0.00 A
MESSAGE				STATOR DIFF OPERATE
				Ibd: 0.00 A
MESSAGE				STATOR DIFF RESTRAIN
				Iar: 0.00 A
MESSAGE				STATOR DIFF OPERATE
				Icd: 0.00 A
MESSAGE				STATOR DIFF RESTRAIN
				Icr: 0.00 A

The phasors of differential and restraint currents are displayed in primary amperes.

## 6.3.3 SOURCES

PATH: ACTUAL VALUES ⇌ METERING ⇌ SOURCE SRC 1 ⇌

<div> <div>■ PHASE CURRENT</div> <div>■ SRC 1</div> </div>				SRC 1 RMS Ia: 0.000
				b: 0.000 c: 0.000 A
MESSAGE				SRC 1 RMS Ia:
				0.000 A
MESSAGE				SRC 1 RMS Ib:
				0.000 A
MESSAGE				SRC 1 RMS Ic:
				0.000 A
MESSAGE				SRC 1 RMS In:
				0.000 A
MESSAGE				SRC 1 PHASOR Ia:
				0.000 A 0.0°
MESSAGE				SRC 1 PHASOR Ib:
				0.000 A 0.0°
MESSAGE				SRC 1 PHASOR Ic:
				0.000 A 0.0°
MESSAGE				SRC 1 PHASOR In:
				0.000 A 0.0°
MESSAGE				SRC 1 ZERO SEQ I0:
				0.000 A 0.0°
MESSAGE				SRC 1 POS SEQ I1:
				0.000 A 0.0°
MESSAGE				SRC 1 NEG SEQ I2:
				0.000 A 0.0°



<div> <div>■ GROUND CURRENT</div> <div>■ SRC 1</div> </div>			SRC 1 RMS Ig:
			0.000 A
	MESSAGE		
			SRC 1 PHASOR Ig:
			0.000 A 0.0°
	MESSAGE		
			SRC 1 PHASOR Igd:
			0.000 A 0.0°
<div> <div>■ PHASE VOLTAGE</div> <div>■ SRC 1</div> </div>			SRC 1 RMS Vag:
			0.000 V
	MESSAGE		
			SRC 1 RMS Vbg:
			0.000 V
	MESSAGE		
			SRC 1 RMS Vcg:
			0.000 V
	MESSAGE		
			SRC 1 PHASOR Vag:
			0.000 V 0.0°
	MESSAGE		
			SRC 1 PHASOR Vbg:
			0.000 V 0.0°
	MESSAGE		
			SRC 1 PHASOR Vcg:
			0.000 V 0.0°
	MESSAGE		
			SRC 1 RMS Vab:
			0.000 V
	MESSAGE		
			SRC 1 RMS Vbc:
			0.000 V
	MESSAGE		
			SRC 1 RMS Vca:
			0.000 V
	MESSAGE		
			SRC 1 PHASOR Vab:
			0.000 V 0.0°
	MESSAGE		
			SRC 1 PHASOR Vbc:
			0.000 V 0.0°
	MESSAGE		
			SRC 1 PHASOR Vca:
			0.000 V 0.0°
	MESSAGE		
			SRC 1 ZERO SEQ V0:
			0.000 V 0.0°
	MESSAGE		
			SRC 1 POS SEQ V1:
			0.000 V 0.0°
	MESSAGE		
			SRC 1 NEG SEQ V2:
			0.000 V 0.0°
<div> <div>■ AUXILIARY VOLTAGE</div> <div>■ SRC 1</div> </div>			SRC 1 RMS Vx:
			0.000 V
	MESSAGE		
			SRC 1 PHASOR Vx:
			0.000 V 0.0°



<div> <div> <div>■ POWER</div> <div>■ SRC 1</div> </div> </div>			<div> <div> <div>◀▶</div> </div> </div>	<div> <div>SRC 1 REAL POWER</div> <div>3φ: 0.000 W</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 REAL POWER</div> <div>φa: 0.000 W</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 REAL POWER</div> <div>φb: 0.000 W</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 REAL POWER</div> <div>φc: 0.000 W</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 REACTIVE PWR</div> <div>3φ: 0.000 var</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 REACTIVE PWR</div> <div>φa: 0.000 var</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 REACTIVE PWR</div> <div>φb: 0.000 var</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 REACTIVE PWR</div> <div>φc: 0.000 var</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 APPARENT PWR</div> <div>3φ: 0.000 VA</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 APPARENT PWR</div> <div>φa: 0.000 VA</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 APPARENT PWR</div> <div>φb: 0.000 VA</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 APPARENT PWR</div> <div>φc: 0.000 VA</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 POWER FACTOR</div> <div>3φ: 1.000</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 POWER FACTOR</div> <div>φa: 1.000</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 POWER FACTOR</div> <div>φb: 1.000</div> </div>
	MESSAGE	▲	<div> <div> <div>▲</div> </div> </div>	<div> <div>SRC 1 POWER FACTOR</div> <div>φc: 1.000</div> </div>
		▲		
<div> <div> <div>■ ENERGY</div> <div>■ SRC 1</div> </div> </div>			<div> <div> <div>◀▶</div> </div> </div>	<div> <div>SRC 1 POS WATTHOUR:</div> <div>0.000 Wh</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 NEG WATTHOUR:</div> <div>0.000 Wh</div> </div>
	MESSAGE	▲▼	<div> <div> <div>▲▼</div> </div> </div>	<div> <div>SRC 1 POS VARHOUR:</div> <div>0.000 varh</div> </div>
	MESSAGE	▲	<div> <div> <div>▲</div> </div> </div>	<div> <div>SRC 1 NEG VARHOUR:</div> <div>0.000 varh</div> </div>
		▲		
<div> <div> <div>■ FREQUENCY</div> <div>■ SRC 1</div> </div> </div>			<div> <div> <div>◀▶</div> </div> </div>	<div> <div>SRC 1 FREQUENCY:</div> <div>0.00 Hz</div> </div>

A maximum of 4 identical Source menus are available, numbered from SRC 1 to SRC 4. "SRC 1" will be replaced by whatever name was programmed by the user for the associated source (see **SETTINGS** ⇒ **SYSTEM SETUP** ⇒ **SIGNAL SOURCES**).

**SOURCE FREQUENCY** is measured via software-implemented zero-crossing detection of an AC signal. The signal is either a Clarke transformation of three-phase voltages or currents, auxiliary voltage, or ground current as per source configuration (see **SETTINGS** ⇒ **SYSTEM SETUP** ⇒ **POWER SYSTEM**). The signal used for frequency estimation is low-pass filtered. The final frequency measurement is passed through a validation filter that eliminates false readings due to signal distortions and transients.

6.3.4 SYNCHROCHECK

PATH: ACTUAL VALUES ⇒ METERING ⇒ SYNCHROCHECK ⇒ SYNCHROCHECK 1

■ SYNCHROCHECK1

■

MESSAGE

MESSAGE

◀▶

SYNCHROCHECK 1 DELTA  
VOLT: 0.000 V

▲▼

SYNCHROCHECK 1 DELTA  
PHASE: 0.0°

▲

SYNCHROCHECK 1 DELTA  
FREQ: 0.00 Hz

The Actual Values menu for SYNCHROCHECK2 is identical to that of SYNCHROCHECK1. If a Synchrocheck Function setting is set to "Disabled", the corresponding Actual Values menu item will not be displayed.

6.3.5 TRACKING FREQUENCY

PATH: ACTUAL VALUES ⇒ METERING ⇒ TRACKING FREQUENCY

■ TRACKING FREQUENCY

■

◀▶

TRACKING FREQUENCY:  
60.00 Hz

The tracking frequency is displayed here. The frequency is tracked based on configuration of the reference source. See **SETTINGS** ⇒ **SYSTEM SETUP** ⇒ **POWER SYSTEM** for more details on frequency metering and tracking. With three-phase inputs configured the frequency is measured digitally using a Clarke combination of all three-phase signals for optimized performance during faults, open pole, and VT fuse fail conditions.

## 6.3.6 FLEXELEMENTS™

PATH: ACTUAL VALUES ⇒ METERING ⇒ FLEXELEMENTS ⇒ FLEXELEMENT 1(16)




The operating signals for the FlexElements are displayed in pu values using the following definitions of the base units.

Table 6–2: FLEXELEMENT™ BASE UNITS

dcmA	BASE = maximum value of the <b>DCMA INPUT MAX</b> setting for the two transducers configured under the +IN and –IN inputs.
FREQUENCY	$f_{BASE} = 1 \text{ Hz}$
PHASE ANGLE	$\phi_{BASE} = 360 \text{ degrees}$ (see the UR angle referencing convention)
POWER FACTOR	$PF_{BASE} = 1.00$
RTDs	BASE = 100°C
SENSITIVE DIR POWER (Sns Dir Power)	$P_{BASE}$ = maximum value of $3 \times V_{BASE} \times I_{BASE}$ for the +IN and –IN inputs of the sources configured for the Sensitive Power Directional element(s).
SOURCE CURRENT	$I_{BASE}$ = maximum nominal primary RMS value of the +IN and –IN inputs
SOURCE ENERGY (SRC X Positive Watthours) (SRC X Negative Watthours) (SRC X Positive Varhours) (SRC X Negative Varhours)	$E_{BASE} = 10000 \text{ MWh or MVAh, respectively}$
SOURCE POWER	$P_{BASE}$ = maximum value of $V_{BASE} \times I_{BASE}$ for the +IN and –IN inputs
SOURCE VOLTAGE	$V_{BASE}$ = maximum nominal primary RMS value of the +IN and –IN inputs
STATOR DIFFERENTIAL CURRENT (Stator Diff Iar, Ibr, and Icr)	$I_{BASE}$ = maximum primary RMS value of the +IN and –IN inputs (CT primary for source currents, and bus reference primary current for bus differential currents)
STATOR GROUND 3RD HARMONIC VOLTAGES (Stator Gnd Vn/V0 3rd)	$V_{BASE}$ = Primary phase voltage of the STATOR GROUND SOURCE
STATOR RESTRAINING CURRENT (Stator Diff Iad, Ibd, and Icd)	$I_{BASE}$ = maximum primary RMS value of the +IN and –IN inputs (CT primary for source currents, and bus reference primary current for bus differential currents)
SYNCHROCHECK (Max Delta Volts)	$V_{BASE}$ = maximum primary RMS value of all the sources related to the +IN and –IN inputs
VOLTS PER HERTZ	BASE = 1.00 pu

## 6.3.7 SENSITIVE DIRECTIONAL POWER

PATH: ACTUAL VALUES ⇒ METERING ⇒ SENSITIVE DIRECTIONAL POWER

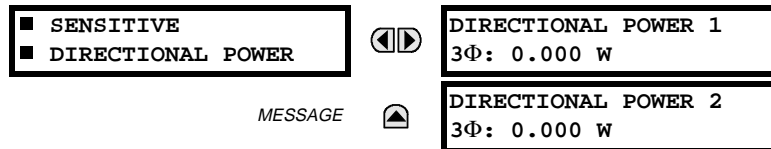

The effective operating quantities of the SENSITIVE DIRECTIONAL POWER elements are displayed here. The display may be useful to calibrate the feature by compensating the angular errors of the CTs and VTs with the use of the RCA and CALIBRATION settings.

## 6.3.8 STATOR GROUND

PATH: ACTUAL VALUES ⇒ METERING ⇒ STATOR GROUND

■ STATOR GROUND	◀▶	STATOR GND 3RD HARM VN: 0.000 V
■ MESSAGE	▲	STATOR GND 3RD HARM VN+V0: 0.000 V

Magnitudes of the 3rd harmonic components in the neutral voltage at the machine neutral point (VN) and in the vector sum of the voltage at the machine neutral point and the zero-sequence voltage at the machine terminals (VN + V0) are available for display. The values are calculated for a signal source specified under STATOR GROUND menu.

These readings may be useful when selecting a PICKUP and SUPERVISION setting for the 100% STATOR GROUND and THIRD HARMONIC NEUTRAL UNDERVOLTAGE protection elements.

## 6.3.9 VOLTS PER HERTZ

PATH: ACTUAL VALUES ⇒ METERING ⇒ VOLTS PER HERTZ 1(2)

■ VOLTS PER HERTZ 1	◀▶	VOLTS PER HERTZ 1: 0.000 pu
---------------------	----	--------------------------------

The V/Hz actual values are displayed in this menu.

## 6.3.10 TRANSDUCER I/O

## a) DCMA INPUTS

PATH: ACTUAL VALUES ⇒ METERING ⇒ TRANSDUCER I/O DCMA INPUTS ⇒ DCMA INPUT xx

■ DCMA INPUT xx	◀▶	DCMA INPUT xx 0.000 mA
-----------------	----	---------------------------

Actual values for each DCMA input channel that is Enabled are displayed with the top line as the programmed channel "ID" and the bottom line as the value followed by the programmed units.

## b) RTD INPUTS


PATH: ACTUAL VALUES ⇒ METERING ⇒ TRANSDUCER I/O RTD INPUTS ⇒ RTD INPUT xx

■ RTD INPUT xx	◀▶	RTD INPUT xx -50 °C
----------------	----	------------------------

Actual values for each RTD input channel that is Enabled are displayed with the top line as the programmed channel "ID" and the bottom line as the value.

## 6.4.1 EVENT RECORDS


PATH: ACTUAL VALUES ⇌ RECORDS ⇌ EVENT RECORDS

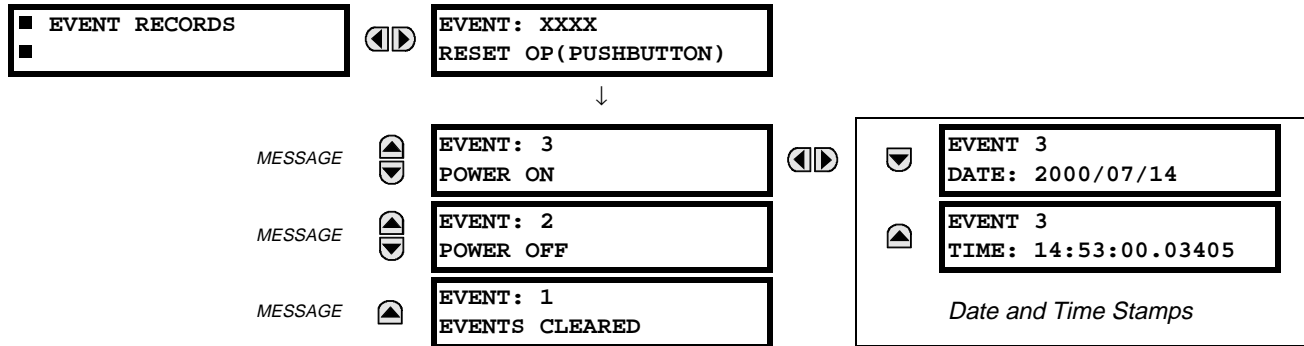

The Event Records menu shows the contextual data associated with up to the last 1024 events, listed in chronological order from most recent to oldest. If all 1024 event records have been filled, the oldest record will be removed as a new record is added. Each event record shows the event identifier/sequence number, cause, and date/time stamp associated with the event trigger. Refer to the **COMMANDS CLEAR RECORDS** menu for clearing event records.

## 6.4.2 OSCILLOGRAPHY

PATH: ACTUAL VALUES ⇌ RECORDS ⇌ OSCILLOGRAPHY

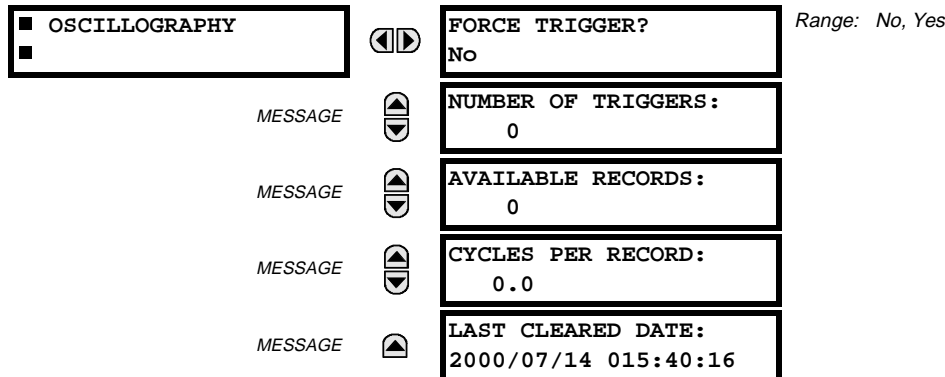


This menu allows the user to view the number of triggers involved and number of oscillography traces available. The 'cycles per record' value is calculated to account for the fixed amount of data storage for oscillography. See the **OSCILLOGRAPHY** section of Chapter 5.

A trigger can be forced here at any time by setting "Yes" to the **FORCE TRIGGER?** command. Refer to the **COMMANDS ⇌ CLEAR RECORDS** menu for clearing the oscillography records.

## 6.4.3 DATA LOGGER

PATH: ACTUAL VALUES ⇌ RECORDS ⇌ DATA LOGGER

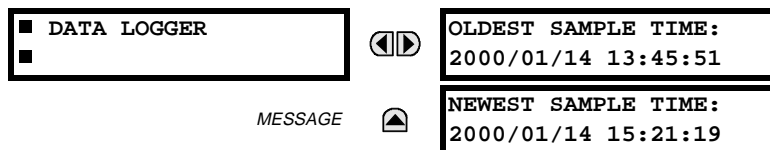

The **OLDEST SAMPLE TIME** is the time at which the oldest available samples were taken. It will be static until the log gets full, at which time it will start counting at the defined sampling rate. The **NEWEST SAMPLE TIME** is the time the most recent samples were taken. It counts up at the defined sampling rate. If Data Logger channels are defined, then both values are static.

Refer to the **COMMANDS ⇌ CLEAR RECORDS** menu for clearing data logger records.

## 6.5.1 MODEL INFORMATION

PATH: ACTUAL VALUES ⇒⇅ PRODUCT INFO ⇒ MODEL INFORMATION

■ MODEL INFORMATION	◀▶	ORDER CODE LINE 1: G60-D00-HCH-F8B-H6B	Example code shown
MESSAGE	▲▼	ORDER CODE LINE 2:	
MESSAGE	▲▼	ORDER CODE LINE 3:	
MESSAGE	▲▼	ORDER CODE LINE 4:	
MESSAGE	▲▼	SERIAL NUMBER:	
MESSAGE	▲▼	ETHERNET MAC ADDRESS 000000000000	
MESSAGE	▲▼	MANUFACTURING DATE: 0	Range: YYYY/MM/DD HH:MM:SS
MESSAGE	▲	OPERATING TIME: 0:00:00	

The product order code, serial number, Ethernet MAC address, date/time of manufacture, and operating time are shown here.


## 6.5.2 FIRMWARE REVISIONS

PATH: ACTUAL VALUES ⇒⇅ PRODUCT INFO ⇒ FIRMWARE REVISIONS


■ FIRMWARE REVISIONS	◀▶	G60 Relay REVISION: 2.9X	Range: 0.00 to 655.35 Revision number of the application firmware.
MESSAGE	▲▼	MODIFICATION FILE NUMBER: 0	Range: 0 to 65535 (ID of the MOD FILE) Value is 0 for each standard firmware release.
MESSAGE	▲▼	BOOT PROGRAM REVISION: 1.12	Range: 0.00 to 655.35 Revision number of the boot program firmware.
MESSAGE	▲▼	FRONT PANEL PROGRAM REVISION: 0.08	Range: 0.00 to 655.35 Revision number of faceplate program firmware.
MESSAGE	▲▼	COMPILE DATE: 2000/09/08 04:55:16	Range: Any valid date and time. Date and time when product firmware was built.
MESSAGE	▲	BOOT DATE: 2000/05/11 16:41:32	Range: Any valid date and time. Date and time when the boot program was built.

The shown data is illustrative only. A modification file number of 0 indicates that, currently, no modifications have been installed.

## 7.1.1 COMMANDS MENU

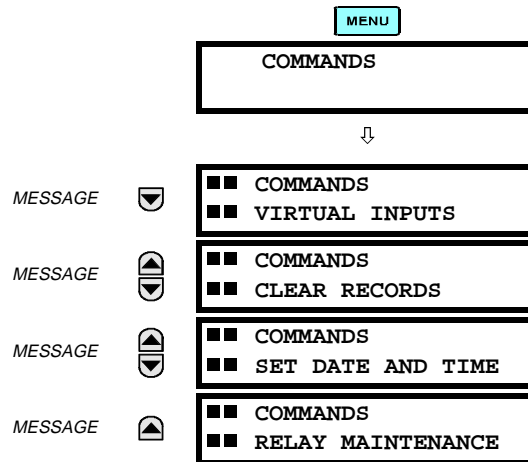


The COMMANDS menu contains relay directives intended for operations personnel. All commands can be protected from unauthorized access via the Command Password; see the PASSWORD SECURITY menu description in the PRODUCT SETUP section of Chapter 5. The following flash message appears after successfully command entry:



## 7.1.2 VIRTUAL INPUTS

PATH: COMMANDS ↓ COMMANDS VIRTUAL INPUTS

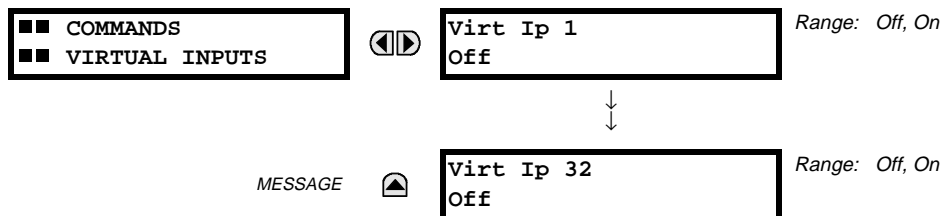

The states of up to 32 virtual inputs are changed here. The first line of the display indicates the ID of the virtual input. The second line indicates the current or selected status of the virtual input. This status will be a logical state 'Off' (0) or 'On' (1).

## 7.1.3 CLEAR RECORDS

PATH: COMMANDS ↓ COMMANDS CLEAR RECORDS

<b>COMMANDS</b> <b>CLEAR RECORDS</b>	◀▶	CLEAR FAULT REPORTS? No	Range: No, Yes
	▲▼	CLEAR EVENT RECORDS? No	Range: No, Yes
	▲▼	CLEAR OSCILLOGRAPHY? No	Range: No, Yes
	▲▼	CLEAR DATA LOGGER? No	Range: No, Yes
	▲	CLEAR ENERGY? No	Range: No, Yes

This menu contains commands for clearing historical data such as the Event Records. Data is cleared by changing a command setting to "Yes" and pressing the **ENTER** key. After clearing data, the command setting automatically reverts to "No".

## 7.1.4 SET DATE AND TIME

PATH: COMMANDS ↓ SET DATE AND TIME

<b>COMMANDS</b> <b>SET DATE AND TIME</b>	◀▶	SET DATE AND TIME: 2000/01/14 13:47:03	(YYYY/MM/DD HH:MM:SS)
---	----	---	-----------------------

The date and time can be entered here via the faceplate keypad, provided that the IRIG-B signal is not being used. The time setting is based on the 24-hour clock. The complete date, as a minimum, must be entered to allow execution of this command. The new time will take effect at the moment the **ENTER** key is clicked.

## 7.1.5 RELAY MAINTENANCE

PATH: COMMANDS ↓ RELAY MAINTENANCE

<b>COMMANDS</b> <b>RELAY MAINTENANCE</b>	◀▶	PERFORM LAMPTEST? No	Range: No, Yes
	▲	UPDATE ORDER CODE? No	Range: No, Yes

This menu contains commands for relay maintenance purposes. Commands are activated by changing a command setting to "Yes" and pressing the **ENTER** key. The command setting will then automatically revert to "No".

The **PERFORM LAMPTEST** command turns on all faceplate LEDs and display pixels for a short duration. The **UPDATE ORDER CODE** command causes the relay to scan the backplane for the hardware modules and update the order code to match. If an update occurs, the following message is shown.

```

UPDATING...
PLEASE WAIT

```

There is no impact if there have been no changes to the hardware modules. When an update does not occur, the following message will be shown.


```

ORDER CODE
NOT UPDATED

```



## 7.2.1 TARGETS MENU

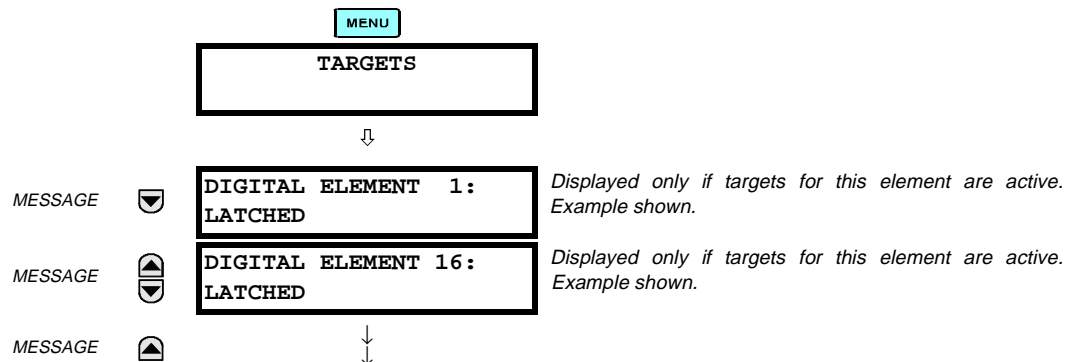

The status of any active targets will be displayed in the TARGETS menu. If no targets are active, the display will read:

No Active  
Targets

## a) TARGET MESSAGES

When there are no active targets, the first target to become active will cause the display to immediately default to that message. If there are active targets and the user is navigating through other messages, and when the default message timer times out (i.e. the keypad has not been used for a determined period of time), the display will again default back to the target message.

The range of variables for the target messages is described below. Phase information will be included if applicable. If a target message status changes, the status with the highest priority will be displayed.

**Table 7-1: TARGET MESSAGE PRIORITY STATUS**

PRIORITY	ACTIVE STATUS	DESCRIPTION
1	OP	element operated and still picked up
2	PKP	element picked up and timed out
3	LATCHED	element had operated but has dropped out

If a self test error is detected, a message appears indicating the cause of the error. For example:

UNIT NOT PROGRAMMED  
:Self Test Error

## 7.2.2 RELAY SELF-TESTS

The relay performs a number of self-test diagnostic checks to ensure device integrity. The two types of self-tests (major and minor) are listed in the tables below. When either type of self-test error occurs, the TROUBLE indicator will turn on and a target message displayed. All errors record an event in the event recorder. Latched errors can be cleared by pressing the RESET key, providing the condition is no longer present.

Major self-test errors also result in the following:

- the critical fail relay on the power supply module is de-energized
- all other output relays are de-energized and are prevented from further operation
- the faceplate IN SERVICE indicator is turned off
- a RELAY OUT OF SERVICE event is recorded

Table 7–2: MAJOR SELF-TEST ERROR MESSAGES

SELF-TEST ERROR MESSAGE	LATCHED TARGET MSG?	DESCRIPTION OF PROBLEM	HOW OFTEN THE TEST IS PERFORMED	WHAT TO DO
UNIT NOT PROGRAMMED	No	<b>PRODUCT SETUP</b> ⇄ <b>INSTALLATION</b> setting indicates relay is not in a programmed state.	On power up and whenever the <b>RELAY PROGRAMMED</b> setting is altered.	Program all settings (especially those under <b>PRODUCT SETUP</b> ⇄ <b>INSTALLATION</b> ).
EQUIPMENT MISMATCH with 2nd-line detail message	No	Configuration of modules does not match the order code stored in the CPU.	On power up; thereafter, the backplane is checked for missing cards every 5 seconds.	Check all module types against the order code, ensure they are inserted properly, and cycle control power (if problem persists, contact the factory).
UNIT NOT CALIBRATED	No	Settings indicate the unit is not calibrated.	On power up.	Contact the factory.
FLEXLOGIC ERR TOKEN with 2nd-line detail message	No	FlexLogic equations do not compile properly.	Event driven; whenever Flex-Logic equations are modified.	Finish all equation editing and use self test to debug any errors.
DSP ERRORS: A/D RESET FAILURE A/D CAL FAILURE A/D INT. MISSING A/D VOLT REF. FAIL NO DSP INTERRUPTS DSP CHECKSUM FAILED DSP FAILED	Yes	CT/VT module with digital signal processor may have a problem.	Every 1/8th of a cycle.	Cycle the control power (if the problem recurs, contact the factory).
PROGRAM MEMORY Test Failed	Yes	Error was found while checking Flash memory.	Once flash is uploaded with new firmware.	Contact the factory.

Table 7–3: MINOR SELF-TEST ERROR MESSAGES

SELF-TEST ERROR MESSAGE	LATCHED TARGET MSG?	DESCRIPTION OF PROBLEM	HOW OFTEN THE TEST IS PERFORMED	WHAT TO DO
EEPROM CORRUPTED	Yes	The non-volatile memory has been corrupted.	On power up only.	Contact the factory.
IRIG-B FAILURE	No	Bad IRIG-B input signal.	Monitored whenever an IRIG-B signal is received.	<ul style="list-style-type: none"> <li>• Ensure the IRIG-B cable is connected to the relay.</li> <li>• Check functionality of the cable (i.e. look for physical damage or perform a continuity test).</li> <li>• Ensure the IRIG-B receiver is functioning properly.</li> <li>• Check the input signal level; it may be lower than specification.</li> </ul> If none of the above items apply, contact the factory.
PRIM ETHERNET FAIL	No	Primary Ethernet connection failed	Monitored every 2 seconds	Check connections.
SEC ETHERNET FAIL	No	Secondary Ethernet connection failed	Monitored every 2 seconds	Check connections.
BATTERY FAIL	No	Battery is not functioning.	Monitored every 5 seconds. Reported after 1 minute if problem persists.	Replace the battery.
PROTOTYPE FIRMWARE	Yes	A prototype version of the firmware is loaded.	On power up only.	Contact the factory.
SYSTEM EXCEPTION or ABNORMAL RESTART	Yes	Abnormal restart due to modules being removed/inserted when powered-up, abnormal DC supply, or internal relay failure.	Event driven.	Contact the factory.
LOW ON MEMORY	Yes	Memory is close to 100% capacity	Monitored every 5 seconds.	Contact the factory.
WATCHDOG ERROR	No	Some tasks are behind schedule	Event driven.	Contact the factory.
REMOTE DEVICE OFFLINE	Yes	One or more GOOSE devices are not responding	Event driven. Occurs when a device programmed to receive GOOSE messages stops receiving message. Time is 1 to 60 sec. depending on GOOSE protocol packets.	Check GOOSE setup

The following tables are provided to keep a record of settings to be used on a relay.

## 8.1.1 SETTINGS

Table 8–1: PRODUCT SETUP (Sheet 1 of 14)

SETTING	VALUE
<b>PASSWORD SECURITY</b>	
Access Level	
Command Password	
Setting Password	
Encrypted Command Password	
Encrypted Setting Password	
<b>DISPLAY PROPERTIES</b>	
Flash Message Time	
Default Message Timeout	
Default Message Intensity	
<b>REAL TIME CLOCK</b>	
IRIG-B Signal Type	
<b>COMMUNICATIONS &gt; SERIAL PORTS</b>	
RS485 COM1 Baud Rate	
RS485 COM1 Parity	
RS485 COM2 Baud Rate	
RS485 COM2 Parity	
<b>COMMUNICATIONS &gt; NETWORK</b>	
IP Address	
Subnet IP Mask	
Gateway IP Address	
OSI Network Address (NSAP)	
Ethernet Operation Mode	
Ethernet Primary Link Monitor	
Ethernet Secondary Link Monitor	
<b>COMMUNICATIONS &gt; MODBUS PROTOCOL</b>	
Modbus Slave Address	
Modbus TCP Port Number	
<b>COMMUNICATIONS &gt; DNP PROTOCOL</b>	
DNP Port	
DNP Address	
DNP Network Client Address 1	
DNP Network Client Address 2	
DNP TCP/UDP Port Number	
DNP Unsol Response Function	
DNP Unsol Response Timeout	
DNP Unsol Response Max Retries	
Unsol Response Dest Address	
User Map for DNP Analogs	
Number of Sources in Analog List	

Table 8–1: PRODUCT SETUP (Sheet 2 of 14)

SETTING	VALUE
DNP Current Scale Factor	
DNP Voltage Scale Factor	
DNP Power Scale Factor	
DNP Energy Scale Factor	
DNP Other Scale Factor	
DNP Current Default Deadband	
DNP Voltage Default Deadband	
DNP Power Default Deadband	
DNP Energy Default Deadband	
DNP Other Default Deadband	
DNP Time Sync In IIN Period	
DNP Message Fragment Size	
<b>COMMUNICATIONS &gt; UCA/MMS PROTOCOL</b>	
Default GOOSE Update Time	
UCA Logical Device	
UCA/MMS TCP Port Number	
<b>COMMUNICATIONS &gt; WEB SERVER HTTP PROT.</b>	
HTTP TCP Port Number	
<b>COMMUNICATIONS &gt; TFTP PROTOCOL</b>	
TFTP Main UDP Port Number	
TFTP Data UDP Port 1 Number	
TFTP Data UDP Port 2 Number	
<b>COMMUNICATIONS &gt; IEC 60870-5-104 PROTOCOL</b>	
IEC 60870-5-104 Function	
IEC TCP Port Number	
IEC Common Address of ASDU	
IEC Cyclic Data Period	
Number of Sources in MMENC1 List	
IEC Current Default Threshold	
IEC Voltage Default Threshold	
IEC Power Default Threshold	
IEC Energy Default Threshold	
IEC Other Default Threshold	
<b>OSCILLOGRAPHY</b>	
Number of Records	
Trigger Mode	
Trigger Position	
Trigger Source	
AC Input Waveforms	

Table 8–1: PRODUCT SETUP (Sheet 3 of 14)

SETTING	VALUE
<b>OSCILLOGRAPHY &gt; DIGITAL CHANNELS</b>	
Digital Channel 1	
Digital Channel 2	
Digital Channel 3	
Digital Channel 4	
Digital Channel 5	
Digital Channel 6	
Digital Channel 7	
Digital Channel 8	
Digital Channel 9	
Digital Channel 10	
Digital Channel 11	
Digital Channel 12	
Digital Channel 13	
Digital Channel 14	
Digital Channel 15	
Digital Channel 16	
Digital Channel 17	
Digital Channel 18	
Digital Channel 19	
Digital Channel 20	
Digital Channel 21	
Digital Channel 22	
Digital Channel 23	
Digital Channel 24	
Digital Channel 25	
Digital Channel 26	
Digital Channel 27	
Digital Channel 28	
Digital Channel 29	
Digital Channel 30	
Digital Channel 31	
Digital Channel 32	
Digital Channel 33	
Digital Channel 34	
Digital Channel 35	
Digital Channel 36	
Digital Channel 37	
Digital Channel 38	
Digital Channel 39	
Digital Channel 40	
Digital Channel 41	
Digital Channel 42	
Digital Channel 43	
Digital Channel 44	
Digital Channel 45	
Digital Channel 46	

Table 8–1: PRODUCT SETUP (Sheet 4 of 14)

SETTING	VALUE
Digital Channel 47	
Digital Channel 48	
Digital Channel 49	
Digital Channel 50	
Digital Channel 51	
Digital Channel 52	
Digital Channel 53	
Digital Channel 54	
Digital Channel 55	
Digital Channel 56	
Digital Channel 57	
Digital Channel 58	
Digital Channel 59	
Digital Channel 60	
Digital Channel 61	
Digital Channel 62	
Digital Channel 63	
Digital Channel 64	
<b>OSCILLOGRAPHY &gt; ANALOG CHANNELS</b>	
Analog Channel 1	
Analog Channel 2	
Analog Channel 3	
Analog Channel 4	
Analog Channel 5	
Analog Channel 6	
Analog Channel 7	
Analog Channel 8	
Analog Channel 9	
Analog Channel 10	
Analog Channel 11	
Analog Channel 12	
Analog Channel 13	
Analog Channel 14	
Analog Channel 15	
Analog Channel 16	
<b>DATA LOGGER</b>	
Rate	
Channel 1	
Channel 2	
Channel 3	
Channel 4	
Channel 5	
Channel 6	
Channel 7	
Channel 8	
Channel 9	
Channel 10	

Table 8–1: PRODUCT SETUP (Sheet 5 of 14)

SETTING	VALUE
Channel 11	
Channel 12	
Channel 13	
Channel 14	
Channel 15	
Channel 16	
<b>USER PROGRAMMABLE LEADS</b>	
Trip LED Input	
Alarm LED Input	
LED 1 Operand	
LED 1 Type	
LED 2 Operand	
LED 2 Type	
LED 3 Operand	
LED 3 Type	
LED 4 Operand	
LED 4 Type	
LED 5 Operand	
LED 5 Type	
LED 6 Operand	
LED 6 Type	
LED 7 Operand	
LED 7 Type	
LED 8 Operand	
LED 8 Type	
LED 9 Operand	
LED 9 Type	
LED 10 Operand	
LED 10 Type	
LED 11 Operand	
LED 11 Type	
LED 12 Operand	
LED 12 Type	
LED 13 Operand	
LED 13 Type	
LED 14 Operand	
LED 14 Type	
LED 15 Operand	
LED 15 Type	
LED 16 Operand	
LED 16 Type	
LED 17 Operand	
LED 17 Type	
LED 18 Operand	
LED 18 Type	
LED 19 Operand	
LED 19 Type	

Table 8–1: PRODUCT SETUP (Sheet 6 of 14)

SETTING	VALUE
LED 20 Operand	
LED 20 Type	
LED 21 Operand	
LED 21 Type	
LED 22 Operand	
LED 22 Type	
LED 23 Operand	
LED 23 Type	
LED 24 Operand	
LED 24 Type	
LED 25 Operand	
LED 25 Type	
LED 26 Operand	
LED 26 Type	
LED 27 Operand	
LED 27 Type	
LED 28 Operand	
LED 28 Type	
LED 29 Operand	
LED 29 Type	
LED 30 Operand	
LED 30 Type	
LED 31 Operand	
LED 31 Type	
LED 32 Operand	
LED 32 Type	
LED 33 Operand	
LED 33 Type	
LED 34 Operand	
LED 34 Type	
LED 35 Operand	
LED 35 Type	
LED 36 Operand	
LED 36 Type	
LED 37 Operand	
LED 37 Type	
LED 38 Operand	
LED 38 Type	
LED 39 Operand	
LED 39 Type	
LED 40 Operand	
LED 40 Type	
LED 41 Operand	
LED 41 Type	
LED 42 Operand	
LED 42 Type	
LED 43 Operand	

Table 8–1: PRODUCT SETUP (Sheet 7 of 14)

SETTING	VALUE
LED 43 Type	
LED 44 Operand	
LED 44 Type	
LED 45 Operand	
LED 45 Type	
LED 46 Operand	
LED 46 Type	
LED 47 Operand	
LED 47 Type	
LED 48 Operand	
LED 48 Type	
<b>FLEX STATE PARAMETERS</b>	
Flex State Parameter 1	
Flex State Parameter 2	
Flex State Parameter 3	
Flex State Parameter 4	
Flex State Parameter 5	
Flex State Parameter 6	
Flex State Parameter 7	
Flex State Parameter 8	
Flex State Parameter 9	
Flex State Parameter 10	
Flex State Parameter 11	
Flex State Parameter 12	
Flex State Parameter 13	
Flex State Parameter 14	
Flex State Parameter 15	
Flex State Parameter 16	
Flex State Parameter 17	
Flex State Parameter 18	
Flex State Parameter 19	
Flex State Parameter 20	
Flex State Parameter 21	
Flex State Parameter 22	
Flex State Parameter 23	
Flex State Parameter 24	
Flex State Parameter 25	
Flex State Parameter 26	
Flex State Parameter 27	
Flex State Parameter 28	
Flex State Parameter 29	
Flex State Parameter 30	
Flex State Parameter 31	
Flex State Parameter 32	
Flex State Parameter 33	
Flex State Parameter 34	
Flex State Parameter 35	

Table 8–1: PRODUCT SETUP (Sheet 8 of 14)

SETTING	VALUE
Flex State Parameter 36	
Flex State Parameter 37	
Flex State Parameter 38	
Flex State Parameter 39	
Flex State Parameter 40	
Flex State Parameter 41	
Flex State Parameter 42	
Flex State Parameter 43	
Flex State Parameter 44	
Flex State Parameter 45	
Flex State Parameter 46	
Flex State Parameter 47	
Flex State Parameter 48	
Flex State Parameter 49	
Flex State Parameter 50	
Flex State Parameter 51	
Flex State Parameter 52	
Flex State Parameter 53	
Flex State Parameter 54	
Flex State Parameter 55	
Flex State Parameter 56	
Flex State Parameter 57	
Flex State Parameter 58	
Flex State Parameter 59	
Flex State Parameter 60	
Flex State Parameter 61	
Flex State Parameter 62	
Flex State Parameter 63	
Flex State Parameter 64	
Flex State Parameter 65	
Flex State Parameter 66	
Flex State Parameter 67	
Flex State Parameter 68	
Flex State Parameter 69	
Flex State Parameter 70	
Flex State Parameter 71	
Flex State Parameter 72	
Flex State Parameter 73	
Flex State Parameter 74	
Flex State Parameter 75	
Flex State Parameter 76	
Flex State Parameter 77	
Flex State Parameter 78	
Flex State Parameter 79	
Flex State Parameter 80	
Flex State Parameter 81	
Flex State Parameter 82	

Table 8–1: PRODUCT SETUP (Sheet 9 of 14)

SETTING	VALUE
Flex State Parameter 83	
Flex State Parameter 84	
Flex State Parameter 85	
Flex State Parameter 86	
Flex State Parameter 87	
Flex State Parameter 88	
Flex State Parameter 89	
Flex State Parameter 90	
Flex State Parameter 91	
Flex State Parameter 92	
Flex State Parameter 93	
Flex State Parameter 94	
Flex State Parameter 95	
Flex State Parameter 96	
Flex State Parameter 97	
Flex State Parameter 98	
Flex State Parameter 99	
Flex State Parameter 100	
Flex State Parameter 101	
Flex State Parameter 102	
Flex State Parameter 103	
Flex State Parameter 104	
Flex State Parameter 105	
Flex State Parameter 106	
Flex State Parameter 107	
Flex State Parameter 108	
Flex State Parameter 109	
Flex State Parameter 110	
Flex State Parameter 111	
Flex State Parameter 112	
Flex State Parameter 113	
Flex State Parameter 114	
Flex State Parameter 115	
Flex State Parameter 116	
Flex State Parameter 117	
Flex State Parameter 118	
Flex State Parameter 119	
Flex State Parameter 120	
Flex State Parameter 121	
Flex State Parameter 122	
Flex State Parameter 123	
Flex State Parameter 124	
Flex State Parameter 125	
Flex State Parameter 126	
Flex State Parameter 127	
Flex State Parameter 128	
Flex State Parameter 129	

Table 8–1: PRODUCT SETUP (Sheet 10 of 14)

SETTING	VALUE
Flex State Parameter 130	
Flex State Parameter 131	
Flex State Parameter 132	
Flex State Parameter 133	
Flex State Parameter 134	
Flex State Parameter 135	
Flex State Parameter 136	
Flex State Parameter 137	
Flex State Parameter 138	
Flex State Parameter 139	
Flex State Parameter 140	
Flex State Parameter 141	
Flex State Parameter 142	
Flex State Parameter 143	
Flex State Parameter 144	
Flex State Parameter 145	
Flex State Parameter 146	
Flex State Parameter 147	
Flex State Parameter 148	
Flex State Parameter 149	
Flex State Parameter 150	
Flex State Parameter 151	
Flex State Parameter 152	
Flex State Parameter 153	
Flex State Parameter 154	
Flex State Parameter 155	
Flex State Parameter 156	
Flex State Parameter 157	
Flex State Parameter 158	
Flex State Parameter 159	
Flex State Parameter 160	
Flex State Parameter 161	
Flex State Parameter 162	
Flex State Parameter 163	
Flex State Parameter 164	
Flex State Parameter 165	
Flex State Parameter 166	
Flex State Parameter 167	
Flex State Parameter 168	
Flex State Parameter 169	
Flex State Parameter 170	
Flex State Parameter 171	
Flex State Parameter 172	
Flex State Parameter 173	
Flex State Parameter 174	
Flex State Parameter 175	
Flex State Parameter 176	

Table 8–1: PRODUCT SETUP (Sheet 11 of 14)

SETTING	VALUE
Flex State Parameter 177	
Flex State Parameter 178	
Flex State Parameter 179	
Flex State Parameter 180	
Flex State Parameter 181	
Flex State Parameter 182	
Flex State Parameter 183	
Flex State Parameter 184	
Flex State Parameter 185	
Flex State Parameter 186	
Flex State Parameter 187	
Flex State Parameter 188	
Flex State Parameter 189	
Flex State Parameter 190	
Flex State Parameter 191	
Flex State Parameter 192	
Flex State Parameter 193	
Flex State Parameter 194	
Flex State Parameter 195	
Flex State Parameter 196	
Flex State Parameter 197	
Flex State Parameter 198	
Flex State Parameter 199	
Flex State Parameter 200	
Flex State Parameter 201	
Flex State Parameter 202	
Flex State Parameter 203	
Flex State Parameter 204	
Flex State Parameter 205	
Flex State Parameter 206	
Flex State Parameter 207	
Flex State Parameter 208	
Flex State Parameter 209	
Flex State Parameter 210	
Flex State Parameter 211	
Flex State Parameter 212	
Flex State Parameter 213	
Flex State Parameter 214	
Flex State Parameter 215	
Flex State Parameter 216	
Flex State Parameter 217	
Flex State Parameter 218	
Flex State Parameter 219	
Flex State Parameter 220	
Flex State Parameter 221	
Flex State Parameter 222	
Flex State Parameter 223	

Table 8–1: PRODUCT SETUP (Sheet 12 of 14)

SETTING	VALUE
Flex State Parameter 224	
Flex State Parameter 225	
Flex State Parameter 226	
Flex State Parameter 227	
Flex State Parameter 228	
Flex State Parameter 229	
Flex State Parameter 230	
Flex State Parameter 231	
Flex State Parameter 232	
Flex State Parameter 233	
Flex State Parameter 234	
Flex State Parameter 235	
Flex State Parameter 236	
Flex State Parameter 237	
Flex State Parameter 238	
Flex State Parameter 239	
Flex State Parameter 240	
Flex State Parameter 241	
Flex State Parameter 242	
Flex State Parameter 243	
Flex State Parameter 244	
Flex State Parameter 245	
Flex State Parameter 246	
Flex State Parameter 247	
Flex State Parameter 248	
Flex State Parameter 249	
Flex State Parameter 250	
Flex State Parameter 251	
Flex State Parameter 252	
Flex State Parameter 253	
Flex State Parameter 254	
Flex State Parameter 255	
Flex State Parameter 256	
<b>USER DISPLAY 1</b>	
Disp 1 Top Line	
Disp 1 Bottom Line	
Disp 1 Item 1	
Disp 1 Item 2	
Disp 1 Item 3	
Disp 1 Item 4	
Disp 1 Item 5	
<b>USER DISPLAY 2</b>	
Disp 2 Top Line	
Disp 2 Bottom Line	
Disp 2 Item 1	
Disp 2 Item 2	
Disp 2 Item 3	



Table 8–1: PRODUCT SETUP (Sheet 13 of 14)

SETTING	VALUE
Disp 2 Item 4	
Disp 2 Item 5	
<b>USER DISPLAY 3</b>	
Disp 3 Top Line	
Disp 3 Bottom Line	
Disp 3 Item 1	
Disp 3 Item 2	
Disp 3 Item 3	
Disp 3 Item 4	
Disp 3 Item 5	
<b>USER DISPLAY 4</b>	
Disp 4 Top Line	
Disp 4 Bottom Line	
Disp 4 Item 1	
Disp 4 Item 2	
Disp 4 Item 3	
Disp 4 Item 4	
Disp 4 Item 5	
<b>USER DISPLAY 5</b>	
Disp 5 Top Line	
Disp 5 Bottom Line	
Disp 5 Item 1	
Disp 5 Item 2	
Disp 5 Item 3	
Disp 5 Item 4	
Disp 5 Item 5	
<b>USER DISPLAY 6</b>	
Disp 6 Top Line	
Disp 6 Bottom Line	
Disp 6 Item 1	
Disp 6 Item 2	
Disp 6 Item 3	
Disp 6 Item 4	
Disp 6 Item 5	
<b>USER DISPLAY 7</b>	
Disp 7 Top Line	
Disp 7 Bottom Line	
Disp 7 Item 1	
Disp 7 Item 2	
Disp 7 Item 3	
Disp 7 Item 4	
Disp 7 Item 5	
<b>USER DISPLAY 8</b>	
Disp 8 Top Line	
Disp 8 Bottom Line	
Disp 8 Item 1	
Disp 8 Item 2	

Table 8–1: PRODUCT SETUP (Sheet 14 of 14)

SETTING	VALUE
Disp 8 Item 3	
Disp 8 Item 4	
Disp 8 Item 5	
<b>INSTALLATION</b>	
Relay Settings	
Relay Name	

## 8.2.1 SETTINGS

Table 8–2: SYSTEM SETUP (Sheet 1 of 3)

SETTING	VALUE
<b>CURRENT BANK 1</b>	
Phase CT _____ Primary	
Phase CT _____ Secondary	
Ground CT _____ Primary	
Ground CT _____ Secondary	
<b>CURRENT BANK 2</b>	
Phase CT _____ Primary	
Phase CT _____ Secondary	
Ground CT _____ Primary	
Ground CT _____ Secondary	
<b>CURRENT BANK 3</b>	
Phase CT _____ Primary	
Phase CT _____ Secondary	
Ground CT _____ Primary	
Ground CT _____ Secondary	
<b>CURRENT BANK 4</b>	
Phase CT _____ Primary	
Phase CT _____ Secondary	
Ground CT _____ Primary	
Ground CT _____ Secondary	
<b>CURRENT BANK 5</b>	
Phase CT _____ Primary	
Phase CT _____ Secondary	
Ground CT _____ Primary	
Ground CT _____ Secondary	
<b>CURRENT BANK 6</b>	
Phase CT _____ Primary	
Phase CT _____ Secondary	
Ground CT _____ Primary	
Ground CT _____ Secondary	
<b>VOLTAGE BANK 1</b>	
Phase VT _____ Connection	
Phase VT _____ Secondary	
Phase VT _____ Ratio	
Auxiliary VT _____ Connection	
Auxiliary VT _____ Secondary	
Auxiliary VT _____ Ratio	
<b>VOLTAGE BANK 2</b>	
Phase VT _____ Connection	
Phase VT _____ Secondary	
Phase VT _____ Ratio	
Auxiliary VT _____ Connection	
Auxiliary VT _____ Secondary	
Auxiliary VT _____ Ratio	

Table 8–2: SYSTEM SETUP (Sheet 2 of 3)

SETTING	VALUE
<b>VOLTAGE BANK 3</b>	
Phase VT _____ Connection	
Phase VT _____ Secondary	
Phase VT _____ Ratio	
Auxiliary VT _____ Connection	
Auxiliary VT _____ Secondary	
Auxiliary VT _____ Ratio	
<b>POWER SYSTEM</b>	
Nominal Frequency	
Phase Rotation	
Frequency and Phase Reference	
Frequency Tracking	
<b>SIGNAL SOURCE 1</b>	
Source 1 Name	
Source 1 Phase CT	
Source 1 Ground CT	
Source 1 Phase VT	
Source 1 Auxiliary VT	
<b>SIGNAL SOURCE 2</b>	
Source 2 Name	
Source 2 Phase CT	
Source 2 Ground CT	
Source 2 Phase VT	
Source 2 Auxiliary VT	
<b>SIGNAL SOURCE 3</b>	
Source 3 Name	
Source 3 Phase CT	
Source 3 Ground CT	
Source 3 Phase VT	
Source 3 Auxiliary VT	
<b>SIGNAL SOURCE 4</b>	
Source 4 Name	
Source 4 Phase CT	
Source 4 Ground CT	
Source 4 Phase VT	
Source 4 Auxiliary VT	
<b>SIGNAL SOURCE 5</b>	
Source 5 Name	
Source 5 Phase CT	
GSource 5 round CT	
Source 5 Phase VT	
Source 5 Auxiliary VT	
<b>SIGNAL SOURCE 6</b>	
Source 6 Name	

Table 8–2: SYSTEM SETUP (Sheet 3 of 3)

SETTING	VALUE
Source 6 Phase CT	
Source 6 Ground CT	
Source 6 Phase VT	
Source 6 Auxiliary VT	

## 8.2.2 FLEXCURVE A

Table 8–3: FLEXCURVE™ TABLE

RESET	TIME MS	RESET	TIME MS	OPERATE	TIME MS	OPERATE	TIME MS	OPERATE	TIME MS	OPERATE	TIME MS
0.00		0.68		1.03		2.9		4.9		10.5	
0.05		0.70		1.05		3.0		5.0		11.0	
0.10		0.72		1.1		3.1		5.1		11.5	
0.15		0.74		1.2		3.2		5.2		12.0	
0.20		0.76		1.3		3.3		5.3		12.5	
0.25		0.78		1.4		3.4		5.4		13.0	
0.30		0.80		1.5		3.5		5.5		13.5	
0.35		0.82		1.6		3.6		5.6		14.0	
0.40		0.84		1.7		3.7		5.7		14.5	
0.45		0.86		1.8		3.8		5.8		15.0	
0.48		0.88		1.9		3.9		5.9		15.5	
0.50		0.90		2.0		4.0		6.0		16.0	
0.52		0.91		2.1		4.1		6.5		16.5	
0.54		0.92		2.2		4.2		7.0		17.0	
0.56		0.93		2.3		4.3		7.5		17.5	
0.58		0.94		2.4		4.4		8.0		18.0	
0.60		0.95		2.5		4.5		8.5		18.5	
0.62		0.96		2.6		4.6		9.0		19.0	
0.64		0.97		2.7		4.7		9.5		19.5	
0.66		0.98		2.8		4.8		10.0		20.0	

## 8.2.3 FLEXCURVE B

Table 8–4: FLEXCURVE™ TABLE

RESET	TIME MS	RESET	TIME MS	OPERATE	TIME MS	OPERATE	TIME MS	OPERATE	TIME MS	OPERATE	TIME MS
0.00		0.68		1.03		2.9		4.9		10.5	
0.05		0.70		1.05		3.0		5.0		11.0	
0.10		0.72		1.1		3.1		5.1		11.5	
0.15		0.74		1.2		3.2		5.2		12.0	
0.20		0.76		1.3		3.3		5.3		12.5	
0.25		0.78		1.4		3.4		5.4		13.0	
0.30		0.80		1.5		3.5		5.5		13.5	
0.35		0.82		1.6		3.6		5.6		14.0	
0.40		0.84		1.7		3.7		5.7		14.5	
0.45		0.86		1.8		3.8		5.8		15.0	
0.48		0.88		1.9		3.9		5.9		15.5	
0.50		0.90		2.0		4.0		6.0		16.0	
0.52		0.91		2.1		4.1		6.5		16.5	
0.54		0.92		2.2		4.2		7.0		17.0	
0.56		0.93		2.3		4.3		7.5		17.5	
0.58		0.94		2.4		4.4		8.0		18.0	
0.60		0.95		2.5		4.5		8.5		18.5	
0.62		0.96		2.6		4.6		9.0		19.0	
0.64		0.97		2.7		4.7		9.5		19.5	
0.66		0.98		2.8		4.8		10.0		20.0	

## 8.3.1 SETTINGS

Table 8–5: FLEXLOGIC™ (Sheet 1 of 20)

SETTING	VALUE
<b>FLEXLOGIC EQUATION EDITOR</b>	
FlexLogic Entry 1	
FlexLogic Entry 2	
FlexLogic Entry 3	
FlexLogic Entry 4	
FlexLogic Entry 5	
FlexLogic Entry 6	
FlexLogic Entry 7	
FlexLogic Entry 8	
FlexLogic Entry 9	
FlexLogic Entry 10	
FlexLogic Entry 11	
FlexLogic Entry 12	
FlexLogic Entry 13	
FlexLogic Entry 14	
FlexLogic Entry 15	
FlexLogic Entry 16	
FlexLogic Entry 17	
FlexLogic Entry 18	
FlexLogic Entry 19	
FlexLogic Entry 20	
FlexLogic Entry 21	
FlexLogic Entry 22	
FlexLogic Entry 23	
FlexLogic Entry 24	
FlexLogic Entry 25	
FlexLogic Entry 26	
FlexLogic Entry 27	
FlexLogic Entry 28	
FlexLogic Entry 29	
FlexLogic Entry 30	
FlexLogic Entry 31	
FlexLogic Entry 32	
FlexLogic Entry 33	
FlexLogic Entry 34	
FlexLogic Entry 35	
FlexLogic Entry 36	
FlexLogic Entry 37	
FlexLogic Entry 38	
FlexLogic Entry 39	
FlexLogic Entry 40	
FlexLogic Entry 41	
FlexLogic Entry 42	
FlexLogic Entry 43	

Table 8–5: FLEXLOGIC™ (Sheet 2 of 20)

SETTING	VALUE
FlexLogic Entry 44	
FlexLogic Entry 45	
FlexLogic Entry 46	
FlexLogic Entry 47	
FlexLogic Entry 48	
FlexLogic Entry 49	
FlexLogic Entry 50	
FlexLogic Entry 51	
FlexLogic Entry 52	
FlexLogic Entry 53	
FlexLogic Entry 54	
FlexLogic Entry 55	
FlexLogic Entry 56	
FlexLogic Entry 57	
FlexLogic Entry 58	
FlexLogic Entry 59	
FlexLogic Entry 60	
FlexLogic Entry 61	
FlexLogic Entry 62	
FlexLogic Entry 63	
FlexLogic Entry 64	
FlexLogic Entry 65	
FlexLogic Entry 66	
FlexLogic Entry 67	
FlexLogic Entry 68	
FlexLogic Entry 69	
FlexLogic Entry 70	
FlexLogic Entry 71	
FlexLogic Entry 72	
FlexLogic Entry 73	
FlexLogic Entry 74	
FlexLogic Entry 75	
FlexLogic Entry 76	
FlexLogic Entry 77	
FlexLogic Entry 78	
FlexLogic Entry 79	
FlexLogic Entry 80	
FlexLogic Entry 81	
FlexLogic Entry 82	
FlexLogic Entry 83	
FlexLogic Entry 84	
FlexLogic Entry 85	
FlexLogic Entry 86	
FlexLogic Entry 87	

Table 8–5: FLEXLOGIC™ (Sheet 3 of 20)

SETTING	VALUE
FlexLogic Entry 88	
FlexLogic Entry 89	
FlexLogic Entry 90	
FlexLogic Entry 91	
FlexLogic Entry 92	
FlexLogic Entry 93	
FlexLogic Entry 94	
FlexLogic Entry 95	
FlexLogic Entry 96	
FlexLogic Entry 97	
FlexLogic Entry 98	
FlexLogic Entry 99	
FlexLogic Entry 100	
FlexLogic Entry 101	
FlexLogic Entry 102	
FlexLogic Entry 103	
FlexLogic Entry 104	
FlexLogic Entry 105	
FlexLogic Entry 106	
FlexLogic Entry 107	
FlexLogic Entry 108	
FlexLogic Entry 109	
FlexLogic Entry 110	
FlexLogic Entry 111	
FlexLogic Entry 112	
FlexLogic Entry 113	
FlexLogic Entry 114	
FlexLogic Entry 115	
FlexLogic Entry 116	
FlexLogic Entry 117	
FlexLogic Entry 118	
FlexLogic Entry 119	
FlexLogic Entry 120	
FlexLogic Entry 121	
FlexLogic Entry 122	
FlexLogic Entry 123	
FlexLogic Entry 124	
FlexLogic Entry 125	
FlexLogic Entry 126	
FlexLogic Entry 127	
FlexLogic Entry 128	
FlexLogic Entry 129	
FlexLogic Entry 130	
FlexLogic Entry 131	
FlexLogic Entry 132	
FlexLogic Entry 133	
FlexLogic Entry 134	

Table 8–5: FLEXLOGIC™ (Sheet 4 of 20)

SETTING	VALUE
FlexLogic Entry 135	
FlexLogic Entry 136	
FlexLogic Entry 137	
FlexLogic Entry 138	
FlexLogic Entry 139	
FlexLogic Entry 140	
FlexLogic Entry 141	
FlexLogic Entry 142	
FlexLogic Entry 143	
FlexLogic Entry 144	
FlexLogic Entry 145	
FlexLogic Entry 146	
FlexLogic Entry 147	
FlexLogic Entry 148	
FlexLogic Entry 149	
FlexLogic Entry 150	
FlexLogic Entry 151	
FlexLogic Entry 152	
FlexLogic Entry 153	
FlexLogic Entry 154	
FlexLogic Entry 155	
FlexLogic Entry 156	
FlexLogic Entry 157	
FlexLogic Entry 158	
FlexLogic Entry 159	
FlexLogic Entry 160	
FlexLogic Entry 161	
FlexLogic Entry 162	
FlexLogic Entry 163	
FlexLogic Entry 164	
FlexLogic Entry 165	
FlexLogic Entry 166	
FlexLogic Entry 167	
FlexLogic Entry 168	
FlexLogic Entry 169	
FlexLogic Entry 170	
FlexLogic Entry 171	
FlexLogic Entry 172	
FlexLogic Entry 173	
FlexLogic Entry 174	
FlexLogic Entry 175	
FlexLogic Entry 176	
FlexLogic Entry 177	
FlexLogic Entry 178	
FlexLogic Entry 179	
FlexLogic Entry 180	
FlexLogic Entry 181	

Table 8–5: FLEXLOGIC™ (Sheet 5 of 20)

SETTING	VALUE
FlexLogic Entry 182	
FlexLogic Entry 183	
FlexLogic Entry 184	
FlexLogic Entry 185	
FlexLogic Entry 186	
FlexLogic Entry 187	
FlexLogic Entry 188	
FlexLogic Entry 189	
FlexLogic Entry 190	
FlexLogic Entry 191	
FlexLogic Entry 192	
FlexLogic Entry 193	
FlexLogic Entry 194	
FlexLogic Entry 195	
FlexLogic Entry 196	
FlexLogic Entry 197	
FlexLogic Entry 198	
FlexLogic Entry 199	
FlexLogic Entry 200	
FlexLogic Entry 201	
FlexLogic Entry 202	
FlexLogic Entry 203	
FlexLogic Entry 204	
FlexLogic Entry 205	
FlexLogic Entry 206	
FlexLogic Entry 207	
FlexLogic Entry 208	
FlexLogic Entry 209	
FlexLogic Entry 210	
FlexLogic Entry 211	
FlexLogic Entry 212	
FlexLogic Entry 213	
FlexLogic Entry 214	
FlexLogic Entry 215	
FlexLogic Entry 216	
FlexLogic Entry 217	
FlexLogic Entry 218	
FlexLogic Entry 219	
FlexLogic Entry 220	
FlexLogic Entry 221	
FlexLogic Entry 222	
FlexLogic Entry 223	
FlexLogic Entry 224	
FlexLogic Entry 225	
FlexLogic Entry 226	
FlexLogic Entry 227	
FlexLogic Entry 228	

Table 8–5: FLEXLOGIC™ (Sheet 6 of 20)

SETTING	VALUE
FlexLogic Entry 229	
FlexLogic Entry 230	
FlexLogic Entry 231	
FlexLogic Entry 232	
FlexLogic Entry 233	
FlexLogic Entry 234	
FlexLogic Entry 235	
FlexLogic Entry 236	
FlexLogic Entry 237	
FlexLogic Entry 238	
FlexLogic Entry 239	
FlexLogic Entry 240	
FlexLogic Entry 241	
FlexLogic Entry 242	
FlexLogic Entry 243	
FlexLogic Entry 244	
FlexLogic Entry 245	
FlexLogic Entry 246	
FlexLogic Entry 247	
FlexLogic Entry 248	
FlexLogic Entry 249	
FlexLogic Entry 250	
FlexLogic Entry 251	
FlexLogic Entry 252	
FlexLogic Entry 253	
FlexLogic Entry 254	
FlexLogic Entry 255	
FlexLogic Entry 256	
FlexLogic Entry 257	
FlexLogic Entry 258	
FlexLogic Entry 259	
FlexLogic Entry 260	
FlexLogic Entry 261	
FlexLogic Entry 262	
FlexLogic Entry 263	
FlexLogic Entry 264	
FlexLogic Entry 265	
FlexLogic Entry 266	
FlexLogic Entry 267	
FlexLogic Entry 268	
FlexLogic Entry 269	
FlexLogic Entry 270	
FlexLogic Entry 271	
FlexLogic Entry 272	
FlexLogic Entry 273	
FlexLogic Entry 274	
FlexLogic Entry 275	

Table 8–5: FLEXLOGIC™ (Sheet 7 of 20)

SETTING	VALUE
FlexLogic Entry 276	
FlexLogic Entry 277	
FlexLogic Entry 278	
FlexLogic Entry 279	
FlexLogic Entry 280	
FlexLogic Entry 281	
FlexLogic Entry 282	
FlexLogic Entry 283	
FlexLogic Entry 284	
FlexLogic Entry 285	
FlexLogic Entry 286	
FlexLogic Entry 287	
FlexLogic Entry 288	
FlexLogic Entry 289	
FlexLogic Entry 290	
FlexLogic Entry 291	
FlexLogic Entry 292	
FlexLogic Entry 293	
FlexLogic Entry 294	
FlexLogic Entry 295	
FlexLogic Entry 296	
FlexLogic Entry 297	
FlexLogic Entry 298	
FlexLogic Entry 299	
FlexLogic Entry 300	
FlexLogic Entry 301	
FlexLogic Entry 302	
FlexLogic Entry 303	
FlexLogic Entry 304	
FlexLogic Entry 305	
FlexLogic Entry 306	
FlexLogic Entry 307	
FlexLogic Entry 308	
FlexLogic Entry 309	
FlexLogic Entry 310	
FlexLogic Entry 311	
FlexLogic Entry 312	
FlexLogic Entry 313	
FlexLogic Entry 314	
FlexLogic Entry 315	
FlexLogic Entry 316	
FlexLogic Entry 317	
FlexLogic Entry 318	
FlexLogic Entry 319	
FlexLogic Entry 320	
FlexLogic Entry 321	
FlexLogic Entry 322	

Table 8–5: FLEXLOGIC™ (Sheet 8 of 20)

SETTING	VALUE
FlexLogic Entry 323	
FlexLogic Entry 324	
FlexLogic Entry 325	
FlexLogic Entry 326	
FlexLogic Entry 327	
FlexLogic Entry 328	
FlexLogic Entry 329	
FlexLogic Entry 330	
FlexLogic Entry 331	
FlexLogic Entry 332	
FlexLogic Entry 333	
FlexLogic Entry 334	
FlexLogic Entry 335	
FlexLogic Entry 336	
FlexLogic Entry 337	
FlexLogic Entry 338	
FlexLogic Entry 339	
FlexLogic Entry 340	
FlexLogic Entry 341	
FlexLogic Entry 342	
FlexLogic Entry 343	
FlexLogic Entry 344	
FlexLogic Entry 345	
FlexLogic Entry 346	
FlexLogic Entry 347	
FlexLogic Entry 348	
FlexLogic Entry 349	
FlexLogic Entry 350	
FlexLogic Entry 351	
FlexLogic Entry 352	
FlexLogic Entry 353	
FlexLogic Entry 354	
FlexLogic Entry 355	
FlexLogic Entry 356	
FlexLogic Entry 357	
FlexLogic Entry 358	
FlexLogic Entry 359	
FlexLogic Entry 360	
FlexLogic Entry 361	
FlexLogic Entry 362	
FlexLogic Entry 363	
FlexLogic Entry 364	
FlexLogic Entry 365	
FlexLogic Entry 366	
FlexLogic Entry 367	
FlexLogic Entry 368	
FlexLogic Entry 369	



Table 8–5: FLEXLOGIC™ (Sheet 9 of 20)

SETTING	VALUE
FlexLogic Entry 370	
FlexLogic Entry 371	
FlexLogic Entry 372	
FlexLogic Entry 373	
FlexLogic Entry 374	
FlexLogic Entry 375	
FlexLogic Entry 376	
FlexLogic Entry 377	
FlexLogic Entry 378	
FlexLogic Entry 379	
FlexLogic Entry 380	
FlexLogic Entry 381	
FlexLogic Entry 382	
FlexLogic Entry 383	
FlexLogic Entry 384	
FlexLogic Entry 385	
FlexLogic Entry 386	
FlexLogic Entry 387	
FlexLogic Entry 388	
FlexLogic Entry 389	
FlexLogic Entry 390	
FlexLogic Entry 391	
FlexLogic Entry 392	
FlexLogic Entry 393	
FlexLogic Entry 394	
FlexLogic Entry 395	
FlexLogic Entry 396	
FlexLogic Entry 397	
FlexLogic Entry 398	
FlexLogic Entry 399	
FlexLogic Entry 400	
FlexLogic Entry 401	
FlexLogic Entry 402	
FlexLogic Entry 403	
FlexLogic Entry 404	
FlexLogic Entry 405	
FlexLogic Entry 406	
FlexLogic Entry 407	
FlexLogic Entry 408	
FlexLogic Entry 409	
FlexLogic Entry 410	
FlexLogic Entry 411	
FlexLogic Entry 412	
FlexLogic Entry 413	
FlexLogic Entry 414	
FlexLogic Entry 415	
FlexLogic Entry 416	

Table 8–5: FLEXLOGIC™ (Sheet 10 of 20)

SETTING	VALUE
FlexLogic Entry 417	
FlexLogic Entry 418	
FlexLogic Entry 419	
FlexLogic Entry 420	
FlexLogic Entry 421	
FlexLogic Entry 422	
FlexLogic Entry 423	
FlexLogic Entry 424	
FlexLogic Entry 425	
FlexLogic Entry 426	
FlexLogic Entry 427	
FlexLogic Entry 428	
FlexLogic Entry 429	
FlexLogic Entry 430	
FlexLogic Entry 431	
FlexLogic Entry 432	
FlexLogic Entry 433	
FlexLogic Entry 434	
FlexLogic Entry 435	
FlexLogic Entry 436	
FlexLogic Entry 437	
FlexLogic Entry 438	
FlexLogic Entry 439	
FlexLogic Entry 440	
FlexLogic Entry 441	
FlexLogic Entry 442	
FlexLogic Entry 443	
FlexLogic Entry 444	
FlexLogic Entry 445	
FlexLogic Entry 446	
FlexLogic Entry 447	
FlexLogic Entry 448	
FlexLogic Entry 449	
FlexLogic Entry 450	
FlexLogic Entry 451	
FlexLogic Entry 452	
FlexLogic Entry 453	
FlexLogic Entry 454	
FlexLogic Entry 455	
FlexLogic Entry 456	
FlexLogic Entry 457	
FlexLogic Entry 458	
FlexLogic Entry 459	
FlexLogic Entry 460	
FlexLogic Entry 461	
FlexLogic Entry 462	
FlexLogic Entry 463	

Table 8–5: FLEXLOGIC™ (Sheet 11 of 20)

SETTING	VALUE
FlexLogic Entry 464	
FlexLogic Entry 465	
FlexLogic Entry 466	
FlexLogic Entry 467	
FlexLogic Entry 468	
FlexLogic Entry 469	
FlexLogic Entry 470	
FlexLogic Entry 471	
FlexLogic Entry 472	
FlexLogic Entry 473	
FlexLogic Entry 474	
FlexLogic Entry 475	
FlexLogic Entry 476	
FlexLogic Entry 477	
FlexLogic Entry 478	
FlexLogic Entry 479	
FlexLogic Entry 480	
FlexLogic Entry 481	
FlexLogic Entry 482	
FlexLogic Entry 483	
FlexLogic Entry 484	
FlexLogic Entry 485	
FlexLogic Entry 486	
FlexLogic Entry 487	
FlexLogic Entry 488	
FlexLogic Entry 489	
FlexLogic Entry 490	
FlexLogic Entry 491	
FlexLogic Entry 492	
FlexLogic Entry 493	
FlexLogic Entry 494	
FlexLogic Entry 495	
FlexLogic Entry 496	
FlexLogic Entry 497	
FlexLogic Entry 498	
FlexLogic Entry 499	
FlexLogic Entry 500	
FlexLogic Entry 501	
FlexLogic Entry 502	
FlexLogic Entry 503	
FlexLogic Entry 504	
FlexLogic Entry 505	
FlexLogic Entry 506	
FlexLogic Entry 507	
FlexLogic Entry 508	
FlexLogic Entry 509	
FlexLogic Entry 510	

Table 8–5: FLEXLOGIC™ (Sheet 12 of 20)

SETTING	VALUE
FlexLogic Entry 511	
FlexLogic Entry 512	
<b>FLEXLOGIC TIMER 1</b>	
FlexLogic Timer 1 Type	
FlexLogic Timer 1 Pickup Delay	
FlexLogic Timer 1 Dropout Delay	
<b>FLEXLOGIC TIMER 2</b>	
FlexLogic Timer 2 Type	
FlexLogic Timer 2 Pickup Delay	
FlexLogic Timer 2 Dropout Delay	
<b>FLEXLOGIC TIMER 3</b>	
FlexLogic Timer 3 Type	
FlexLogic Timer 3 Pickup Delay	
FlexLogic Timer 3 Dropout Delay	
<b>FLEXLOGIC TIMER 4</b>	
FlexLogic Timer 4 Type	
FlexLogic Timer 4 Pickup Delay	
FlexLogic Timer 4 Dropout Delay	
<b>FLEXLOGIC TIMER 5</b>	
FlexLogic Timer 5 Type	
FlexLogic Timer 5 Pickup Delay	
FlexLogic Timer 5 Dropout Delay	
<b>FLEXLOGIC TIMER 6</b>	
FlexLogic Timer 6 Type	
FlexLogic Timer 6 Pickup Delay	
FlexLogic Timer 6 Dropout Delay	
<b>FLEXLOGIC TIMER 7</b>	
FlexLogic Timer 7 Type	
FlexLogic Timer 7 Pickup Delay	
FlexLogic Timer 7 Dropout Delay	
<b>FLEXLOGIC TIMER 8</b>	
FlexLogic Timer 8 Type	
FlexLogic Timer 8 Pickup Delay	
FlexLogic Timer 8 Dropout Delay	
<b>FLEXLOGIC TIMER 9</b>	
FlexLogic Timer 9 Type	
FlexLogic Timer 9 Pickup Delay	
FlexLogic Timer 9 Dropout Delay	
<b>FLEXLOGIC TIMER 10</b>	
FlexLogic Timer 10 Type	
FlexLogic Timer 10 Pickup Delay	
FlexLogic Timer 10 Dropout Delay	
<b>FLEXLOGIC TIMER 11</b>	
FlexLogic Timer 11 Type	
FlexLogic Timer 11 Pickup Delay	
FlexLogic Timer 11 Dropout Delay	

Table 8–5: FLEXLOGIC™ (Sheet 13 of 20)

SETTING	VALUE
<b>FLEXLOGIC TIMER 12</b>	
FlexLogic Timer 12 Type	
FlexLogic Timer 12 Pickup Delay	
FlexLogic Timer 12 Dropout Delay	
<b>FLEXLOGIC TIMER 13</b>	
FlexLogic Timer 13 Type	
FlexLogic Timer 13 Pickup Delay	
FlexLogic Timer 13 Dropout Delay	
<b>FLEXLOGIC TIMER 14</b>	
FlexLogic Timer 14 Type	
FlexLogic Timer 14 Pickup Delay	
FlexLogic Timer 14 Dropout Delay	
<b>FLEXLOGIC TIMER 15</b>	
FlexLogic Timer 15 Type	
FlexLogic Timer 15 Pickup Delay	
FlexLogic Timer 15 Dropout Delay	
<b>FLEXLOGIC TIMER 16</b>	
FlexLogic Timer 16 Type	
FlexLogic Timer 16 Pickup Delay	
FlexLogic Timer 16 Dropout Delay	
<b>FLEXLOGIC TIMER 17</b>	
FlexLogic Timer 17 Type	
FlexLogic Timer 17 Pickup Delay	
FlexLogic Timer 17 Dropout Delay	
<b>FLEXLOGIC TIMER 18</b>	
FlexLogic Timer 18 Type	
FlexLogic Timer 18 Pickup Delay	
FlexLogic Timer 18 Dropout Delay	
<b>FLEXLOGIC TIMER 19</b>	
FlexLogic Timer 19 Type	
FlexLogic Timer 19 Pickup Delay	
FlexLogic Timer 19 Dropout Delay	
<b>FLEXLOGIC TIMER 20</b>	
FlexLogic Timer 20 Type	
FlexLogic Timer 20 Pickup Delay	
FlexLogic Timer 20 Dropout Delay	
<b>FLEXLOGIC TIMER 21</b>	
FlexLogic Timer 21 Type	
FlexLogic Timer 21 Pickup Delay	
FlexLogic Timer 21 Dropout Delay	
<b>FLEXLOGIC TIMER 22</b>	
FlexLogic Timer 22 Type	
FlexLogic Timer 22 Pickup Delay	
FlexLogic Timer 22 Dropout Delay	
<b>FLEXLOGIC TIMER 23</b>	
FlexLogic Timer 23 Type	
FlexLogic Timer 23 Pickup Delay	

Table 8–5: FLEXLOGIC™ (Sheet 14 of 20)

SETTING	VALUE
FlexLogic Timer 23 Dropout Delay	
<b>FLEXLOGIC TIMER 24</b>	
FlexLogic Timer 24 Type	
FlexLogic Timer 24 Pickup Delay	
FlexLogic Timer 24 Dropout Delay	
<b>FLEXLOGIC TIMER 25</b>	
FlexLogic Timer 25 Type	
FlexLogic Timer 25 Pickup Delay	
FlexLogic Timer 25 Dropout Delay	
<b>FLEXLOGIC TIMER 26</b>	
FlexLogic Timer 26 Type	
FlexLogic Timer 26 Pickup Delay	
FlexLogic Timer 26 Dropout Delay	
<b>FLEXLOGIC TIMER 27</b>	
FlexLogic Timer 27 Type	
FlexLogic Timer 27 Pickup Delay	
FlexLogic Timer 27 Dropout Delay	
<b>FLEXLOGIC TIMER 28</b>	
FlexLogic Timer 28 Type	
FlexLogic Timer 28 Pickup Delay	
FlexLogic Timer 28 Dropout Delay	
<b>FLEXLOGIC TIMER 29</b>	
FlexLogic Timer 29 Type	
FlexLogic Timer 29 Pickup Delay	
FlexLogic Timer 29 Dropout Delay	
<b>FLEXLOGIC TIMER 30</b>	
FlexLogic Timer 30 Type	
FlexLogic Timer 30 Pickup Delay	
FlexLogic Timer 30 Dropout Delay	
<b>FLEXLOGIC TIMER 31</b>	
FlexLogic Timer 31 Type	
FlexLogic Timer 31 Pickup Delay	
FlexLogic Timer 31 Dropout Delay	
<b>FLEXLOGIC TIMER 32</b>	
FlexLogic Timer 32 Type	
FlexLogic Timer 32 Pickup Delay	
FlexLogic Timer 32 Dropout Delay	
<b>FLEXELEMENT 1</b>	
FlexElement 1 Function	
FlexElement 1 Name	
FlexElement 1 +IN	
FlexElement 1 –IN	
FlexElement 1 Input Mode	
FlexElement 1 Comp Mode	
FlexElement 1 Direction	
FlexElement 1 Pickup	
FlexElement 1 Hysteresis	

Table 8–5: FLEXLOGIC™ (Sheet 15 of 20)

SETTING	VALUE
FlexElement 1 dt Unit	
FlexElement 1 dt	
FlexElement 1 Pkp Delay	
FlexElement 1 Rst Delay	
FlexElement 1 Blk	
FlexElement 1 Target	
FlexElement 1 Events	
<b>FLEXELEMENT 2</b>	
FlexElement 2 Function	
FlexElement 2 Name	
FlexElement 2 +IN	
FlexElement 2 –IN	
FlexElement 2 Input Mode	
FlexElement 2 Comp Mode	
FlexElement 2 Direction	
FlexElement 2 Pickup	
FlexElement 2 Hysteresis	
FlexElement 2 dt Unit	
FlexElement 2 dt	
FlexElement 2 Pkp Delay	
FlexElement 2 Rst Delay	
FlexElement 2 Blk	
FlexElement 2 Target	
FlexElement 2 Events	
<b>FLEXELEMENT 3</b>	
FlexElement 3 Function	
FlexElement 3 Name	
FlexElement 3 +IN	
FlexElement 3 –IN	
FlexElement 3 Input Mode	
FlexElement 3 Comp Mode	
FlexElement 3 Direction	
FlexElement 3 Pickup	
FlexElement 3 Hysteresis	
FlexElement 3 dt Unit	
FlexElement 3 dt	
FlexElement 3 Pkp Delay	
FlexElement 3 Rst Delay	
FlexElement 3 Blk	
FlexElement 3 Target	
FlexElement 3 Events	
<b>FLEXELEMENT 4</b>	
FlexElement 4 Function	
FlexElement 4 Name	
FlexElement 4 +IN	
FlexElement 4 –IN	
FlexElement 4 Input Mode	

Table 8–5: FLEXLOGIC™ (Sheet 16 of 20)

SETTING	VALUE
FlexElement 4 Comp Mode	
FlexElement 4 Direction	
FlexElement 4 Pickup	
FlexElement 4 Hysteresis	
FlexElement 4 dt Unit	
FlexElement 4 dt	
FlexElement 4 Pkp Delay	
FlexElement 4 Rst Delay	
FlexElement 4 Blk	
FlexElement 4 Target	
FlexElement 4 Events	
<b>FLEXELEMENT 5</b>	
FlexElement 5 Function	
FlexElement 5 Name	
FlexElement 5 +IN	
FlexElement 5 –IN	
FlexElement 5 Input Mode	
FlexElement 5 Comp Mode	
FlexElement 5 Direction	
FlexElement 5 Pickup	
FlexElement 5 Hysteresis	
FlexElement 5 dt Unit	
FlexElement 5 dt	
FlexElement 5 Pkp Delay	
FlexElement 5 Rst Delay	
FlexElement 5 Blk	
FlexElement 5 Target	
FlexElement 5 Events	
<b>FLEXELEMENT 6</b>	
FlexElement 6 Function	
FlexElement 6 Name	
FlexElement 6 +IN	
FlexElement 6 –IN	
FlexElement 6 Input Mode	
FlexElement 6 Comp Mode	
FlexElement 6 Direction	
FlexElement 6 Pickup	
FlexElement 6 Hysteresis	
FlexElement 6 dt Unit	
FlexElement 6 dt	
FlexElement 6 Pkp Delay	
FlexElement 6 Rst Delay	
FlexElement 6 Blk	
FlexElement 6 Target	
FlexElement 6 Events	
<b>FLEXELEMENT 7</b>	
FlexElement 7 Function	

Table 8–5: FLEXLOGIC™ (Sheet 17 of 20)

SETTING	VALUE
FlexElement 7 Name	
FlexElement 7 +IN	
FlexElement 7 –IN	
FlexElement 7 Input Mode	
FlexElement 7 Comp Mode	
FlexElement 7 Direction	
FlexElement 7 Pickup	
FlexElement 7 Hysteresis	
FlexElement 7 dt Unit	
FlexElement 7 dt	
FlexElement 7 Pkp Delay	
FlexElement 7 Rst Delay	
FlexElement 7 Blk	
FlexElement 7 Target	
FlexElement 7 Events	
<b>FLEXELEMENT 8</b>	
FlexElement 8 Function	
FlexElement 8 Name	
FlexElement 8 +IN	
FlexElement 8 –IN	
FlexElement 8 Input Mode	
FlexElement 8 Comp Mode	
FlexElement 8 Direction	
FlexElement 8 Pickup	
FlexElement 8 Hysteresis	
FlexElement 8 dt Unit	
FlexElement 8 dt	
FlexElement 8 Pkp Delay	
FlexElement 8 Rst Delay	
FlexElement 8 Blk	
FlexElement 8 Target	
FlexElement 8 Events	
<b>FLEXELEMENT 9</b>	
FlexElement 9 Function	
FlexElement 9 Name	
FlexElement 9 +IN	
FlexElement 9 –IN	
FlexElement 9 Input Mode	
FlexElement 9 Comp Mode	
FlexElement 9 Direction	
FlexElement 9 Pickup	
FlexElement 9 Hysteresis	
FlexElement 9 dt Unit	
FlexElement 9 dt	
FlexElement 9 Pkp Delay	
FlexElement 9 Rst Delay	
FlexElement 9 Blk	

Table 8–5: FLEXLOGIC™ (Sheet 18 of 20)

SETTING	VALUE
FlexElement 9 Target	
FlexElement 9 Events	
<b>FLEXELEMENT 10</b>	
FlexElement 10 Function	
FlexElement 10 Name	
FlexElement 10 +IN	
FlexElement 10 –IN	
FlexElement 10 Input Mode	
FlexElement 10 Comp Mode	
FlexElement 10 Direction	
FlexElement 10 Pickup	
FlexElement 10 Hysteresis	
FlexElement 10 dt Unit	
FlexElement 10 dt	
FlexElement 10 Pkp Delay	
FlexElement 10 Rst Delay	
FlexElement 10 Blk	
FlexElement 10 Target	
FlexElement 10 Events	
<b>FLEXELEMENT 11</b>	
FlexElement 11 Function	
FlexElement 11 Name	
FlexElement 11 +IN	
FlexElement 11 –IN	
FlexElement 11 Input Mode	
FlexElement 11 Comp Mode	
FlexElement 11 Direction	
FlexElement 11 Pickup	
FlexElement 11 Hysteresis	
FlexElement 11 dt Unit	
FlexElement 11 dt	
FlexElement 11 Pkp Delay	
FlexElement 11 Rst Delay	
FlexElement 11 Blk	
FlexElement 11 Target	
FlexElement 11 Events	
<b>FLEXELEMENT 12</b>	
FlexElement 12 Function	
FlexElement 12 Name	
FlexElement 12 +IN	
FlexElement 12 –IN	
FlexElement 12 Input Mode	
FlexElement 12 Comp Mode	
FlexElement 12 Direction	
FlexElement 12 Pickup	
FlexElement 12 Hysteresis	
FlexElement 12 dt Unit	

Table 8–5: FLEXLOGIC™ (Sheet 19 of 20)

SETTING	VALUE
FlexElement 12 dt	
FlexElement 12 Pkp Delay	
FlexElement 12 Rst Delay	
FlexElement 12 Blk	
FlexElement 12 Target	
FlexElement 12 Events	
<b>FLEXELEMENT 13</b>	
FlexElement 13 Function	
FlexElement 13 Name	
FlexElement 13 +IN	
FlexElement 13 –IN	
FlexElement 13 Input Mode	
FlexElement 13 Comp Mode	
FlexElement 13 Direction	
FlexElement 13 Pickup	
FlexElement 13 Hysteresis	
FlexElement 13 dt Unit	
FlexElement 13 dt	
FlexElement 13 Pkp Delay	
FlexElement 13 Rst Delay	
FlexElement 13 Blk	
FlexElement 13 Target	
FlexElement 13 Events	
<b>FLEXELEMENT 14</b>	
FlexElement 14 Function	
FlexElement 14 Name	
FlexElement 14 +IN	
FlexElement 14 –IN	
FlexElement 14 Input Mode	
FlexElement 14 Comp Mode	
FlexElement 14 Direction	
FlexElement 14 Pickup	
FlexElement 14 Hysteresis	
FlexElement 14 dt Unit	
FlexElement 14 dt	
FlexElement 14 Pkp Delay	
FlexElement 14 Rst Delay	
FlexElement 14 Blk	
FlexElement 14 Target	
FlexElement 14 Events	
<b>FLEXELEMENT 15</b>	
FlexElement 15 Function	
FlexElement 15 Name	
FlexElement 15 +IN	
FlexElement 15 –IN	
FlexElement 15 Input Mode	
FlexElement 15 Comp Mode	

Table 8–5: FLEXLOGIC™ (Sheet 20 of 20)

SETTING	VALUE
FlexElement 15 Direction	
FlexElement 15 Pickup	
FlexElement 15 Hysteresis	
FlexElement 15 dt Unit	
FlexElement 15 dt	
FlexElement 15 Pkp Delay	
FlexElement 15 Rst Delay	
FlexElement 15 Blk	
FlexElement 15 Target	
FlexElement 15 Events	
<b>FLEXELEMENT 16</b>	
FlexElement 16 Function	
FlexElement 16 Name	
FlexElement 16 +IN	
FlexElement 16 –IN	
FlexElement 16 Input Mode	
FlexElement 16 Comp Mode	
FlexElement 16 Direction	
FlexElement 16 Pickup	
FlexElement 16 Hysteresis	
FlexElement 16 dt Unit	
FlexElement 16 dt	
FlexElement 16 Pkp Delay	
FlexElement 16 Rst Delay	
FlexElement 16 Blk	
FlexElement 16 Target	
FlexElement 16 Events	

## 8.4.1 SETTINGS

Table 8–6: GROUPED ELEMENTS (Sheet 1 of 7)

SETTING	VALUE
<b>DIFFERENTIAL ELEMENTS</b>	
<b>STATOR DIFFERENTIAL</b>	
Stator Diff Function	
Stator Diff Line End Source	
Stator Diff Neutral End Source	
Stator Diff Pickup	
Stator Diff Slope 1	
Stator Diff Break 1	
Stator Diff Slope 2	
Stator Diff Break 2	
Stator Diff Block	
Stator Diff Target	
Stator Diff Events	
<b>DISTANCE ELEMENTS</b>	
<b>POWER SWING DETECT</b>	
Power Swing Function	
Power Swing Source	
Power Swing Mode	
Power Swing Supv	
Power Swing Fwd Reach	
Power Swing Fwd RCA	
Power Swing Rev Reach	
Power Swing Rev RCA	
Power Swing Outer Limit Angle	
Power Swing Middle Limit Angle	
Power Swing Inner Limit Angle	
Power Swing Pickup Delay 1	
Power Swing Reset Delay 1	
Power Swing Pickup Delay 2	
Power Swing Pickup Delay 3	
Power Swing Pickup Delay 4	
Power Swing Seal-In Delay 1	
Power Swing Trip Mode	
Power Swing Blk	
Power Swing Target	
Power Swing Events	
<b>CURRENT ELEMENTS</b>	
<b>PHASE TOC1</b>	
Phase TOC1 Function	
Phase TOC1 Signal Source	
Phase TOC1 Input	
Phase TOC1 Pickup	
Phase TOC1 Curve	
Phase TOC1 Multiplier	

Table 8–6: GROUPED ELEMENTS (Sheet 2 of 7)

SETTING	VALUE
Phase TOC1 Reset	
Phase TOC1 Voltage Restraint	
Phase TOC1 Block A	
Phase TOC1 Block B	
Phase TOC1 Block C	
Phase TOC1 Target	
Phase TOC1 Events	
<b>PHASE IOC1</b>	
Phase IOC1 Function	
Phase IOC1 Signal Source	
Phase IOC1 Pickup	
Phase IOC1 Pickup Delay	
Phase IOC1 Reset Delay	
Phase IOC1 Block A	
Phase IOC1 Block B	
Phase IOC1 Block C	
Phase IOC1 Target	
Phase IOC1 Events	
<b>NEUTRAL TOC1</b>	
Neutral TOC1 Function	
Neutral TOC1 Signal Source	
Neutral TOC1 Input	
Neutral TOC1 Pickup	
Neutral TOC1 Curve	
Neutral TOC1 TD Multiplier	
Neutral TOC1 Reset	
Neutral TOC1 Block	
Neutral TOC1 Target	
Neutral TOC1 Events	
<b>NEUTRAL IOC1</b>	
Neutral IOC1 Function	
Neutral IOC1 Signal Source	
Neutral IOC1 Pickup	
Neutral IOC1 Pickup Delay	
Neutral IOC1 Reset Delay	
Neutral IOC1 Block	
Neutral IOC1 Target	
Neutral IOC1 Events	
<b>GROUND TOC1</b>	
Ground TOC1 Function	
Ground TOC1 Signal Source	
Ground TOC1 Input	
Ground TOC1 Pickup	
Ground TOC1 Curve	

Table 8–6: GROUPED ELEMENTS (Sheet 3 of 7)

SETTING	VALUE
Ground TOC1 TD Multiplier	
Ground TOC1 Reset	
Ground TOC1 Block	
Ground TOC1 Target	
Ground TOC1 Events	
<b>GROUND IOC1</b>	
Ground IOC1 Function	
Ground IOC1 Signal Source	
Ground IOC1 Pickup	
Ground IOC1 Pickup Delay	
Ground IOC1 Reset Delay	
Ground IOC1 Block	
Ground IOC1 Target	
Ground IOC1 Events	
<b>CURRENT DIRECTIONALS</b>	
<b>PHASE DIRECTIONAL 1</b>	
Phase Dir 1 Function	
Phase Dir 1 Signal Source	
Phase Dir 1 Block	
Phase Dir 1 ECA	
Phase Dir Pol V1 Threshold	
Phase Dir 1 Block When V Mem Exp	
Phase Dir 1 Target	
Phase Dir 1 Events	
<b>PHASE DIRECTIONAL 2</b>	
Phase Dir 2 Function	
Phase Dir 2 Signal Source	
Phase Dir 2 Block	
Phase Dir 2 ECA	
Phase Dir Pol V2 Threshold	
Phase Dir 2 Block When V Mem Exp	
Phase Dir 2 Target	
Phase Dir 2 Events	
<b>NEUTRAL DIRECTIONAL OC1</b>	
Neutral Dir OC1 Function	
Neutral Dir OC1 Source	
Neutral Dir OC1 Polarizing	
Neutral Dir OC1 Pol Volt	
Neutral Dir OC1 Op Curr	
Neutral Dir OC1 Offeset	
Neutral Dir OC1 Fwd ECA	
Neutral Dir OC1 Fwd Limit Angle	
Neutral Dir OC1 Fwd Pickup	
Neutral Dir OC1 Rev Limit Angle	
Neutral Dir OC1 Rev Pickup	
Neutral Dir OC1 Blk	
Neutral Dir OC1 Target	

Table 8–6: GROUPED ELEMENTS (Sheet 4 of 7)

SETTING	VALUE
Neutral Dir OC1 Events	
<b>NEUTRAL DIRECTIONAL OC2</b>	
Neutral Dir OC2 Function	
Neutral Dir OC2 Source	
Neutral Dir OC2 Polarizing	
Neutral Dir OC2 Pol Volt	
Neutral Dir OC2 Op Curr	
Neutral Dir OC2 Offeset	
Neutral Dir OC2 Fwd ECA	
Neutral Dir OC2 Fwd Limit Angle	
Neutral Dir OC2 Fwd Pickup	
Neutral Dir OC2 Rev Limit Angle	
Neutral Dir OC2 Rev Pickup	
Neutral Dir OC2 Blk	
Neutral Dir OC2 Target	
Neutral Dir OC2 Events	
<b>VOLTAGE ELEMENTS</b>	
<b>PHASE UNDERVOLTAGE 1</b>	
Phase UV1 Function	
Phase UV1 Signal Source	
Phase UV1 Mode	
Phase UV1 Pickup	
Phase UV1 Curve	
Phase UV1 Delay	
Phase UV1 Minimum Voltage	
Phase UV1 Block	
Phase UV1 Target	
Phase UV1 Events	
<b>PHASE UNDERVOLTAGE 2</b>	
Phase UV2 Function	
Phase UV2 Signal Source	
Phase UV2 Mode	
Phase UV2 Pickup	
Phase UV2 Curve	
Phase UV2 Delay	
Phase UV2 Minimum Voltage	
Phase UV2 Block	
Phase UV2 Target	
Phase UV2 Events	
<b>PHASE OVERVOLTAGE 1</b>	
Phase OV1 Function	
Phase OV1 Signal Source	
Phase OV1 Pickup	
Phase OV1 Delay	
Phase OV1 Reset Delay	
Phase OV1 Block	
Phase OV1 Target	



Table 8–6: GROUPED ELEMENTS (Sheet 5 of 7)

SETTING	VALUE
Phase OV1 Events	
<b>NEUTRAL OVERVOLTAGE 1</b>	
Neutral OV1 Function	
Neutral OV1 Signal Source	
Neutral OV1 Pickup	
Neutral OV1 Pickup Delay	
Neutral OV1 Reset Delay	
Neutral OV1 Block	
Neutral OV1 Target	
Neutral OV1 Events	
<b>NEGATIVE SEQUENCE OVERVOLTAGE</b>	
Neg Seq OV Function	
Neg Seq OV Signal Source	
Neg Seq OV Pickup	
Neg Seq OV Delay	
Neg Seq OV Reset Delay	
Neg Seq OV Block	
Neg Seq OV Target	
Neg Seq OV Events	
<b>AUXILIARY UNDERVOLTAGE 1</b>	
Aux UV1 Function	
Aux UV1 Signal Source	
Aux UV1 Pickup	
Aux UV1 Curve	
Aux UV1 Delay	
Aux UV1 Minimum Voltage	
Aux UV1 Block	
Aux UV1 Target	
Aux UV1 Events	
<b>AUXILIARY OVERVOLTAGE 1</b>	
Aux OV1 Function	
Aux OV1 Signal Source	
Aux OV1 Pickup	
Aux OV1 Pickup Delay	
Aux OV1 Reset Delay	
Aux OV1 Block	
Aux OV1 Target	
Aux OV1 Events	
<b>VOLTS/HZ 1</b>	
Volts/Hz 1 Function	
Volts/Hz 1 Source	
Volts/Hz 1 Pickup	
Volts/Hz 1 Curve	
Volts/Hz 1 TD Multiplier	
Volts/Hz 1 T-Reset	
Volts/Hz 1 Block	
Volts/Hz 1 Target	

Table 8–6: GROUPED ELEMENTS (Sheet 6 of 7)

SETTING	VALUE
Volts/Hz 1 Events	
<b>VOLTS/HZ 2</b>	
Volts/Hz 2 Function	
Volts/Hz 2 Source	
Volts/Hz 2 Pickup	
Volts/Hz 2 Curve	
Volts/Hz 2 TD Multiplier	
Volts/Hz 1 T-Reset	
Volts/Hz 2 Block	
Volts/Hz 2 Target	
Volts/Hz 2 Events	
<b>LOSS OF EXCITATION</b>	
Loss of Excitation Function	
Loss of Excitation Source	
Loss of Excitation Center 1	
Loss of Excitation Radius 1	
Loss of Excitation UV Supv 1	
Loss of Excitation Pkp Delay 1	
Loss of Excitation Center 2	
Loss of Excitation Radius 2	
Loss of Excitation UV Supv 2	
Loss of Excitation Pkp Delay 2	
Loss of Excitation UV Sup	
Loss of Excitation Blk	
Loss of Excitation Target	
Loss of Excitation Events	
<b>ACCIDENTAL ENERGIZATION</b>	
Accdnt Enrg Function	
Accdnt Enrg Source	
Accdnt Enrg Arming Mode	
Accdnt Enrg OC Pickup	
Accdnt Enrg UV Pickup	
Accdnt Enrg Offline	
Accdnt Enrg Block	
Accdnt Enrg Target	
Accdnt Enrg Events	
<b>SENSITIVE DIRECTIONAL POWER</b>	
<b>DIRECTIONAL POWER 1</b>	
Dir Power 1 Function	
Dir Power 1 Source	
Dir Power 1 RCA	
Dir Power 1 Calibration	
Dir Power 1 STG1 SMIN	
Dir Power 1 STG1 Delay	
Dir Power 1 STG2 SMIN	
Dir Power 1 STG2 Delay	
Dir Power 1 Blk	

Table 8–6: GROUPED ELEMENTS (Sheet 7 of 7)

SETTING	VALUE
Dir Power 1 Target	
Dir Power 1 Events	
DIRECTIONAL POWER 2	
Dir Power 2 Function	
Dir Power 2 Source	
Dir Power 2 RCA	
Dir Power 2 Calibration	
Dir Power 2 STG1 SMIN	
Dir Power 2 STG1 Delay	
Dir Power 2 STG2 SMIN	
Dir Power 2 STG2 Delay	
Dir Power 2 Blk	
Dir Power 2 Target	
Dir Power 2 Events	
STATOR GROUND	
Stator Ground Source	
100% STATOR GROUND	
100% Stator Ground Function	
100% Stator Gnd STG1 Pickup	
100% Stator Gnd STG1 Delay	
100% Stator Gnd STG1 Supv	
100% Stator Gnd STG2 Pickup	
100% Stator Gnd STG2 Delay	
100% Stator Gnd STG2 Supv	
100% Stator Gnd Blk	
100% Stator Ground Targets	
100% Stator Ground Events	
3RD HARM NTRL UNDERVOLTAGE	
3rd Harm Ntrl UV Function	
3rd Harm Ntrl UV Terminal SRC	
3rd Harm Ntrl UV Neutral SRC	
3rd Harm Ntrl UV Pickup	
3rd Harm Ntrl UV Pkp Delay	
3rd Harm Ntrl UV Max Power	
3rd Harm Ntrl UV Min Power	
3rd Harm Ntrl UV Blk	
3rd Harm Ntrl UV Target	
3rd Harm Ntrl UV Events	

## 8.5.1 SETTINGS

Table 8–7: CONTROL ELEMENTS (Sheet 1 of 9)

SETTING	VALUE
<b>SETTING GROUPS</b>	
Setting Groups Function	
Setting Groups Block	
Group 2 Activate On	
Group 3 Activate On	
Group 4 Activate On	
Group 5 Activate On	
Group 6 Activate On	
Group 7 Activate On	
Group 8 Activate On	
Setting Group Events	
<b>UNDERFREQUENCY 1</b>	
Underfreq 1 Function	
Underfreq 1 Block	
Underfreq 1 Source	
Underfreq 1 Min Volt/Amp	
Underfreq 1 Pickup	
Underfreq 1 Pickup Delay	
Underfreq 1 Reset Delay	
Underfreq 1 Target	
Underfreq 1 Events	
<b>UNDERFREQUENCY 2</b>	
Underfreq 2 Function	
Underfreq 2 Block	
Underfreq 2 Source	
Underfreq 2 Min Volt/Amp	
Underfreq 2 Pickup	
Underfreq 2 Pickup Delay	
Underfreq 2 Reset Delay	
Underfreq 2 Target	
Underfreq 2 Events	
<b>UNDERFREQUENCY 3</b>	
Underfreq 3 Function	
Underfreq 3 Block	
Underfreq 3 Source	
Underfreq 3 Min Volt/Amp	
Underfreq 3 Pickup	
Underfreq 3 Pickup Delay	
Underfreq 3 Reset Delay	
Underfreq 3 Target	
Underfreq 3 Events	
<b>UNDERFREQUENCY 4</b>	
Underfreq 4 Function	
Underfreq 4 Block	

Table 8–7: CONTROL ELEMENTS (Sheet 2 of 9)

SETTING	VALUE
Underfreq 4 Source	
Underfreq 4 Min Volt/Amp	
Underfreq 4 Pickup	
Underfreq 4 Pickup Delay	
Underfreq 4 Reset Delay	
Underfreq 4 Target	
Underfreq 4 Events	
<b>UNDERFREQUENCY 5</b>	
Underfreq 5 Function	
Underfreq 5 Block	
Underfreq 5 Source	
Underfreq 5 Min Volt/Amp	
Underfreq 5 Pickup	
Underfreq 5 Pickup Delay	
Underfreq 5 Reset Delay	
Underfreq 5 Target	
Underfreq 5 Events	
<b>UNDERFREQUENCY 6</b>	
Underfreq 6 Function	
Underfreq 6 Block	
Underfreq 6 Source	
Underfreq 6 Min Volt/Amp	
Underfreq 6 Pickup	
Underfreq 6 Pickup Delay	
Underfreq 6 Reset Delay	
Underfreq 6 Target	
Underfreq 6 Events	
<b>OVERFREQUENCY 1</b>	
Overfreq 1 Function	
Overfreq 1 Block	
Overfreq 1 Source	
Overfreq 1 Pickup	
Overfreq 1 Pickup Delay	
Overfreq 1 Reset Delay	
Overfreq 1 Target	
Overfreq 1 Events	
<b>OVERFREQUENCY 2</b>	
Overfreq 2 Function	
Overfreq 2 Block	
Overfreq 2 Source	
Overfreq 2 Pickup	
Overfreq 2 Pickup Delay	
Overfreq 2 Reset Delay	
Overfreq 2 Target	

Table 8–7: CONTROL ELEMENTS (Sheet 3 of 9)

SETTING	VALUE
Overfreq 2 Events	
<b>OVERFREQUENCY 3</b>	
Overfreq 3 Function	
Overfreq 3 Block	
Overfreq 3 Source	
Overfreq 3 Pickup	
Overfreq 3 Pickup Delay	
Overfreq 3 Reset Delay	
Overfreq 3 Target	
Overfreq 3 Events	
<b>OVERFREQUENCY 4</b>	
Overfreq 4 Function	
Overfreq 4 Block	
Overfreq 4 Source	
Overfreq 4 Pickup	
Overfreq 4 Pickup Delay	
Overfreq 4 Reset Delay	
Overfreq 4 Target	
Overfreq 4 Events	
<b>SYNCHROCHECK 1</b>	
Synchk1 Function	
Synchk1 Block	
Synchk1 V1 Source	
Synchk1 V2 Source	
Synchk1 Max Volt Diff	
Synchk1 Max Angle Diff	
Synchk1 Max Freq Diff	
Synchk1 Dead Source Select	
Synchk1 Dead V1 Max Volt	
Synchk1 Dead V2 Max Volt	
Synchk1 Line V1 Min Volt	
Synchk1 Line V2 Min Volt	
Synchk1 Target	
Synchk1 Events	
<b>SYNCHROCHECK 2</b>	
Synchk2 Function	
Synchk2 Block	
Synchk2 V1 Source	
Synchk2 V2 Source	
Synchk2 Max Volt Diff	
Synchk2 Max Angle Diff	
Synchk2 Max Freq Diff	
Synchk2 Dead Source Select	
Synchk2 Dead V1 Max Volt	
Synchk2 Dead V2 Max Volt	
Synchk2 Line V1 Min Volt	
Synchk2 Line V2 Min Volt	

Table 8–7: CONTROL ELEMENTS (Sheet 4 of 9)

SETTING	VALUE
Synchk2 Target	
Synchk2 Events	
<b>DIGITAL ELEMENT 1</b>	
Digital Element 1 Function	
Dig Elem 1 Name	
Dig Elem 1 Input	
Dig Elem 1 Pickup Delay	
Dig Elem 1 Reset Delay	
Dig Elem 1 Block	
Digital Element 1 Target	
Digital Element 1 Events	
<b>DIGITAL ELEMENT 2</b>	
Digital Element 2 Function	
Dig Elem 2 Name	
Dig Elem 2 Input	
Dig Elem 2 Pickup Delay	
Dig Elem 2 Reset Delay	
Dig Elem 2 Block	
Digital Element 2 Target	
Digital Element 2 Events	
<b>DIGITAL ELEMENT 3</b>	
Digital Element 3 Function	
Dig Elem 3 Name	
Dig Elem 3 Input	
Dig Elem 3 Pickup Delay	
Dig Elem 3 Reset Delay	
Dig Elem 3 Block	
Digital Element 3 Target	
Digital Element 3 Events	
<b>DIGITAL ELEMENT 4</b>	
Digital Element 4 Function	
Dig Elem 4 Name	
Dig Elem 4 Input	
Dig Elem 4 Pickup Delay	
Dig Elem 4 Reset Delay	
Dig Elem 4 Block	
Digital Element 4 Target	
Digital Element 4 Events	
<b>DIGITAL ELEMENT 5</b>	
Digital Element 5 Function	
Dig Elem 5 Name	
Dig Elem 5 Input	
Dig Elem 5 Pickup Delay	
Dig Elem 5 Reset Delay	
Dig Elem 5 Block	
Digital Element 5 Target	
Digital Element 5 Events	

Table 8–7: CONTROL ELEMENTS (Sheet 5 of 9)

SETTING	VALUE
<b>DIGITAL ELEMENT 6</b>	
Digital Element 6 Function	
Dig Elem 6 Name	
Dig Elem 6 Input	
Dig Elem 6 Pickup Delay	
Dig Elem 6 Reset Delay	
Dig Elem 6 Block	
Digital Element 6 Target	
Digital Element 6 Events	
<b>DIGITAL ELEMENT 7</b>	
Digital Element 7 Function	
Dig Elem 7 Name	
Dig Elem 7 Input	
Dig Elem 7 Pickup Delay	
Dig Elem 7 Reset Delay	
Dig Elem 7 Block	
Digital Element 7 Target	
Digital Element 7 Events	
<b>DIGITAL ELEMENT 8</b>	
Digital Element 8 Function	
Dig Elem 8 Name	
Dig Elem 8 Input	
Dig Elem 8 Pickup Delay	
Dig Elem 8 Reset Delay	
Dig Elem 8 Block	
Digital Element 8 Target	
Digital Element 8 Events	
<b>DIGITAL ELEMENT 9</b>	
Digital Element 9 Function	
Dig Elem 9 Name	
Dig Elem 9 Input	
Dig Elem 9 Pickup Delay	
Dig Elem 9 Reset Delay	
Dig Elem 9 Block	
Digital Element 9 Target	
Digital Element 9 Events	
<b>DIGITAL ELEMENT 10</b>	
Digital Element 10 Function	
Dig Elem 10 Name	
Dig Elem 10 Input	
Dig Elem 10 Pickup Delay	
Dig Elem 10 Reset Delay	
Dig Elem 10 Block	
Digital Element 10 Target	
Digital Element 10 Events	
<b>DIGITAL ELEMENT 11</b>	
Digital Element 11 Function	

Table 8–7: CONTROL ELEMENTS (Sheet 6 of 9)

SETTING	VALUE
Dig Elem 11 Name	
Dig Elem 11 Input	
Dig Elem 11 Pickup Delay	
Dig Elem 11 Reset Delay	
Dig Elem 11 Block	
Digital Element 11 Target	
Digital Element 11 Events	
<b>DIGITAL ELEMENT 12</b>	
Digital Element 12 Function	
Dig Elem 12 Name	
Dig Elem 12 Input	
Dig Elem 12 Pickup Delay	
Dig Elem 12 Reset Delay	
Dig Elem 12 Block	
Digital Element 12 Target	
Digital Element 12 Events	
<b>DIGITAL ELEMENT 13</b>	
Digital Element 13 Function	
Dig Elem 13 Name	
Dig Elem 13 Input	
Dig Elem 13 Pickup Delay	
Dig Elem 13 Reset Delay	
Dig Elem 13 Block	
Digital Element 13 Target	
Digital Element 13 Events	
<b>DIGITAL ELEMENT 14</b>	
Digital Element 14 Function	
Dig Elem 14 Name	
Dig Elem 14 Input	
Dig Elem 14 Pickup Delay	
Dig Elem 14 Reset Delay	
Dig Elem 14 Block	
Digital Element 14 Target	
Digital Element 14 Events	
<b>DIGITAL ELEMENT 15</b>	
Digital Element 15 Function	
Dig Elem 15 Name	
Dig Elem 15 Input	
Dig Elem 15 Pickup Delay	
Dig Elem 15 Reset Delay	
Dig Elem 15 Block	
Digital Element 15 Target	
Digital Element 15 Events	
<b>DIGITAL ELEMENT 16</b>	
Digital Element 16 Function	
Dig Elem 16 Name	
Dig Elem 16 Input	

Table 8–7: CONTROL ELEMENTS (Sheet 7 of 9)

SETTING	VALUE
Dig Elem 16 Pickup Delay	
Dig Elem 16 Reset Delay	
Dig Elem 16 Block	
Digital Element 16 Target	
Digital Element 16 Events	
<b>DIGITAL COUNTER 1</b>	
Counter 1 Function	
Counter 1 Name	
Counter 1 Units	
Counter 1 Preset	
Counter 1 Compare	
Counter 1 Up	
Counter 1 Down	
Counter 1 Block	
Counter 1 Set to Preset	
Counter 1 Reset	
Counter 1 Freeze/Reset	
Counter 1 Freeze/Count	
<b>DIGITAL COUNTER 2</b>	
Counter 2 Function	
Counter 2 Name	
Counter 2 Units	
Counter 2 Preset	
Counter 2 Compare	
Counter 2 Up	
Counter 2 Down	
Counter 2 Block	
Counter 2 Set to Preset	
Counter 2 Reset	
Counter 2 Freeze/Reset	
Counter 2 Freeze/Count	
<b>DIGITAL COUNTER 3</b>	
Counter 3 Function	
Counter 3 Name	
Counter 3 Units	
Counter 3 Preset	
Counter 3 Compare	
Counter 3 Up	
Counter 3 Down	
Counter 3 Block	
Counter 3 Set to Preset	
Counter 3 Reset	
Counter 3 Freeze/Reset	
Counter 3 Freeze/Count	
<b>DIGITAL COUNTER 4</b>	
Counter 4 Function	
Counter 4 Name	

Table 8–7: CONTROL ELEMENTS (Sheet 8 of 9)

SETTING	VALUE
Counter 4 Units	
Counter 4 Preset	
Counter 4 Compare	
Counter 4 Up	
Counter 4 Down	
Counter 4 Block	
Counter 4 Set to Preset	
Counter 4 Reset	
Counter 4 Freeze/Reset	
Counter 4 Freeze/Count	
<b>DIGITAL COUNTER 5</b>	
Counter 5 Function	
Counter 5 Name	
Counter 5 Units	
Counter 5 Preset	
Counter 5 Compare	
Counter 5 Up	
Counter 5 Down	
Counter 5 Block	
Counter 5 Set to Preset	
Counter 5 Reset	
Counter 5 Freeze/Reset	
Counter 5 Freeze/Count	
<b>DIGITAL COUNTER 6</b>	
Counter 6 Function	
Counter 6 Name	
Counter 6 Units	
Counter 6 Preset	
Counter 6 Compare	
Counter 6 Up	
Counter 6 Down	
Counter 6 Block	
Counter 6 Set to Preset	
Counter 6 Reset	
Counter 6 Freeze/Reset	
Counter 6 Freeze/Count	
<b>DIGITAL COUNTER 7</b>	
Counter 7 Function	
Counter 7 Name	
Counter 7 Units	
Counter 7 Preset	
Counter 7 Compare	
Counter 7 Up	
Counter 7 Down	
Counter 7 Block	
Counter 7 Set to Preset	
Counter 7 Reset	

Table 8–7: CONTROL ELEMENTS (Sheet 9 of 9)

SETTING	VALUE
Counter 7 Freeze/Reset	
Counter 7 Freeze/Count	
<b>DIGITAL COUNTER 8</b>	
Counter 8 Function	
Counter 8 Name	
Counter 8 Units	
Counter 8 Preset	
Counter 8 Compare	
Counter 8 Up	
Counter 8 Down	
Counter 8 Block	
Counter 8 Set to Preset	
Counter 8 Reset	
Counter 8 Freeze/Reset	
Counter 8 Freeze/Count	
<b>VT FUSE FAILURE</b>	
VT Fuse Failure Function	

### 8.6.1 CONTACT INPUTS

### Table 8–8: CONTACT INPUTS

[illegible]



## 8.6.2 VIRTUAL INPUTS

Table 8–9: VIRTUAL INPUTS

VIRTUAL INPUT	FUNCTION	ID	TYPE	EVENTS
Virtual Input 1				
Virtual Input 2				
Virtual Input 3				
Virtual Input 4				
Virtual Input 5				
Virtual Input 6				
Virtual Input 7				
Virtual Input 8				
Virtual Input 9				
Virtual Input 10				
Virtual Input 11				
Virtual Input 12				
Virtual Input 13				
Virtual Input 14				
Virtual Input 15				
Virtual Input 16				
Virtual Input 17				
Virtual Input 18				
Virtual Input 19				
Virtual Input 20				
Virtual Input 21				
Virtual Input 22				
Virtual Input 23				
Virtual Input 24				
Virtual Input 25				
Virtual Input 26				
Virtual Input 27				
Virtual Input 28				
Virtual Input 29				
Virtual Input 30				
Virtual Input 31				
Virtual Input 32				

## 8.6.3 SBO TIMER

Table 8–10: UCA SBO TIMER

UCA SBO TIMER	
UCA SBO Timeout	

### Table 8–11: CONTACT OUTPUTS

[illegible]

## 8.6.5 VIRTUAL OUTPUTS

Table 8–12: VIRTUAL OUTPUTS (Sheet 1 of 2)

VIRTUAL OUTPUT	ID	EVENTS
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		

Table 8–12: VIRTUAL OUTPUTS (Sheet 2 of 2)

VIRTUAL OUTPUT	ID	EVENTS
44		
45		
46		
47		
48		
49		
50		
51		
52		
53		
54		
55		
56		
57		
58		
59		
60		
61		
62		
63		
64		

## 8.6.6 REMOTE DEVICES

Table 8–13: REMOTE DEVICES

REMOTE DEVICE	ID
Remote Device 1	
Remote Device 2	
Remote Device 3	
Remote Device 4	
Remote Device 5	
Remote Device 6	
Remote Device 7	
Remote Device 8	
Remote Device 9	
Remote Device 10	
Remote Device 11	
Remote Device 12	
Remote Device 13	
Remote Device 14	
Remote Device 15	
Remote Device 16	

## 8.6.7 REMOTE INPUTS

Table 8–14: REMOTE INPUTS

REMOTE INPUT	REMOTE DEVICE	BIT PAIR	DEFAULT STATE	EVENTS
Remote Input 1				
Remote Input 2				
Remote Input 3				
Remote Input 4				
Remote Input 5				
Remote Input 6				
Remote Input 7				
Remote Input 8				
Remote Input 9				
Remote Input 10				
Remote Input 11				
Remote Input 12				
Remote Input 13				
Remote Input 14				
Remote Input 15				
Remote Input 16				
Remote Input 17				
Remote Input 18				
Remote Input 19				
Remote Input 20				
Remote Input 21				
Remote Input 22				
Remote Input 23				
Remote Input 24				
Remote Input 25				
Remote Input 26				
Remote Input 27				
Remote Input 28				
Remote Input 29				
Remote Input 30				
Remote Input 31				
Remote Input 32				

## 8.6.8 REMOTE OUTPUTS

Table 8–15: REMOTE OUTPUTS (Sheet 1 of 2)

OUTPUT #	OPERAND	EVENTS
REMOTE OUTPUTS – DNA		
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		

Table 8–15: REMOTE OUTPUTS (Sheet 2 of 2)

OUTPUT #	OPERAND	EVENTS
REMOTE OUTPUTS – UserSt		
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		

## 8.6.9 RESETTNG

SETTING	VALUE
RESETTNG	
Reset Operand	

### 8.7.1 DCMA INPUTS

### Table 8–16: DCMA INPUTS

[illegible]

### Table 8–17: RTD INPUTS

[illegible]



### 8.8.1 FORCE CONTACT INPUTS/OUTPUTS

### Table 8–18: FORCE CONTACT INPUTS

[illegible]

### Table 8–19: FORCE CONTACT OUTPUTS

[illegible]



Table A-1: FLEXANALOG PARAMETERS (Sheet 1 of 4)

SETTING	DISPLAY TEXT	DESCRIPTION
5728	Stator Diff Iad	Stator Differential Iad (A)
5730	Stator Rest Iar	Stator Restraint Iar (A)
5732	Stator Diff Ibd	Stator Differential Ibd (A)
5734	Stator Rest Ibr	Stator Restraint Ibr (A)
5736	Stator Diff Icd	Stator Differential Icd (A)
5738	Stator Rest Icr	Stator Restraint Icr (A)
5744	Stator Gnd Vn 3rd	Stator Ground Vn 3rd (V)
5746	Stator Gnd Vn V0 3rd	Stator Ground Vn V0 3rd (V)
5760	Sns Dir Power 1	Sens Dir Power 1 Actual (W)
5762	Sns Dir Power 2	Sens Dir Power 2 Actual (W)
6144	SRC 1 Ia RMS	SRC 1 Phase A Current RMS (A)
6146	SRC 1 Ib RMS	SRC 1 Phase B Current RMS (A)
6148	SRC 1 Ic RMS	SRC 1 Phase C Current RMS (A)
6150	SRC 1 In RMS	SRC 1 Neutral Current RMS (A)
6152	SRC 1 Ia Mag	SRC 1 Phase A Current Magnitude (A)
6154	SRC 1 Ia Angle	SRC 1 Phase A Current Angle (°)
6155	SRC 1 Ib Mag	SRC 1 Phase B Current Magnitude (A)
6157	SRC 1 Ib Angle	SRC 1 Phase B Current Angle (°)
6158	SRC 1 Ic Mag	SRC 1 Phase C Current Magnitude (A)
6160	SRC 1 Ic Angle	SRC 1 Phase C Current Angle (°)
6161	SRC 1 In Mag	SRC 1 Neutral Current Magnitude (A)
6163	SRC 1 In Angle	SRC 1 Neutral Current Angle (°)
6164	SRC 1 Ig RMS	SRC 1 Ground Current RMS (A)
6166	SRC 1 Ig Mag	SRC 1 Ground Current Magnitude (A)
6168	SRC 1 Ig Angle	SRC 1 Ground Current Angle (°)
6169	SRC 1 I <sub>0</sub> Mag	SRC 1 Zero Sequence Current Magnitude (A)
6171	SRC 1 I <sub>0</sub> Angle	SRC 1 Zero Sequence Current Angle (°)
6172	SRC 1 I <sub>1</sub> Mag	SRC 1 Positive Sequence Current Magnitude (A)
6174	SRC 1 I <sub>1</sub> Angle	SRC 1 Positive Sequence Current Angle (°)
6175	SRC 1 I <sub>2</sub> Mag	SRC 1 Negative Sequence Current Magnitude (A)
6177	SRC 1 I <sub>2</sub> Angle	SRC 1 Negative Sequence Current Angle (°)
6178	SRC 1 Igd Mag	SRC 1 Differential Ground Current Magnitude (A)
6180	SRC 1 Igd Angle	SRC 1 Differential Ground Current Angle (°)
6208	SRC 2 Ia RMS	SRC 2 Phase A Current RMS (A)
6210	SRC 2 Ib RMS	SRC 2 Phase B Current RMS (A)
6212	SRC 2 Ic RMS	SRC 2 Phase C Current RMS (A)
6214	SRC 2 In RMS	SRC 2 Neutral Current RMS (A)
6216	SRC 2 Ia Mag	SRC 2 Phase A Current Magnitude (A)
6218	SRC 2 Ia Angle	SRC 2 Phase A Current Angle (°)
6219	SRC 2 Ib Mag	SRC 2 Phase B Current Magnitude (A)
6221	SRC 2 Ib Angle	SRC 2 Phase B Current Angle (°)
6222	SRC 2 Ic Mag	SRC 2 Phase C Current Magnitude (A)
6224	SRC 2 Ic Angle	SRC 2 Phase C Current Angle (°)
6225	SRC 2 In Mag	SRC 2 Neutral Current Magnitude (A)

A

Table A-1: FLEXANALOG PARAMETERS (Sheet 2 of 4)

SETTING	DISPLAY TEXT	DESCRIPTION
6227	SRC 2 In Angle	SRC 2 Neutral Current Angle (°)
6228	SRC 2 Ig RMS	SRC 2 Ground Current RMS (A)
6230	SRC 2 Ig Mag	SRC 2 Ground Current Magnitude (A)
6232	SRC 2 Ig Angle	SRC 2 Ground Current Angle (°)
6233	SRC 2 I <sub>0</sub> Mag	SRC 2 Zero Sequence Current Magnitude (A)
6235	SRC 2 I <sub>0</sub> Angle	SRC 2 Zero Sequence Current Angle (°)
6236	SRC 2 I <sub>1</sub> Mag	SRC 2 Positive Sequence Current Magnitude (A)
6238	SRC 2 I <sub>1</sub> Angle	SRC 2 Positive Sequence Current Angle (°)
6239	SRC 2 I <sub>2</sub> Mag	SRC 2 Negative Sequence Current Magnitude (A)
6241	SRC 2 I <sub>2</sub> Angle	SRC 2 Negative Sequence Current Angle (°)
6242	SRC 2 Igd Mag	SRC 2 Differential Ground Current Magnitude (A)
6244	SRC 2 Igd Angle	SRC 2 Differential Ground Current Angle (°)
6656	SRC 1 Vag RMS	SRC 1 Phase AG Voltage RMS (V)
6658	SRC 1 Vbg RMS	SRC 1 Phase BG Voltage RMS (V)
6660	SRC 1 Vcg RMS	SRC 1 Phase CG Voltage RMS (V)
6662	SRC 1 Vag Mag	SRC 1 Phase AG Voltage Magnitude (V)
6664	SRC 1 Vag Angle	SRC 1 Phase AG Voltage Angle (°)
6665	SRC 1 Vbg Mag	SRC 1 Phase BG Voltage Magnitude (V)
6667	SRC 1 Vbg Angle	SRC 1 Phase BG Voltage Angle (°)
6668	SRC 1 Vcg Mag	SRC 1 Phase CG Voltage Magnitude (V)
6670	SRC 1 Vcg Angle	SRC 1 Phase CG Voltage Angle (°)
6671	SRC 1 Vab RMS	SRC 1 Phase AB Voltage RMS (V)
6673	SRC 1 Vbc RMS	SRC 1 Phase BC Voltage RMS (V)
6675	SRC 1 Vca RMS	SRC 1 Phase CA Voltage RMS (V)
6677	SRC 1 Vab Mag	SRC 1 Phase AB Voltage Magnitude (V)
6679	SRC 1 Vab Angle	SRC 1 Phase AB Voltage Angle (°)
6680	SRC 1 Vbc Mag	SRC 1 Phase BC Voltage Magnitude (V)
6682	SRC 1 Vbc Angle	SRC 1 Phase BC Voltage Angle (°)
6683	SRC 1 Vca Mag	SRC 1 Phase CA Voltage Magnitude (V)
6685	SRC 1 Vca Angle	SRC 1 Phase CA Voltage Angle (°)
6686	SRC 1 Vx RMS	SRC 1 Auxiliary Voltage RMS (V)
6688	SRC 1 Vx Mag	SRC 1 Auxiliary Voltage Magnitude (V)
6690	SRC 1 Vx Angle	SRC 1 Auxiliary Voltage Angle (°)
6691	SRC 1 V <sub>0</sub> Mag	SRC 1 Zero Sequence Voltage Magnitude (V)
6693	SRC 1 V <sub>0</sub> Angle	SRC 1 Zero Sequence Voltage Angle (°)
6694	SRC 1 V <sub>1</sub> Mag	SRC 1 Positive Sequence Voltage Magnitude (V)
6696	SRC 1 V <sub>1</sub> Angle	SRC 1 Positive Sequence Voltage Angle (°)
6697	SRC 1 V <sub>2</sub> Mag	SRC 1 Negative Sequence Voltage Magnitude (V)
6699	SRC 1 V <sub>2</sub> Angle	SRC 1 Negative Sequence Voltage Angle (°)
6720	SRC 2 Vag RMS	SRC 2 Phase AG Voltage RMS (V)
6722	SRC 2 Vbg RMS	SRC 2 Phase BG Voltage RMS (V)
6724	SRC 2 Vcg RMS	SRC 2 Phase CG Voltage RMS (V)
6726	SRC 2 Vag Mag	SRC 2 Phase AG Voltage Magnitude (V)
6728	SRC 2 Vag Angle	SRC 2 Phase AG Voltage Angle (°)
6729	SRC 2 Vbg Mag	SRC 2 Phase BG Voltage Magnitude (V)
6731	SRC 2 Vbg Angle	SRC 2 Phase BG Voltage Angle (°)
6732	SRC 2 Vcg Mag	SRC 2 Phase CG Voltage Magnitude (V)

Table A–1: FLEXANALOG PARAMETERS (Sheet 3 of 4)

SETTING	DISPLAY TEXT	DESCRIPTION
6734	SRC 2 Vcg Angle	SRC 2 Phase CG Voltage Angle (°)
6735	SRC 2 Vab RMS	SRC 2 Phase AB Voltage RMS (V)
6737	SRC 2 Vbc RMS	SRC 2 Phase BC Voltage RMS (V)
6739	SRC 2 Vca RMS	SRC 2 Phase CA Voltage RMS (V)
6741	SRC 2 Vab Mag	SRC 2 Phase AB Voltage Magnitude (V)
6743	SRC 2 Vab Angle	SRC 2 Phase AB Voltage Angle (°)
6744	SRC 2 Vbc Mag	SRC 2 Phase BC Voltage Magnitude (V)
6746	SRC 2 Vbc Angle	SRC 2 Phase BC Voltage Angle (°)
6747	SRC 2 Vca Mag	SRC 2 Phase CA Voltage Magnitude (V)
6749	SRC 2 Vca Angle	SRC 2 Phase CA Voltage Angle (°)
6750	SRC 2 Vx RMS	SRC 2 Auxiliary Voltage RMS (V)
6752	SRC 2 Vx Mag	SRC 2 Auxiliary Voltage Magnitude (V)
6754	SRC 2 Vx Angle	SRC 2 Auxiliary Voltage Angle (°)
6755	SRC 2 V_0 Mag	SRC 2 Zero Sequence Voltage Magnitude (V)
6757	SRC 2 V_0 Angle	SRC 2 Zero Sequence Voltage Angle (°)
6758	SRC 2 V_1 Mag	SRC 2 Positive Sequence Voltage Magnitude (V)
6760	SRC 2 V_1 Angle	SRC 2 Positive Sequence Voltage Angle (°)
6761	SRC 2 V_2 Mag	SRC 2 Negative Sequence Voltage Magnitude (V)
6763	SRC 2 V_2 Angle	SRC 2 Negative Sequence Voltage Angle (°)
7168	SRC 1 P	SRC 1 Three Phase Real Power (W)
7170	SRC 1 Pa	SRC 1 Phase A Real Power (W)
7172	SRC 1 Pb	SRC 1 Phase B Real Power (W)
7174	SRC 1 Pc	SRC 1 Phase C Real Power (W)
7176	SRC 1 Q	SRC 1 Three Phase Reactive Power (var)
7178	SRC 1 Qa	SRC 1 Phase A Reactive Power (var)
7180	SRC 1 Qb	SRC 1 Phase B Reactive Power (var)
7182	SRC 1 Qc	SRC 1 Phase C Reactive Power (var)
7184	SRC 1 S	SRC 1 Three Phase Apparent Power (VA)
7186	SRC 1 Sa	SRC 1 Phase A Apparent Power (VA)
7188	SRC 1 Sb	SRC 1 Phase B Apparent Power (VA)
7190	SRC 1 Sc	SRC 1 Phase C Apparent Power (VA)
7192	SRC 1 PF	SRC 1 Three Phase Power Factor
7193	SRC 1 Phase A PF	SRC 1 Phase A Power Factor
7194	SRC 1 Phase B PF	SRC 1 Phase B Power Factor
7195	SRC 1 Phase C PF	SRC 1 Phase C Power Factor
7200	SRC 2 P	SRC 2 Three Phase Real Power (W)
7202	SRC 2 Pa	SRC 2 Phase A Real Power (W)
7204	SRC 2 Pb	SRC 2 Phase B Real Power (W)
7206	SRC 2 Pc	SRC 2 Phase C Real Power (W)
7208	SRC 2 Q	SRC 2 Three Phase Reactive Power (var)
7210	SRC 2 Qa	SRC 2 Phase A Reactive Power (var)
7212	SRC 2 Qb	SRC 2 Phase B Reactive Power (var)
7214	SRC 2 Qc	SRC 2 Phase C Reactive Power (var)
7216	SRC 2 S	SRC 2 Three Phase Apparent Power (VA)
7218	SRC 2 Sa	SRC 2 Phase A Apparent Power (VA)
7220	SRC 2 Sb	SRC 2 Phase B Apparent Power (VA)
7222	SRC 2 Sc	SRC 2 Phase C Apparent Power (VA)

A

Table A-1: FLEXANALOG PARAMETERS (Sheet 4 of 4)

SETTING	DISPLAY TEXT	DESCRIPTION
7224	SRC 2 PF	SRC 2 Three Phase Power Factor
7225	SRC 2 Phase A PF	SRC 2 Phase A Power Factor
7226	SRC 2 Phase B PF	SRC 2 Phase B Power Factor
7227	SRC 2 Phase C PF	SRC 2 Phase C Power Factor
7424	SRC 1 Pos Watthour	SRC 1 Positive Watthour (Wh)
7426	SRC 1 Neg Watthour	SRC 1 Negative Watthour (Wh)
7428	SRC 1 Pos varh	SRC 1 Positive Varhour (varh)
7430	SRC 1 Neg varh	SRC 1 Negative Varhour (varh)
7440	SRC 2 Pos Watthour	SRC 2 Positive Watthour (Wh)
7442	SRC 2 Neg Watthour	SRC 2 Negative Watthour (Wh)
7444	SRC 2 Pos varh	SRC 2 Positive Varhour (varh)
7446	SRC 2 Neg varh	SRC 2 Negative Varhour (varh)
7552	SRC 1 Frequency	SRC 1 Frequency (Hz)
7553	SRC 2 Frequency	SRC 2 Frequency (Hz)
9216	Synchchk 1 Delta V	Synchrocheck 1 Delta Voltage (V)
9218	Synchchk 1 Delta F	Synchrocheck 1 Delta Frequency (Hz)
9219	Synchchk 1 Delta Phs	Synchrocheck 1 Delta Phase (°)
9220	Synchchk 2 Delta V	Synchrocheck 2 Delta Voltage (V)
9222	Synchchk 2 Delta F	Synchrocheck 2 Delta Frequency (Hz)
9223	Synchchk 2 Delta Phs	Synchrocheck 2 Delta Phase (°)
9248	1 S1 S2 Angle	Power Swing S1 S2 Angle (°)
32768	Tracking Frequency	Tracking Frequency (Hz)
39425	FlexElement 1 OpSig	FlexElement 1 Actual
39427	FlexElement 2 OpSig	FlexElement 2 Actual
39429	FlexElement 3 OpSig	FlexElement 3 Actual
39431	FlexElement 4 OpSig	FlexElement 4 Actual
39433	FlexElement 5 OpSig	FlexElement 5 Actual
39435	FlexElement 6 OpSig	FlexElement 6 Actual
39437	FlexElement 7 OpSig	FlexElement 7 Actual
39439	FlexElement 8 OpSig	FlexElement 8 Actual
39441	FlexElement 9 OpSig	FlexElement 9 Actual
39443	FlexElement 10 OpSig	FlexElement 10 Actual
39445	FlexElement 11 OpSig	FlexElement 11 Actual
39447	FlexElement 12 OpSig	FlexElement 12 Actual
39449	FlexElement 13 OpSig	FlexElement 13 Actual
39451	FlexElement 14 OpSig	FlexElement 14 Actual
39453	FlexElement 15 OpSig	FlexElement 15 Actual
39455	FlexElement 16 OpSig	FlexElement 16 Actual
40960	Communications Group	Communications Group
40971	Active Setting Group	Current Setting Group
43808	Volts Per Hertz 1	VHZ 1 Actual (pu)
43809	Volts Per Hertz 2	VHZ 2 Actual (pu)

## B.1.1 INTRODUCTION

The UR series relays support a number of communications protocols to allow connection to equipment such as personal computers, RTUs, SCADA masters, and programmable logic controllers. The Modicon Modbus RTU protocol is the most basic protocol supported by the UR. Modbus is available via RS232 or RS485 serial links or via ethernet (using the Modbus/TCP specification). The following description is intended primarily for users who wish to develop their own master communication drivers and applies to the serial Modbus RTU protocol. Note that:

- The UR always acts as a slave device, meaning that it never initiates communications; it only listens and responds to requests issued by a master computer.
- For Modbus®, a subset of the Remote Terminal Unit (RTU) protocol format is supported that allows extensive monitoring, programming, and control functions using read and write register commands.

## B.1.2 PHYSICAL LAYER

The Modbus® RTU protocol is hardware-independent so that the physical layer can be any of a variety of standard hardware configurations including RS232 and RS485. The relay includes a faceplate (front panel) RS232 port and two rear terminal communications ports that may be configured as RS485, fiber optic, 10BaseT, or 10BaseF. Data flow is half-duplex in all configurations. See Chapter 3: HARDWARE for details on wiring.

Each data byte is transmitted in an asynchronous format consisting of 1 start bit, 8 data bits, 1 stop bit, and possibly 1 parity bit. This produces a 10 or 11 bit data frame. This can be important for transmission through modems at high bit rates (11 bit data frames are not supported by many modems at baud rates greater than 300).

The baud rate and parity are independently programmable for each communications port. Baud rates of 300, 1200, 2400, 4800, 9600, 14400, 19200, 28800, 33600, 38400, 57600, or 115200 bps are available. Even, odd, and no parity are available. Refer to the COMMUNICATIONS section of the SETTINGS chapter for further details.

The master device in any system must know the address of the slave device with which it is to communicate. The relay will not act on a request from a master if the address in the request does not match the relay's slave address (unless the address is the broadcast address – see below).

A single setting selects the slave address used for all ports, with the exception that for the faceplate port, the relay will accept any address when the Modbus® RTU protocol is used.

## B.1.3 DATA LINK LAYER

Communications takes place in packets which are groups of asynchronously framed byte data. The master transmits a packet to the slave and the slave responds with a packet. The end of a packet is marked by 'dead-time' on the communications line. The following describes general format for both transmit and receive packets. For exact details on packet formatting, refer to subsequent sections describing each function code.

**Table B-1: MODBUS PACKET FORMAT**

DESCRIPTION	SIZE
SLAVE ADDRESS	1 byte
FUNCTION CODE	1 byte
DATA	N bytes
CRC	2 bytes
DEAD TIME	3.5 bytes transmission time

## SLAVE ADDRESS

This is the address of the slave device that is intended to receive the packet sent by the master and to perform the desired action. Each slave device on a communications bus must have a unique address to prevent bus contention. All of the relay's ports have the same address which is programmable from 1 to 254; see Chapter 5 for details. Only the addressed slave will respond to a packet that starts with its address. Note that the faceplate port is an exception to this rule; it will act on a message containing any slave address.

A master transmit packet with a slave address of 0 indicates a broadcast command. All slaves on the communication link will take action based on the packet, but none will respond to the master. Broadcast mode is only recognized when associated with FUNCTION CODE 05h. For any other function code, a packet with broadcast mode slave address 0 will be ignored.

### FUNCTION CODE

This is one of the supported functions codes of the unit which tells the slave what action to perform. See the SUPPORTED FUNCTION CODES section for complete details. An exception response from the slave is indicated by setting the high order bit of the function code in the response packet. See the EXCEPTION RESPONSES section for further details.

### DATA

This will be a variable number of bytes depending on the function code. This may include actual values, settings, or addresses sent by the master to the slave or by the slave to the master.

### CRC

This is a two byte error checking code. The RTU version of Modbus® includes a 16 bit cyclic redundancy check (CRC-16) with every packet which is an industry standard method used for error detection. If a Modbus® slave device receives a packet in which an error is indicated by the CRC, the slave device will not act upon or respond to the packet thus preventing any erroneous operations. See the CRC-16 ALGORITHM section for a description of how to calculate the CRC.

### DEAD TIME

A packet is terminated when no data is received for a period of 3.5 byte transmission times (about 15 ms at 2400 bps, 2 ms at 19200 bps, and 300  $\mu$ s at 115200 bps). Consequently, the transmitting device must not allow gaps between bytes longer than this interval. Once the dead time has expired without a new byte transmission, all slaves start listening for a new packet from the master except for the addressed slave.



## B.1.4 CRC-16 ALGORITHM

The CRC-16 algorithm essentially treats the entire data stream (data bits only; start, stop and parity ignored) as one continuous binary number. This number is first shifted left 16 bits and then divided by a characteristic polynomial (1100000000000101B). The 16 bit remainder of the division is appended to the end of the packet, MSByte first. The resulting packet including CRC, when divided by the same polynomial at the receiver will give a zero remainder if no transmission errors have occurred. This algorithm requires the characteristic polynomial to be reverse bit ordered. The most significant bit of the characteristic polynomial is dropped, since it does not affect the value of the remainder.

Note: A C programming language implementation of the CRC algorithm will be provided upon request.

Table B-2: CRC-16 ALGORITHM

<b>SYMBOLS:</b>	-->	data transfer	
	A	16 bit working register	
	Alow	low order byte of A	
	Ahigh	high order byte of A	
	CRC	16 bit CRC-16 result	
	i,j	loop counters	
	(+)	logical EXCLUSIVE-OR operator	
	N	total number of data bytes	
	Di	i-th data byte (i = 0 to N-1)	
	G	16 bit characteristic polynomial = 1010000000000001 (binary) with MSbit dropped and bit order reversed	
	shr (x)	right shift operator (th LSbit of x is shifted into a carry flag, a '0' is shifted into the MSbit of x, all other bits are shifted right one location)	
<b>ALGORITHM:</b>	1.	FFFF (hex) --> A	
	2.	0 --> i	
	3.	0 --> j	
	4.	Di (+) Alow --> Alow	
	5.	j + 1 --> j	
	6.	shr (A)	
	7.	Is there a carry?	No: go to 8 Yes: G (+) A --> A and continue.
	8.	Is j = 8?	No: go to 5 Yes: continue
	9.	i + 1 --> i	
	10.	Is i = N?	No: go to 3 Yes: continue
	11.	A --> CRC	

## B.2.1 SUPPORTED FUNCTION CODES

Modbus® officially defines function codes from 1 to 127 though only a small subset is generally needed. The relay supports some of these functions, as summarized in the following table. Subsequent sections describe each function code in detail.

FUNCTION CODE		MODBUS DEFINITION	GE POWER MANAGEMENT DEFINITION
HEX	DEC		
03	3	Read Holding Registers	Read Actual Values or Settings
04	4	Read Holding Registers	Read Actual Values or Settings
05	5	Force Single Coil	Execute Operation
06	6	Preset Single Register	Store Single Setting
10	16	Preset Multiple Registers	Store Multiple Settings

## B.2.2 03H/04H: READ ACTUAL VALUES OR SETTINGS

This function code allows the master to read one or more consecutive data registers (actual values or settings) from a relay. Data registers are always 16 bit (two byte) values transmitted with high order byte first. The maximum number of registers that can be read in a single packet is 125. See the section MODBUS® MEMORY MAP for exact details on the data registers.

Since some PLC implementations of Modbus® only support one of function codes 03h and 04h, the relay interpretation allows either function code to be used for reading one or more consecutive data registers. The data starting address will determine the type of data being read. Function codes 03h and 04h are therefore identical.

The following table shows the format of the master and slave packets. The example shows a master device requesting 3 register values starting at address 4050h from slave device 11h (17 decimal); the slave device responds with the values 40, 300, and 0 from registers 4050h, 4051h, and 4052h, respectively.

Table B-3: MASTER AND SLAVE DEVICE PACKET TRANSMISSION EXAMPLE

MASTER TRANSMISSION		SLAVE RESPONSE	
PACKET FORMAT	EXAMPLE (HEX)	PACKET FORMAT	EXAMPLE (HEX)
SLAVE ADDRESS	11	SLAVE ADDRESS	11
FUNCTION CODE	04	FUNCTION CODE	04
DATA STARTING ADDRESS - hi	40	BYTE COUNT	06
DATA STARTING ADDRESS - lo	50	DATA #1 - hi	00
NUMBER OF REGISTERS - hi	00	DATA #1 - lo	28
NUMBER OF REGISTERS - lo	03	DATA #2 - hi	01
CRC - lo	A7	DATA #2 - lo	2C
CRC - hi	4A	DATA #3 - hi	00
		DATA #3 - lo	00
		CRC - lo	0D
		CRC - hi	60

## B.2.3 05H: EXECUTE OPERATION

This function code allows the master to perform various operations in the relay. Available operations are in the table SUMMARY OF OPERATION CODES.

The following table shows the format of the master and slave packets. The example shows a master device requesting the slave device 11H (17 dec) to perform a reset. The hi and lo CODE VALUE bytes always have the values 'FF' and '00' respectively and are a remnant of the original Modbus<sup>®</sup> definition of this function code.

Table B-4: MASTER AND SLAVE DEVICE PACKET TRANSMISSION EXAMPLE

MASTER TRANSMISSION		SLAVE RESPONSE	
PACKET FORMAT	EXAMPLE (HEX)	PACKET FORMAT	EXAMPLE (HEX)
SLAVE ADDRESS	11	SLAVE ADDRESS	11
FUNCTION CODE	05	FUNCTION CODE	05
OPERATION CODE - hi	00	OPERATION CODE - hi	00
OPERATION CODE - lo	01	OPERATION CODE - lo	01
CODE VALUE - hi	FF	CODE VALUE - hi	FF
CODE VALUE - lo	00	CODE VALUE - lo	00
CRC - lo	DF	CRC - lo	DF
CRC - hi	6A	CRC - hi	6A

Table B-5: SUMMARY OF OPERATION CODES (FUNCTION CODE 05H)

OPERATION CODE (HEX)	DEFINITION	DESCRIPTION
0000	NO OPERATION	Does not do anything.
0001	RESET	Performs the same function as the faceplate RESET key.
0005	CLEAR EVENT RECORDS	Performs the same function as the faceplate <b>CLEAR EVENT RECORDS</b> menu command.
0006	CLEAR OSCILLOGRAPHY	Clears all oscillography records.
1000 to 101F	VIRTUAL IN 1-32 ON/OFF	Sets the states of Virtual Inputs 1 to 32 either "ON" or "OFF".

## B.2.4 06H: STORE SINGLE SETTING

This function code allows the master to modify the contents of a single setting register in an relay. Setting registers are always 16 bit (two byte) values transmitted high order byte first.

The following table shows the format of the master and slave packets. The example shows a master device storing the value 200 at memory map address 4051h to slave device 11h (17 dec).

Table B-6: MASTER AND SLAVE DEVICE PACKET TRANSMISSION EXAMPLE

MASTER TRANSMISSION		SLAVE RESPONSE	
PACKET FORMAT	EXAMPLE (HEX)	PACKET FORMAT	EXAMPLE (HEX)
SLAVE ADDRESS	11	SLAVE ADDRESS	11
FUNCTION CODE	06	FUNCTION CODE	06
DATA STARTING ADDRESS - hi	40	DATA STARTING ADDRESS - hi	40
DATA STARTING ADDRESS - lo	51	DATA STARTING ADDRESS - lo	51
DATA - hi	00	DATA - hi	00
DATA - lo	C8	DATA - lo	C8
CRC - lo	CE	CRC - lo	CE
CRC - hi	DD	CRC - hi	DD

## B.2.5 10H: STORE MULTIPLE SETTINGS

This function code allows the master to modify the contents of a one or more consecutive setting registers in a relay. Setting registers are 16-bit (two byte) values transmitted high order byte first. The maximum number of setting registers that can be stored in a single packet is 60. The following table shows the format of the master and slave packets. The example shows a master device storing the value 200 at memory map address 4051h, and the value 1 at memory map address 4052h to slave device 11h (17 dec).

Table B-7: MASTER AND SLAVE DEVICE PACKET TRANSMISSION EXAMPLE

MASTER TRANSMISSION		SLAVE RESPONSE	
PACKET FORMAT	EXAMPLE (HEX)	PACKET FORMAT	EXAMPLE (HEX)
SLAVE ADDRESS	11	SLAVE ADDRESS	11
FUNCTION CODE	10	FUNCTION CODE	10
DATA STARTING ADDRESS - hi	40	DATA STARTING ADDRESS - hi	40
DATA STARTING ADDRESS - lo	51	DATA STARTING ADDRESS - lo	51
NUMBER OF SETTINGS - hi	00	NUMBER OF SETTINGS - hi	00
NUMBER OF SETTINGS - lo	02	NUMBER OF SETTINGS - lo	02
BYTE COUNT	04	CRC - lo	07
DATA #1 - high order byte	00	CRC - hi	64
DATA #1 - low order byte	C8		
DATA #2 - high order byte	00		
DATA #2 - low order byte	01		
CRC - low order byte	12		
CRC - high order byte	62		

## B.2.6 EXCEPTION RESPONSES

Programming or operation errors usually happen because of illegal data in a packet. These errors result in an exception response from the slave. The slave detecting one of these errors sends a response packet to the master with the high order bit of the function code set to 1.

The following table shows the format of the master and slave packets. The example shows a master device sending the unsupported function code 39h to slave device 11.

Table B-8: MASTER AND SLAVE DEVICE PACKET TRANSMISSION EXAMPLE

MASTER TRANSMISSION		SLAVE RESPONSE	
PACKET FORMAT	EXAMPLE (HEX)	PACKET FORMAT	EXAMPLE (HEX)
SLAVE ADDRESS	11	SLAVE ADDRESS	11
FUNCTION CODE	39	FUNCTION CODE	B9
CRC - low order byte	CD	ERROR CODE	01
CRC - high order byte	F2	CRC - low order byte	93
		CRC - high order byte	95

## B.3.1 OBTAINING UR FILES USING MODBUS® PROTOCOL

The UR relay has a generic file transfer facility, meaning that you use the same method to obtain all of the different types of files from the unit. The Modbus registers that implement file transfer are found in the "Modbus File Transfer (Read/Write)" and "Modbus File Transfer (Read Only)" modules, starting at address 3100 in the Modbus Memory Map. To read a file from the UR relay, use the following steps:

1. Write the filename to the "Name of file to read" register using a write multiple registers command. If the name is shorter than 80 characters, you may write only enough registers to include all the text of the filename. Filenames are not case sensitive.
2. Repeatedly read all the registers in "Modbus File Transfer (Read Only)" using a read multiple registers command. It is not necessary to read the entire data block, since the UR relay will remember which was the last register you read. The "position" register is initially zero and thereafter indicates how many bytes (2 times the number of registers) you have read so far. The "size of..." register indicates the number of bytes of data remaining to read, to a maximum of 244.
3. Keep reading until the "size of..." register is smaller than the number of bytes you are transferring. This condition indicates end of file. Discard any bytes you have read beyond the indicated block size.
4. If you need to re-try a block, read only the "size of.." and "block of data", without reading the position. The file pointer is only incremented when you read the position register, so the same data block will be returned as was read in the previous operation. On the next read, check to see if the position is where you expect it to be, and discard the previous block if it is not (this condition would indicate that the UR relay did not process your original read request).

The UR relay retains connection-specific file transfer information, so files may be read simultaneously on multiple Modbus connections.

#### a) OBTAINING FILES FROM THE UR USING OTHER PROTOCOLS

All the files available via Modbus may also be retrieved using the standard file transfer mechanisms in other protocols (for example, TFTP or MMS).

#### b) COMTRADE, OSCILLOGRAPHY AND DATA LOGGER FILES

Oscillography and data logger files are formatted using the COMTRADE file format per IEEE PC37.111 Draft 7c (02 September 1997). The files may be obtained in either text or binary COMTRADE format.

#### c) READING OSCILLOGRAPHY FILES

Familiarity with the oscillography feature is required to understand the following description. Refer to the OSCILLOGRAPHY section in the SETTINGS chapter for additional details.

The Oscillography\_Number\_of\_Triggers register is incremented by one every time a new oscillography file is triggered (captured) and cleared to zero when oscillography data is cleared. When a new trigger occurs, the associated oscillography file is assigned a file identifier number equal to the incremented value of this register; the newest file number is equal to the Oscillography\_Number\_of\_Triggers register. This register can be used to determine if any new data has been captured by periodically reading it to see if the value has changed; if the number has increased then new data is available.

The Oscillography\_Number\_of\_Records setting specifies the maximum number of files (and the number of cycles of data per file) that can be stored in memory of the relay. The Oscillography\_Available\_Records register specifies the actual number of files that are stored and still available to be read out of the relay.

Writing 'Yes' (i.e. the value 1) to the Oscillography\_Clear\_Data register clears oscillography data files, clears both the Oscillography\_Number\_of\_Triggers and Oscillography\_Available\_Records registers to zero, and sets the Oscillography\_Last\_Cleared\_Date to the present date and time.

To read binary COMTRADE oscillography files, read the following filenames:

- OSCnnnn.CFG
- OSCnnn.DAT

Replace "nnn" with the desired oscillography trigger number. For ASCII format, use the following file names

- OSCAnnn.CFG
- OSCAnnn.DAT

**d) READING DATA LOGGER FILES**

Familiarity with the data logger feature is required to understand this description. Refer to the DATA LOGGER section of Chapter 5 for details. To read the entire data logger in binary COMTRADE format, read the following files.

- datalog.cfg
- datalog.dat

To read the entire data logger in ASCII COMTRADE format, read the following files.

- dataloga.cfg
- dataloga.dat

To limit the range of records to be returned in the COMTRADE files, append the following to the filename before writing it:

- To read from a specific time to the end of the log: <space> startTime
- To read a specific range of records: <space> startTime <space> endTime
- Replace <startTime> and <endTime> with Julian dates (seconds since Jan. 1 1970) as numeric text.

**e) READING EVENT RECORDER FILES**

To read the entire event recorder contents in ASCII format (the only available format), use the following filename:

- EVT.TXT

To read from a specific record to the end of the log, use the following filename:

- EVTnnn.TXT (replace "nnn" with the desired starting record number)

**B.3.2 MODBUS® PASSWORD OPERATION**

The COMMAND password is set up at memory location 4000. Storing a value of "0" removes COMMAND password protection. When reading the password setting, the encrypted value (zero if no password is set) is returned. COMMAND security is required to change the COMMAND password. Similarly, the SETTING password is set up at memory location 4002. These are the same settings and encrypted values found in the **SETTINGS** ⇒ **PRODUCT SETUP** ⇒ **PASSWORD SECURITY** menu via the keypad. Enabling password security for the faceplate display will also enable it for Modbus, and vice-versa.

To gain COMMAND level security access, the COMMAND password must be entered at memory location 4008. To gain SETTING level security access, the SETTING password must be entered at memory location 400A. The entered SETTING password must match the current SETTING password setting, or must be zero, to change settings or download firmware.

COMMAND and SETTING passwords each have a 30-minute timer. Each timer starts when you enter the particular password, and is re-started whenever you "use" it. For example, writing a setting re-starts the SETTING password timer and writing a command register or forcing a coil re-starts the COMMAND password timer. The value read at memory location 4010 can be used to confirm whether a COMMAND password is enabled or disabled (0 for Disabled). The value read at memory location 4011 can be used to confirm whether a SETTING password is enabled or disabled.

COMMAND or SETTING password security access is restricted to the particular port or particular TCP/IP connection on which the entry was made. Passwords must be entered when accessing the relay through other ports or connections, and the passwords must be re-entered after disconnecting and re-connecting on TCP/IP.

## B.4.1 MODBUS® MEMORY MAP

Table B–9: MODBUS MEMORY MAP (Sheet 1 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
<b>Product Information (Read Only)</b>						
0000	UR Product Type	0 to 65535	---	1	F001	0
0002	Product Version	0 to 655.35	---	0.01	F001	1
<b>Product Information (Read Only -- Written by Factory)</b>						
0010	Serial Number	---	---	---	F203	"0"
0020	Manufacturing Date	0 to 4294967295	---	1	F050	0
0022	Modification Number	0 to 65535	---	1	F001	0
0040	Order Code	---	---	---	F204	"Order Code x "
0090	Ethernet MAC Address	---	---	---	F072	0
0093	Reserved (13 items)	---	---	---	F001	0
00A0	CPU Module Serial Number	---	---	---	F203	(none)
00B0	CPU Supplier Serial Number	---	---	---	F203	(none)
00C0	Ethernet Sub Module Serial Number (8 items)	---	---	---	F203	(none)
<b>Self Test Targets (Read Only)</b>						
0200	Self Test States (2 items)	0 to 4294967295	0	1	F143	0
<b>Front Panel (Read Only)</b>						
0204	LED Column x State (9 items)	0 to 65535	---	1	F501	0
0220	Display Message	---	---	---	F204	(none)
<b>Keypress Emulation (Read/Write)</b>						
0280	Simulated keypress – write zero before each keystroke	0 to 26	---	1	F190	0 (No key – use between real key)
<b>Virtual Input Commands (Read/Write Command) (32 modules)</b>						
0400	Virtual Input x State	0 to 1	---	1	F108	0 (Off)
0401	...Repeated for module number 2					
0402	...Repeated for module number 3					
0403	...Repeated for module number 4					
0404	...Repeated for module number 5					
0405	...Repeated for module number 6					
0406	...Repeated for module number 7					
0407	...Repeated for module number 8					
0408	...Repeated for module number 9					
0409	...Repeated for module number 10					
040A	...Repeated for module number 11					
040B	...Repeated for module number 12					
040C	...Repeated for module number 13					
040D	...Repeated for module number 14					
040E	...Repeated for module number 15					
040F	...Repeated for module number 16					
0410	...Repeated for module number 17					
0411	...Repeated for module number 18					
0412	...Repeated for module number 19					
0413	...Repeated for module number 20					
0414	...Repeated for module number 21					
0415	...Repeated for module number 22					
0416	...Repeated for module number 23					
0417	...Repeated for module number 24					
0418	...Repeated for module number 25					
0419	...Repeated for module number 26					
041A	...Repeated for module number 27					
041B	...Repeated for module number 28					
041C	...Repeated for module number 29					

Table B–9: MODBUS MEMORY MAP (Sheet 2 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
041D	...Repeated for module number 30					
041E	...Repeated for module number 31					
041F	...Repeated for module number 32					
<b>Digital Counter States (Read Only Non-Volatile) (8 modules)</b>						
0800	Digital Counter x Value	–2147483647 to 2147483647	---	1	F004	0
0802	Digital Counter x Frozen	–2147483647 to 2147483647	---	1	F004	0
0804	Digital Counter x Frozen Time Stamp	0 to 4294967295	---	1	F050	0
0806	Digital Counter x Frozen Time Stamp us	0 to 4294967295	---	1	F003	0
0808	...Repeated for module number 2					
0810	...Repeated for module number 3					
0818	...Repeated for module number 4					
0820	...Repeated for module number 5					
0828	...Repeated for module number 6					
0830	...Repeated for module number 7					
0838	...Repeated for module number 8					
<b>Flex States (Read Only)</b>						
0900	Flex State Bits (16 items)	0 to 65535	---	1	F001	0
<b>Element States (Read Only)</b>						
1000	Element Operate States (64 items)	0 to 65535	---	1	F502	0
<b>User Displays Actuals (Read Only)</b>						
1080	Formatted user-definable displays (8 items)	---	---	---	F200	(none)
<b>Modbus User Map Actuals (Read Only)</b>						
1200	User Map Values (256 items)	0 to 65535	---	1	F001	0
<b>Element Targets (Read Only)</b>						
14C0	Target Sequence	0 to 65535	---	1	F001	0
14C1	Number of Targets	0 to 65535	---	1	F001	0
<b>Element Targets (Read/Write)</b>						
14C2	Target to Read	0 to 65535	---	1	F001	0
<b>Element Targets (Read Only)</b>						
14C3	Target Message	---	---	---	F200	"."
<b>Digital I/O States (Read Only)</b>						
1500	Contact Input States (6 items)	0 to 65535	---	1	F500	0
1508	Virtual Input States (2 items)	0 to 65535	---	1	F500	0
1510	Contact Output States (4 items)	0 to 65535	---	1	F500	0
1518	Contact Output Current States (4 items)	0 to 65535	---	1	F500	0
1520	Contact Output Voltage States (4 items)	0 to 65535	---	1	F500	0
1528	Virtual Output States (4 items)	0 to 65535	---	1	F500	0
1530	Contact Output Detectors (4 items)	0 to 65535	---	1	F500	0
<b>Remote I/O States (Read Only)</b>						
1540	Remote Device x States	0 to 65535	---	1	F500	0
1542	Remote Input x States (2 items)	0 to 65535	---	1	F500	0
1550	Remote Devices Online	0 to 1	---	1	F126	0 (No)
<b>Remote Device Status (Read Only) (16 modules)</b>						
1551	Remote Device x StNum	0 to 4294967295	---	1	F003	0
1553	Remote Device x SqNum	0 to 4294967295	---	1	F003	0
1555	...Repeated for module number 2					
1559	...Repeated for module number 3					
155D	...Repeated for module number 4					
1561	...Repeated for module number 5					
1565	...Repeated for module number 6					
1569	...Repeated for module number 7					
156D	...Repeated for module number 8					
1571	...Repeated for module number 9					

B



Table B-9: MODBUS MEMORY MAP (Sheet 3 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
1575	...Repeated for module number 10					
1579	...Repeated for module number 11					
157D	...Repeated for module number 12					
1581	...Repeated for module number 13					
1585	...Repeated for module number 14					
1589	...Repeated for module number 15					
158D	...Repeated for module number 16					
<b>Ethernet Fibre Channel Status (Read/Write)</b>						
1610	Ethernet Primary Fibre Channel Status	0 to 2	---	1	F134	0 (Fail)
1611	Ethernet Secondary Fibre Channel Status	0 to 2	---	1	F134	0 (Fail)
<b>Data Logger Actuals (Read Only)</b>						
1618	Data Logger Channel Count	0 to 16	CHNL	1	F001	0
1619	Time of oldest available samples	0 to 4294967295	seconds	1	F050	0
161B	Time of newest available samples	0 to 4294967295	seconds	1	F050	0
161D	Data Logger Duration	0 to 999.9	DAYS	0.1	F001	0
<b>Stator Differential Actuals (Read Only)</b>						
1660	Generator Differential Iad	0 to 999999.999	A	0.001	F060	0
1662	Generator Rest Iar	0 to 999999.999	A	0.001	F060	0
1664	Generator Differential Ibd	0 to 999999.999	A	0.001	F060	0
1666	Generator Rest Ibr	0 to 999999.999	A	0.001	F060	0
1668	Generator Differential Icd	0 to 999999.999	A	0.001	F060	0
166A	Generator Rest Icr	0 to 999999.999	A	0.001	F060	0
<b>Stator Ground Actuals (Read Only)</b>						
1670	Stator Ground Vn 3rd	0 to 999999.999	V	0.001	F060	0
1672	Stator Gnd Vn V0 3rd	0 to 999999.999	V	0.001	F060	0
<b>Sensitive Directional Power Actuals (Read Only) (2 modules)</b>						
1680	Sensitive Directional Power X Power	-2147483647 to 2147483647	W	1	F060	0
1682	...Repeated for module number 2					
<b>Source Current (Read Only) (6 modules)</b>						
1800	Phase A Current RMS	0 to 999999.999	A	0.001	F060	0
1802	Phase B Current RMS	0 to 999999.999	A	0.001	F060	0
1804	Phase C Current RMS	0 to 999999.999	A	0.001	F060	0
1806	Neutral Current RMS	0 to 999999.999	A	0.001	F060	0
1808	Phase A Current Magnitude	0 to 999999.999	A	0.001	F060	0
180A	Phase A Current Angle	-359.9 to 0	°	0.1	F002	0
180B	Phase B Current Magnitude	0 to 999999.999	A	0.001	F060	0
180D	Phase B Current Angle	-359.9 to 0	°	0.1	F002	0
180E	Phase C Current Magnitude	0 to 999999.999	A	0.001	F060	0
1810	Phase C Current Angle	-359.9 to 0	°	0.1	F002	0
1811	Neutral Current Magnitude	0 to 999999.999	A	0.001	F060	0
1813	Neutral Current Angle	-359.9 to 0	°	0.1	F002	0
1814	Ground Current RMS	0 to 999999.999	A	0.001	F060	0
1816	Ground Current Magnitude	0 to 999999.999	A	0.001	F060	0
1818	Ground Current Angle	-359.9 to 0	°	0.1	F002	0
1819	Zero Sequence Current Magnitude	0 to 999999.999	A	0.001	F060	0
181B	Zero Sequence Current Angle	-359.9 to 0	°	0.1	F002	0
181C	Positive Sequence Current Magnitude	0 to 999999.999	A	0.001	F060	0
181E	Positive Sequence Current Angle	-359.9 to 0	°	0.1	F002	0
181F	Negative Sequence Current Magnitude	0 to 999999.999	A	0.001	F060	0
1821	Negative Sequence Current Angle	-359.9 to 0	°	0.1	F002	0
1822	Differential Ground Current Magnitude	0 to 999999.999	A	0.001	F060	0
1824	Differential Ground Current Angle	-359.9 to 0	°	0.1	F002	0
1825	Reserved (27 items)	---	---	---	F001	0

Table B-9: MODBUS MEMORY MAP (Sheet 4 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
1840	...Repeated for module number 2					
1880	...Repeated for module number 3					
18C0	...Repeated for module number 4					
1900	...Repeated for module number 5					
1940	...Repeated for module number 6					
<b>Source Voltage (Read Only) (6 modules)</b>						
1A00	Phase AG Voltage RMS	0 to 999999.999	V	0.001	F060	0
1A02	Phase BG Voltage RMS	0 to 999999.999	V	0.001	F060	0
1A04	Phase CG Voltage RMS	0 to 999999.999	V	0.001	F060	0
1A06	Phase AG Voltage Magnitude	0 to 999999.999	V	0.001	F060	0
1A08	Phase AG Voltage Angle	-359.9 to 0	°	0.1	F002	0
1A09	Phase BG Voltage Magnitude	0 to 999999.999	V	0.001	F060	0
1A0B	Phase BG Voltage Angle	-359.9 to 0	°	0.1	F002	0
1A0C	Phase CG Voltage Magnitude	0 to 999999.999	V	0.001	F060	0
1A0E	Phase CG Voltage Angle	-359.9 to 0	°	0.1	F002	0
1A0F	Phase AB or AC Voltage RMS	0 to 999999.999	V	0.001	F060	0
1A11	Phase BC or BA Voltage RMS	0 to 999999.999	V	0.001	F060	0
1A13	Phase CA or CB Voltage RMS	0 to 999999.999	V	0.001	F060	0
1A15	Phase AB or AC Voltage Magnitude	0 to 999999.999	V	0.001	F060	0
1A17	Phase AB or AC Voltage Angle	-359.9 to 0	°	0.1	F002	0
1A18	Phase BC or BA Voltage Magnitude	0 to 999999.999	V	0.001	F060	0
1A1A	Phase BC or BA Voltage Angle	-359.9 to 0	°	0.1	F002	0
1A1B	Phase CA or CB Voltage Magnitude	0 to 999999.999	V	0.001	F060	0
1A1D	Phase CA or CB Voltage Angle	-359.9 to 0	°	0.1	F002	0
1A1E	Auxiliary Voltage RMS	0 to 999999.999	V	0.001	F060	0
1A20	Auxiliary Voltage Magnitude	0 to 999999.999	V	0.001	F060	0
1A22	Auxiliary Voltage Angle	-359.9 to 0	°	0.1	F002	0
1A23	Zero Sequence Voltage Magnitude	0 to 999999.999	V	0.001	F060	0
1A25	Zero Sequence Voltage Angle	-359.9 to 0	°	0.1	F002	0
1A26	Positive Sequence Voltage Magnitude	0 to 999999.999	V	0.001	F060	0
1A28	Positive Sequence Voltage Angle	-359.9 to 0	°	0.1	F002	0
1A29	Negative Sequence Voltage Magnitude	0 to 999999.999	V	0.001	F060	0
1A2B	Negative Sequence Voltage Angle	-359.9 to 0	°	0.1	F002	0
1A2C	Reserved (20 items)	---	---	---	F001	0
1A40	...Repeated for module number 2					
1A80	...Repeated for module number 3					
1AC0	...Repeated for module number 4					
1B00	...Repeated for module number 5					
1B40	...Repeated for module number 6					
<b>Source Power (Read Only) (6 modules)</b>						
1C00	Three Phase Real Power	-1000000000000 to 1000000000000	W	0.001	F060	0
1C02	Phase A Real Power	-1000000000000 to 1000000000000	W	0.001	F060	0
1C04	Phase B Real Power	-1000000000000 to 1000000000000	W	0.001	F060	0
1C06	Phase C Real Power	-1000000000000 to 1000000000000	W	0.001	F060	0
1C08	Three Phase Reactive Power	-1000000000000 to 1000000000000	var	0.001	F060	0
1C0A	Phase A Reactive Power	-1000000000000 to 1000000000000	var	0.001	F060	0
1C0C	Phase B Reactive Power	-1000000000000 to 1000000000000	var	0.001	F060	0
1C0E	Phase C Reactive Power	-1000000000000 to 1000000000000	var	0.001	F060	0

Table B-9: MODBUS MEMORY MAP (Sheet 5 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
1C10	Three Phase Apparent Power	-1000000000000 to 1000000000000	VA	0.001	F060	0
1C12	Phase A Apparent Power	-1000000000000 to 1000000000000	VA	0.001	F060	0
1C14	Phase B Apparent Power	-1000000000000 to 1000000000000	VA	0.001	F060	0
1C16	Phase C Apparent Power	-1000000000000 to 1000000000000	VA	0.001	F060	0
1C18	Three Phase Power Factor	-0.999 to 1	---	0.001	F013	0
1C19	Phase A Power Factor	-0.999 to 1	---	0.001	F013	0
1C1A	Phase B Power Factor	-0.999 to 1	---	0.001	F013	0
1C1B	Phase C Power Factor	-0.999 to 1	---	0.001	F013	0
1C1C	Reserved (4 items)	---	---	---	F001	0
1C20	...Repeated for module number 2					
1C40	...Repeated for module number 3					
1C60	...Repeated for module number 4					
1C80	...Repeated for module number 5					
1CA0	...Repeated for module number 6					
<b>Source Energy (Read Only Non-Volatile) (6 modules)</b>						
1D00	Positive Watthour	0 to 1000000000000	Wh	0.001	F060	0
1D02	Negative Watthour	0 to 1000000000000	Wh	0.001	F060	0
1D04	Positive Varhour	0 to 1000000000000	varh	0.001	F060	0
1D06	Negative Varhour	0 to 1000000000000	varh	0.001	F060	0
1D08	Reserved (8 items)	---	---	---	F001	0
1D10	...Repeated for module number 2					
1D20	...Repeated for module number 3					
1D30	...Repeated for module number 4					
1D40	...Repeated for module number 5					
1D50	...Repeated for module number 6					
<b>Energy Commands (Read/Write Command)</b>						
1D60	Energy Clear Command	0 to 1	---	1	F126	0 (No)
<b>Source Frequency (Read Only) (6 modules)</b>						
1D80	Frequency	2 to 90	Hz	0.01	F001	0
1D81	...Repeated for module number 2					
1D82	...Repeated for module number 3					
1D83	...Repeated for module number 4					
1D84	...Repeated for module number 5					
1D85	...Repeated for module number 6					
<b>Synchrocheck Actuals (Read Only) (2 modules)</b>						
2400	Synchrocheck X Delta Voltage	-1000000000000 to 1000000000000	V	1	F060	0
2402	Synchrocheck X Delta Frequency	0 to 655.35	Hz	0.01	F001	0
2403	Synchrocheck X Delta Phase	0 to 359.9	°	0.1	F001	0
2404	...Repeated for module number 2					
<b>Expanded FlexStates (Read Only)</b>						
2B00	FlexStates, one per register (256 items)	0 to 1	---	1	F108	0 (Off)
<b>Expanded Digital I/O states (Read Only)</b>						
2D00	Contact Input States, one per register (96 items)	0 to 1	---	1	F108	0 (Off)
2D80	Contact Output States, one per register (64 items)	0 to 1	---	1	F108	0 (Off)
2E00	Virtual Output States, one per register (64 items)	0 to 1	---	1	F108	0 (Off)
<b>Expanded Remote I/O Status (Read Only)</b>						
2F00	Remote Device States, one per register (16 items)	0 to 1	---	1	F155	0 (Offline)
2F80	Remote Input States, one per register (32 items)	0 to 1	---	1	F108	0 (Off)
<b>Oscillography Values (Read Only)</b>						
3000	Oscillography Number of Triggers	0 to 65535	---	1	F001	0
3001	Oscillography Available Records	0 to 65535	---	1	F001	0

Table B–9: MODBUS MEMORY MAP (Sheet 6 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
3002	Oscillography Last Cleared Date	0 to 400000000	---	1	F050	0
3004	Oscillography Number Of Cycles Per Record	0 to 65535	---	1	F001	0
<b>Oscillography Commands (Read/Write Command)</b>						
3005	Oscillography Force Trigger	0 to 1	---	1	F126	0 (No)
3011	Oscillography Clear Data	0 to 1	---	1	F126	0 (No)
<b>Modbus File Transfer (Read/Write)</b>						
3100	Name of file to read	---	---	---	F204	(none)
<b>Modbus File Transfer (Read Only)</b>						
3200	Character position of current block within file	0 to 4294967295	---	1	F003	0
3202	Size of currently-available data block	0 to 65535	---	1	F001	0
3203	Block of data from requested file (122 items)	0 to 65535	---	1	F001	0
<b>Event Recorder (Read Only)</b>						
3400	Events Since Last Clear	0 to 4294967295	---	1	F003	0
3402	Number of Available Events	0 to 4294967295	---	1	F003	0
3404	Event Recorder Last Cleared Date	0 to 4294967295	---	1	F050	0
<b>Event Recorder (Read/Write Command)</b>						
3406	Event Recorder Clear Command	0 to 1	---	1	F126	0 (No)
<b>DCMA Input Values (Read Only) (24 modules)</b>						
34C0	DCMA Inputs x Value	-9999.999 to 9999.999	---	0.001	F004	0
34C2	...Repeated for module number 2					
34C4	...Repeated for module number 3					
34C6	...Repeated for module number 4					
34C8	...Repeated for module number 5					
34CA	...Repeated for module number 6					
34CC	...Repeated for module number 7					
34CE	...Repeated for module number 8					
34D0	...Repeated for module number 9					
34D2	...Repeated for module number 10					
34D4	...Repeated for module number 11					
34D6	...Repeated for module number 12					
34D8	...Repeated for module number 13					
34DA	...Repeated for module number 14					
34DC	...Repeated for module number 15					
34DE	...Repeated for module number 16					
34E0	...Repeated for module number 17					
34E2	...Repeated for module number 18					
34E4	...Repeated for module number 19					
34E6	...Repeated for module number 20					
34E8	...Repeated for module number 21					
34EA	...Repeated for module number 22					
34EC	...Repeated for module number 23					
34EE	...Repeated for module number 24					
<b>RTD Input Values (Read Only) (48 modules)</b>						
34F0	RTD Inputs x Value	-32768 to 32767	°C	1	F002	0
34F1	...Repeated for module number 2					
34F2	...Repeated for module number 3					
34F3	...Repeated for module number 4					
34F4	...Repeated for module number 5					
34F5	...Repeated for module number 6					
34F6	...Repeated for module number 7					
34F7	...Repeated for module number 8					
34F8	...Repeated for module number 9					
34F9	...Repeated for module number 10					
34FA	...Repeated for module number 11					

Table B-9: MODBUS MEMORY MAP (Sheet 7 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
34FB	...Repeated for module number 12					
34FC	...Repeated for module number 13					
34FD	...Repeated for module number 14					
34FE	...Repeated for module number 15					
34FF	...Repeated for module number 16					
3500	...Repeated for module number 17					
3501	...Repeated for module number 18					
3502	...Repeated for module number 19					
3503	...Repeated for module number 20					
3504	...Repeated for module number 21					
3505	...Repeated for module number 22					
3506	...Repeated for module number 23					
3507	...Repeated for module number 24					
3508	...Repeated for module number 25					
3509	...Repeated for module number 26					
350A	...Repeated for module number 27					
350B	...Repeated for module number 28					
350C	...Repeated for module number 29					
350D	...Repeated for module number 30					
350E	...Repeated for module number 31					
350F	...Repeated for module number 32					
3510	...Repeated for module number 33					
3511	...Repeated for module number 34					
3512	...Repeated for module number 35					
3513	...Repeated for module number 36					
3514	...Repeated for module number 37					
3515	...Repeated for module number 38					
3516	...Repeated for module number 39					
3517	...Repeated for module number 40					
3518	...Repeated for module number 41					
3519	...Repeated for module number 42					
351A	...Repeated for module number 43					
351B	...Repeated for module number 44					
351C	...Repeated for module number 45					
351D	...Repeated for module number 46					
351E	...Repeated for module number 47					
351F	...Repeated for module number 48					
<b>Ohm Input Values (Read Only) (2 modules)</b>						
3520	Ohm Inputs x Value	0 to 65535	Ω	1	F001	0
3521	...Repeated for module number 2					
<b>Passwords (Read/Write Command)</b>						
4000	Command Password Setting	0 to 4294967295	---	1	F003	0
<b>Passwords (Read/Write Setting)</b>						
4002	Setting Password Setting	0 to 4294967295	---	1	F003	0
<b>Passwords (Read/Write)</b>						
4008	Command Password Entry	0 to 4294967295	---	1	F003	0
400A	Setting Password Entry	0 to 4294967295	---	1	F003	0
<b>Passwords (Read Only)</b>						
4010	Command Password Status	0 to 1	---	1	F102	0 (Disabled)
4011	Setting Password Status	0 to 1	---	1	F102	0 (Disabled)
<b>Preferences (Read/Write Setting)</b>						
4050	Flash Message Time	0.5 to 10	s	0.1	F001	10
4051	Default Message Timeout	10 to 900	s	1	F001	300
4052	Default Message Intensity	0 to 3	---	1	F101	0 (25%)

Table B–9: MODBUS MEMORY MAP (Sheet 8 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
<b>Communications (Read/Write Setting)</b>						
407E	COM1 minimum response time	0 to 1000	ms	10	F001	0
407F	COM2 minimum response time	0 to 1000	ms	10	F001	0
4080	Modbus Slave Address	1 to 254	---	1	F001	254
4083	RS485 Com1 Baud Rate	0 to 11	---	1	F112	5 (19200)
4084	RS485 Com1 Parity	0 to 2	---	1	F113	0 (None)
4085	RS485 Com2 Baud Rate	0 to 11	---	1	F112	5 (19200)
4086	RS485 Com2 Parity	0 to 2	---	1	F113	0 (None)
4087	IP Address	0 to 4294967295	---	1	F003	56554706
4089	IP Subnet Mask	0 to 4294967295	---	1	F003	4294966272
408B	Gateway IP Address	0 to 4294967295	---	1	F003	56554497
408D	Network Address NSAP	---	---	---	F074	0
4097	Default GOOSE Update Time	1 to 60	s	1	F001	60
4098	Ethernet Primary Fibre Channel Link Monitor	0 to 1	---	1	F102	0 (Disabled)
4099	Ethernet Secondary Fibre Channel Link Monitor	0 to 1	---	1	F102	0 (Disabled)
409A	DNP Port	0 to 4	---	1	F177	0 (NONE)
409B	DNP Address	0 to 65519	---	1	F001	255
409C	DNP Client Addresses (2 items)	0 to 4294967295	---	1	F003	0
40A0	TCP Port Number for the Modbus protocol	1 to 65535	---	1	F001	502
40A1	TCP/UDP Port Number for the DNP Protocol	1 to 65535	---	1	F001	20000
40A2	TCP Port Number for the UCA/MMS Protocol	1 to 65535	---	1	F001	102
40A3	TCP Port No. for the HTTP (Web Server) Protocol	1 to 65535	---	1	F001	80
40A4	Main UDP Port Number for the TFTP Protocol	1 to 65535	---	1	F001	69
40A5	Data Transfer UDP Port Numbers for the TFTP Protocol (zero means "automatic") (2 items)	0 to 65535	---	1	F001	0
40A7	DNP Unsolicited Responses Function	0 to 1	---	1	F102	0 (Disabled)
40A8	DNP Unsolicited Responses Timeout	0 to 60	s	1	F001	5
40A9	DNP Unsolicited Responses Max Retries	1 to 255	---	1	F001	10
40AA	DNP Unsolicited Responses Destination Address	0 to 65519	---	1	F001	1
40AB	Ethernet Operation Mode	0 to 1	---	1	F192	0 (Half-Duplex)
40AC	DNP User Map Function	0 to 1	---	1	F102	0 (Disabled)
40AD	DNP Number of Sources used in Analog points list	1 to 6	---	1	F001	1
40AE	DNP Current Scale Factor	0 to 5	---	1	F194	2 (1)
40AF	DNP Voltage Scale Factor	0 to 5	---	1	F194	2 (1)
40B0	DNP Power Scale Factor	0 to 5	---	1	F194	2 (1)
40B1	DNP Energy Scale Factor	0 to 5	---	1	F194	2 (1)
40B2	DNP Other Scale Factor	0 to 5	---	1	F194	2 (1)
40B3	DNP Current Default Deadband	0 to 65535	---	1	F001	30000
40B4	DNP Voltage Default Deadband	0 to 65535	---	1	F001	30000
40B5	DNP Power Default Deadband	0 to 65535	---	1	F001	30000
40B6	DNP Energy Default Deadband	0 to 65535	---	1	F001	30000
40B7	DNP Other Default Deadband	0 to 65535	---	1	F001	30000
40B8	DNP IIN Time Sync Bit Period	1 to 10080	min	1	F001	1440
40B9	DNP Message Fragment Size	30 to 2048	---	1	F001	240
40BA	DNP Client Address 3	0 to 4294967295	---	1	F003	0
40BC	DNP Client Address 4	0 to 4294967295	---	1	F003	0
40BE	DNP Client Address 5	0 to 4294967295	---	1	F003	0
40C0	DNP Communications Reserved (8 items)	0 to 1	---	1	F001	0
40C8	UCA Logical Device Name	---	---	---	F203	"UCADevice"
40D0	UCA Communications Reserved (16 items)	0 to 1	---	1	F001	0
40E0	TCP Port Number for the IEC 60870-5-104 Protocol	1 to 65535	---	1	F001	2404
40E1	IEC 60870-5-104 Protocol Function	0 to 1	---	1	F102	0 (Disabled)
40E2	IEC 60870-5-104 Protocol Common Addr of ASDU	0 to 65535	---	1	F001	0
40E3	IEC 60870-5-104 Protocol Cyclic Data Tx Period	1 to 65535	s	1	F001	60

Table B-9: MODBUS MEMORY MAP (Sheet 9 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
40E4	IEC No. of Sources used in M_ME_NC_1 point list	1 to 6	---	1	F001	1
40E5	IEC Current Default Threshold	0 to 65535	---	1	F001	30000
40E6	IEC Voltage Default Threshold	0 to 65535	---	1	F001	30000
40E7	IEC Power Default Threshold	0 to 65535	---	1	F001	30000
40E8	IEC Energy Default Threshold	0 to 65535	---	1	F001	30000
40E9	IEC Other Default Threshold	0 to 65535	---	1	F001	30000
40EA	IEC Communications Reserved (22 items)	0 to 1	---	1	F001	0
4100	DNP Binary Input Block of 16 Points (58 items)	0 to 58	---	1	F197	0 (Not Used)
<b>Data Logger Commands (Read/Write Command)</b>						
4170	Clear Data Logger	0 to 1	---	1	F126	0 (No)
<b>Data Logger (Read/Write Setting)</b>						
4180	Data Logger Rate	0 to 7	---	1	F178	1 (1 min)
4181	Data Logger Channel Settings (16 items)	---	---	---	F600	0
<b>Clock (Read/Write Command)</b>						
41A0	RTC Set Time	0 to 235959	---	1	F003	0
<b>Clock (Read/Write Setting)</b>						
41A2	SR Date Format	0 to 4294967295	---	1	F051	0
41A4	SR Time Format	0 to 4294967295	---	1	F052	0
41A6	IRIG-B Signal Type	0 to 2	---	1	F114	0 (None)
<b>Oscillography (Read/Write Setting)</b>						
41C0	Oscillography Number of Records	1 to 64	---	1	F001	15
41C1	Oscillography Trigger Mode	0 to 1	---	1	F118	0 (Auto Overwrite)
41C2	Oscillography Trigger Position	0 to 100	%	1	F001	50
41C3	Oscillography Trigger Source	0 to 65535	---	1	F300	0
41C4	Oscillography AC Input Waveforms	0 to 4	---	1	F183	2 (16 samples/cycle)
41D0	Oscillography Analog Channel X (16 items)	0 to 65535	---	1	F600	0
4200	Oscillography Digital Channel X (63 items)	0 to 65535	---	1	F300	0
<b>Trip and Alarm LEDs (Read/Write Setting)</b>						
4260	Trip LED Input FlexLogic Operand	0 to 65535	---	1	F300	0
4261	Alarm LED Input FlexLogic Operand	0 to 65535	---	1	F300	0
<b>User Programmable LEDs (Read/Write Setting) (48 modules)</b>						
4280	FlexLogic Operand to Activate LED	0 to 65535	---	1	F300	0
4281	User LED type (latched or self-resetting)	0 to 1	---	1	F127	1 (Self-Reset)
4282	...Repeated for module number 2					
4284	...Repeated for module number 3					
4286	...Repeated for module number 4					
4288	...Repeated for module number 5					
428A	...Repeated for module number 6					
428C	...Repeated for module number 7					
428E	...Repeated for module number 8					
4290	...Repeated for module number 9					
4292	...Repeated for module number 10					
4294	...Repeated for module number 11					
4296	...Repeated for module number 12					
4298	...Repeated for module number 13					
429A	...Repeated for module number 14					
429C	...Repeated for module number 15					
429E	...Repeated for module number 16					
42A0	...Repeated for module number 17					
42A2	...Repeated for module number 18					
42A4	...Repeated for module number 19					
42A6	...Repeated for module number 20					
42A8	...Repeated for module number 21					
42AA	...Repeated for module number 22					

Table B-9: MODBUS MEMORY MAP (Sheet 10 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
42AC	...Repeated for module number 23					
42AE	...Repeated for module number 24					
42B0	...Repeated for module number 25					
42B2	...Repeated for module number 26					
42B4	...Repeated for module number 27					
42B6	...Repeated for module number 28					
42B8	...Repeated for module number 29					
42BA	...Repeated for module number 30					
42BC	...Repeated for module number 31					
42BE	...Repeated for module number 32					
42C0	...Repeated for module number 33					
42C2	...Repeated for module number 34					
42C4	...Repeated for module number 35					
42C6	...Repeated for module number 36					
42C8	...Repeated for module number 37					
42CA	...Repeated for module number 38					
42CC	...Repeated for module number 39					
42CE	...Repeated for module number 40					
42D0	...Repeated for module number 41					
42D2	...Repeated for module number 42					
42D4	...Repeated for module number 43					
42D6	...Repeated for module number 44					
42D8	...Repeated for module number 45					
42DA	...Repeated for module number 46					
42DC	...Repeated for module number 47					
42DE	...Repeated for module number 48					
<b>Installation (Read/Write Setting)</b>						
43E0	Relay Programmed State	0 to 1	---	1	F133	0 (Not Programmed)
43E1	Relay Name	---	---	---	F202	"Relay-1"
<b>CT Settings (Read/Write Setting) (6 modules)</b>						
4480	Phase CT Primary	1 to 65000	A	1	F001	1
4481	Phase CT Secondary	0 to 1	---	1	F123	0 (1 A)
4482	Ground CT Primary	1 to 65000	A	1	F001	1
4483	Ground CT Secondary	0 to 1	---	1	F123	0 (1 A)
4484	...Repeated for module number 2					
4488	...Repeated for module number 3					
448C	...Repeated for module number 4					
4490	...Repeated for module number 5					
4494	...Repeated for module number 6					
<b>VT Settings (Read/Write Setting) (3 modules)</b>						
4500	Phase VT Connection	0 to 1	---	1	F100	0 (Wye)
4501	Phase VT Secondary	50 to 240	V	0.1	F001	664
4502	Phase VT Ratio	1 to 24000	:1	1	F060	1
4504	Auxiliary VT Connection	0 to 6	---	1	F166	1 (Vag)
4505	Auxiliary VT Secondary	50 to 240	V	0.1	F001	664
4506	Auxiliary VT Ratio	1 to 24000	:1	1	F060	1
4508	...Repeated for module number 2					
4510	...Repeated for module number 3					
<b>Source Settings (Read/Write Setting) (6 modules)</b>						
4580	Source Name	---	---	---	F206	"SRC 1 "
4583	Source Phase CT	0 to 63	---	1	F400	0
4584	Source Ground CT	0 to 63	---	1	F400	0
4585	Source Phase VT	0 to 63	---	1	F400	0
4586	Source Auxiliary VT	0 to 63	---	1	F400	0



Table B-9: MODBUS MEMORY MAP (Sheet 11 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
4587	...Repeated for module number 2					
458E	...Repeated for module number 3					
4595	...Repeated for module number 4					
459C	...Repeated for module number 5					
45A3	...Repeated for module number 6					
<b>Power System (Read/Write Setting)</b>						
4600	Nominal Frequency	25 to 60	Hz	1	F001	60
4601	Phase Rotation	0 to 1	---	1	F106	0 (ABC)
4602	Frequency And Phase Reference	0 to 5	---	1	F167	0 (SRC 1)
4603	Frequency Tracking	0 to 1	---	1	F102	1 (Enabled)
<b>Synchrocheck (Read/Write Setting) (2 modules)</b>						
4780	Synchrocheck Function	0 to 1	---	1	F102	0 (Disabled)
4781	Synchrocheck V1 Source	0 to 5	---	1	F167	0 (SRC 1)
4782	Synchrocheck V2 Source	0 to 5	---	1	F167	1 (SRC 2)
4783	Synchrocheck Max Volt Diff	0 to 100000	V	1	F060	10000
4785	Synchrocheck Max Angle Diff	0 to 100	°	1	F001	30
4786	Synchrocheck Max Freq Diff	0 to 2	Hz	0.01	F001	100
4787	Synchrocheck Dead Source Select	0 to 5	---	1	F176	1 (LV1 and DV2)
4788	Synchrocheck Dead V1 Max Volt	0 to 1.25	pu	0.01	F001	30
4789	Synchrocheck Dead V2 Max Volt	0 to 1.25	pu	0.01	F001	30
478A	Synchrocheck Live V1 Min Volt	0 to 1.25	pu	0.01	F001	70
478B	Synchrocheck Live V2 Min Volt	0 to 1.25	pu	0.01	F001	70
478C	Synchrocheck Target	0 to 2	---	1	F109	0 (Self-reset)
478D	Synchrocheck Events	0 to 1	---	1	F102	0 (Disabled)
478E	Synchrocheck Block	0 to 65535	---	1	F300	0
478F	Synchrocheck X Reserved	0 to 65535	---	1	F001	0
4790	...Repeated for module number 2					
<b>Flexcurve A (Read/Write Setting)</b>						
4800	FlexCurve A (120 items)	0 to 65535	ms	1	F011	0
<b>Flexcurve B (Read/Write Setting)</b>						
48F0	FlexCurve B (120 items)	0 to 65535	ms	1	F011	0
<b>Modbus User Map (Read/Write Setting)</b>						
4A00	Modbus Address Settings for User Map (256 items)	0 to 65535	---	1	F001	0
<b>User Displays Settings (Read/Write Setting) (8 modules)</b>						
4C00	User display top line text	---	---	---	F202	" "
4C0A	User display bottom line text	---	---	---	F202	" "
4C14	Modbus addresses of displayed items (5 items)	0 to 65535	---	1	F001	0
4C19	Reserved (7 items)	---	---	---	F001	0
4C20	...Repeated for module number 2					
4C40	...Repeated for module number 3					
4C60	...Repeated for module number 4					
4C80	...Repeated for module number 5					
4CA0	...Repeated for module number 6					
4CC0	...Repeated for module number 7					
4CE0	...Repeated for module number 8					
<b>FlexLogic™ (Read/Write Setting)</b>						
5000	FlexLogic Entry (512 items)	0 to 65535	---	1	F300	16384
<b>FlexLogic™ Timers (Read/Write Setting) (32 modules)</b>						
5800	Timer x Type	0 to 2	---	1	F129	0 (millisecond)
5801	Timer x Pickup Delay	0 to 60000	---	1	F001	0
5802	Timer x Dropout Delay	0 to 60000	---	1	F001	0
5803	Timer x Reserved (5 items)	0 to 65535	---	1	F001	0
5808	...Repeated for module number 2					
5810	...Repeated for module number 3					

Table B-9: MODBUS MEMORY MAP (Sheet 12 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
5818	...Repeated for module number 4					
5820	...Repeated for module number 5					
5828	...Repeated for module number 6					
5830	...Repeated for module number 7					
5838	...Repeated for module number 8					
5840	...Repeated for module number 9					
5848	...Repeated for module number 10					
5850	...Repeated for module number 11					
5858	...Repeated for module number 12					
5860	...Repeated for module number 13					
5868	...Repeated for module number 14					
5870	...Repeated for module number 15					
5878	...Repeated for module number 16					
5880	...Repeated for module number 17					
5888	...Repeated for module number 18					
5890	...Repeated for module number 19					
5898	...Repeated for module number 20					
58A0	...Repeated for module number 21					
58A8	...Repeated for module number 22					
58B0	...Repeated for module number 23					
58B8	...Repeated for module number 24					
58C0	...Repeated for module number 25					
58C8	...Repeated for module number 26					
58D0	...Repeated for module number 27					
58D8	...Repeated for module number 28					
58E0	...Repeated for module number 29					
58E8	...Repeated for module number 30					
58F0	...Repeated for module number 31					
58F8	...Repeated for module number 32					
<b>Phase TOC (Read/Write Grouped Setting) (6 modules)</b>						
5900	Phase TOC Function	0 to 1	---	1	F102	0 (Disabled)
5901	Phase TOC Signal Source	0 to 5	---	1	F167	0 (SRC 1)
5902	Phase TOC Input	0 to 1	---	1	F122	0 (Phasor)
5903	Phase TOC Pickup	0 to 30	pu	0.001	F001	1000
5904	Phase TOC Curve	0 to 14	---	1	F103	0 (IEEE Mod Inv)
5905	Phase TOC Multiplier	0 to 600	---	0.01	F001	100
5906	Phase TOC Reset	0 to 1	---	1	F104	0 (Instantaneous)
5907	Phase TOC Voltage Restraint	0 to 1	---	1	F102	0 (Disabled)
5908	Phase TOC Block For Each Phase (3 items)	0 to 65535	---	1	F300	0
590B	Phase TOC Target	0 to 2	---	1	F109	0 (Self-reset)
590C	Phase TOC Events	0 to 1	---	1	F102	0 (Disabled)
590D	Reserved (3 items)	0 to 1	---	1	F001	0
5910	...Repeated for module number 2					
5920	...Repeated for module number 3					
5930	...Repeated for module number 4					
5940	...Repeated for module number 5					
5950	...Repeated for module number 6					
<b>Phase IOC (Read/Write Grouped Setting) (12 modules)</b>						
5A00	Phase IOC1 Function	0 to 1	---	1	F102	0 (Disabled)
5A01	Phase IOC1 Signal Source	0 to 5	---	1	F167	0 (SRC 1)
5A02	Phase IOC1 Pickup	0 to 30	pu	0.001	F001	1000
5A03	Phase IOC1 Delay	0 to 600	s	0.01	F001	0
5A04	Phase IOC1 Reset Delay	0 to 600	s	0.01	F001	0
5A05	Phase IOC1 Block For Each Phase (3 items)	0 to 65535	---	1	F300	0

Table B-9: MODBUS MEMORY MAP (Sheet 13 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
5A08	Phase IOC1 Target	0 to 2	---	1	F109	0 (Self-reset)
5A09	Phase IOC1 Events	0 to 1	---	1	F102	0 (Disabled)
5A0A	Reserved (6 items)	0 to 1	---	1	F001	0
5A10	...Repeated for module number 2					
5A20	...Repeated for module number 3					
5A30	...Repeated for module number 4					
5A40	...Repeated for module number 5					
5A50	...Repeated for module number 6					
5A60	...Repeated for module number 7					
5A70	...Repeated for module number 8					
5A80	...Repeated for module number 9					
5A90	...Repeated for module number 10					
5AA0	...Repeated for module number 11					
5AB0	...Repeated for module number 12					
<b>Neutral TOC (Read/Write Grouped Setting) (6 modules)</b>						
5B00	Neutral TOC1 Function	0 to 1	---	1	F102	0 (Disabled)
5B01	Neutral TOC1 Signal Source	0 to 5	---	1	F167	0 (SRC 1)
5B02	Neutral TOC1 Input	0 to 1	---	1	F122	0 (Phasor)
5B03	Neutral TOC1 Pickup	0 to 30	pu	0.001	F001	1000
5B04	Neutral TOC1 Curve	0 to 14	---	1	F103	0 (IEEE Mod Inv)
5B05	Neutral TOC1 Multiplier	0 to 600	---	0.01	F001	100
5B06	Neutral TOC1 Reset	0 to 1	---	1	F104	0 (Instantaneous)
5B07	Neutral TOC1 Block	0 to 65535	---	1	F300	0
5B08	Neutral TOC1 Target	0 to 2	---	1	F109	0 (Self-reset)
5B09	Neutral TOC1 Events	0 to 1	---	1	F102	0 (Disabled)
5B0A	Reserved (6 items)	0 to 1	---	1	F001	0
5B10	...Repeated for module number 2					
5B20	...Repeated for module number 3					
5B30	...Repeated for module number 4					
5B40	...Repeated for module number 5					
5B50	...Repeated for module number 6					
<b>Neutral IOC (Read/Write Grouped Setting) (12 modules)</b>						
5C00	Neutral IOC1 Function	0 to 1	---	1	F102	0 (Disabled)
5C01	Neutral IOC1 Signal Source	0 to 5	---	1	F167	0 (SRC 1)
5C02	Neutral IOC1 Pickup	0 to 30	pu	0.001	F001	1000
5C03	Neutral IOC1 Delay	0 to 600	s	0.01	F001	0
5C04	Neutral IOC1 Reset Delay	0 to 600	s	0.01	F001	0
5C05	Neutral IOC1 Block	0 to 65535	---	1	F300	0
5C06	Neutral IOC1 Target	0 to 2	---	1	F109	0 (Self-reset)
5C07	Neutral IOC1 Events	0 to 1	---	1	F102	0 (Disabled)
5C08	Reserved (8 items)	0 to 1	---	1	F001	0
5C10	...Repeated for module number 2					
5C20	...Repeated for module number 3					
5C30	...Repeated for module number 4					
5C40	...Repeated for module number 5					
5C50	...Repeated for module number 6					
5C60	...Repeated for module number 7					
5C70	...Repeated for module number 8					
5C80	...Repeated for module number 9					
5C90	...Repeated for module number 10					
5CA0	...Repeated for module number 11					
5CB0	...Repeated for module number 12					
<b>Ground TOC (Read/Write Grouped Setting) (6 modules)</b>						
5D00	Ground TOC1 Function	0 to 1	---	1	F102	0 (Disabled)

Table B-9: MODBUS MEMORY MAP (Sheet 14 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
5D01	Ground TOC1 Signal Source	0 to 5	---	1	F167	0 (SRC 1)
5D02	Ground TOC1 Input	0 to 1	---	1	F122	0 (Phasor)
5D03	Ground TOC1 Pickup	0 to 30	pu	0.001	F001	1000
5D04	Ground TOC1 Curve	0 to 14	---	1	F103	0 (IEEE Mod Inv)
5D05	Ground TOC1 Multiplier	0 to 600	---	0.01	F001	100
5D06	Ground TOC1 Reset	0 to 1	---	1	F104	0 (Instantaneous)
5D07	Ground TOC1 Block	0 to 65535	---	1	F300	0
5D08	Ground TOC1 Target	0 to 2	---	1	F109	0 (Self-reset)
5D09	Ground TOC1 Events	0 to 1	---	1	F102	0 (Disabled)
5D0A	Reserved (6 items)	0 to 1	---	1	F001	0
5D10	...Repeated for module number 2					
5D20	...Repeated for module number 3					
5D30	...Repeated for module number 4					
5D40	...Repeated for module number 5					
5D50	...Repeated for module number 6					
<b>Ground IOC (Read/Write Grouped Setting) (12 modules)</b>						
5E00	Ground IOC1 Signal Source	0 to 5	---	1	F167	0 (SRC 1)
5E01	Ground IOC1 Function	0 to 1	---	1	F102	0 (Disabled)
5E02	Ground IOC1 Pickup	0 to 30	pu	0.001	F001	1000
5E03	Ground IOC1 Delay	0 to 600	s	0.01	F001	0
5E04	Ground IOC1 Reset Delay	0 to 600	s	0.01	F001	0
5E05	Ground IOC1 Block	0 to 65535	---	1	F300	0
5E06	Ground IOC1 Target	0 to 2	---	1	F109	0 (Self-reset)
5E07	Ground IOC1 Events	0 to 1	---	1	F102	0 (Disabled)
5E08	Reserved (8 items)	0 to 1	---	1	F001	0
5E10	...Repeated for module number 2					
5E20	...Repeated for module number 3					
5E30	...Repeated for module number 4					
5E40	...Repeated for module number 5					
5E50	...Repeated for module number 6					
5E60	...Repeated for module number 7					
5E70	...Repeated for module number 8					
5E80	...Repeated for module number 9					
5E90	...Repeated for module number 10					
5EA0	...Repeated for module number 11					
5EB0	...Repeated for module number 12					
<b>Disturbance Detector (Read/Write Grouped Setting)</b>						
5F20	DD Function	0 to 1	---	1	F102	0 (Disabled)
5F21	DD Non Cur Supervision	0 to 65535	---	1	F300	0
5F22	DD Control Logic	0 to 65535	---	1	F300	0
5F23	DD Logic Seal In	0 to 65535	---	1	F300	0
5F24	DD Events	0 to 1	---	1	F102	0 (Disabled)
<b>Negative Sequence TOC (Read/Write Grouped Setting) (2 modules)</b>						
6300	Negative Sequence TOC1 Function	0 to 1	---	1	F102	0 (Disabled)
6301	Negative Sequence TOC1 Signal Source	0 to 5	---	1	F167	0 (SRC 1)
6302	Negative Sequence TOC1 Pickup	0 to 30	pu	0.001	F001	1000
6303	Negative Sequence TOC1 Curve	0 to 14	---	1	F103	0 (IEEE Mod Inv)
6304	Negative Sequence TOC1 Multiplier	0 to 600	---	0.01	F001	100
6305	Negative Sequence TOC1 Reset	0 to 1	---	1	F104	0 (Instantaneous)
6306	Negative Sequence TOC1 Block	0 to 65535	---	1	F300	0
6307	Negative Sequence TOC1 Target	0 to 2	---	1	F109	0 (Self-reset)
6308	Negative Sequence TOC1 Events	0 to 1	---	1	F102	0 (Disabled)
6309	Reserved (7 items)	0 to 1	---	1	F001	0
6310	...Repeated for module number 2					

Table B-9: MODBUS MEMORY MAP (Sheet 15 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
<b>Stator Differential (Read/Write Grouped Setting)</b>						
6470	Stator Differential Function	0 to 1	---	1	F102	0 (Disabled)
6471	Stator Differential Pickup	0.05 to 1	pu	0.001	F001	100
6472	Stator Differential Slope 1	1 to 100	%	1	F001	10
6473	Stator Differential Slope 2	1 to 100	%	1	F001	80
6474	Stator Differential Break 1	1 to 1.5	pu	0.01	F001	115
6475	Stator Differential Break 2	1.5 to 30	pu	0.01	F001	800
6476	Stator Differential Block	0 to 65535	---	1	F300	0
6477	Stator Differential Targets	0 to 2	---	1	F109	0 (Self-reset)
6478	Stator Differential Events	0 to 1	---	1	F102	0 (Disabled)
6479	Stator Differential Line End Source	0 to 5	---	1	F167	0 (SRC 1)
647A	Stator Differential Neutral End Source	0 to 5	---	1	F167	0 (SRC 1)
<b>Negative Sequence Overvoltage (Read/Write Grouped Setting)</b>						
64A0	Negative Sequence Overvoltage Function	0 to 1	---	1	F102	0 (Disabled)
64A1	Negative Sequence Overvoltage Source	0 to 5	---	1	F167	0 (SRC 1)
64A2	Negative Sequence Overvoltage Pickup	0 to 1.25	pu	0.001	F001	300
64A3	Negative Sequence Overvoltage Pickup Delay	0 to 600	s	0.01	F001	50
64A4	Negative Sequence Overvoltage Reset Delay	0 to 600	s	0.01	F001	50
64A5	Negative Sequence Overvoltage Block	0 to 65535	---	1	F300	0
64A6	Negative Sequence Overvoltage Target	0 to 2	---	1	F109	0 (Self-reset)
64A7	Negative Sequence Overvoltage Events	0 to 1	---	1	F102	0 (Disabled)
<b>Overfrequency (Read/Write Setting) (4 modules)</b>						
64D0	Overfrequency Function	0 to 1	---	1	F102	0 (Disabled)
64D1	Overfrequency Block	0 to 65535	---	1	F300	0
64D2	Overfrequency Source	0 to 5	---	1	F167	0 (SRC 1)
64D3	Overfrequency Pickup	20 to 65	Hz	0.01	F001	6050
64D4	Overfrequency Pickup Delay	0 to 65.535	s	0.001	F001	500
64D5	Overfrequency Reset Delay	0 to 65.535	s	0.001	F001	500
64D6	Overfrequency Target	0 to 2	---	1	F109	0 (Self-reset)
64D7	Overfrequency Events	0 to 1	---	1	F102	0 (Disabled)
64D8	Reserved (4 items)	0 to 1	---	1	F001	0
64DC	...Repeated for module number 2					
64E8	...Repeated for module number 3					
64F4	...Repeated for module number 4					
<b>Power Swing Detect (Read/Write Grouped Setting)</b>						
65C0	Power Swing Function	0 to 1	---	1	F102	0 (Disabled)
65C1	Power Swing Source	0 to 5	---	1	F167	0 (SRC 1)
65C2	Power Swing Mode	0 to 1	---	1	F513	0 (Two Step)
65C3	Power Swing Supv	0.05 to 30	pu	0.001	F001	600
65C4	Power Swing Fwd Reach	0.1 to 500	ohms	0.01	F001	5000
65C5	Power Swing Fwd Rca	40 to 90	°	1	F001	75
65C6	Power Swing Rev Reach	0.1 to 500	ohms	0.01	F001	5000
65C7	Power Swing Rev Rca	40 to 90	°	1	F001	75
65C8	Outer Limit Angle	40 to 140	°	1	F001	120
65C9	Middle Limit Angle	40 to 140	°	1	F001	90
65CA	Inner Limit Angle	40 to 140	°	1	F001	60
65CB	Delay 1 Pickup	0 to 65.535	s	0.001	F001	30
65CC	Delay 1 Reset	0 to 65.535	s	0.001	F001	50
65CD	Delay 2 Pickup	0 to 65.535	s	0.001	F001	17
65CE	Delay 3 Pickup	0 to 65.535	s	0.001	F001	9
65CF	Delay 4 Pickup	0 to 65.535	s	0.001	F001	17
65D0	Seal In Delay	0 to 65.535	s	0.001	F001	400
65D1	Trip Mode	0 to 1	---	1	F514	0 (Delayed)
65D2	Power Swing Block	0 to 65535	---	1	F300	0

Table B-9: MODBUS MEMORY MAP (Sheet 16 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
65D3	Power Swing Target	0 to 2	---	1	F109	0 (Self-reset)
65D4	Power Swing Event	0 to 1	---	1	F102	0 (Disabled)
<b>Accidental Energization (Read/Write Grouped Setting)</b>						
6660	Accidental Energization Function	0 to 1	---	1	F102	0 (Disabled)
6661	Accidental Energization Source	0 to 5	---	1	F167	0 (SRC 1)
6662	Accidental Energization Arming Mode	0 to 1	---	1	F193	0 (UV and OFFLINE)
6663	Accidental Energization OC Pickup	0 to 3	---	0.001	F003	300
6665	Accidental Energization UV Pickup	0 to 3	---	0.001	F003	500
6667	Accidental Energization Offline	0 to 65535	---	1	F300	0
6668	Accidental Energization Block	0 to 65535	---	1	F300	0
6669	Accidental Energization Target	0 to 2	---	1	F109	0 (Self-reset)
666A	Accidental Energization Events	0 to 1	---	1	F102	0 (Disabled)
666B	Accidental Energization Reserved (5 items)	0 to 65535	---	1	F001	0
<b>Loss of Excitation (Read/Write Grouped Setting)</b>						
6680	Loss Of Excitation Function	0 to 1	---	1	F102	0 (Disabled)
6681	Loss Of Excitation Signal Source	0 to 5	---	1	F167	0 (SRC 1)
6682	Loss Of Excitation Center 1	0 to 350	ohm	0.01	F001	1000
6683	Loss Of Excitation Radius 1	0 to 300	ohm	0.01	F001	800
6684	Loss Of Excitation UV Supervision Enable 1	0 to 1	---	1	F102	1 (Enabled)
6685	Loss Of Excitation Pickup Delay 1	0 to 65.535	s	0.001	F001	50
6686	Loss Of Excitation Center 2	0 to 350	ohm	0.01	F001	1200
6687	Loss Of Excitation Radius 2	0 to 300	ohm	0.01	F001	1000
6688	Loss Of Excitation UV Supervision Enable 2	0 to 1	---	1	F102	1 (Enabled)
6689	Loss Of Excitation Pickup Delay 2	0 to 65.535	s	0.001	F001	500
668A	Loss Of Excitation UV Supervision	0 to 1.25	pu	0.001	F001	700
668B	Loss Of Excitation Block	0 to 65535	---	1	F300	0
668C	Loss Of Excitation Target	0 to 2	---	1	F109	0 (Self-reset)
668D	Loss Of Excitation Events	0 to 1	---	1	F102	0 (Disabled)
668E	Loss Of Excitation Reserved (5 items)	0 to 65535	---	1	F001	0
<b>Sensitive Directional Power (Read/Write Grouped Setting) (2 modules)</b>						
66A0	Sensitive Directional Power Function	0 to 1	---	1	F102	0 (Disabled)
66A1	Sensitive Directional Power Signal Source	0 to 5	---	1	F167	0 (SRC 1)
66A2	Sensitive Directional Power RCA	0 to 359	°	1	F001	0
66A3	Sensitive Directional Power Calibration	0 to 0.95	°	0.05	F001	0
66A4	Sensitive Directional Power STG1 SMIN	-1.2 to 1.2	pu	0.001	F002	100
66A5	Sensitive Directional Power STG1 Delay	0 to 600	s	0.01	F001	50
66A6	Sensitive Directional Power STG2 SMIN	-1.2 to 1.2	pu	0.001	F002	100
66A7	Sensitive Directional Power STG2 Delay	0 to 600	s	0.01	F001	2000
66A8	Sensitive Directional Power Block	---	---	---	F001	0
66A9	Sensitive Directional Power Target	0 to 2	---	1	F109	0 (Self-reset)
66AA	Sensitive Directional Power Events	0 to 1	---	1	F102	0 (Disabled)
66AB	Sensitive Directional Power X Reserved (5 items)	0 to 65535	---	1	F001	0
66B0	...Repeated for module number 2					
<b>Third Harmonic Neutral Undervoltage (Read/Write Grouped Setting)</b>						
6730	Third Harmonic Neutral Undervoltage Function	0 to 1	---	1	F102	0 (Disabled)
6731	Third Harmonic Neutral Undervoltage Pickup	0 to 30	pu	0.001	F003	300
6733	Third Harmonic Neutral Undervoltage Delay	0 to 600	s	0.01	F001	0
6734	Third Harmonic Neutral Undervoltage Max Power	0 to 30	pu	0.001	F003	200
6736	Third Harmonic Neutral Undervoltage Min Power	0 to 30	pu	0.001	F003	200
6738	Third Harmonic Neutral Undervoltage Volt Supervision	0 to 1.25	pu	0.001	F001	500
6739	Third Harmonic Neutral Undervoltage Block	0 to 65535	---	1	F300	0
673A	Third Harmonic Neutral Undervoltage Target	0 to 2	---	1	F109	0 (Self-reset)
673B	Third Harmonic Neutral Undervoltage Events	0 to 1	---	1	F102	0 (Disabled)
673C	Reserved (4 items)	0 to 65535	---	1	F001	0

Table B-9: MODBUS MEMORY MAP (Sheet 17 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
<b>Generator Unbalance (Read/Write Grouped Setting)</b>						
6740	Generator Unbalance Function	0 to 1	---	1	F102	0 (Disabled)
6741	Generator Unbalance Source	0 to 5	---	1	F167	0 (SRC 1)
6742	Generator Unbalance Source	0 to 1.25	pu	0.001	F001	800
6743	Generator Unbalance Stage 1 Pickup	0 to 100	%	0.01	F001	800
6744	Generator Unbalance Stage 1 K value	0 to 100	---	0.01	F001	100
6745	Generator Unbalance Stage 1 Tmin	0 to 50	s	0.001	F001	250
6746	Generator Unbalance Stage 1 Tmax	0 to 1000	s	0.1	F001	6000
6747	Generator Unbalance Stage 1 K Reset	0 to 1000	s	0.1	F001	2400
6748	Generator Unbalance Stage 2 Pickup	0 to 100	%	0.01	F001	300
6749	Generator Unbalance Stage 2 Pickup Delay	0 to 1000	s	0.1	F001	50
674A	Generator Unbalance Block	0 to 65535	---	1	F300	0
674B	Generator Unbalance Target	0 to 2	---	1	F109	0 (Self-reset)
674C	Generator Unbalance Events	0 to 1	---	1	F102	0 (Disabled)
674D	Gen Unbal Reserved (3 items)	0 to 65535	---	1	F001	0
<b>Stator Ground Source (Read/Write Grouped Setting)</b>						
6750	Stator Ground Source	0 to 5	---	1	F167	0 (SRC 1)
<b>Stator Ground (Read/Write Grouped Setting)</b>						
6780	Stator Ground Function	0 to 1	---	1	F102	0 (Disabled)
6781	Stator Ground Stg1 Pkp	0 to 0.25	pu	0.001	F001	150
6782	Stator Ground Stg1 Pkp Delay	0 to 600	s	0.01	F001	100
6783	Stator Ground Stage 1 Supv	0.001 to 0.1	pu	0.0001	F001	75
6784	Stator Ground Stage 2 Pkp	0 to 0.25	pu	0.001	F001	150
6785	Stator Ground Stg2 Pkp Delay	0 to 600	s	0.01	F001	0
6786	Stator Ground Stage 2 Supv	0.001 to 0.1	pu	0.0001	F001	75
6787	Stator Ground Block	---	---	---	F001	0
6788	Stator Ground Target	0 to 2	---	1	F109	0 (Self-reset)
6789	Stator Ground Event	0 to 1	---	1	F102	0 (Disabled)
678A	Reserved (5 items)	0 to 65535	---	1	F001	0
<b>Phase Undervoltage (Read/Write Grouped Setting) (2 modules)</b>						
7000	Phase UV1 Function	0 to 1	---	1	F102	0 (Disabled)
7001	Phase UV1 Signal Source	0 to 5	---	1	F167	0 (SRC 1)
7002	Phase UV1 Pickup	0 to 3	pu	0.001	F001	1000
7003	Phase UV1 Curve	0 to 1	---	1	F111	0 (Definite Time)
7004	Phase UV1 Delay	0 to 600	s	0.01	F001	100
7005	Phase UV1 Minimum Voltage	0 to 3	pu	0.001	F001	100
7006	Phase UV1 Block	0 to 65535	---	1	F300	0
7007	Phase UV1 Target	0 to 2	---	1	F109	0 (Self-reset)
7008	Phase UV1 Events	0 to 1	---	1	F102	0 (Disabled)
7009	Phase UV Measurement Mode	0 to 1	---	1	F186	0 (Phase to Ground)
700A	Reserved (6 items)	0 to 1	---	1	F001	0
7010	...Repeated for module number 2					
<b>Phase Overvoltage (Read/Write Grouped Setting)</b>						
7100	Phase OV1 Function	0 to 1	---	1	F102	0 (Disabled)
7101	Phase OV1 Source	0 to 5	---	1	F167	0 (SRC 1)
7102	Phase OV1 Pickup	0 to 3	pu	0.001	F001	1000
7103	Phase OV1 Delay	0 to 600	s	0.01	F001	100
7104	Phase OV1 Reset Delay	0 to 600	s	0.01	F001	100
7105	Phase OV1 Block	0 to 65535	---	1	F300	0
7106	Phase OV1 Target	0 to 2	---	1	F109	0 (Self-reset)
7107	Phase OV1 Events	0 to 1	---	1	F102	0 (Disabled)
7108	Reserved (8 items)	0 to 1	---	1	F001	0
<b>Phase Directional (Read/Write Grouped Setting) (2 modules)</b>						
7260	Phase DIR 1 Function	0 to 1	---	1	F102	0 (Disabled)

Table B-9: MODBUS MEMORY MAP (Sheet 18 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
7261	Phase DIR 1 Source	0 to 5	---	1	F167	0 (SRC 1)
7262	Phase DIR 1 Block	0 to 65535	---	1	F300	0
7263	Phase DIR 1 ECA	0 to 359	---	1	F001	30
7264	Phase DIR 1 Pol V Threshold	0 to 3	pu	0.001	F001	50
7265	Phase DIR 1 Block OC	0 to 1	---	1	F126	0 (No)
7266	Phase DIR 1 Target	0 to 2	---	1	F109	0 (Self-reset)
7267	Phase DIR 1 Events	0 to 1	---	1	F102	0 (Disabled)
7268	Reserved (8 items)	0 to 1	---	1	F001	0
7270	...Repeated for module number 2					
<b>Neutral Directional OC (Read/Write Grouped Setting) (2 modules)</b>						
7280	Neutral DIR OC1 Function	0 to 1	---	1	F102	0 (Disabled)
7281	Neutral DIR OC1 Source	0 to 5	---	1	F167	0 (SRC 1)
7282	Neutral DIR OC1 Polarizing	0 to 2	---	1	F230	0 (Voltage)
7283	Neutral DIR OC1 Forward ECA	-90 to 90	° Lag	1	F002	75
7284	Neutral DIR OC1 Forward Limit Angle	40 to 90	°	1	F001	90
7285	Neutral DIR OC1 Forward Pickup	0.002 to 30	pu	0.001	F001	50
7286	Neutral DIR OC1 Reverse Limit Angle	40 to 90	°	1	F001	90
7287	Neutral DIR OC1 Reverse Pickup	0.002 to 30	pu	0.001	F001	50
7288	Neutral DIR OC1 Target	0 to 2	---	1	F109	0 (Self-reset)
7289	Neutral DIR OC1 Block	0 to 65535	---	1	F300	0
728A	Neutral DIR OC1 Events	0 to 1	---	1	F102	0 (Disabled)
728B	Neutral DIR OC X Polarizing Voltage	0 to 1	---	1	F231	0 (Calculated V0)
728C	Neutral DIR OC X Op Current	0 to 1	---	1	F196	0 (Calculated 3I0)
728D	Neutral DIR OC X Offset	0 to 250	p	0.01	F001	0
728E	Reserved (2 items)	0 to 1	---	1	F001	0
7290	...Repeated for module number 2					
<b>DCMA Inputs (Read/Write Setting) (24 modules)</b>						
7300	DCMA Inputs x Function	0 to 1	---	1	F102	0 (Disabled)
7301	DCMA Inputs x ID	---	---	---	F205	"DCMA Ip 1 "
7307	DCMA Inputs x Reserved 1 (4 items)	0 to 65535	---	1	F001	0
730B	DCMA Inputs x Units	---	---	---	F206	"mA"
730E	DCMA Inputs x Range	0 to 6	---	1	F173	6 (4 to 20 mA)
730F	DCMA Inputs x Minimum Value	-9999.999 to 9999.999	---	0.001	F004	4000
7311	DCMA Inputs x Maximum Value	-9999.999 to 9999.999	---	0.001	F004	20000
7313	DCMA Inputs x Reserved (5 items)	0 to 65535	---	1	F001	0
7318	...Repeated for module number 2					
7330	...Repeated for module number 3					
7348	...Repeated for module number 4					
7360	...Repeated for module number 5					
7378	...Repeated for module number 6					
7390	...Repeated for module number 7					
73A8	...Repeated for module number 8					
73C0	...Repeated for module number 9					
73D8	...Repeated for module number 10					
73F0	...Repeated for module number 11					
7408	...Repeated for module number 12					
7420	...Repeated for module number 13					
7438	...Repeated for module number 14					
7450	...Repeated for module number 15					
7468	...Repeated for module number 16					
7480	...Repeated for module number 17					
7498	...Repeated for module number 18					
74B0	...Repeated for module number 19					
74C8	...Repeated for module number 20					



Table B-9: MODBUS MEMORY MAP (Sheet 19 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
74E0	...Repeated for module number 21					
74F8	...Repeated for module number 22					
7510	...Repeated for module number 23					
7528	...Repeated for module number 24					
<b>RTD Inputs (Read/Write Setting) (48 modules)</b>						
7540	RTD Inputs x Function	0 to 1	---	1	F102	0 (Disabled)
7541	RTD Inputs x ID	---	---	---	F205	"RTD Ip 1 "
7547	RTD Inputs x Reserved 1 (4 items)	0 to 65535	---	1	F001	0
754B	RTD Inputs x Type	0 to 3	---	1	F174	0 (100 $\Omega$ Platinum)
754C	RTD Inputs x Reserved 2 (4 items)	0 to 65535	---	1	F001	0
7550	...Repeated for module number 2					
7560	...Repeated for module number 3					
7570	...Repeated for module number 4					
7580	...Repeated for module number 5					
7590	...Repeated for module number 6					
75A0	...Repeated for module number 7					
75B0	...Repeated for module number 8					
75C0	...Repeated for module number 9					
75D0	...Repeated for module number 10					
75E0	...Repeated for module number 11					
75F0	...Repeated for module number 12					
7600	...Repeated for module number 13					
7610	...Repeated for module number 14					
7620	...Repeated for module number 15					
7630	...Repeated for module number 16					
7640	...Repeated for module number 17					
7650	...Repeated for module number 18					
7660	...Repeated for module number 19					
7670	...Repeated for module number 20					
7680	...Repeated for module number 21					
7690	...Repeated for module number 22					
76A0	...Repeated for module number 23					
76B0	...Repeated for module number 24					
76C0	...Repeated for module number 25					
76D0	...Repeated for module number 26					
76E0	...Repeated for module number 27					
76F0	...Repeated for module number 28					
7700	...Repeated for module number 29					
7710	...Repeated for module number 30					
7720	...Repeated for module number 31					
7730	...Repeated for module number 32					
7740	...Repeated for module number 33					
7750	...Repeated for module number 34					
7760	...Repeated for module number 35					
7770	...Repeated for module number 36					
7780	...Repeated for module number 37					
7790	...Repeated for module number 38					
77A0	...Repeated for module number 39					
77B0	...Repeated for module number 40					
77C0	...Repeated for module number 41					
77D0	...Repeated for module number 42					
77E0	...Repeated for module number 43					
77F0	...Repeated for module number 44					
7800	...Repeated for module number 45					

Table B–9: MODBUS MEMORY MAP (Sheet 20 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
7810	...Repeated for module number 46					
7820	...Repeated for module number 47					
7830	...Repeated for module number 48					
<b>Ohm Inputs (Read/Write Setting) (2 modules)</b>						
7840	Ohm Inputs x Function	0 to 1	---	1	F102	0 (Disabled)
7841	Ohm Inputs x ID	---	---	---	F205	"Ohm Ip 1 "
7847	Ohm Inputs x Reserved (9 items)	0 to 65535	---	1	F001	0
7850	...Repeated for module number 2					
<b>Underfrequency (Read/Write Setting) (6 modules)</b>						
7E00	Underfrequency Function	0 to 1	---	1	F102	0 (Disabled)
7E01	Underfrequency Block	0 to 65535	---	1	F300	0
7E02	Min Current	0.1 to 1.25	pu	0.01	F001	10
7E03	Underfrequency Pickup	20 to 65	Hz	0.01	F001	5950
7E04	Pickup Delay	0 to 65.535	s	0.001	F001	2000
7E05	Reset Delay	0 to 65.535	s	0.001	F001	2000
7E06	Underfrequency Source	0 to 5	---	1	F167	0 (SRC 1)
7E07	Underfrequency Events	0 to 1	---	1	F102	0 (Disabled)
7E08	Underfrequency Target	0 to 2	---	1	F109	0 (Self-reset)
7E09	Underfrequency X Reserved (8 items)	0 to 1	---	1	F001	0
7E11	...Repeated for module number 2					
7E22	...Repeated for module number 3					
7E33	...Repeated for module number 4					
7E44	...Repeated for module number 5					
7E55	...Repeated for module number 6					
<b>Frequency (Read Only)</b>						
8000	Tracking Frequency	2 to 90	Hz	0.01	F001	0
<b>FlexState Settings (Read/Write Setting)</b>						
8800	FlexState Parameters (256 items)	---	---	---	F300	0
<b>FlexElement (Read/Write Setting) (16 modules)</b>						
9000	FlexElement Function	0 to 1	---	1	F102	0 (Disabled)
9001	FlexElement Name	---	---	---	F206	"FxE \x040"
9004	FlexElement InputP	0 to 65535	---	1	F600	0
9005	FlexElement InputM	0 to 65535	---	1	F600	0
9006	FlexElement Compare	0 to 1	---	1	F516	0 (LEVEL)
9007	FlexElement Input	0 to 1	---	1	F515	0 (SIGNED)
9008	FlexElement Direction	0 to 1	---	1	F517	0 (OVER)
9009	FlexElement Hysteresis	0.1 to 50	%	0.1	F001	30
900A	FlexElement Pickup	-90 to 90	pu	0.001	F004	1000
900C	FlexElement DeltaT Units	0 to 2	---	1	F518	0 (Milliseconds)
900D	FlexElement DeltaT	20 to 86400	---	1	F003	20
900F	FlexElement Pkp Delay	0 to 65.535	s	0.001	F001	0
9010	FlexElement Rst Delay	0 to 65.535	s	0.001	F001	0
9011	FlexElement Block	0 to 65535	---	1	F300	0
9012	FlexElement Target	0 to 2	---	1	F109	0 (Self-reset)
9013	FlexElement Events	0 to 1	---	1	F102	0 (Disabled)
9014	...Repeated for module number 2					
9028	...Repeated for module number 3					
903C	...Repeated for module number 4					
9050	...Repeated for module number 5					
9064	...Repeated for module number 6					
9078	...Repeated for module number 7					
908C	...Repeated for module number 8					
90A0	...Repeated for module number 9					
90B4	...Repeated for module number 10					

Table B-9: MODBUS MEMORY MAP (Sheet 21 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
90C8	...Repeated for module number 11					
90DC	...Repeated for module number 12					
90F0	...Repeated for module number 13					
9104	...Repeated for module number 14					
9118	...Repeated for module number 15					
912C	...Repeated for module number 16					
<b>FlexElement Actuals (Read Only) (16 modules)</b>						
9A01	FlexElement Actual	-2147483.647 to 2147483.647	---	0.001	F004	0
9A03	...Repeated for module number 2					
9A05	...Repeated for module number 3					
9A07	...Repeated for module number 4					
9A09	...Repeated for module number 5					
9A0B	...Repeated for module number 6					
9A0D	...Repeated for module number 7					
9A0F	...Repeated for module number 8					
9A11	...Repeated for module number 9					
9A13	...Repeated for module number 10					
9A15	...Repeated for module number 11					
9A17	...Repeated for module number 12					
9A19	...Repeated for module number 13					
9A1B	...Repeated for module number 14					
9A1D	...Repeated for module number 15					
9A1F	...Repeated for module number 16					
<b>Setting Groups (Read/Write Setting)</b>						
A000	Setting Group for Modbus Comm (0 means group 1)	0 to 7	---	1	F001	0
A001	Setting Groups Block	0 to 65535	---	1	F300	0
A002	FlexLogic Operands to Activate Grps 2 to 8 (7 items)	0 to 65535	---	1	F300	0
A009	Setting Group Function	0 to 1	---	1	F102	0 (Disabled)
A00A	Setting Group Events	0 to 1	---	1	F102	0 (Disabled)
<b>Setting Groups (Read Only)</b>						
A00B	Current Setting Group	0 to 7	---	1	F001	0
<b>VT Fuse Failure (Read/Write Setting) (6 modules)</b>						
A040	VT Fuse Failure Function	0 to 1	---	1	F102	0 (Disabled)
A041	...Repeated for module number 2					
A042	...Repeated for module number 3					
A043	...Repeated for module number 4					
A044	...Repeated for module number 5					
A045	...Repeated for module number 6					
<b>Volts Per Hertz (Read/Write Grouped Setting) (2 modules)</b>						
AB00	V/Hz Function	0 to 1	---	1	F102	0 (Disabled)
AB01	V/Hz Source	0 to 5	---	1	F167	0 (SRC 1)
AB02	V/Hz Pickup	0.8 to 4	pu	0.01	F001	80
AB03	V/Hz Curves	0 to 5	---	1	F240	0 (Definite Time)
AB04	V/HZ TD Multiplier	0 to 600	---	0.01	F001	100
AB05	V/Hz Block	0 to 65535	---	1	F300	0
AB08	V/Hz Events	0 to 1	---	1	F102	0 (Disabled)
AB09	V/Hz Target	0 to 2	---	1	F109	0 (Self-reset)
AB0A	Volts Per Hertz T Reset	0 to 1000	---	0.1	F001	10
AB0B	...Repeated for module number 2					
<b>Volts Per Hertz Actuals (Read Only) (2 modules)</b>						
AB20	Volts Per Hertz	0 to 65.535	pu	0.001	F001	0
AB21	...Repeated for module number 2					

Table B-9: MODBUS MEMORY MAP (Sheet 22 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
<b>Digital Elements (Read/Write Setting) (16 modules)</b>						
B000	Digital Element x Function	0 to 1	---	1	F102	0 (Disabled)
B001	Digital Element x Name	---	---	---	F203	"Dig Element 1 "
B015	Digital Element x Input	0 to 65535	---	1	F300	0
B016	Digital Element x Pickup Delay	0 to 999999.999	s	0.001	F003	0
B018	Digital Element x Reset Delay	0 to 999999.999	s	0.001	F003	0
B01A	Digital Element x Block	0 to 65535	---	1	F300	0
B01B	Digital Element x Target	0 to 2	---	1	F109	0 (Self-reset)
B01C	Digital Element x Events	0 to 1	---	1	F102	0 (Disabled)
B01D	Digital Element x Reserved (3 items)	---	---	---	F001	0
B020	...Repeated for module number 2					
B040	...Repeated for module number 3					
B060	...Repeated for module number 4					
B080	...Repeated for module number 5					
B0A0	...Repeated for module number 6					
B0C0	...Repeated for module number 7					
B0E0	...Repeated for module number 8					
B100	...Repeated for module number 9					
B120	...Repeated for module number 10					
B140	...Repeated for module number 11					
B160	...Repeated for module number 12					
B180	...Repeated for module number 13					
B1A0	...Repeated for module number 14					
B1C0	...Repeated for module number 15					
B1E0	...Repeated for module number 16					
<b>Digital Counter (Read/Write Setting) (8 modules)</b>						
B300	Digital Counter x Function	0 to 1	---	1	F102	0 (Disabled)
B301	Digital Counter x Name	---	---	---	F205	"Counter 1 "
B307	Digital Counter x Units	---	---	---	F206	(none)
B30A	Digital Counter x Block	0 to 65535	---	1	F300	0
B30B	Digital Counter x Up	0 to 65535	---	1	F300	0
B30C	Digital Counter x Down	0 to 65535	---	1	F300	0
B30D	Digital Counter x Preset	-2147483647 to 2147483647	---	1	F004	0
B30F	Digital Counter x Compare	-2147483647 to 2147483647	---	1	F004	0
B311	Digital Counter x Reset	0 to 65535	---	1	F300	0
B312	Digital Counter x Freeze/Reset	0 to 65535	---	1	F300	0
B313	Digital Counter x Freeze/Count	0 to 65535	---	1	F300	0
B314	Digital Counter Set To Preset	0 to 65535	---	1	F300	0
B315	Digital Counter x Reserved (11 items)	---	---	---	F001	0
B320	...Repeated for module number 2					
B340	...Repeated for module number 3					
B360	...Repeated for module number 4					
B380	...Repeated for module number 5					
B3A0	...Repeated for module number 6					
B3C0	...Repeated for module number 7					
B3E0	...Repeated for module number 8					
<b>Contact Inputs (Read/Write Setting) (96 modules)</b>						
C000	Contact Input x Name	---	---	---	F205	"Cont Ip 1 "
C006	Contact Input x Events	0 to 1	---	1	F102	0 (Disabled)
C007	Contact Input x Debounce Time	0 to 16	ms	0.5	F001	20
C008	...Repeated for module number 2					
C010	...Repeated for module number 3					
C018	...Repeated for module number 4					

Table B-9: MODBUS MEMORY MAP (Sheet 23 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
C020	...Repeated for module number 5					
C028	...Repeated for module number 6					
C030	...Repeated for module number 7					
C038	...Repeated for module number 8					
C040	...Repeated for module number 9					
C048	...Repeated for module number 10					
C050	...Repeated for module number 11					
C058	...Repeated for module number 12					
C060	...Repeated for module number 13					
C068	...Repeated for module number 14					
C070	...Repeated for module number 15					
C078	...Repeated for module number 16					
C080	...Repeated for module number 17					
C088	...Repeated for module number 18					
C090	...Repeated for module number 19					
C098	...Repeated for module number 20					
C0A0	...Repeated for module number 21					
C0A8	...Repeated for module number 22					
C0B0	...Repeated for module number 23					
C0B8	...Repeated for module number 24					
C0C0	...Repeated for module number 25					
C0C8	...Repeated for module number 26					
C0D0	...Repeated for module number 27					
C0D8	...Repeated for module number 28					
C0E0	...Repeated for module number 29					
C0E8	...Repeated for module number 30					
C0F0	...Repeated for module number 31					
C0F8	...Repeated for module number 32					
C100	...Repeated for module number 33					
C108	...Repeated for module number 34					
C110	...Repeated for module number 35					
C118	...Repeated for module number 36					
C120	...Repeated for module number 37					
C128	...Repeated for module number 38					
C130	...Repeated for module number 39					
C138	...Repeated for module number 40					
C140	...Repeated for module number 41					
C148	...Repeated for module number 42					
C150	...Repeated for module number 43					
C158	...Repeated for module number 44					
C160	...Repeated for module number 45					
C168	...Repeated for module number 46					
C170	...Repeated for module number 47					
C178	...Repeated for module number 48					
C180	...Repeated for module number 49					
C188	...Repeated for module number 50					
C190	...Repeated for module number 51					
C198	...Repeated for module number 52					
C1A0	...Repeated for module number 53					
C1A8	...Repeated for module number 54					
C1B0	...Repeated for module number 55					
C1B8	...Repeated for module number 56					
C1C0	...Repeated for module number 57					
C1C8	...Repeated for module number 58					

Table B-9: MODBUS MEMORY MAP (Sheet 24 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
C1D0	...Repeated for module number 59					
C1D8	...Repeated for module number 60					
C1E0	...Repeated for module number 61					
C1E8	...Repeated for module number 62					
C1F0	...Repeated for module number 63					
C1F8	...Repeated for module number 64					
C200	...Repeated for module number 65					
C208	...Repeated for module number 66					
C210	...Repeated for module number 67					
C218	...Repeated for module number 68					
C220	...Repeated for module number 69					
C228	...Repeated for module number 70					
C230	...Repeated for module number 71					
C238	...Repeated for module number 72					
C240	...Repeated for module number 73					
C248	...Repeated for module number 74					
C250	...Repeated for module number 75					
C258	...Repeated for module number 76					
C260	...Repeated for module number 77					
C268	...Repeated for module number 78					
C270	...Repeated for module number 79					
C278	...Repeated for module number 80					
C280	...Repeated for module number 81					
C288	...Repeated for module number 82					
C290	...Repeated for module number 83					
C298	...Repeated for module number 84					
C2A0	...Repeated for module number 85					
C2A8	...Repeated for module number 86					
C2B0	...Repeated for module number 87					
C2B8	...Repeated for module number 88					
C2C0	...Repeated for module number 89					
C2C8	...Repeated for module number 90					
C2D0	...Repeated for module number 91					
C2D8	...Repeated for module number 92					
C2E0	...Repeated for module number 93					
C2E8	...Repeated for module number 94					
C2F0	...Repeated for module number 95					
C2F8	...Repeated for module number 96					
<b>Contact Input Thresholds (Read/Write Setting)</b>						
C600	Contact Input x Threshold (24 items)	0 to 3	---	1	F128	1 (33 Vdc)
<b>Virtual Inputs Global Settings (Read/Write Setting)</b>						
C680	Virtual Inputs SBO Timeout	1 to 60	s	1	F001	30
<b>Virtual Inputs (Read/Write Setting) (32 modules)</b>						
C690	Virtual Input x Function	0 to 1	---	1	F102	0 (Disabled)
C691	Virtual Input x Name	---	---	---	F205	"Virt Ip 1 "
C69B	Virtual Input x Programmed Type	0 to 1	---	1	F127	0 (Latched)
C69C	Virtual Input x Events	0 to 1	---	1	F102	0 (Disabled)
C69D	Virtual Input x UCA SBOClass	1 to 2	---	1	F001	1
C69E	Virtual Input x UCA SBOEna	0 to 1	---	1	F102	0 (Disabled)
C69F	Virtual Input x Reserved	---	---	---	F001	0
C6A0	...Repeated for module number 2					
C6B0	...Repeated for module number 3					
C6C0	...Repeated for module number 4					
C6D0	...Repeated for module number 5					

Table B-9: MODBUS MEMORY MAP (Sheet 25 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
C6E0	...Repeated for module number 6					
C6F0	...Repeated for module number 7					
C700	...Repeated for module number 8					
C710	...Repeated for module number 9					
C720	...Repeated for module number 10					
C730	...Repeated for module number 11					
C740	...Repeated for module number 12					
C750	...Repeated for module number 13					
C760	...Repeated for module number 14					
C770	...Repeated for module number 15					
C780	...Repeated for module number 16					
C790	...Repeated for module number 17					
C7A0	...Repeated for module number 18					
C7B0	...Repeated for module number 19					
C7C0	...Repeated for module number 20					
C7D0	...Repeated for module number 21					
C7E0	...Repeated for module number 22					
C7F0	...Repeated for module number 23					
C800	...Repeated for module number 24					
C810	...Repeated for module number 25					
C820	...Repeated for module number 26					
C830	...Repeated for module number 27					
C840	...Repeated for module number 28					
C850	...Repeated for module number 29					
C860	...Repeated for module number 30					
C870	...Repeated for module number 31					
C880	...Repeated for module number 32					
<b>Virtual Outputs (Read/Write Setting) (64 modules)</b>						
CC90	Virtual Output x Name	---	---	---	F205	"Virt Op 1 "
CC9A	Virtual Output x Events	0 to 1	---	1	F102	0 (Disabled)
CC9B	Virtual Output x Reserved (5 items)	---	---	---	F001	0
CCA0	...Repeated for module number 2					
CCB0	...Repeated for module number 3					
CCC0	...Repeated for module number 4					
CCD0	...Repeated for module number 5					
CCE0	...Repeated for module number 6					
CCF0	...Repeated for module number 7					
CD00	...Repeated for module number 8					
CD10	...Repeated for module number 9					
CD20	...Repeated for module number 10					
CD30	...Repeated for module number 11					
CD40	...Repeated for module number 12					
CD50	...Repeated for module number 13					
CD60	...Repeated for module number 14					
CD70	...Repeated for module number 15					
CD80	...Repeated for module number 16					
CD90	...Repeated for module number 17					
CDA0	...Repeated for module number 18					
CDB0	...Repeated for module number 19					
CDC0	...Repeated for module number 20					
CDD0	...Repeated for module number 21					
CDE0	...Repeated for module number 22					
CDF0	...Repeated for module number 23					
CE00	...Repeated for module number 24					

Table B-9: MODBUS MEMORY MAP (Sheet 26 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
CE10	...Repeated for module number 25					
CE20	...Repeated for module number 26					
CE30	...Repeated for module number 27					
CE40	...Repeated for module number 28					
CE50	...Repeated for module number 29					
CE60	...Repeated for module number 30					
CE70	...Repeated for module number 31					
CE80	...Repeated for module number 32					
CE90	...Repeated for module number 33					
CEA0	...Repeated for module number 34					
CEB0	...Repeated for module number 35					
CEC0	...Repeated for module number 36					
CED0	...Repeated for module number 37					
CEE0	...Repeated for module number 38					
CEF0	...Repeated for module number 39					
CF00	...Repeated for module number 40					
CF10	...Repeated for module number 41					
CF20	...Repeated for module number 42					
CF30	...Repeated for module number 43					
CF40	...Repeated for module number 44					
CF50	...Repeated for module number 45					
CF60	...Repeated for module number 46					
CF70	...Repeated for module number 47					
CF80	...Repeated for module number 48					
CF90	...Repeated for module number 49					
CFA0	...Repeated for module number 50					
CFB0	...Repeated for module number 51					
CFC0	...Repeated for module number 52					
CFD0	...Repeated for module number 53					
CFE0	...Repeated for module number 54					
CFF0	...Repeated for module number 55					
D000	...Repeated for module number 56					
D010	...Repeated for module number 57					
D020	...Repeated for module number 58					
D030	...Repeated for module number 59					
D040	...Repeated for module number 60					
D050	...Repeated for module number 61					
D060	...Repeated for module number 62					
D070	...Repeated for module number 63					
D080	...Repeated for module number 64					
<b>Mandatory (Read/Write Setting)</b>						
D280	Test Mode Function	0 to 1	---	1	F102	0 (Disabled)
<b>Contact Outputs (Read/Write Setting) (64 modules)</b>						
D290	Contact Output x Name	---	---	---	F205	"Cont Op 1 "
D29A	Contact Output x Operation	0 to 65535	---	1	F300	0
D29B	Contact Output x Seal-In	0 to 65535	---	1	F300	0
D29C	Reserved	---	---	1	F001	0
D29D	Contact Output x Events	0 to 1	---	1	F102	1 (Enabled)
D29E	Reserved (2 items)	---	---	---	F001	0
D2A0	...Repeated for module number 2					
D2B0	...Repeated for module number 3					
D2C0	...Repeated for module number 4					
D2D0	...Repeated for module number 5					
D2E0	...Repeated for module number 6					



Table B-9: MODBUS MEMORY MAP (Sheet 27 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
D2F0	...Repeated for module number 7					
D300	...Repeated for module number 8					
D310	...Repeated for module number 9					
D320	...Repeated for module number 10					
D330	...Repeated for module number 11					
D340	...Repeated for module number 12					
D350	...Repeated for module number 13					
D360	...Repeated for module number 14					
D370	...Repeated for module number 15					
D380	...Repeated for module number 16					
D390	...Repeated for module number 17					
D3A0	...Repeated for module number 18					
D3B0	...Repeated for module number 19					
D3C0	...Repeated for module number 20					
D3D0	...Repeated for module number 21					
D3E0	...Repeated for module number 22					
D3F0	...Repeated for module number 23					
D400	...Repeated for module number 24					
D410	...Repeated for module number 25					
D420	...Repeated for module number 26					
D430	...Repeated for module number 27					
D440	...Repeated for module number 28					
D450	...Repeated for module number 29					
D460	...Repeated for module number 30					
D470	...Repeated for module number 31					
D480	...Repeated for module number 32					
D490	...Repeated for module number 33					
D4A0	...Repeated for module number 34					
D4B0	...Repeated for module number 35					
D4C0	...Repeated for module number 36					
D4D0	...Repeated for module number 37					
D4E0	...Repeated for module number 38					
D4F0	...Repeated for module number 39					
D500	...Repeated for module number 40					
D510	...Repeated for module number 41					
D520	...Repeated for module number 42					
D530	...Repeated for module number 43					
D540	...Repeated for module number 44					
D550	...Repeated for module number 45					
D560	...Repeated for module number 46					
D570	...Repeated for module number 47					
D580	...Repeated for module number 48					
D590	...Repeated for module number 49					
D5A0	...Repeated for module number 50					
D5B0	...Repeated for module number 51					
D5C0	...Repeated for module number 52					
D5D0	...Repeated for module number 53					
D5E0	...Repeated for module number 54					
D5F0	...Repeated for module number 55					
D600	...Repeated for module number 56					
D610	...Repeated for module number 57					
D620	...Repeated for module number 58					
D630	...Repeated for module number 59					
D640	...Repeated for module number 60					

Table B-9: MODBUS MEMORY MAP (Sheet 28 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
D650	...Repeated for module number 61					
D660	...Repeated for module number 62					
D670	...Repeated for module number 63					
D680	...Repeated for module number 64					
<b>Reset (Read/Write Setting)</b>						
D800	FlexLogic operand which initiates a reset	0 to 65535	---	1	F300	0
<b>Force Contact Inputs (Read/Write Setting)</b>						
D8B0	Force Contact Input x State (96 items)	0 to 2	---	1	F144	0 (Disabled)
<b>Force Contact Outputs (Read/Write Setting)</b>						
D910	Force Contact Output x State (64 items)	0 to 3	---	1	F131	0 (Disabled)
<b>Remote Devices (Read/Write Setting) (16 modules)</b>						
E000	Remote Device x ID	---	---	---	F202	"Remote Device 1 "
E00A	...Repeated for module number 2					
E014	...Repeated for module number 3					
E01E	...Repeated for module number 4					
E028	...Repeated for module number 5					
E032	...Repeated for module number 6					
E03C	...Repeated for module number 7					
E046	...Repeated for module number 8					
E050	...Repeated for module number 9					
E05A	...Repeated for module number 10					
E064	...Repeated for module number 11					
E06E	...Repeated for module number 12					
E078	...Repeated for module number 13					
E082	...Repeated for module number 14					
E08C	...Repeated for module number 15					
E096	...Repeated for module number 16					
<b>Remote Inputs (Read/Write Setting) (32 modules)</b>						
E100	Remote Input x Device	1 to 16	---	1	F001	1
E101	Remote Input x Bit Pair	0 to 64	---	1	F156	0 (None)
E102	Remote Input x Default State	0 to 1	---	1	F108	0 (Off)
E103	Remote Input x Events	0 to 1	---	1	F102	0 (Disabled)
E104	...Repeated for module number 2					
E108	...Repeated for module number 3					
E10C	...Repeated for module number 4					
E110	...Repeated for module number 5					
E114	...Repeated for module number 6					
E118	...Repeated for module number 7					
E11C	...Repeated for module number 8					
E120	...Repeated for module number 9					
E124	...Repeated for module number 10					
E128	...Repeated for module number 11					
E12C	...Repeated for module number 12					
E130	...Repeated for module number 13					
E134	...Repeated for module number 14					
E138	...Repeated for module number 15					
E13C	...Repeated for module number 16					
E140	...Repeated for module number 17					
E144	...Repeated for module number 18					
E148	...Repeated for module number 19					
E14C	...Repeated for module number 20					
E150	...Repeated for module number 21					
E154	...Repeated for module number 22					
E158	...Repeated for module number 23					

Table B-9: MODBUS MEMORY MAP (Sheet 29 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
E15C	...Repeated for module number 24					
E160	...Repeated for module number 25					
E164	...Repeated for module number 26					
E168	...Repeated for module number 27					
E16C	...Repeated for module number 28					
E170	...Repeated for module number 29					
E174	...Repeated for module number 30					
E178	...Repeated for module number 31					
E17C	...Repeated for module number 32					
<b>Remote Output DNA Pairs (Read/Write Setting) (32 modules)</b>						
E600	Remote Output DNA x Operand	0 to 65535	---	1	F300	0
E601	Remote Output DNA x Events	0 to 1	---	1	F102	0 (Disabled)
E602	Remote Output DNA x Reserved (2 items)	0 to 1	---	1	F001	0
E604	...Repeated for module number 2					
E608	...Repeated for module number 3					
E60C	...Repeated for module number 4					
E610	...Repeated for module number 5					
E614	...Repeated for module number 6					
E618	...Repeated for module number 7					
E61C	...Repeated for module number 8					
E620	...Repeated for module number 9					
E624	...Repeated for module number 10					
E628	...Repeated for module number 11					
E62C	...Repeated for module number 12					
E630	...Repeated for module number 13					
E634	...Repeated for module number 14					
E638	...Repeated for module number 15					
E63C	...Repeated for module number 16					
E640	...Repeated for module number 17					
E644	...Repeated for module number 18					
E648	...Repeated for module number 19					
E64C	...Repeated for module number 20					
E650	...Repeated for module number 21					
E654	...Repeated for module number 22					
E658	...Repeated for module number 23					
E65C	...Repeated for module number 24					
E660	...Repeated for module number 25					
E664	...Repeated for module number 26					
E668	...Repeated for module number 27					
E66C	...Repeated for module number 28					
E670	...Repeated for module number 29					
E674	...Repeated for module number 30					
E678	...Repeated for module number 31					
E67C	...Repeated for module number 32					
<b>Remote Output UserSt Pairs (Read/Write Setting) (32 modules)</b>						
E680	Remote Output UserSt x Operand	0 to 65535	---	1	F300	0
E681	Remote Output UserSt x Events	0 to 1	---	1	F102	0 (Disabled)
E682	Remote Output UserSt x Reserved (2 items)	0 to 1	---	1	F001	0
E684	...Repeated for module number 2					
E688	...Repeated for module number 3					
E68C	...Repeated for module number 4					
E690	...Repeated for module number 5					
E694	...Repeated for module number 6					
E698	...Repeated for module number 7					

Table B-9: MODBUS MEMORY MAP (Sheet 30 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
E69C	...Repeated for module number 8					
E6A0	...Repeated for module number 9					
E6A4	...Repeated for module number 10					
E6A8	...Repeated for module number 11					
E6AC	...Repeated for module number 12					
E6B0	...Repeated for module number 13					
E6B4	...Repeated for module number 14					
E6B8	...Repeated for module number 15					
E6BC	...Repeated for module number 16					
E6C0	...Repeated for module number 17					
E6C4	...Repeated for module number 18					
E6C8	...Repeated for module number 19					
E6CC	...Repeated for module number 20					
E6D0	...Repeated for module number 21					
E6D4	...Repeated for module number 22					
E6D8	...Repeated for module number 23					
E6DC	...Repeated for module number 24					
E6E0	...Repeated for module number 25					
E6E4	...Repeated for module number 26					
E6E8	...Repeated for module number 27					
E6EC	...Repeated for module number 28					
E6F0	...Repeated for module number 29					
E6F4	...Repeated for module number 30					
E6F8	...Repeated for module number 31					
E6FC	...Repeated for module number 32					
<b>Factory Service Password Protection (Read/Write)</b>						
F000	Modbus Factory Password	0 to 4294967295	---	1	F003	0
<b>Factory Service Password Protection (Read Only)</b>						
F002	Factory Service Password Status	0 to 1	---	1	F102	0 (Disabled)
<b>Factory Service - Initialization (Read Only -- Written by Factory)</b>						
F008	Load Default Settings	0 to 1	---	1	F126	0 (No)
F009	Reboot Relay	0 to 1	---	1	F126	0 (No)
<b>Factory Service - Calibration (Read Only -- Written by Factory)</b>						
F010	Calibration	0 to 1	---	1	F102	0 (Disabled)
F011	DSP Card to Calibrate	0 to 15	---	1	F172	0 (F)
F012	Channel to Calibrate	0 to 7	---	1	F001	0
F013	Channel Type	0 to 6	---	1	F140	0 (Disabled)
F014	Channel Name	---	---	---	F201	"0"
<b>Factory Service - Calibration (Read Only)</b>						
F018	A/D Counts	-32767 to 32767	---	1	F002	0
<b>Factory Service - Calibration (Read Only -- Written by Factory)</b>						
F019	Offset	-32767 to 32767	---	1	F002	0
F01B	Gain Stage	0 to 1	---	1	F135	0 (x1)
F01C	CT Winding	0 to 1	---	1	F123	0 (1 A)
<b>Factory Service - Calibration (Read Only)</b>						
F01D	Measured Input	0 to 300	---	0.0001	F060	0
<b>Factory Service - Calibration (Read Only -- Written by Factory)</b>						
F01F	Gain Parameter	0.8 to 1.2	---	0.0001	F060	1
<b>Factory Service - Calibration (Read Only)</b>						
F02A	DSP Calibration Date	0 to 4294967295	---	1	F050	0
<b>Factory Service - Debug Data (Read Only -- Written by Factory)</b>						
F040	Debug Data 16 (16 items)	-32767 to 32767	---	1	F002	0
F050	Debug Data 32 (16 items)	-2147483647 to 2147483647	---	1	F004	0

Table B-9: MODBUS MEMORY MAP (Sheet 31 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
<b>Transducer Calibration (Read Only -- Written by Factory)</b>						
F0A0	Transducer Calibration Function	0 to 1	---	1	F102	0 (Disabled)
F0A1	Transducer Card to Calibrate	0 to 15	---	1	F172	0 (F)
F0A2	Transducer Channel to Calibrate	0 to 7	---	1	F001	0
F0A3	Transducer Channel to Calibrate Type	0 to 3	---	1	F171	0 (dcmA IN)
F0A4	Transducer Channel to Calibrate Gain Stage	0 to 1	---	1	F170	0 (LOW)
<b>Transducer Calibration (Read Only)</b>						
F0A5	Transducer Channel to Calibrate Counts	0 to 4095	---	1	F001	0
<b>Transducer Calibration (Read Only -- Written by Factory)</b>						
F0A6	Transducer Channel to Calibrate Offset	-4096 to 4095	---	1	F002	0
F0A7	Transducer Channel to Calibrate Value	-1.1 to 366.5	---	0.001	F004	0
F0A9	Transducer Channel to Calibrate Gain	0.8 to 1.2	---	0.0001	F060	1
F0AB	Transducer Calibration Date	0 to 4294967295	---	1	F050	0
<b>Transducer Calibration (Read Only)</b>						
F0AD	Transducer Channel to Calibrate Units	---	---	---	F206	(none)
<b>Factory Service Software Revisions (Read Only)</b>						
F0F0	Compile Date	0 to 4294967295	---	1	F050	0
F0F3	Boot Version	0 to 655.35	---	0.01	F001	1
F0F4	Front Panel Version	0 to 655.35	---	0.01	F001	1
F0F5	Boot Date	0 to 4294967295	---	1	F050	0
<b>Factory Service - Serial EEPROM (Read Only -- Written by Factory)</b>						
F100	Serial EEPROM Enable	0 to 1	---	1	F102	0 (Disabled)
F101	Serial EEPROM Slot	0 to 15	---	1	F172	0 (F)
F102	Serial EEPROM Load Factory Defaults	0 to 1	---	1	F126	0 (No)
F110	Serial EEPROM Module Serial Number	---	---	---	F203	(none)
F120	Serial EEPROM Supplier Serial Number	---	---	---	F203	(none)
F130	Serial EEPROM Sub Module Serial Number (8 items)	---	---	---	F203	(none)
<b>Factory Service CPU Diagnostics (Read Only Non-Volatile)</b>						
F200	Operating Hours	0 to 4294967295	---	1	F050	0
<b>Factory Service CPU Diagnostics (Read Only)</b>						
F210	DSP Spurious Interrupt Counter	0 to 4294967295	---	1	F003	0
<b>Factory Service CPU Diagnostics (Read Only -- Written by Factory)</b>						
F220	Real Time Profiling	0 to 1	---	1	F102	0 (Disabled)
F221	Enable Windview	0 to 1	---	1	F102	0 (Disabled)
F222	Factory Reload Cause	---	---	---	F200	(none)
F236	Clear Diagnostics	0 to 1	---	1	F126	0 (No)
<b>Factory Service CPU Performance (Read Only)</b>						
F300	CPU Utilization	0 to 100	%	0.1	F001	0
<b>Factory Service CPU Performance (Read/Write)</b>						
F301	CPU Overload	0 to 6553.5	%	0.1	F001	0
<b>Factory Service CPU Performance (Read Only)</b>						
F302	Protection Pass Time	0 to 65535	us	1	F001	0
<b>Factory Service CPU Performance (Read/Write)</b>						
F303	Protection Pass Worst Time	0 to 65535	us	1	F001	0
<b>Factory Service DSP Diagnostics (Read Only) (3 modules)</b>						
F380	DSP Checksum Error Counter	0 to 4294967295	---	1	F003	0
F382	DSP Corrupt Settings Counter	0 to 4294967295	---	1	F003	0
F384	DSP Out Of Sequence Error Counter	0 to 4294967295	---	1	F003	0
F386	DSP Flags Error Counter	0 to 4294967295	---	1	F003	0
F38D	DSP Error Flags	0 to 65535	---	1	F001	0
F38E	DSP Error Code	0 to 65535	---	1	F001	0
F38F	DSP Usage	0 to 100	---	0.1	F001	0
F390	...Repeated for module number 2					
F3A0	...Repeated for module number 3					

Table B–9: MODBUS MEMORY MAP (Sheet 32 of 32)

ADDR	REGISTER NAME	RANGE	UNITS	STEP	FORMAT	DEFAULT
<b>Modbus File Transfer Area 2 (Read/Write)</b>						
FA00	Name of file to read	---	---	---	F204	(none)
<b>Modbus File Transfer Area 2 (Read Only)</b>						
FB00	Character position of current block within file	0 to 4294967295	---	1	F003	0
FB02	Size of currently-available data block	0 to 65535	---	1	F001	0
FB03	Block of data from requested file (122 items)	0 to 65535	---	1	F001	0
<b>Neutral Overvoltage (Read/Write Grouped Setting) (3 modules)</b>						
FC00	Neutral OV X Function	0 to 1	---	1	F102	0 (Disabled)
FC01	Neutral OV X Signal Source	0 to 5	---	1	F167	0 (SRC 1)
FC02	Neutral OV X Pickup	0 to 1.25	pu	0.001	F001	300
FC03	Neutral OV X Pickup Delay	0 to 600	s	0.01	F001	100
FC04	Neutral OV X Reset Delay	0 to 600	s	0.01	F001	100
FC05	Neutral OV X Block	0 to 65535	---	1	F300	0
FC06	Neutral OV X Target	0 to 2	---	1	F109	0 (Self-reset)
FC07	Neutral OV X Events	0 to 1	---	1	F102	0 (Disabled)
FC08	Neutral OV Reserved (8 items)	0 to 65535	---	1	F001	0
FC10	...Repeated for module number 2					
FC20	...Repeated for module number 3					
<b>Auxiliary Overvoltage (Read/Write Grouped Setting) (3 modules)</b>						
FC30	Auxiliary OV X Function	0 to 1	---	1	F102	0 (Disabled)
FC31	Auxiliary OV X Signal Source	0 to 5	---	1	F167	0 (SRC 1)
FC32	Auxiliary OV X Pickup	0 to 3	pu	0.001	F001	300
FC33	Auxiliary OV X Pickup Delay	0 to 600	s	0.01	F001	100
FC34	Auxiliary OV X Reset Delay	0 to 600	s	0.01	F001	100
FC35	Auxiliary OV X Block	0 to 65535	---	1	F300	0
FC36	Auxiliary OV X Target	0 to 2	---	1	F109	0 (Self-reset)
FC37	Auxiliary OV X Events	0 to 1	---	1	F102	0 (Disabled)
FC38	Auxiliary OV X Reserved (8 items)	0 to 65535	---	1	F001	0
FC40	...Repeated for module number 2					
FC50	...Repeated for module number 3					
<b>Auxiliary Undervoltage (Read/Write Grouped Setting) (3 modules)</b>						
FC60	Auxiliary UV X Function	0 to 1	---	1	F102	0 (Disabled)
FC61	Auxiliary UV X Signal Source	0 to 5	---	1	F167	0 (SRC 1)
FC62	Auxiliary UV X Pickup	0 to 3	pu	0.001	F001	700
FC63	Auxiliary UV X Delay	0 to 600	s	0.01	F001	100
FC64	Auxiliary UV X Curve	0 to 1	---	1	F111	0 (Definite Time)
FC65	Auxiliary UV X Minimum Voltage	0 to 3	pu	0.001	F001	100
FC66	Auxiliary UV X Block	0 to 65535	---	1	F300	0
FC67	Auxiliary UV X Target	0 to 2	---	1	F109	0 (Self-reset)
FC68	Auxiliary UV X Events	0 to 1	---	1	F102	0 (Disabled)
FC69	Auxiliary UV X Reserved (7 items)	0 to 65535	---	1	F001	0
FC70	...Repeated for module number 2					
FC80	...Repeated for module number 3					

## B.4.2 MODBUS® MEMORY MAP DATA FORMATS

**F001**  
**UR\_UINT16 UNSIGNED 16 BIT INTEGER**

**F002**  
**UR\_SINT16 SIGNED 16 BIT INTEGER**

**F003**  
**UR\_UINT32 UNSIGNED 32 BIT INTEGER (2 registers)**

High order word is stored in the first register.  
Low order word is stored in the second register.

**F004**  
**UR\_SINT32 SIGNED 32 BIT INTEGER (2 registers)**

High order word is stored in the first register/  
Low order word is stored in the second register.

**F005**  
**UR\_UINT8 UNSIGNED 8 BIT INTEGER**

**F006**  
**UR\_SINT8 SIGNED 8 BIT INTEGER**

**F011**  
**UR\_UINT16 FLEXCURVE DATA (120 points)**

A FlexCurve is an array of 120 consecutive data points (x, y) which are interpolated to generate a smooth curve. The y-axis is the user defined trip or operation time setting; the x-axis is the pickup ratio and is pre-defined. Refer to format F119 for a listing of the pickup ratios; the enumeration value for the pickup ratio indicates the offset into the FlexCurve base address where the corresponding time value is stored.

**F012**  
**DISPLAY\_SCALE DISPLAY SCALING**  
**(unsigned 16-bit integer)**

MSB indicates the SI units as a power of ten. LSB indicates the number of decimal points to display.

Example: Current values are stored as 32 bit numbers with three decimal places and base units in Amps. If the retrieved value is 12345.678 A and the display scale equals 0x0302 then the displayed value on the unit is 12.35 kA.

**F013**  
**POWER\_FACTOR PWR FACTOR (SIGNED 16 BIT INTEGER)**

Positive values indicate lagging power factor; negative values indicate leading.

**F040**  
**UR\_UINT48 48-BIT UNSIGNED INTEGER**

**F050**  
**UR\_UINT32 TIME and DATE (UNSIGNED 32 BIT INTEGER)**

Gives the current time in seconds elapsed since 00:00:00 January 1, 1970.

**F051**  
**UR\_UINT32 DATE in SR format (alternate format for F050)**

First 16 bits are Month/Day (MM/DD/xxxx). Month: 1=January, 2=February,...,12=December; Day: 1 to 31 in steps of 1  
Last 16 bits are Year (xx/xx/YYYY): 1970 to 2106 in steps of 1

**F052**  
**UR\_UINT32 TIME in SR format (alternate format for F050)**

First 16 bits are Hours/Minutes (HH:MM:xx.xxx).  
Hours: 0=12am, 1=1am,...,12=12pm,...23=11pm;  
Minutes: 0 to 59 in steps of 1

Last 16 bits are Seconds (xx:xx:SS.SSS): 0=00.000s, 1=00.001,...,59999=59.999s)

**F060**  
**FLOATING\_POINT IEE FLOATING POINT (32 bits)**

**F070**  
**HEX2 2 BYTES - 4 ASCII DIGITS**

**F071**  
**HEX4 4 BYTES - 8 ASCII DIGITS**

**F072**  
**HEX6 6 BYTES - 12 ASCII DIGITS**

**F073**  
**HEX8 8 BYTES - 16 ASCII DIGITS**

**F074**  
**HEX20 20 BYTES - 40 ASCII DIGITS**

**F100**  
**ENUMERATION: VT CONNECTION TYPE**

0 = Wye; 1 = Delta

**F101**  
**ENUMERATION: MESSAGE DISPLAY INTENSITY**

0 = 25%, 1 = 50%, 2 = 75%, 3 = 100%

**F102**  
**ENUMERATION: DISABLED/ENABLED**

0 = Disabled; 1 = Enabled

**F103**  
**ENUMERATION: CURVE SHAPES**

bitmask	curve shape	bitmask	curve shape
0	IEEE Mod Inv	8	IAC Very Inv
1	IEEE Very Inv	9	IAC Inverse
2	IEEE Ext Inv	10	IAC Short Inv
3	IEC Curve A	11	I2t
4	IEC Curve B	12	Definite Time
5	IEC Curve C	13	Flexcurve A
6	IEC Short Inv	14	Flexcurve B
7	IAC Ext Inv		

**F104**  
**ENUMERATION: RESET TYPE**

0 = Instantaneous, 1 = Timed, 2 = Linear

**F105**  
**ENUMERATION: LOGIC INPUT**

0 = Disabled, 1 = Input 1, 2 = Input 2

**F106**  
**ENUMERATION: PHASE ROTATION**

0 = ABC, 1 = ACB

**F108**  
**ENUMERATION: OFF/ON**

0 = Off, 1 = On

**F109**  
**ENUMERATION: CONTACT OUTPUT OPERATION**

0 = Self-reset, 1 = Latched, 2 = Disabled

**F110**  
**ENUMERATION: CONTACT OUTPUT LED CONTROL**

0 = Trip, 1 = Alarm, 2 = None

**F111**  
**ENUMERATION: UNDERVOLTAGE CURVE SHAPES**

0 = Definite Time, 1 = Inverse Time

**F112**  
**ENUMERATION: RS485 BAUD RATES**

bitmask	value	bitmask	value	bitmask	value
0	300	4	9600	8	115200
1	1200	5	19200	9	14400
2	2400	6	38400	10	28800
3	4800	7	57600	11	33600

**F113**  
**ENUMERATION: PARITY**

0 = None, 1 = Odd, 2 = Even

**F114**  
**ENUMERATION: IRIG-B SIGNAL TYPE**

0 = None, 1 = DC Shift, 2 = Amplitude Modulated

**F117**  
**ENUMERATION: NUMBER OF OSCILLOGRAPHY RECORDS**

0 = 1×72 cycles, 1 = 3×36 cycles, 2 = 7×18 cycles, 3 = 15×9 cycles

**F118**  
**ENUMERATION: OSCILLOGRAPHY MODE**

0 = Automatic Overwrite, 1 = Protected



**F119****ENUMERATION: FLEXCURVE PICKUP RATIOS**

mask	value	mask	value	mask	value	mask	value
0	0.00	30	0.88	60	2.90	90	5.90
1	0.05	31	0.90	61	3.00	91	6.00
2	0.10	32	0.91	62	3.10	92	6.50
3	0.15	33	0.92	63	3.20	93	7.00
4	0.20	34	0.93	64	3.30	94	7.50
5	0.25	35	0.94	65	3.40	95	8.00
6	0.30	36	0.95	66	3.50	96	8.50
7	0.35	37	0.96	67	3.60	97	9.00
8	0.40	38	0.97	68	3.70	98	9.50
9	0.45	39	0.98	69	3.80	99	10.00
10	0.48	40	1.03	70	3.90	100	10.50
11	0.50	41	1.05	71	4.00	101	11.00
12	0.52	42	1.10	72	4.10	102	11.50
13	0.54	43	1.20	73	4.20	103	12.00
14	0.56	44	1.30	74	4.30	104	12.50
15	0.58	45	1.40	75	4.40	105	13.00
16	0.60	46	1.50	76	4.50	106	13.50
17	0.62	47	1.60	77	4.60	107	14.00
18	0.64	48	1.70	78	4.70	108	14.50
19	0.66	49	1.80	79	4.80	109	15.00
20	0.68	50	1.90	80	4.90	110	15.50
21	0.70	51	2.00	81	5.00	111	16.00
22	0.72	52	2.10	82	5.10	112	16.50
23	0.74	53	2.20	83	5.20	113	17.00
24	0.76	54	2.30	84	5.30	114	17.50
25	0.78	55	2.40	85	5.40	115	18.00
26	0.80	56	2.50	86	5.50	116	18.50
27	0.82	57	2.60	87	5.60	117	19.00
28	0.84	58	2.70	88	5.70	118	19.50
29	0.86	59	2.80	89	5.80	119	20.00

**F122****ENUMERATION: ELEMENT INPUT SIGNAL TYPE**

0 = Phasor, 1 = RMS

**F123****ENUMERATION: CT SECONDARY**

0 = 1 A, 1 = 5 A

**F124****ENUMERATION: LIST OF ELEMENTS**

bitmask	element
0	PHASE IOC1
1	PHASE IOC2
2	PHASE IOC3
3	PHASE IOC4
4	PHASE IOC5
5	PHASE IOC6
6	PHASE IOC7
7	PHASE IOC8
8	PHASE IOC9
9	PHASE IOC10
10	PHASE IOC11
11	PHASE IOC12
16	PHASE TOC1
17	PHASE TOC2
18	PHASE TOC3
19	PHASE TOC4
20	PHASE TOC5
21	PHASE TOC6
24	PH DIR1
25	PH DIR2
32	NEUTRAL IOC1
33	NEUTRAL IOC2
34	NEUTRAL IOC3
35	NEUTRAL IOC4
36	NEUTRAL IOC5
37	NEUTRAL IOC6
38	NEUTRAL IOC7
39	NEUTRAL IOC8
40	NEUTRAL IOC9
41	NEUTRAL IOC10
42	NEUTRAL IOC11
43	NEUTRAL IOC12
48	NEUTRAL TOC1
49	NEUTRAL TOC2
50	NEUTRAL TOC3
51	NEUTRAL TOC4
52	NEUTRAL TOC5
53	NEUTRAL TOC6
56	NTRL DIR
57	NTRL DIR
60	NEG SEQ
61	NEG SEQ
64	GROUND IOC1
65	GROUND IOC2
66	GROUND IOC3

B

bitmask	element
67	GROUND IOC4
68	GROUND IOC5
69	GROUND IOC6
70	GROUND IOC7
71	GROUND IOC8
72	GROUND IOC9
73	GROUND IOC10
74	GROUND IOC11
75	GROUND IOC12
80	GROUND TOC1
81	GROUND TOC2
82	GROUND TOC3
83	GROUND TOC4
84	GROUND TOC5
85	GROUND TOC6
140	AUX UV1
141	AUX UV2
142	AUX UV3
144	PHASE UV1
145	PHASE UV2
148	AUX OV1
149	AUX OV2
150	AUX OV3
152	PHASE OV1
156	NEUTRAL OV1
157	NEUTRAL OV2
158	NEUTRAL OV3
180	LOAD ENCHR
184	DUTT
185	PUTT
186	POTT
187	HYBRID POTT
188	BLOCK SCHEME
190	POWER SWING
210	VOLT PER HERTZ 1
211	VOLT PER HERTZ 2
214	DIR POWER 1
215	DIR POWER 2
221	100% STATOR
224	SRC1 VT
225	SRC2 VT
226	SRC3 VT
227	SRC4 VT
228	SRC5 VT
229	SRC6 VT
242	OPEN POLE
244	50DD
245	CONT MONITOR

bitmask	element
246	CT FAIL
247	CT TROUBLE1
248	CT TROUBLE2
265	STATOR DIFF
272	BREAKER 1
273	BREAKER 2
280	BKR FAIL
281	BKR FAIL
288	BKR ARC
289	BKR ARC
296	ACCDNT ENRG
300	LOSS EXCIT
312	SYNC 1
313	SYNC 2
320	COLD LOAD
321	COLD LOAD
324	AMP UNBALANCE
325	AMP UNBALANCE
330	3RD HARM
336	SETTING GROUP
337	RESET
344	OVERFREQ 1
345	OVERFREQ 2
346	OVERFREQ 3
347	OVERFREQ 4
352	UNDERFREQ 1
353	UNDERFREQ 2
354	UNDERFREQ 3
355	UNDERFREQ 4
356	UNDERFREQ 5
357	UNDERFREQ 6
400	FLEX ELEMENT 1
401	FLEX ELEMENT 2
402	FLEX ELEMENT 3
403	FLEX ELEMENT 4
404	FLEX ELEMENT 5
405	FLEX ELEMENT 6
406	FLEX ELEMENT 7
407	FLEX ELEMENT 8
408	FLEX ELEMENT 9
409	FLEX ELEMENT 10
410	FLEX ELEMENT 11
411	FLEX ELEMENT 12
412	FLEX ELEMENT 13
413	FLEX ELEMENT 14
414	FLEX ELEMENT 15
415	FLEX ELEMENT 16
512	DIG ELEM 1

bitmask	element
513	DIG ELEM 2
514	DIG ELEM 3
515	DIG ELEM 4
516	DIG ELEM 5
517	DIG ELEM 6
518	DIG ELEM 7
519	DIG ELEM 8
520	DIG ELEM 9
521	DIG ELEM 10
522	DIG ELEM 11
523	DIG ELEM 12
524	DIG ELEM 13
525	DIG ELEM 14
526	DIG ELEM 15
527	DIG ELEM 16
544	COUNTER 1
545	COUNTER 2
546	COUNTER 3
547	COUNTER 4
548	COUNTER 5
549	COUNTER 6
550	COUNTER 7
551	COUNTER 8

**F125****ENUMERATION: ACCESS LEVEL**

0 = Restricted; 1 = Command, 2 = Setting, 3 = Factory Service

**F126****ENUMERATION: NO/YES CHOICE**

0 = No, 1 = Yes

**F127****ENUMERATION: LATCHED OR SELF-RESETTING**

0 = Latched, 1 = Self-Reset

**F128****ENUMERATION: CONTACT INPUT THRESHOLD**

0 = 16 Vdc, 1 = 30 Vdc, 2 = 80 Vdc, 3 = 140 Vdc

**F129****ENUMERATION: FLEXLOGIC TIMER TYPE**

0 = millisecond, 1 = second, 2 = minute

**F130****ENUMERATION: SIMULATION MODE**

0 = Off, 1 = Pre-Fault, 2 = Fault, 3 = Post-Fault

**F131****ENUMERATION: FORCED CONTACT OUTPUT STATE**

0 = Disabled, 1 = Energized, 2 = De-energized, 3 = Freeze

**F133****ENUMERATION: PROGRAM STATE**

0 = Not Programmed, 1 = Programmed

**F134****ENUMERATION: PASS/FAIL**

0 = Fail, 1 = OK, 2 = n/a

**F135****ENUMERATION: GAIN CALIBRATION**

0 = 0x1, 1 = 1x16

**F136****ENUMERATION: NUMBER OF OSCILLOGRAPHY RECORDS**

0 = 31 x 8 cycles, 1 = 15 x 16 cycles, 2 = 7 x 32 cycles  
3 = 3 x 64 cycles, 4 = 1 x 128 cycles

**F138****ENUMERATION: OSCILLOGRAPHY FILE TYPE**

0 = Data File, 1 = Configuration File, 2 = Header File

**F140****ENUMERATION: CURRENT, SENS CURRENT, VOLTAGE, DISABLED**

0 = Disabled, 1 = Current 46A, 2 = Voltage 280V, 3 = Current 4.6A  
4 = Current 2A, 5 = Notched 4.6A, 6 = Notched 2A

**F141****ENUMERATION: SELF TEST ERROR**

bitmask	error
0	ANY SELF TESTS
1	IRIG-B FAILURE
2	DSP ERROR
4	NO DSP INTERRUPTS
5	UNIT NOT CALIBRATED
9	PROTOTYPE FIRMWARE

bitmask	error
10	FLEXLOGIC ERR TOKEN
11	EQUIPMENT MISMATCH
13	UNIT NOT PROGRAMMED
14	SYSTEM EXCEPTION
19	BATTERY FAIL
20	PRI ETHERNET FAIL
21	SEC ETHERNET FAIL
22	EEPROM DATA ERROR
23	SRAM DATA ERROR
24	PROGRAM MEMORY
25	WATCHDOG ERROR
26	LOW ON MEMORY
27	REMOTE DEVICE OFF
30	ANY MINOR ERROR
31	ANY MAJOR ERROR

**F142****ENUMERATION: EVENT RECORDER ACCESS FILE TYPE**

0 = All Record Data, 1 = Headers Only, 2 = Numeric Event Cause

**F143****UR\_UINT32: 32 BIT ERROR CODE (F141 specifies bit number)**

A bit value of 0 = no error, 1 = error

**F144****ENUMERATION: FORCED CONTACT INPUT STATE**

0 = Disabled, 1 = Open, 2 = Closed

**F145****ENUMERATION: ALPHABET LETTER**

bitmask	type	bitmask	type	bitmask	type	bitmask	type
0	null	7	G	14	N	21	U
1	A	8	H	15	O	22	V
2	B	9	I	16	P	23	W
3	C	10	J	17	Q	24	X
4	D	11	K	18	R	25	Y
5	E	12	L	19	S	26	Z
6	F	13	M	20	T		

**F146****ENUMERATION: MISC. EVENT CAUSES**

bitmask	definition
0	EVENTS CLEARED
1	OSCILLOGRAPHY TRIGGERED
2	DATE/TIME CHANGED
3	DEF SETTINGS LOADED
4	TEST MODE ON
5	TEST MODE OFF
6	POWER ON
7	POWER OFF
8	RELAY IN SERVICE
9	RELAY OUT OF SERVICE
10	WATCHDOG RESET
11	OSCILLOGRAPHY CLEAR
12	REBOOT COMMAND

**F151****ENUMERATION: RTD SELECTION**

bitmask	RTD#	bitmask	RTD#	bitmask	RTD#
0	NONE	17	RTD 17	33	RTD 33
1	RTD 1	18	RTD 18	34	RTD 34
2	RTD 2	19	RTD 19	35	RTD 35
3	RTD 3	20	RTD 20	36	RTD 36
4	RTD 4	21	RTD 21	37	RTD 37
5	RTD 5	22	RTD 22	38	RTD 38
6	RTD 6	23	RTD 23	39	RTD 39
7	RTD 7	24	RTD 24	40	RTD 40
8	RTD 8	25	RTD 25	41	RTD 41
9	RTD 9	26	RTD 26	42	RTD 42
10	RTD 10	27	RTD 27	43	RTD 43
11	RTD 11	28	RTD 28	44	RTD 44
12	RTD 12	29	RTD 29	45	RTD 45
13	RTD 13	30	RTD 30	46	RTD 46
14	RTD 14	31	RTD 31	47	RTD 47
15	RTD 15	32	RTD 32	48	RTD 48
16	RTD 16				

**F152****ENUMERATION: SETTING GROUP**

0 = Active Group, 1 = Group 1, 2 = Group 2, 3 = Group 3

4 = Group 4, 5 = Group 5, 6 = Group 6, 7 = Group 7, 8 = Group 8

**F155****ENUMERATION: REMOTE DEVICE STATE**

0 = Offline, 1 = Online

**F156****ENUMERATION: REMOTE INPUT BIT PAIRS**

bitmask	RTD#	bitmask	RTD#	bitmask	RTD#
0	NONE	22	DNA-22	44	UserSt-12
1	DNA-1	23	DNA-23	45	UserSt-13
2	DNA-2	24	DNA-24	46	UserSt-14
3	DNA-3	25	DNA-25	47	UserSt-15
4	DNA-4	26	DNA-26	48	UserSt-16
5	DNA-5	27	DNA-27	49	UserSt-17
6	DNA-6	28	DNA-28	50	UserSt-18
7	DNA-7	29	DNA-29	51	UserSt-19
8	DNA-8	30	DNA-30	52	UserSt-20
9	DNA-9	31	DNA-31	53	UserSt-21
10	DNA-10	32	DNA-32	54	UserSt-22
11	DNA-11	33	UserSt-1	55	UserSt-23
12	DNA-12	34	UserSt-2	56	UserSt-24
13	DNA-13	35	UserSt-3	57	UserSt-25
14	DNA-14	36	UserSt-4	58	UserSt-26
15	DNA-15	37	UserSt-5	59	UserSt-27
16	DNA-16	38	UserSt-6	60	UserSt-28
17	DNA-17	39	UserSt-7	61	UserSt-29
18	DNA-18	40	UserSt-8	62	UserSt-30
19	DNA-19	41	UserSt-9	63	UserSt-31
20	DNA-20	42	UserSt-10	64	UserSt-32
21	DNA-21	43	UserSt-11		

**F166****ENUMERATION: AUXILIARY VT CONNECTION TYPE**

0 = Vn, 1 = Vag, 2 = Vbg, 3 = Vcg, 4 = Vab, 5 = Vbc, 6 = Vca

**F167****ENUMERATION: SIGNAL SOURCE**

0 = SRC 1, 1 = SRC 2, 2 = SRC 3, 3 = SRC 4,  
4 = SRC 5, 5 = SRC 6

**F168****ENUMERATION: INRUSH INHIBIT FUNCTION**

0 = Disabled, 1 = 2nd

**F169****ENUMERATION: OVEREXCITATION INHIBIT FUNCTION**

0 = Disabled, 1 = 5th

**F170****ENUMERATION: LOW/HIGH OFFSET & GAIN  
TRANSDUCER I/O SELECTION**

0 = LOW, 1 = HIGH

**F171****ENUMERATION: TRANSDUCER CHANNEL INPUT TYPE**

0 = dcma IN, 1 = OHMS IN, 2 = RTD IN, 3 = dcma OUT

**F172****ENUMERATION: SLOT LETTERS**

bitmask	slot	bitmask	slot	bitmask	slot	bitmask	slot
0	F	4	K	8	P	12	U
1	G	5	L	9	R	13	V
2	H	6	M	10	S	14	W
3	J	7	N	11	T	15	X

**F173****ENUMERATION: TRANSDUCER DCMA I/O RANGE**

bitmask	dcma I/O range
0	0 to -1 mA
1	0 to 1 mA
2	-1 to 1 mA
3	0 to 5 mA
4	0 to 10 mA
5	0 to 20 mA
6	4 to 20 mA

**F174****ENUMERATION: TRANSDUCER RTD INPUT TYPE**

0 = 100 Ohm Platinum, 1 = 120 Ohm Nickel,  
2 = 100 Ohm Nickel, 3 = 10 Ohm Copper

**F175****ENUMERATION: PHASE LETTERS**

0 = A, 1 = B, 2 = C

**F176**  
**ENUMERATION: SYNCHROCHECK DEAD SOURCE SELECT**

bitmask	synchrocheck dead source
0	None
1	LV1 and DV2
2	DV1 and LV2
3	DV1 or DV2
4	DV1 Xor DV2
5	DV1 and DV2

**F177**  
**ENUMERATION: COMMUNICATION PORT**

0 = NONE, 1 = COM1-RS485, 2 = COM2-RS485,  
3 = FRONT PANEL-RS232, 4 = NETWORK

**F178**  
**ENUMERATION: DATA LOGGER RATES**

0 = 1 sec, 1 = 1 min, 2 = 5 min, 3 = 10 min, 4 = 15 min,  
5 = 20 min, 6 = 30 min, 7 = 60 min

**F180**  
**ENUMERATION: PHASE/GROUND**

0 = PHASE, 1 = GROUND

**F181**  
**ENUMERATION: ODD/EVEN/NONE**

0 = ODD, 1 = EVEN, 2 = NONE

**F183**  
**ENUMERATION AC INPUT WAVEFORMS**

bitmask	definition
0	Off
1	8 samples/cycle
2	16 samples/cycle
3	32 samples/cycle
4	64 samples/cycle

**F185**  
**ENUMERATION PHASE A,B,C, GROUND SELECTOR**

0 = A, 1 = B, 2 = C, 3 = G

**F186**  
**ENUMERATION MEASUREMENT MODE**

0 = Phase to Ground, 1 = Phase to Phase

**F190**  
**ENUMERATION Simulated Keypress**

bitmask	keypress
0	--- use between real keys
1	1
2	2
3	3
4	4
5	5
6	6
7	7
8	8
9	9
10	0
11	Decimal Pt
12	Plus/Minus

bitmask	keypress
13	Value Up
14	Value Down
15	Message Up
16	Message Down
17	Message Left
18	Message Right
19	Menu
20	Help
21	Escape
22	Enter
23	Reset
24	User 1
25	User 2
26	User 3

**F192**  
**ENUMERATION ETHERNET OPERATION MODE**

0 = Half-Duplex, 1 = Full-Duplex

**F193**  
**ENUMERATION ACCIDENTAL ENERG. ARMING MODE**

0 = UV AND OFFLINE, 1 = UV OR OFFLINE

**F194**  
**ENUMERATION DNP SCALE**

A bitmask of 0 = 0.01, 1 = 0.1, 2 = 1, 3 = 10, 4 = 100, 5 = 1000

**F197**  
**ENUMERATION DNP BINARY INPUT POINT BLOCK**

bitmask	Input Point Block
0	Not Used
1	Virtual Inputs 1 to 16
2	Virtual Inputs 17 to 32
3	Virtual Outputs 1 to 16
4	Virtual Outputs 17 to 32
5	Virtual Outputs 33 to 48
6	Virtual Outputs 49 to 64
7	Contact Inputs 1 to 16
8	Contact Inputs 17 to 32
9	Contact Inputs 33 to 48
10	Contact Inputs 49 to 64
11	Contact Inputs 65 to 80

bitmask	Input Point Block
12	Contact Inputs 81 to 96
13	Contact Outputs 1 to 16
14	Contact Outputs 17 to 32
15	Contact Outputs 33 to 48
16	Contact Outputs 49 to 64
17	Remote Inputs 1 to 16
18	Remote Inputs 17 to 32
19	Remote Devs 1 to 16
20	Elements 1 to 16
21	Elements 17 to 32
22	Elements 33 to 48
23	Elements 49 to 64
24	Elements 65 to 80
25	Elements 81 to 96
26	Elements 97 to 112
27	Elements 113 to 128
28	Elements 129 to 144
29	Elements 145 to 160
30	Elements 161 to 176
31	Elements 177 to 192
32	Elements 193 to 208
33	Elements 209 to 224
34	Elements 225 to 240
35	Elements 241 to 256
36	Elements 257 to 272
37	Elements 273 to 288
38	Elements 289 to 304
39	Elements 305 to 320
40	Elements 321 to 336
41	Elements 337 to 352
42	Elements 353 to 368
43	Elements 369 to 384
44	Elements 385 to 400
45	Elements 401 to 406
46	Elements 417 to 432
47	Elements 433 to 448
48	Elements 449 to 464
49	Elements 465 to 480
50	Elements 481 to 496
51	Elements 497 to 512
52	Elements 513 to 528
53	Elements 529 to 544
54	Elements 545 to 560
55	LED States 1 to 16
56	LED States 17 to 32
57	Self Tests 1 to 16
58	Self Tests 17 to 32

**F200****TEXT40 40 CHARACTER ASCII TEXT**

20 registers, 16 Bits: 1st Char MSB, 2nd Char. LSB

**F201****TEXT8 8 CHARACTER ASCII PASSCODE**

4 registers, 16 Bits: 1st Char MSB, 2nd Char. LSB

**F202****TEXT20 20 CHARACTER ASCII TEXT**

10 registers, 16 Bits: 1st Char MSB, 2nd Char. LSB

**F203****TEXT16 16 CHARACTER ASCII TEXT****F204****TEXT80 80 CHARACTER ASCII TEXT****F205****TEXT12 12 CHARACTER ASCII TEXT****F206****TEXT6 6 CHARACTER ASCII TEXT****F207****TEXT4 4 CHARACTER ASCII TEXT****F208****TEXT2 2 CHARACTER ASCII TEXT****F222****ENUMERATION TEST ENUMERATION**

0 = Test Enumeration 0, 1 = Test Enumeration 1

**F240****ENUMERATION V/HZ CURVES**

0 = Definite Time, 1 = Inverse A, 2 = Inverse B, 3 = Inverse C

**F300****UR\_UINT16 FLEXLOGIC BASE TYPE (6 bit type)**

The FlexLogic™ BASE type is 6 bits and is combined with a 9 bit descriptor and 1 bit for protection element to form a 16 bit value. The combined bits are of the form: PTTTTTDDDDDDDDDD, where P bit if set, indicates that the FlexLogic™ type is associated with a protection element state and T represents bits for the BASE type, and D represents bits for the descriptor.

The values in square brackets indicate the base type with P prefix [PTTTTTT] and the values in round brackets indicate the descriptor range.

[0] Off(0) this is boolean FALSE value  
 [0] On (1) This is boolean TRUE value  
 [2] CONTACT INPUTS (1 - 96)  
 [3] CONTACT INPUTS OFF (1-96)  
 [4] VIRTUAL INPUTS (1-64)  
 [6] VIRTUAL OUTPUTS (1-64)  
 [10] CONTACT OUTPUTS VOLTAGE DETECTED (1-64)  
 [11] CONTACT OUTPUTS VOLTAGE OFF DETECTED (1-64)  
 [12] CONTACT OUTPUTS CURRENT DETECTED (1-64)  
 [13] CONTACT OUTPUTS CURRENT OFF DETECTED (1-64)  
 [14] REMOTE INPUTS (1-32)  
 [28] INSERT (Via Keypad only)  
 [32] END  
 [34] NOT (1 INPUT)  
 [36] 2 INPUT XOR (0)  
 [38] LATCH SET/RESET (2 INPUTS)  
 [40] OR (2-16 INPUTS)  
 [42] AND (2-16 INPUTS)  
 [44] NOR (2-16 INPUTS)  
 [46] NAND (2-16 INPUTS)  
 [48] TIMER (1-32)  
 [50] ASSIGN VIRTUAL OUTPUT (1 - 64)  
 [52] SELF-TEST ERROR (See F141 for range)  
 [56] ACTIVE SETTING GROUP (1-8)  
 [62] MISCELLANEOUS EVENTS (See F146 for range)  
 [64-127] ELEMENT STATES  
 (Refer to Memory Map Element States Section)

**F400****UR\_UINT16 CT/VT BANK SELECTION**

bitmask	bank selection
0	Card 1 Contact 1 to 4
1	Card 1 Contact 5 to 8
2	Card 2 Contact 1 to 4
3	Card 2 Contact 5 to 8
4	Card 3 Contact 1 to 4
5	Card 3 Contact 5 to 8

**F500****UR\_UINT16 PACKED BITFIELD**

First register indicates I/O state with bits 0(MSB)-15(LSB) corresponding to I/O state 1-16. The second register indicates I/O state with bits 0-15 corresponding to I/O state 17-32 (if required) The third register indicates I/O state with bits 0-15 corresponding to I/O state 33-48 (if required). The fourth register indicates I/O state with bits 0-15 corresponding to I/O state 49-64 (if required).

The number of registers required is determined by the specific data item. A bit value of 0 = Off, 1 = On

**F501****UR\_UINT16 LED STATUS**

Low byte of register indicates LED status with bit 0 representing the top LED and bit 7 the bottom LED. A bit value of 1 indicates the LED is on, 0 indicates the LED is off.

**F502****BITFIELD ELEMENT OPERATE STATES**

Each bit contains the operate state for an element. See the F124 format code for a list of element IDs. The operate bit for element ID X is bit [X mod 16] in register [X/16].

**F504****BITFIELD 3 PHASE ELEMENT STATE**

bitmask	element state
0	Pickup
1	Operate
2	Pickup Phase A
3	Pickup Phase B
4	Pickup Phase C
5	Operate Phase A
6	Operate Phase B
7	Operate Phase C

**F505****BITFIELD CONTACT OUTPUT STATE**

0 = Contact State, 1 = Voltage Detected, 2 = Current Detected

**F506****BITFIELD 1 PHASE ELEMENT STATE**

0 = Pickup, 1 = Operate

**F507****BITFIELD COUNTER ELEMENT STATE**

0 = Count Greater Than, 1 = Count Equal To, 2 = Count Less Than

**F509****BITFIELD SIMPLE ELEMENT STATE**

0 = Operate

**F511****BITFIELD 3 PHASE SIMPLE ELEMENT STATE**

0 = Operate, 1 = Operate A, 2 = Operate B, 3 = Operate C



**F513****ENUMERATION POWER SWING MODE**

0 = Two Step, 1 = Three Step

**F514****ENUMERATION POWER SWING TRIP MODE**

0 = Delayed, 1 = Early

**F515****ENUMERATION ELEMENT INPUT MODE**

0 = SIGNED, 1 = ABSOLUTE

**F516****ENUMERATION ELEMENT COMPARE MODE**

0 = LEVEL, 1 = DELTA

**F518****ENUMERATION FlexElement Units**

0 = Milliseconds, 1 = Seconds, 2 = Minutes

**F600****UR\_UINT16 FlexAnalog Parameter**

The 16-bit value corresponds to the modbus address of the value to be used when this parameter is selected. Only certain values may be used as FlexAnalog (basically all the metering quantities used in protection)

**MMI\_FLASH ENUMERATION****Flash message definitions for Front-panel MMI**

bitmask	Flash Message
1	ADJUSTED VALUE HAS BEEN STORED
2	ENTERED PASSCODE IS INVALID
3	COMMAND EXECUTED
4	DEFAULT MESSAGE HAS BEEN ADDED
5	DEFAULT MESSAGE HAS BEEN REMOVED
6	INPUT FUNCTION IS ALREADY ASSIGNED
7	PRESS [ENTER] TO ADD AS DEFAULT
8	PRESS [ENTER] TO REMOVE MESSAGE
9	PRESS [ENTER] TO BEGIN TEXT EDIT

bitmask	Flash Message
10	ENTRY MISMATCH - CODE NOT STORED
11	PRESSED KEY IS INVALID HERE
12	INVALID KEY: MUST BE IN LOCAL MODE
13	NEW PASSWORD HAS BEEN STORED
14	PLEASE ENTER A NON-ZERO PASSCODE
15	NO ACTIVE TARGETS (TESTING LEDS)
16	OUT OF RANGE - VALUE NOT STORED
17	RESETTING LATCHED CONDITIONS
18	SETPOINT ACCESS IS NOW ALLOWED
19	SETPOINT ACCESS DENIED (PASSCODE)
20	SETPOINT ACCESS IS NOW RESTRICTED
21	NEW SETTING HAS BEEN STORED
22	SETPOINT ACCESS DENIED (SWITCH)
23	DATA NOT ACCEPTED
24	NOT ALL CONDITIONS HAVE BEEN RESET
25	DATE NOT ACCEPTED IRIGB IS ENABLED
26	NOT EXECUTED
27	DISPLAY ADDED TO USER DISPLAY LIST
28	DISPLAY NOT ADDED TO USER DISPLAY LIST
29	DISPLAY REMOVED FROM USER DISPLAY LIST

**MMI\_PASSWORD\_TYPE ENUMERATION****Password types for display in password prompts**

bitmask	password type
0	No
1	MASTER
2	SETTING
3	COMMAND
4	FACTORY

**MMI\_SETTING\_TYPE ENUMERATION****Setting types for display in web pages**

bitmask	Setting Type
0	Unrestricted Setting
1	Master-accessed Setting
2	Setting
3	Command
4	Factory Setting

**B**

## C.1.1 UCA

The **Utility Communications Architecture** (UCA) version 2 represents an attempt by utilities and vendors of electronic equipment to produce standardized communications systems. There is a set of reference documents available from the Electric Power Research Institute (EPRI) and vendors of UCA/MMS software libraries that describe the complete capabilities of the UCA. Following, is a description of the subset of UCA/MMS features that are supported by the UR relay. The reference document set includes:

- Introduction to UCA version 2
- Generic Object Models for Substation & Feeder Equipment (GOMSFE)
- Common Application Service Models (CASM) and Mapping to MMS
- UCA Version 2 Profiles

These documents can be obtained from <ftp://www.sisconet.com/epri/subdemo/uca2.0>. It is strongly recommended that all those involved with any UCA implementation obtain this document set.

**COMMUNICATION PROFILES:**

The UCA specifies a number of possibilities for communicating with electronic devices based on the OSI Reference Model. The UR relay uses the seven layer OSI stack (TP4/CLNP and TCP/IP profiles). Refer to the "UCA Version 2 Profiles" reference document for details.

The TP4/CLNP profile requires the UR relay to have a network address or Network Service Access Point (NSAP) in order to establish a communication link. The TCP/IP profile requires the UR relay to have an IP address in order to establish a communication link. These addresses are set in the **SETTINGS** ⇒ **PRODUCT SETUP** ⇒ **COMMUNICATIONS** ⇒ **NETWORK** menu. Note that the UR relay supports UCA operation over the TP4/CLNP or the TCP/IP stacks and also supports operation over both stacks simultaneously. It is possible to have up to two simultaneous connections. This is in addition to DNP and Modbus/TCP (non-UCA) connections.

## C.1.2 MMS

The UCA specifies the use of the **Manufacturing Message Specification** (MMS) at the upper (Application) layer for transfer of real-time data. This protocol has been in existence for a number of years and provides a set of services suitable for the transfer of data within a substation LAN environment. Data can be grouped to form objects and be mapped to MMS services. Refer to the "GOMSFE" and "CASM" reference documents for details.

**SUPPORTED OBJECTS:**

The "GOMSFE" document describes a number of communication objects. Within these objects are items, some of which are mandatory and some of which are optional, depending on the implementation. The UR relay supports the following GOMSFE objects:

• DI (device identity)	• PHIZ (high impedance ground detector)
• GCTL (generic control)	• PIOC (instantaneous overcurrent relay)
• GIND (generic indicator)	• POVR (overvoltage relay)
• GLOBE (global data)	• PTOC (time overcurrent relay)
• MMXU (polyphase measurement unit)	• PUVR (under voltage relay)
• PBRL (phase balance current relay)	• PVPH (volts per hertz relay)
• PBRO (basic relay object)	• ctRATO (CT ratio information)
• PDIF (differential relay)	• vtRATO (VT ratio information)
• PDIS (distance)	• RREC (reclosing relay)
• PDOC (directional overcurrent)	• RSYN (synchronizing or synchronism-check relay)
• PFRQ (frequency relay)	• XCBR (circuit breaker)

UCA data can be accessed through the "UCADevice" MMS domain.

**PEER-TO-PEER COMMUNICATION:**

Peer-to-peer communication of digital state information, using the UCA GOOSE data object, is supported via the use of the UR Remote Inputs/Outputs feature. This feature allows digital points to be transferred between any UCA conforming devices.

**FILE SERVICES:**

MMS file services are supported to allow transfer of Oscillography, Event Record, or other files from a UR relay.

**COMMUNICATION SOFTWARE UTILITIES:**

The exact structure and values of the implemented objects implemented can be seen by connecting to a UR relay with an MMS browser, such as the "MMS Object Explorer and AXS4-MMS DDE/OPC" server from Sisco Inc.

**NON-UCA DATA:**

The UR relay makes available a number of non-UCA data items. These data items can be accessed through the "UR" MMS domain. UCA data can be accessed through the "UCADevice" MMS domain.

C

**a) PROTOCOL IMPLEMENTATION AND CONFORMANCE STATEMENT (PICS)**

The UR relay functions as a server only; a UR relay cannot be configured as a client. Thus, the following list of supported services is for server operation only:

The MMS supported services are as follows:

**CONNECTION MANAGEMENT SERVICES:**

- Initiate
- Conclude
- Cancel
- Abort
- Reject

**VMD SUPPORT SERVICES:**

- Status
- GetNameList
- Identify

**VARIABLE ACCESS SERVICES:**

- Read
- Write
- InformationReport
- GetVariableAccessAttributes
- GetNamedVariableListAttributes

**OPERATOR COMMUNICATION SERVICES:**

(none)

**SEMAPHORE MANAGEMENT SERVICES:**

(none)

**DOMAIN MANAGEMENT SERVICES:**

- GetDomainAttributes

**PROGRAM INVOCATION MANAGEMENT SERVICES:**

(none)

**EVENT MANAGEMENT SERVICES:**

(none)

**JOURNAL MANAGEMENT SERVICES:**

(none)

**FILE MANAGEMENT SERVICES:**

- ObtainFile
- FileOpen
- FileRead
- FileClose
- FileDirectory

The following MMS parameters are supported:

- STR1 (Arrays)
- STR2 (Structures)
- NEST (Nesting Levels of STR1 and STR2) - 1
- VNAM (Named Variables)
- VADR (Unnamed Variables)
- VALT (Alternate Access Variables)
- VLIS (Named Variable Lists)
- REAL (ASN.1 REAL Type)

C

**b) MODEL IMPLEMENTATION CONFORMANCE (MIC)**

This section provides details of the UCA object models supported by the UR relay. Note that not all of the protective device functions are applicable to all UR relays.

**Table C-1: DEVICE IDENTITY – DI**

NAME	M/O	RWEC
Name	m	rw
Class	o	rw
d	o	rw
Own	o	rw
Loc	o	rw
VndID	m	r
CommID	o	rw

**Table C-2: GENERIC CONTROL – GCTL**

FC	NAME	CLASS	RWECS	DESCRIPTION
ST	BO<n>	SI	rw	Generic Single Point Indication
CO	BO<n>	SI	rw	Generic Binary Output
CF	BO<n>	SBOCF	rw	SBO Configuration
DC	LN	d	rw	Description for brick
	BO<n>	d	rw	Description for each point



Actual instantiation of GCTL objects is as follows:

GCTL1 = Virtual Inputs (32 total points – SI1 to SI32); includes SBO functionality.

**Table C-3: GENERIC INDICATOR – GIND**

FC	NAME	CLASS	RWECS	DESCRIPTION
ST	SIG<n>	SIG	r	Generic Indication (block of 16)
DC	LN	d	rw	Description for brick
RP	BrcbST	BasRCB	rw	Controls reporting of STATUS



Actual instantiation of GIND objects is as follows:

GIND1 = Contact Inputs (96 total points – SIG1 to SIG6)  
 GIND2 = Contact Outputs (64 total points – SIG1 to SIG4)  
 GIND3 = Virtual Inputs (32 total points – SIG1 to SIG2)  
 GIND4 = Virtual Outputs (64 total points – SIG1 to SIG4)  
 GIND5 = Remote Inputs (32 total points – SIG1 to SIG2)  
 GIND6 = Flexstates (16 total points – SIG1 representing Flexstates 1 to 16)

C

**Table C-4: GLOBAL DATA – GLOBE**

FC	OBJECT NAME	CLASS	RWECS	DESCRIPTION
ST	ModeDS	SIT	r	Device is: in test, off-line, available, or unhealthy
	LocRemDS	SIT	r	The mode of control, local or remote (DevST)
	ActSG	INT8U	r	Active Settings Group
	EditSG	INT8u	r	Settings Group selected for read/write operation
CO	CopySG	INT8U	w	Selects Settings Group for read/writer operation
	IndRs	BOOL	w	Resets ALL targets
CF	ClockTOD	BTIME	rw	Date and time
RP	GOOSE	PACT	rw	Reports IED Inputs and Outputs

**Table C-5: MEASUREMENT UNIT (POLYPHASE) – MMXU**

OBJECT NAME	CLASS	RWECS	DESCRIPTION
V	WYE	rw	Voltage on phase A, B, C to G
PPV	DELTA	rw	Voltage on AB, BC, CA
A	WYE	rw	Current in phase A, B, C, and N
W	WYE	rw	Watts in phase A, B, C
TotW	AI	rw	Total watts in all three phases
Var	WYE	rw	Vars in phase A, B, C
TotVar	AI	rw	Total vars in all three phases
VA	WYE	rw	VA in phase A, B, C
TotVA	AI	rw	Total VA in all 3 phases
PF	WYE	rw	Power Factor for phase A, B, C
AvgPF	AI	rw	Average Power Factor for all three phases
Hz	AI	rw	Power system frequency
All MMXU.MX	ACF	rw	Configuration of ALL included MMXU.MX
LN	d	rw	Description for brick
All MMXU.MX	d	rw	Description of ALL included MMXU.MX
BrcbMX	BasRCB	rw	Controls reporting of measurements



Actual instantiation of MMXU objects is as follows:

1 MMXU per Source (as determined from the 'product order code')

**Table C-6: PROTECTIVE ELEMENTS**

FC	OBJECT NAME	CLASS	RWECS	DESCRIPTION
ST	Out	BOOL	r	1 = Element operated, 2 = Element not operated
	Tar	PhsTar	r	Targets since last reset
	FctDS	SIT	r	Function is enabled/disabled
	PuGrp	INT8U	r	Settings group selected for use
CO	EnaDisFct	DCO	w	1 = Element function enabled, 0 = disabled
	RsTar	BO	w	Reset ALL Elements/Targets
	RsLat	BO	w	Reset ALL Elements/Targets
DC	LN	d	rw	Description for brick
	ElementSt	d	r	Element state string

The following GOMSFE objects are defined by the object model described via the above table:

- PBRO (basic relay object)
- PDIF (differential relay)
- PDIS (distance)
- PDOC (directional overcurrent)
- PFRQ (frequency relay)
- PHIZ (high impedance ground detector)
- PIOC (instantaneous overcurrent relay)
- POVR (over voltage relay)
- PTOC (time overcurrent relay)
- PUVR (under voltage relay)
- RSYN (synchronizing or synchronism-check relay)
- POVR (overvoltage)
- PVPH (volts per hertz relay)
- PBRL (phase balance current relay)



Actual instantiation of these objects is determined by the number of the corresponding elements present in the UR as per the 'product order code'.

**Table C-7: CT RATIO INFORMATION – ctRATO**

OBJECT NAME	CLASS	RWECS	DESCRIPTION
PhsARat	RATIO	rw	Primary/secondary winding ratio
NeutARat	RATIO	rw	Primary/secondary winding ratio
LN	d	rw	Description for brick



Actual instantiation of ctRATO objects is as follows:

1 ctRATO per Source (as determined from the 'product order code').

**Table C-8: VT RATIO INFORMATION – vtRATO**

OBJECT NAME	CLASS	RWECS	DESCRIPTION
PhsVRat	RATIO	rw	Primary/secondary winding ratio
LN	d	rw	Description for brick



Actual instantiation of vtRATO objects is as follows:

1 vtRATO per Source (as determined from the 'product order code').

Table C-9: RECLOSING RELAY – RREC

FC	OBJECT NAME	CLASS	RWECS	DESCRIPTION
ST	Out	BOOL	r	1 = Element operated, 2 = Element not operated
	FctDS	SIT	r	Function is enabled/disabled
	PuGrp	INT8U	r	Settings group selected for use
SG	RecISeq	SHOTS	rw	Reclosing Sequence
CO	EnaDisFct	DCO	w	1 = Element function enabled, 0 = disabled
	RsTar	BO	w	Reset ALL Elements/Targets
	RsLat	BO	w	Reset ALL Elements/Targets
CF	RecISeq	ACF	rw	Configuration for RREC.SG
DC	LN	d	rw	Description for brick
	ElementSt	d	r	Element state string



Actual instantiation of RREC objects is determined by the number of autoreclose elements present in the UR as per the 'product order code'.

Also note that the SHOTS class data (i.e. Tmr1, Tmr2, Tmr3, Tmr4, RsTmr) is specified to be of type INT16S (16 bit signed integer); this data type is not large enough to properly display the full range of these settings from the UR. Numbers larger than 32768 will be displayed incorrectly.

### C.1.3 UCA REPORTING

A built-in TCP/IP connection timeout of two minutes is employed by the UR to detect "dead" connections. If there is no data traffic on a TCP connection for greater than two minutes, the connection will be aborted by the UR. This frees up the connection to be used by other clients. Therefore, when using UCA reporting, clients should configure BasRCB objects such that an integrity report will be issued at least every 2 minutes (120000 ms). This ensures that the UR will not abort the connection. If other MMS data is being polled on the same connection at least once every 2 minutes, this timeout will not apply.



## D.1.1 INTEROPERABILITY DOCUMENT

This document is adapted from the IEC 60870-5-104 standard. For this section the boxes indicate the following: ☒ – used in standard direction; ☐ – not used; ☐ – cannot be selected in IEC 60870-5-104 standard.

## 1. SYSTEM OR DEVICE:

- ☐ System Definition  
☐ Controlling Station Definition (Master)  
☒ Controlled Station Definition (Slave)

## 2. NETWORK CONFIGURATION:

- ☐ Point-to-Point ☐ Multipoint  
☐ Multiple Point-to-Point ☐ Multipoint Star

## 3. PHYSICAL LAYER

Transmission Speed (control direction):

Unbalanced Interchange Circuit V.24/V.28 Standard:	Unbalanced Interchange Circuit V.24/V.28 Recommended if >1200 bits/s:	Balanced Interchange Circuit X.24/X.27:
<input type="checkbox"/> 100 bits/sec. <input type="checkbox"/> 200 bits/sec. <input type="checkbox"/> 300 bits/sec. <input type="checkbox"/> 600 bits/sec. <input type="checkbox"/> 1200 bits/sec.	<input type="checkbox"/> 2400 bits/sec. <input type="checkbox"/> 4800 bits/sec. <input type="checkbox"/> 9600 bits/sec.	<input type="checkbox"/> 2400 bits/sec. <input type="checkbox"/> 4800 bits/sec. <input type="checkbox"/> 9600 bits/sec. <input type="checkbox"/> 19200 bits/sec. <input type="checkbox"/> 38400 bits/sec. <input type="checkbox"/> 56000 bits/sec. <input type="checkbox"/> 64000 bits/sec.

Transmission Speed (monitor direction):

Unbalanced Interchange Circuit V.24/V.28 Standard:	Unbalanced Interchange Circuit V.24/V.28 Recommended if >1200 bits/s:	Balanced Interchange Circuit X.24/X.27:
<input type="checkbox"/> 100 bits/sec. <input type="checkbox"/> 200 bits/sec. <input type="checkbox"/> 300 bits/sec. <input type="checkbox"/> 600 bits/sec. <input type="checkbox"/> 1200 bits/sec.	<input type="checkbox"/> 2400 bits/sec. <input type="checkbox"/> 4800 bits/sec. <input type="checkbox"/> 9600 bits/sec.	<input type="checkbox"/> 2400 bits/sec. <input type="checkbox"/> 4800 bits/sec. <input type="checkbox"/> 9600 bits/sec. <input type="checkbox"/> 19200 bits/sec. <input type="checkbox"/> 38400 bits/sec. <input type="checkbox"/> 56000 bits/sec. <input type="checkbox"/> 64000 bits/sec.

## 4. LINK LAYER

Link Transmission Procedure:	Address Field of the Link:
<input type="checkbox"/> Balanced Transmission <input type="checkbox"/> Unbalanced Transmission	<input type="checkbox"/> Not Present (Balanced Transmission Only) <input type="checkbox"/> One Octet <input type="checkbox"/> Two Octets <input type="checkbox"/> Structured <input type="checkbox"/> Unstructured
Frame Length (maximum length, number of octets): Not selectable in companion IEC 60870-5-104 standard	

When using an unbalanced link layer, the following ADSU types are returned in class 2 messages (low priority) with the indicated causes of transmission:

- ☐ The standard assignment of ADSUs to class 2 messages is used as follows:
- ☐ A special assignment of ADSUs to class 2 messages is used as follows:

## 5. APPLICATION LAYER

### Transmission Mode for Application Data:

Mode 1 (least significant octet first), as defined in Clause 4.10 of IEC 60870-5-4, is used exclusively in this companion standard.

### Common Address of ADSU:

- ☐ One Octet
- ☒ Two Octets

### Information Object Address:

- ☐ One Octet ☒ Structured
- ☐ Two Octets ☒ Unstructured
- ☒ Three Octets

### Cause of Transmission:

- ☐ One Octet
- ☒ Two Octets (with originator address). Originator address is set to zero if not used.

**Maximum Length of APDU:** 253 (the maximum length may be reduced by the system).

### Selection of standard ASDUs:

For the following lists, the boxes indicate the following: ☒ – used in standard direction; ☐ – not used; ☐ – cannot be selected in IEC 60870-5-104 standard.

#### Process information in monitor direction

<input checked="" type="checkbox"/> <1> := Single-point information	M_SP_NA_1
<input type="checkbox"/> <2> := Single-point information with time tag	M_SP_TA_1
<input type="checkbox"/> <3> := Double-point information	M_DP_NA_1
<input type="checkbox"/> <4> := Double-point information with time tag	M_DP_TA_1
<input type="checkbox"/> <5> := Step position information	M_ST_NA_1
<input type="checkbox"/> <6> := Step position information with time tag	M_ST_TA_1
<input type="checkbox"/> <7> := Bitstring of 32 bits	M_BO_NA_1
<input type="checkbox"/> <8> := Bitstring of 32 bits with time tag	M_BO_TA_1
<input type="checkbox"/> <9> := Measured value, normalized value	M_ME_NA_1
<input type="checkbox"/> <10> := Measured value, normalized value with time tag	M_ME_TA_1
<input type="checkbox"/> <11> := Measured value, scaled value	M_ME_NB_1
<input type="checkbox"/> <12> := Measured value, scaled value with time tag	M_ME_TB_1
<input checked="" type="checkbox"/> <13> := Measured value, short floating point value	M_ME_NC_1
<input type="checkbox"/> <14> := Measured value, short floating point value with time tag	M_ME_TC_1
<input checked="" type="checkbox"/> <15> := Integrated totals	M_IT_NA_1
<input type="checkbox"/> <16> := Integrated totals with time tag	M_IT_TA_1
<input type="checkbox"/> <17> := Event of protection equipment with time tag	M_EP_TA_1
<input type="checkbox"/> <18> := Packed start events of protection equipment with time tag	M_EP_TB_1
<input type="checkbox"/> <19> := Packed output circuit information of protection equipment with time tag	M_EP_TC_1
<input type="checkbox"/> <20> := Packed single-point information with status change detection	M_SP_NA_1

<input type="checkbox"/> <21> := Measured value, normalized value without quantity descriptor	M_ME_ND_1
<input checked="" type="checkbox"/> <30> := Single-point information with time tag CP56Time2a	M_SP_TB_1
<input type="checkbox"/> <31> := Double-point information with time tag CP56Time2a	M_DP_TB_1
<input type="checkbox"/> <32> := Step position information with time tag CP56Time2a	M_ST_TB_1
<input type="checkbox"/> <33> := Bitstring of 32 bits with time tag CP56Time2a	M_BO_TB_1
<input type="checkbox"/> <34> := Measured value, normalized value with time tag CP56Time2a	M_ME_TD_1
<input type="checkbox"/> <35> := Measured value, scaled value with time tag CP56Time2a	M_ME_TE_1
<input type="checkbox"/> <36> := Measured value, short floating point value with time tag CP56Time2a	M_ME_TF_1
<input checked="" type="checkbox"/> <37> := Integrated totals with time tag CP56Time2a	M_IT_TB_1
<input type="checkbox"/> <38> := Event of protection equipment with time tag CP56Time2a	M_EP_TD_1
<input type="checkbox"/> <39> := Packed start events of protection equipment with time tag CP56Time2a	M_EP_TE_1
<input type="checkbox"/> <40> := Packed output circuit information of protection equipment with time tag CP56Time2a	M_EP_TF_1

Either the ASDUs of the set <2>, <4>, <6>, <8>, <10>, <12>, <14>, <16>, <17>, <18>, and <19> or of the set <30> to <40> are used.

#### Process information in control direction

<input checked="" type="checkbox"/> <45> := Single command	C_SC_NA_1
<input type="checkbox"/> <46> := Double command	C_DC_NA_1
<input type="checkbox"/> <47> := Regulating step command	C_RC_NA_1
<input type="checkbox"/> <48> := Set point command, normalized value	C_SE_NA_1
<input type="checkbox"/> <49> := Set point command, scaled value	C_SE_NB_1
<input type="checkbox"/> <50> := Set point command, short floating point value	C_SE_NC_1
<input type="checkbox"/> <51> := Bitstring of 32 bits	C_BO_NA_1
<input checked="" type="checkbox"/> <58> := Single command with time tag CP56Time2a	C_SC_TA_1
<input type="checkbox"/> <59> := Double command with time tag CP56Time2a	C_DC_TA_1
<input type="checkbox"/> <60> := Regulating step command with time tag CP56Time2a	C_RC_TA_1
<input type="checkbox"/> <61> := Set point command, normalized value with time tag CP56Time2a	C_SE_TA_1
<input type="checkbox"/> <62> := Set point command, scaled value with time tag CP56Time2a	C_SE_TB_1
<input type="checkbox"/> <63> := Set point command, short floating point value with time tag CP56Time2a	C_SE_TC_1
<input type="checkbox"/> <64> := Bitstring of 32 bits with time tag CP56Time2a	C_BO_TA_1

Either the ASDUs of the set <45> to <51> or of the set <58> to <64> are used.

#### System information in monitor direction

<input checked="" type="checkbox"/> <70> := End of initialization	M_EI_NA_1
---	-----------

#### System information in control direction

<input checked="" type="checkbox"/> <100> := Interrogation command	C_IC_NA_1
<input checked="" type="checkbox"/> <101> := Counter interrogation command	C_CI_NA_1
<input checked="" type="checkbox"/> <102> := Read command	C_RD_NA_1
<input checked="" type="checkbox"/> <103> := Clock synchronization command (see Clause 7.6 in standard)	C_CS_NA_1
<input checked="" type="checkbox"/> <104> := Test command	C_TS_NA_1
<input checked="" type="checkbox"/> <105> := Reset process command	C_RP_NA_1
<input checked="" type="checkbox"/> <106> := Delay acquisition command	C_CD_NA_1
<input checked="" type="checkbox"/> <107> := Test command with time tag CP56Time2a	C_TS_TA_1

**Parameter in control direction**

<input type="checkbox"/> <110> := Parameter of measured value, normalized value	PE_ME_NA_1
<input type="checkbox"/> <111> := Parameter of measured value, scaled value	PE_ME_NB_1
<input checked="" type="checkbox"/> <112> := Parameter of measured value, short floating point value	PE_ME_NC_1
<input type="checkbox"/> <113> := Parameter activation	PE_AC_NA_1

**File transfer**

<input type="checkbox"/> <120> := File Ready	F_FR_NA_1
<input type="checkbox"/> <121> := Section Ready	F_SR_NA_1
<input type="checkbox"/> <122> := Call directory, select file, call file, call section	F_SC_NA_1
<input type="checkbox"/> <123> := Last section, last segment	F_LS_NA_1
<input type="checkbox"/> <124> := Ack file, ack section	F_AF_NA_1
<input type="checkbox"/> <125> := Segment	F_SG_NA_1
<input type="checkbox"/> <126> := Directory (blank or X, available only in monitor [standard] direction)	C_CD_NA_1

**Type identifier and cause of transmission assignments**  
 (station-specific parameters)

In the following table:

- Shaded boxes are not required.
- Black boxes are not permitted in this companion standard.
- Blank boxes indicate functions or ASDU not used.
- 'X' if only used in the standard direction

TYPE IDENTIFICATION		CAUSE OF TRANSMISSION																		
		PERIODIC, CYCLIC	BACKGROUND SCAN	SPONTANEOUS	INITIALIZED	REQUEST OR REQUESTED	ACTIVATION	ACTIVATION CONFIRMATION	DEACTIVATION	DEACTIVATION CONFIRMATION	ACTIVATION TERMINATION	RETURN INFO CAUSED BY LOCAL CMD	FILE TRANSFER	INTERROGATED BY GROUP <NUMBER>	REQUEST BY GROUP <N> COUNTER REQ	UNKNOWN TYPE IDENTIFICATION	UNKNOWN CAUSE OF TRANSMISSION	UNKNOWN COMMON ADDRESS OF ADSU	UNKNOWN INFORMATION OBJECT ADDR	UNKNOWN INFORMATION OBJECT ADDR
NO.	MNEMONIC	1	2	3	4	5	6	7	8	9	10	11	12	13	20 to 36	37 to 41	44	45	46	47
<1>	M_SP_NA_1			X		X						X	X		X					
<2>	M_SP_TA_1																			
<3>	M_DP_NA_1																			
<4>	M_DP_TA_1																			
<5>	M_ST_NA_1																			
<6>	M_ST_TA_1																			
<7>	M_BO_NA_1																			
<8>	M_BO_TA_1																			

TYPE IDENTIFICATION		CAUSE OF TRANSMISSION																		
		PERIODIC, CYCLIC	BACKGROUND SCAN	SPONTANEOUS	INITIALIZED	REQUEST OR REQUESTED	ACTIVATION	ACTIVATION CONFIRMATION	DEACTIVATION	DEACTIVATION CONFIRMATION	ACTIVATION TERMINATION	RETURN INFO CAUSED BY LOCAL CMD	FILE TRANSFER	INTERROGATED BY GROUP <NUMBER>	REQUEST BY GROUP <N> COUNTER REQ	UNKNOWN TYPE IDENTIFICATION	UNKNOWN CAUSE OF TRANSMISSION	UNKNOWN COMMON ADDRESS OF ADSU	UNKNOWN INFORMATION OBJECT ADDR	UNKNOWN INFORMATION OBJECT ADDR
NO.	MNEMONIC	1	2	3	4	5	6	7	8	9	10	11	12	13	20 to 36	37 to 41	44	45	46	47
<9>	M_ME_NA_1																			
<10>	M_ME_TA_1																			
<11>	M_ME_NB_1																			
<12>	M_ME_TB_1																			
<13>	M_ME_NC_1	X		X		X									X					
<14>	M_ME_TC_1																			
<15>	M_IT_NA_1			X												X				
<16>	M_IT_TA_1																			
<17>	M_EP_TA_1																			
<18>	M_EP_TB_1																			
<19>	M_EP_TC_1																			
<20>	M_PS_NA_1																			
<21>	M_ME_ND_1																			
<30>	M_SP_TB_1			X								X	X							
<31>	M_DP_TB_1																			
<32>	M_ST_TB_1																			
<33>	M_BO_TB_1																			
<34>	M_ME_TD_1																			
<35>	M_ME_TE_1																			
<36>	M_ME_TF_1																			
<37>	M_IT_TB_1			X												X				
<38>	M_EP_TD_1																			
<39>	M_EP_TE_1																			
<40>	M_EP_TF_1																			
<45>	C_SC_NA_1						X	X	X	X	X									
<46>	C_DC_NA_1																			
<47>	C_RC_NA_1																			
<48>	C_SE_NA_1																			
<49>	C_SE_NB_1																			

D

TYPE IDENTIFICATION		CAUSE OF TRANSMISSION																		
		PERIODIC, CYCLIC	BACKGROUND SCAN	SPONTANEOUS	INITIALIZED	REQUEST OR REQUESTED	ACTIVATION	ACTIVATION CONFIRMATION	DEACTIVATION	DEACTIVATION CONFIRMATION	ACTIVATION TERMINATION	RETURN INFO CAUSED BY LOCAL CMD	FILE TRANSFER	INTERROGATED BY GROUP <NUMBER>	REQUEST BY GROUP <N> COUNTER REQ	UNKNOWN TYPE IDENTIFICATION	UNKNOWN CAUSE OF TRANSMISSION	UNKNOWN COMMON ADDRESS OF ADSU	UNKNOWN INFORMATION OBJECT ADDR	UNKNOWN INFORMATION OBJECT ADDR
NO.	MNEMONIC	1	2	3	4	5	6	7	8	9	10	11	12	13	20 to 36	37 to 41	44	45	46	47
<50>	C_SE_NC_1																			
<51>	C_BO_NA_1																			
<58>	C_SC_TA_1						X	X	X	X	X									
<59>	C_DC_TA_1																			
<60>	C_RC_TA_1																			
<61>	C_SE_TA_1																			
<62>	C_SE_TB_1																			
<63>	C_SE_TC_1																			
<64>	C_BO_TA_1																			
<70>	M_EI_NA_1*)				X															
<100>	C_IC_NA_1						X	X	X	X	X									
<101>	C_CI_NA_1						X	X			X									
<102>	C_RD_NA_1					X														
<103>	C_CS_NA_1			X			X	X												
<104>	C_TS_NA_1																			
<105>	C_RP_NA_1						X	X												
<106>	C_CD_NA_1																			
<107>	C_TS_TA_1																			
<110>	P_ME_NA_1																			
<111>	P_ME_NB_1																			
<112>	P_ME_NC_1						X	X							X					
<113>	P_AC_NA_1																			
<120>	F_FR_NA_1																			
<121>	F_SR_NA_1																			
<122>	F_SC_NA_1																			
<123>	F_LS_NA_1																			
<124>	F_AF_NA_1																			
<125>	F_SG_NA_1																			
<126>	F_DR_TA_1*)																			

## 6. BASIC APPLICATION FUNCTIONS

### Station Initialization:

- ☒ Remote initialization

### Cyclic Data Transmission:

- ☒ Cyclic data transmission

### Read Procedure:

- ☒ Read procedure

### Spontaneous Transmission:

- ☒ Spontaneous transmission

### Double transmission of information objects with cause of transmission spontaneous:

The following type identifications may be transmitted in succession caused by a single status change of an information object. The particular information object addresses for which double transmission is enabled are defined in a project-specific list.

- ☐ Single point information: M\_SP\_NA\_1, M\_SP\_TA\_1, M\_SP\_TB\_1, and M\_PS\_NA\_1
- ☐ Double point information: M\_DP\_NA\_1, M\_DP\_TA\_1, and M\_DP\_TB\_1
- ☐ Step position information: M\_ST\_NA\_1, M\_ST\_TA\_1, and M\_ST\_TB\_1
- ☐ Bitstring of 32 bits: M\_BO\_NA\_1, M\_BO\_TA\_1, and M\_BO\_TB\_1 (if defined for a specific project)
- ☐ Measured value, normalized value: M\_ME\_NA\_1, M\_ME\_TA\_1, M\_ME\_ND\_1, and M\_ME\_TD\_1
- ☐ Measured value, scaled value: M\_ME\_NB\_1, M\_ME\_TB\_1, and M\_ME\_TE\_1
- ☐ Measured value, short floating point number: M\_ME\_NC\_1, M\_ME\_TC\_1, and M\_ME\_TF\_1

### Station interrogation:

- |   |   |  |  |
|---|---|--|--|
| <input checked="" type="checkbox"/> Global  |   |  |  |
| <input checked="" type="checkbox"/> Group 1 | <input checked="" type="checkbox"/> Group 5 | <input checked="" type="checkbox"/> Group 9  | <input checked="" type="checkbox"/> Group 13 |
| <input checked="" type="checkbox"/> Group 2 | <input checked="" type="checkbox"/> Group 6 | <input checked="" type="checkbox"/> Group 10 | <input checked="" type="checkbox"/> Group 14 |
| <input checked="" type="checkbox"/> Group 3 | <input checked="" type="checkbox"/> Group 7 | <input checked="" type="checkbox"/> Group 11 | <input checked="" type="checkbox"/> Group 15 |
| <input checked="" type="checkbox"/> Group 4 | <input checked="" type="checkbox"/> Group 8 | <input checked="" type="checkbox"/> Group 12 | <input checked="" type="checkbox"/> Group 16 |

### Clock synchronization:

- ☒ Clock synchronization (optional, see Clause 7.6)

### Command transmission:

- ☒ Direct command transmission
- ☐ Direct setpoint command transmission
- ☒ Select and execute command
- ☐ Select and execute setpoint command
- ☒ C\_SE ACTTERM used
- ☒ No additional definition
- ☒ Short pulse duration (duration determined by a system parameter in the outstation)
- ☒ Long pulse duration (duration determined by a system parameter in the outstation)
- ☒ Persistent output

- ☒ Supervision of maximum delay in command direction of commands and setpoint commands

Maximum allowable delay of commands and setpoint commands: **10 s**

**Transmission of integrated totals:**

- ☒ Mode A: Local freeze with spontaneous transmission
- ☒ Mode B: Local freeze with counter interrogation
- ☒ Mode C: Freeze and transmit by counter-interrogation commands
- ☒ Mode D: Freeze by counter-interrogation command, frozen values reported simultaneously
  
- ☒ Counter read
- ☒ Counter freeze without reset
- ☒ Counter freeze with reset
- ☒ Counter reset
  
- ☒ General request counter
- ☒ Request counter group 1
- ☒ Request counter group 2
- ☒ Request counter group 3
- ☒ Request counter group 4

**Parameter loading:**

- ☒ Threshold value
- ☐ Smoothing factor
- ☐ Low limit for transmission of measured values
- ☐ High limit for transmission of measured values

**Parameter activation:**

- ☐ Activation/deactivation of persistent cyclic or periodic transmission of the addressed object

**Test procedure:**

- ☐ Test procedure

**File transfer:**

File transfer in monitor direction:

- ☐ Transparent file
- ☐ Transmission of disturbance data of protection equipment
- ☐ Transmission of sequences of events
- ☐ Transmission of sequences of recorded analog values

File transfer in control direction:

- ☐ Transparent file

**Background scan:**

- ☐ Background scan

**Acquisition of transmission delay:**

- ☒ Acquisition of transmission delay



**Definition of time outs:**

PARAMETER	DEFAULT VALUE	REMARKS	SELECTED VALUE
$t_0$	30 s	Timeout of connection establishment	120 s
$t_1$	15 s	Timeout of send or test APDUs	15 s
$t_2$	10 s	Timeout for acknowledgements in case of no data messages $t_2 < t_1$	10 s
$t_3$	20 s	Timeout for sending test frames in case of a long idle state	20 s

Maximum range of values for all time outs: 1 to 255 s, accuracy 1 s

**Maximum number of outstanding I-format APDUs  $k$  and latest acknowledge APDUs ( $w$ ):**

PARAMETER	DEFAULT VALUE	REMARKS	SELECTED VALUE
$k$	12 APDUs	Maximum difference receive sequence number to send state variable	12 APDUs
$w$	8 APDUs	Latest acknowledge after receiving $w$ I-format APDUs	8 APDUs

Maximum range of values  $k$ : 1 to 32767 ( $2^{15} - 1$ ) APDUs, accuracy 1 APDU

Maximum range of values  $w$ : 1 to 32767 APDUs, accuracy 1 APDU  
Recommendation:  $w$  should not exceed two-thirds of  $k$ .

**Portnumber:**

PARAMETER	VALUE	REMARKS
Portnumber	2404	In all cases

**RFC 2200 suite:**

RFC 2200 is an official Internet Standard which describes the state of standardization of protocols used in the Internet as determined by the Internet Architecture Board (IAB). It offers a broad spectrum of actual standards used in the Internet. The suitable selection of documents from RFC 2200 defined in this standard for given projects has to be chosen by the user of this standard.

- ☒ Ethernet 802.3
- ☐ Serial X.21 interface
- ☐ Other selection(s) from RFC 2200 (list below if selected)

## D.1.2 POINT LIST

Table D–1: IEC 60870-5-104 POINTS (Sheet 1 of 4)

POINT	DESCRIPTION	UNITS
<b>M_ME_NC_1 Points</b>		
2000	SRC 1 Phase A Current RMS	A
2001	SRC 1 Phase B Current RMS	A
2002	SRC 1 Phase C Current RMS	A
2003	SRC 1 Neutral Current RMS	A
2004	SRC 1 Phase A Current Magnitude	A
2005	SRC 1 Phase A Current Angle	degrees
2006	SRC 1 Phase B Current Magnitude	A
2007	SRC 1 Phase B Current Angle	degrees
2008	SRC 1 Phase C Current Magnitude	A
2009	SRC 1 Phase C Current Angle	degrees
2010	SRC 1 Neutral Current Magnitude	A
2011	SRC 1 Neutral Current Angle	degrees
2012	SRC 1 Ground Current RMS	A
2013	SRC 1 Ground Current Magnitude	A
2014	SRC 1 Ground Current Angle	degrees
2015	SRC 1 Zero Sequence Current Magnitude	A
2016	SRC 1 Zero Sequence Current Angle	degrees
2017	SRC 1 Positive Sequence Current Magnitude	A
2018	SRC 1 Positive Sequence Current Angle	degrees
2019	SRC 1 Negative Sequence Current Magnitude	A
2020	SRC 1 Negative Sequence Current Angle	degrees
2021	SRC 1 Differential Ground Current Magnitude	A
2022	SRC 1 Differential Ground Current Angle	degrees
2023	SRC 1 Phase AG Voltage RMS	V
2024	SRC 1 Phase BG Voltage RMS	V
2025	SRC 1 Phase CG Voltage RMS	V
2026	SRC 1 Phase AG Voltage Magnitude	V
2027	SRC 1 Phase AG Voltage Angle	degrees
2028	SRC 1 Phase BG Voltage Magnitude	V
2029	SRC 1 Phase BG Voltage Angle	degrees
2030	SRC 1 Phase CG Voltage Magnitude	V
2031	SRC 1 Phase CG Voltage Angle	degrees
2032	SRC 1 Phase AB Voltage RMS	V
2033	SRC 1 Phase BC Voltage RMS	V
2034	SRC 1 Phase CA Voltage RMS	V
2035	SRC 1 Phase AB Voltage Magnitude	V
2036	SRC 1 Phase AB Voltage Angle	degrees
2037	SRC 1 Phase BC Voltage Magnitude	V
2038	SRC 1 Phase BC Voltage Angle	degrees
2039	SRC 1 Phase CA Voltage Magnitude	V
2040	SRC 1 Phase CA Voltage Angle	degrees
2041	SRC 1 Auxiliary Voltage RMS	V
2042	SRC 1 Auxiliary Voltage Magnitude	V
2043	SRC 1 Auxiliary Voltage Angle	degrees
2044	SRC 1 Zero Sequence Voltage Magnitude	V

Table D–1: IEC 60870-5-104 POINTS (Sheet 2 of 4)

POINT	DESCRIPTION	UNITS
2045	SRC 1 Zero Sequence Voltage Angle	degrees
2046	SRC 1 Positive Sequence Voltage Magnitude	V
2047	SRC 1 Positive Sequence Voltage Angle	degrees
2048	SRC 1 Negative Sequence Voltage Magnitude	V
2049	SRC 1 Negative Sequence Voltage Angle	degrees
2050	SRC 1 Three Phase Real Power	W
2051	SRC 1 Phase A Real Power	W
2052	SRC 1 Phase B Real Power	W
2053	SRC 1 Phase C Real Power	W
2054	SRC 1 Three Phase Reactive Power	var
2055	SRC 1 Phase A Reactive Power	var
2056	SRC 1 Phase B Reactive Power	var
2057	SRC 1 Phase C Reactive Power	var
2058	SRC 1 Three Phase Apparent Power	VA
2059	SRC 1 Phase A Apparent Power	VA
2060	SRC 1 Phase B Apparent Power	VA
2061	SRC 1 Phase C Apparent Power	VA
2062	SRC 1 Three Phase Power Factor	none
2063	SRC 1 Phase A Power Factor	none
2064	SRC 1 Phase B Power Factor	none
2065	SRC 1 Phase C Power Factor	none
2066	SRC 1 Positive Watthour	Wh
2067	SRC 1 Negative Watthour	Wh
2068	SRC 1 Positive Varhour	varh
2069	SRC 1 Negative Varhour	varh
2070	SRC 1 Frequency	Hz
2071	Stator Differential Iad	A
2072	Stator Restraint Iar	A
2073	Stator Differential Ibd	A
2074	Stator Restraint Ibr	A
2075	Stator Differential Icd	A
2076	Stator Restraint Icr	A
2077	Stator Ground Vn 3rd	V
2078	Stator Ground Vn V0 3rd	V
2079	Sens Dir Power 1 Actual	W
2080	Sens Dir Power 2 Actual	W
2081	Synchrocheck 1 Delta Voltage	V
2082	Synchrocheck 1 Delta Frequency	Hz
2083	Synchrocheck 1 Delta Phase	degrees
2084	Synchrocheck 2 Delta Voltage	V
2085	Synchrocheck 2 Delta Frequency	Hz
2086	Synchrocheck 2 Delta Phase	degrees
2087	Power Swing S1 S2 Angle	degrees
2088	Tracking Frequency	Hz
2089	FlexElement 1 Actual	none
2090	FlexElement 2 Actual	none

Table D-1: IEC 60870-5-104 POINTS (Sheet 3 of 4)

POINT	DESCRIPTION	UNITS
2091	FlexElement 3 Actual	none
2092	FlexElement 4 Actual	none
2093	FlexElement 5 Actual	none
2094	FlexElement 6 Actual	none
2095	FlexElement 7 Actual	none
2096	FlexElement 8 Actual	none
2097	FlexElement 9 Actual	none
2098	FlexElement 10 Actual	none
2099	FlexElement 11 Actual	none
2100	FlexElement 12 Actual	none
2101	FlexElement 13 Actual	none
2102	FlexElement 14 Actual	none
2103	FlexElement 15 Actual	none
2104	FlexElement 16 Actual	none
2105	Current Setting Group	none
2106	VHZ 1 Actual	p
2107	VHZ 2 Actual	p
<b>P_ME_NC_1 Points</b>		
5000 - 5107	Threshold values for M_ME_NC_1 points	-
<b>M_SP_NA_1 Points</b>		
100-115	Virtual Input States[0]	-
116-131	Virtual Input States[1]	-
132-147	Virtual Output States[0]	-
148-163	Virtual Output States[1]	-
164-179	Virtual Output States[2]	-
180-195	Virtual Output States[3]	-
196-211	Contact Input States[0]	-
212-227	Contact Input States[1]	-
228-243	Contact Input States[2]	-
244-259	Contact Input States[3]	-
260-275	Contact Input States[4]	-
276-291	Contact Input States[5]	-
292-307	Contact Output States[0]	-
308-323	Contact Output States[1]	-
324-339	Contact Output States[2]	-
340-355	Contact Output States[3]	-
356-371	Remote Input x States[0]	-
372-387	Remote Input x States[1]	-
388-403	Remote Device x States	-
404-419	LED Column x State[0]	-
420-435	LED Column x State[1]	-

Table D-1: IEC 60870-5-104 POINTS (Sheet 4 of 4)

POINT	DESCRIPTION	UNITS
<b>C_SC_NA_1 Points</b>		
1100 - 1115	Virtual Input States[0] - No Select Required	-
1116 - 1131	Virtual Input States[1] - Select Required	-
<b>M_IT_NA_1 Points</b>		
4000	Digital Counter 1 Value	-
4001	Digital Counter 2 Value	-
4002	Digital Counter 3 Value	-
4003	Digital Counter 4 Value	-
4004	Digital Counter 5 Value	-
4005	Digital Counter 6 Value	-
4006	Digital Counter 7 Value	-
4007	Digital Counter 8 Value	-

D

## E.1.1 DNP V3.00 DEVICE PROFILE

The following table provides a “Device Profile Document” in the standard format defined in the DNP 3.0 Subset Definitions Document.

**Table E–1: DNP V3.00 DEVICE PROFILE (Sheet 1 of 3)**

(Also see the IMPLEMENTATION TABLE in the following section)	
Vendor Name: <b>General Electric Power Management</b>	
Device Name: <b>UR Series Relay</b>	
<b>Highest DNP Level Supported:</b> For Requests: <b>Level 2</b> For Responses: <b>Level 2</b>	<b>Device Function:</b> <input type="checkbox"/> Master <input checked="" type="checkbox"/> <b>Slave</b>
Notable objects, functions, and/or qualifiers supported in addition to the Highest DNP Levels Supported (the complete list is described in the attached table): <b>Binary Inputs (Object 1)</b> <b>Binary Input Changes (Object 2)</b> <b>Binary Outputs (Object 10)</b> <b>Binary Counters (Object 20)</b> <b>Frozen Counters (Object 21)</b> <b>Counter Change Event (Object 22)</b> <b>Frozen Counter Event (Object 23)</b> <b>Analog Inputs (Object 30)</b> <b>Analog Input Changes (Object 32)</b> <b>Analog Deadbands (Object 34)</b>	
<b>Maximum Data Link Frame Size (octets):</b> Transmitted: <b>292</b> Received: <b>292</b>	<b>Maximum Application Fragment Size (octets):</b> Transmitted: <b>240</b> Received: <b>2048</b>
<b>Maximum Data Link Re-tries:</b> <input type="checkbox"/> None <input checked="" type="checkbox"/> Fixed at 2 <input type="checkbox"/> Configurable	<b>Maximum Application Layer Re-tries:</b> <input checked="" type="checkbox"/> None <input type="checkbox"/> Configurable
<b>Requires Data Link Layer Confirmation:</b> <input checked="" type="checkbox"/> Never <input type="checkbox"/> Always <input type="checkbox"/> Sometimes <input type="checkbox"/> Configurable	

Table E–1: DNP V3.00 DEVICE PROFILE (Sheet 2 of 3)

<b>Requires Application Layer Confirmation:</b>				
<input type="checkbox"/> Never <input type="checkbox"/> Always <input checked="" type="checkbox"/> When reporting Event Data <input checked="" type="checkbox"/> When sending multi-fragment responses <input type="checkbox"/> Sometimes <input type="checkbox"/> Configurable				
<b>Timeouts while waiting for:</b>				
Data Link Confirm:	<input type="checkbox"/> None	<input checked="" type="checkbox"/> <b>Fixed at 3 s</b>	<input type="checkbox"/> Variable	<input type="checkbox"/> Configurable
Complete Appl. Fragment:	<input checked="" type="checkbox"/> <b>None</b>	<input type="checkbox"/> Fixed at ____	<input type="checkbox"/> Variable	<input type="checkbox"/> Configurable
Application Confirm:	<input type="checkbox"/> None	<input checked="" type="checkbox"/> <b>Fixed at 4 s</b>	<input type="checkbox"/> Variable	<input type="checkbox"/> Configurable
Complete Appl. Response:	<input checked="" type="checkbox"/> <b>None</b>	<input type="checkbox"/> Fixed at ____	<input type="checkbox"/> Variable	<input type="checkbox"/> Configurable
<b>Others:</b>				
Transmission Delay:	<b>No intentional delay</b>			
Inter-character Timeout:	<b>50 ms</b>			
Need Time Delay:	<b>Configurable (default = 24 hrs.)</b>			
Select/Operate Arm Timeout:	<b>10 s</b>			
Binary input change scanning period:	<b>8 times per power system cycle</b>			
Packed binary change process period:	<b>1 s</b>			
Analog input change scanning period:	<b>500 ms</b>			
Counter change scanning period:	<b>500 ms</b>			
Frozen counter event scanning period:	<b>500 ms</b>			
Unsolicited response notification delay:	<b>500 ms</b>			
Unsolicited response retry delay	<b>configurable 0 to 60 sec.</b>			
<b>Sends/Executes Control Operations:</b>				
WRITE Binary Outputs	<input checked="" type="checkbox"/> <b>Never</b>	<input type="checkbox"/> Always	<input type="checkbox"/> Sometimes	<input type="checkbox"/> Configurable
SELECT/OPERATE	<input type="checkbox"/> Never	<input checked="" type="checkbox"/> <b>Always</b>	<input type="checkbox"/> Sometimes	<input type="checkbox"/> Configurable
DIRECT OPERATE	<input type="checkbox"/> Never	<input checked="" type="checkbox"/> <b>Always</b>	<input type="checkbox"/> Sometimes	<input type="checkbox"/> Configurable
DIRECT OPERATE – NO ACK	<input type="checkbox"/> Never	<input checked="" type="checkbox"/> <b>Always</b>	<input type="checkbox"/> Sometimes	<input type="checkbox"/> Configurable
Count > 1	<input checked="" type="checkbox"/> <b>Never</b>	<input type="checkbox"/> Always	<input type="checkbox"/> Sometimes	<input type="checkbox"/> Configurable
Pulse On	<input type="checkbox"/> Never	<input type="checkbox"/> Always	<input checked="" type="checkbox"/> <b>Sometimes</b>	<input type="checkbox"/> Configurable
Pulse Off	<input type="checkbox"/> Never	<input type="checkbox"/> Always	<input checked="" type="checkbox"/> <b>Sometimes</b>	<input type="checkbox"/> Configurable
Latch On	<input type="checkbox"/> Never	<input type="checkbox"/> Always	<input checked="" type="checkbox"/> <b>Sometimes</b>	<input type="checkbox"/> Configurable
Latch Off	<input type="checkbox"/> Never	<input type="checkbox"/> Always	<input checked="" type="checkbox"/> <b>Sometimes</b>	<input type="checkbox"/> Configurable
Queue	<input checked="" type="checkbox"/> <b>Never</b>	<input type="checkbox"/> Always	<input type="checkbox"/> Sometimes	<input type="checkbox"/> Configurable
Clear Queue	<input checked="" type="checkbox"/> <b>Never</b>	<input type="checkbox"/> Always	<input type="checkbox"/> Sometimes	<input type="checkbox"/> Configurable
<b>Explanation of 'Sometimes':</b> Object 12 points are mapped to UR Virtual Inputs. The persistence of Virtual Inputs is determined by the <b>VIRTUAL INPUT X TYPE</b> settings. Both "Pulse On" and "Latch On" operations perform the same function in the UR; that is, the appropriate Virtual Input is put into the "On" state. If the Virtual Input is set to "Self-Reset", it will reset after one pass of FlexLogic™. The On/Off times and Count value are ignored. "Pulse Off" and "Latch Off" operations put the appropriate Virtual Input into the "Off" state. "Trip" and "Close" operations both put the appropriate Virtual Input into the "On" state.				

Table E-1: DNP V3.00 DEVICE PROFILE (Sheet 3 of 3)

<b>Reports Binary Input Change Events when no specific variation requested:</b> <ul style="list-style-type: none"> <li><input type="checkbox"/> Never</li> <li><input checked="" type="checkbox"/> <b>Only time-tagged</b></li> <li><input type="checkbox"/> Only non-time-tagged</li> <li><input type="checkbox"/> Configurable</li> </ul>	<b>Reports time-tagged Binary Input Change Events when no specific variation requested:</b> <ul style="list-style-type: none"> <li><input type="checkbox"/> Never</li> <li><input checked="" type="checkbox"/> Binary Input Change With Time</li> <li><input type="checkbox"/> Binary Input Change With Relative Time</li> <li><input type="checkbox"/> Configurable (attach explanation)</li> </ul>
<b>Sends Unsolicited Responses:</b> <ul style="list-style-type: none"> <li><input type="checkbox"/> <b>Never</b></li> <li><input checked="" type="checkbox"/> Configurable</li> <li><input type="checkbox"/> Only certain objects</li> <li><input type="checkbox"/> Sometimes (attach explanation)</li> <li><input checked="" type="checkbox"/> ENABLE/DISABLE unsolicited Function codes supported</li> </ul>	<b>Sends Static Data in Unsolicited Responses:</b> <ul style="list-style-type: none"> <li><input checked="" type="checkbox"/> Never</li> <li><input type="checkbox"/> When Device Restarts</li> <li><input type="checkbox"/> When Status Flags Change</li> </ul> <p>No other options are permitted.</p>
<b>Default Counter Object/Variation:</b> <ul style="list-style-type: none"> <li><input type="checkbox"/> No Counters Reported</li> <li><input type="checkbox"/> Configurable (attach explanation)</li> <li><input checked="" type="checkbox"/> <b>Default Object: 20</b></li> <li><input checked="" type="checkbox"/> <b>Default Variation: 1</b></li> <li><input checked="" type="checkbox"/> <b>Point-by-point list attached</b></li> </ul>	<b>Counters Roll Over at:</b> <ul style="list-style-type: none"> <li><input type="checkbox"/> No Counters Reported</li> <li><input type="checkbox"/> Configurable (attach explanation)</li> <li><input checked="" type="checkbox"/> <b>16 Bits (Counter 8)</b></li> <li><input checked="" type="checkbox"/> <b>32 Bits (Counters 0 to 7, 9)</b></li> <li><input type="checkbox"/> Other Value: _____</li> <li><input checked="" type="checkbox"/> <b>Point-by-point list attached</b></li> </ul>
<b>Sends Multi-Fragment Responses:</b> <ul style="list-style-type: none"> <li><input checked="" type="checkbox"/> Yes</li> <li><input type="checkbox"/> No</li> </ul>	

## E.2.1 IMPLEMENTATION TABLE

The following table identifies the variations, function codes, and qualifiers supported by the UR in both request messages and in response messages. For static (non-change-event) objects, requests sent with qualifiers 00, 01, 06, 07, or 08, will be responded with qualifiers 00 or 01. Static object requests sent with qualifiers 17 or 28 will be responded with qualifiers 17 or 28. For change-event objects, qualifiers 17 or 28 are always responded.

Table E–2: IMPLEMENTATION TABLE (Sheet 1 of 4)

OBJECT			REQUEST		RESPONSE	
OBJECT NO.	VARIATION NO.	DESCRIPTION	FUNCTION CODES (DEC)	QUALIFIER CODES (HEX)	FUNCTION CODES (DEC)	QUALIFIER CODES (HEX)
1	0	Binary Input (Variation 0 is used to request default variation)	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)		
	1	Binary Input	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
	2	Binary Input with Status (default – see Note 1)	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
2	0	Binary Input Change (Variation 0 is used to request default variation)	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
	1	Binary Input Change without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)
	2	Binary Input Change with Time (default – see Note 1)	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)
10	0	Binary Output Status (Variation 0 is used to request default variation)	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)		
	2	Binary Output Status (default – see Note 1)	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
12	1	Control Relay Output Block	3 (select) 4 (operate) 5 (direct op) 6 (dir. op, noack)	00, 01 (start-stop) 07, 08 (limited qty) 17, 28 (index)	129 (response)	echo of request
20	0	Binary Counter (Variation 0 is used to request default variation)	1 (read) 7 (freeze) 8 (freeze noack) 9 (freeze clear) 10 (frz. cl. noack) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)		
	1	32-Bit Binary Counter (default – see Note 1)	1 (read) 7 (freeze) 8 (freeze noack) 9 (freeze clear) 10 (frz. cl. noack) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)

Note 1: A Default variation refers to the variation responded when variation 0 is requested and/or in class 0, 1, 2, or 3 scans. Type 30 (Analog Input) data is limited to data that is actually possible to be used in the UR, based on the product order code. For example, Signal Source data from source numbers that cannot be used is not included. This optimizes the class 0 poll data size.

Note 2: For static (non-change-event) objects, qualifiers 17 or 28 are only responded when a request is sent with qualifiers 17 or 28, respectively. Otherwise, static object requests sent with qualifiers 00, 01, 06, 07, or 08, will be responded with qualifiers 00 or 01 (for change-event objects, qualifiers 17 or 28 are always responded.)

Note 3: Cold restarts are implemented the same as warm restarts – the UR is not restarted, but the DNP process is restarted.



Table E–2: IMPLEMENTATION TABLE (Sheet 2 of 4)

OBJECT			REQUEST		RESPONSE	
OBJECT NO.	VARIATION NO.	DESCRIPTION	FUNCTION CODES (DEC)	QUALIFIER CODES (HEX)	FUNCTION CODES (DEC)	QUALIFIER CODES (HEX)
20 con't	2	16-Bit Binary Counter	1 (read) 7 (freeze) 8 (freeze noack) 9 (freeze clear) 10 (frz. cl. noack) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
	5	32-Bit Binary Counter without Flag	1 (read) 7 (freeze) 8 (freeze noack) 9 (freeze clear) 10 (frz. cl. noack) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
	6	16-Bit Binary Counter without Flag	1 (read) 7 (freeze) 8 (freeze noack) 9 (freeze clear) 10 (frz. cl. noack) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
21	0	Frozen Counter (Variation 0 is used to request default variation)	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)		
	1	32-Bit Frozen Counter (default – see Note 1)	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
	2	16-Bit Frozen Counter	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
	9	32-Bit Frozen Counter without Flag	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
	10	16-Bit Frozen Counter without Flag	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
22	0	Counter Change Event (Variation 0 is used to request default variation)	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
	1	32-Bit Counter Change Event (default – see Note 1)	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)
	5	32-Bit Counter Change Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)
23	0	Frozen Counter Event (Variation 0 is used to request default variation)	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
	1	32-Bit Frozen Counter Event (default – see Note 1)	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)
	5	32-Bit Frozen Counter Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)

Note 1: A Default variation refers to the variation responded when variation 0 is requested and/or in class 0, 1, 2, or 3 scans. Type 30 (Analog Input) data is limited to data that is actually possible to be used in the UR, based on the product order code. For example, Signal Source data from source numbers that cannot be used is not included. This optimizes the class 0 poll data size.

Note 2: For static (non-change-event) objects, qualifiers 17 or 28 are only responded when a request is sent with qualifiers 17 or 28, respectively. Otherwise, static object requests sent with qualifiers 00, 01, 06, 07, or 08, will be responded with qualifiers 00 or 01 (for change-event objects, qualifiers 17 or 28 are always responded.)

Note 3: Cold restarts are implemented the same as warm restarts – the UR is not restarted, but the DNP process is restarted.

Table E–2: IMPLEMENTATION TABLE (Sheet 3 of 4)

OBJECT			REQUEST		RESPONSE	
OBJECT NO.	VARIATION NO.	DESCRIPTION	FUNCTION CODES (DEC)	QUALIFIER CODES (HEX)	FUNCTION CODES (DEC)	QUALIFIER CODES (HEX)
30	0	Analog Input (Variation 0 is used to request default variation)	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)		
	1	32-Bit Analog Input (default – see Note 1)	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
	2	16-Bit Analog Input	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
	3	32-Bit Analog Input without Flag	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
	4	16-Bit Analog Input without Flag	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
	5	short floating point	1 (read) 22 (assign class)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
32	0	Analog Change Event (Variation 0 is used to request default variation)	1 (read)	06 (no range, or all) 07, 08 (limited qty)		
	1	32-Bit Analog Change Event without Time (default – see Note 1)	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)
	2	16-Bit Analog Change Event without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)
	3	32-Bit Analog Change Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)
	4	16-Bit Analog Change Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)
	5	short floating point Analog Change Event without Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)
	7	short floating point Analog Change Event with Time	1 (read)	06 (no range, or all) 07, 08 (limited qty)	129 (response) 130 (unsol. resp.)	17, 28 (index)
34	0	Analog Input Reporting Deadband (Variation 0 is used to request default variation)	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)		
	1	16-bit Analog Input Reporting Deadband (default – see Note 1)	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
			2 (write)	00, 01 (start-stop) 07, 08 (limited qty) 17, 28 (index)		

Note 1: A Default variation refers to the variation responded when variation 0 is requested and/or in class 0, 1, 2, or 3 scans. Type 30 (Analog Input) data is limited to data that is actually possible to be used in the UR, based on the product order code. For example, Signal Source data from source numbers that cannot be used is not included. This optimizes the class 0 poll data size.

Note 2: For static (non-change-event) objects, qualifiers 17 or 28 are only responded when a request is sent with qualifiers 17 or 28, respectively. Otherwise, static object requests sent with qualifiers 00, 01, 06, 07, or 08, will be responded with qualifiers 00 or 01 (for change-event objects, qualifiers 17 or 28 are always responded.)

Note 3: Cold restarts are implemented the same as warm restarts – the UR is not restarted, but the DNP process is restarted.

Table E–2: IMPLEMENTATION TABLE (Sheet 4 of 4)

OBJECT			REQUEST		RESPONSE	
OBJECT NO.	VARIATION NO.	DESCRIPTION	FUNCTION CODES (DEC)	QUALIFIER CODES (HEX)	FUNCTION CODES (DEC)	QUALIFIER CODES (HEX)
34 con't	2	32-bit Analog Input Reporting Deadband (default – see Note 1)	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
			2 (write)	00, 01 (start-stop) 07, 08 (limited qty) 17, 28 (index)		
	3	Short floating point Analog Input Reporting Deadband	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
50	0	Time and Date	1 (read)	00, 01 (start-stop) 06 (no range, or all) 07, 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
	1	Time and Date (default – see Note 1)	1 (read) 2 (write)	00, 01 (start-stop) 06 (no range, or all) 07 (limited qty=1) 08 (limited qty) 17, 28 (index)	129 (response)	00, 01 (start-stop) 17, 28 (index) (see Note 2)
52	2	Time Delay Fine			129 (response)	07 (limited qty) (qty = 1)
60	0	Class 0, 1, 2, and 3 Data	1 (read) 20 (enable unsol) 21 (disable unsol) 22 (assign class)	06 (no range, or all)		
	1	Class 0 Data	1 (read) 22 (assign class)	06 (no range, or all)		
	2	Class 1 Data	1 (read) 20 (enable unsol) 21 (disable unsol) 22 (assign class)	06 (no range, or all) 07, 08 (limited qty)		
	3	Class 2 Data	1 (read) 20 (enable unsol) 21 (disable unsol) 22 (assign class)	06 (no range, or all) 07, 08 (limited qty)		
	4	Class 3 Data	1 (read) 20 (enable unsol) 21 (disable unsol) 22 (assign class)	06 (no range, or all) 07, 08 (limited qty)		
80	1	Internal Indications	2 (write)	00 (start-stop) (index must =7)		
---		No Object (function code only) see Note 3	13 (cold restart)			
---		No Object (function code only)	14 (warm restart)			
---		No Object (function code only)	23 (delay meas.)			

Note 1: A Default variation refers to the variation responded when variation 0 is requested and/or in class 0, 1, 2, or 3 scans. Type 30 (Analog Input) data is limited to data that is actually possible to be used in the UR, based on the product order code. For example, Signal Source data from source numbers that cannot be used is not included. This optimizes the class 0 poll data size.

Note 2: For static (non-change-event) objects, qualifiers 17 or 28 are only responded when a request is sent with qualifiers 17 or 28, respectively. Otherwise, static object requests sent with qualifiers 00, 01, 06, 07, or 08, will be responded with qualifiers 00 or 01 (for change-event objects, qualifiers 17 or 28 are always responded.)

Note 3: Cold restarts are implemented the same as warm restarts – the UR is not restarted, but the DNP process is restarted.

## E.3.1 BINARY INPUT POINTS

The following table lists both Binary Counters (Object 20) and Frozen Counters (Object 21). When a freeze function is performed on a Binary Counter point, the frozen value is available in the corresponding Frozen Counter point.

**BINARY INPUT POINTS**

Static (Steady-State) Object Number: **1**

Change Event Object Number: **2**

Request Function Codes supported: **1 (read), 22 (assign class)**

Static Variation reported when variation 0 requested: **2 (Binary Input with status)**

Change Event Variation reported when variation 0 requested: **2 (Binary Input Change with Time)**

Change Event Scan Rate: **8 times per power system cycle**

Change Event Buffer Size: **1000**

Table E-3: BINARY INPUTS (Sheet 1 of 10)

POINT INDEX	NAME/DESCRIPTION	CHANGE EVENT CLASS (1/2/3/NONE)
0	Virtual Input 1	2
1	Virtual Input 2	2
2	Virtual Input 3	2
3	Virtual Input 4	2
4	Virtual Input 5	2
5	Virtual Input 6	2
6	Virtual Input 7	2
7	Virtual Input 8	2
8	Virtual Input 9	2
9	Virtual Input 10	2
10	Virtual Input 11	2
11	Virtual Input 12	2
12	Virtual Input 13	2
13	Virtual Input 14	2
14	Virtual Input 15	2
15	Virtual Input 16	2
16	Virtual Input 17	2
17	Virtual Input 18	2
18	Virtual Input 19	2
19	Virtual Input 20	2
20	Virtual Input 21	2
21	Virtual Input 22	2
22	Virtual Input 23	2
23	Virtual Input 24	2
24	Virtual Input 25	2
25	Virtual Input 26	2
26	Virtual Input 27	2
27	Virtual Input 28	2
28	Virtual Input 29	2
29	Virtual Input 30	2
30	Virtual Input 31	2
31	Virtual Input 32	2

Table E-3: BINARY INPUTS (Sheet 2 of 10)

POINT INDEX	NAME/DESCRIPTION	CHANGE EVENT CLASS (1/2/3/NONE)
32	Virtual Output 1	2
33	Virtual Output 2	2
34	Virtual Output 3	2
35	Virtual Output 4	2
36	Virtual Output 5	2
37	Virtual Output 6	2
38	Virtual Output 7	2
39	Virtual Output 8	2
40	Virtual Output 9	2
41	Virtual Output 10	2
42	Virtual Output 11	2
43	Virtual Output 12	2
44	Virtual Output 13	2
45	Virtual Output 14	2
46	Virtual Output 15	2
47	Virtual Output 16	2
48	Virtual Output 17	2
49	Virtual Output 18	2
50	Virtual Output 19	2
51	Virtual Output 20	2
52	Virtual Output 21	2
53	Virtual Output 22	2
54	Virtual Output 23	2
55	Virtual Output 24	2
56	Virtual Output 25	2
57	Virtual Output 26	2
58	Virtual Output 27	2
59	Virtual Output 28	2
60	Virtual Output 29	2
61	Virtual Output 30	2
62	Virtual Output 31	2
63	Virtual Output 32	2

Table E-3: BINARY INPUTS (Sheet 3 of 10)

POINT INDEX	NAME/DESCRIPTION	CHANGE EVENT CLASS (1/2/3/NONE)
64	Virtual Output 33	2
65	Virtual Output 34	2
66	Virtual Output 35	2
67	Virtual Output 36	2
68	Virtual Output 37	2
69	Virtual Output 38	2
70	Virtual Output 39	2
71	Virtual Output 40	2
72	Virtual Output 41	2
73	Virtual Output 42	2
74	Virtual Output 43	2
75	Virtual Output 44	2
76	Virtual Output 45	2
77	Virtual Output 46	2
78	Virtual Output 47	2
79	Virtual Output 48	2
80	Virtual Output 49	2
81	Virtual Output 50	2
82	Virtual Output 51	2
83	Virtual Output 52	2
84	Virtual Output 53	2
85	Virtual Output 54	2
86	Virtual Output 55	2
87	Virtual Output 56	2
88	Virtual Output 57	2
89	Virtual Output 58	2
90	Virtual Output 59	2
91	Virtual Output 60	2
92	Virtual Output 61	2
93	Virtual Output 62	2
94	Virtual Output 63	2
95	Virtual Output 64	2
96	Contact Input 1	1
97	Contact Input 2	1
98	Contact Input 3	1
99	Contact Input 4	1
100	Contact Input 5	1
101	Contact Input 6	1
102	Contact Input 7	1
103	Contact Input 8	1
104	Contact Input 9	1
105	Contact Input 10	1
106	Contact Input 11	1
107	Contact Input 12	1
108	Contact Input 13	1
109	Contact Input 14	1
110	Contact Input 15	1
111	Contact Input 16	1
112	Contact Input 17	1
113	Contact Input 18	1
114	Contact Input 19	1

Table E-3: BINARY INPUTS (Sheet 4 of 10)

POINT INDEX	NAME/DESCRIPTION	CHANGE EVENT CLASS (1/2/3/NONE)
115	Contact Input 20	1
116	Contact Input 21	1
117	Contact Input 22	1
118	Contact Input 23	1
119	Contact Input 24	1
120	Contact Input 25	1
121	Contact Input 26	1
122	Contact Input 27	1
123	Contact Input 28	1
124	Contact Input 29	1
125	Contact Input 30	1
126	Contact Input 31	1
127	Contact Input 32	1
128	Contact Input 33	1
129	Contact Input 34	1
130	Contact Input 35	1
131	Contact Input 36	1
132	Contact Input 37	1
133	Contact Input 38	1
134	Contact Input 39	1
135	Contact Input 40	1
136	Contact Input 41	1
137	Contact Input 42	1
138	Contact Input 43	1
139	Contact Input 44	1
140	Contact Input 45	1
141	Contact Input 46	1
142	Contact Input 47	1
143	Contact Input 48	1
144	Contact Input 49	1
145	Contact Input 50	1
146	Contact Input 51	1
147	Contact Input 52	1
148	Contact Input 53	1
149	Contact Input 54	1
150	Contact Input 55	1
151	Contact Input 56	1
152	Contact Input 57	1
153	Contact Input 58	1
154	Contact Input 59	1
155	Contact Input 60	1
156	Contact Input 61	1
157	Contact Input 62	1
158	Contact Input 63	1
159	Contact Input 64	1
160	Contact Input 65	1
161	Contact Input 66	1
162	Contact Input 67	1
163	Contact Input 68	1
164	Contact Input 69	1
165	Contact Input 70	1

Table E-3: BINARY INPUTS (Sheet 5 of 10)

POINT INDEX	NAME/DESCRIPTION	CHANGE EVENT CLASS (1/2/3/NONE)
166	Contact Input 71	1
167	Contact Input 72	1
168	Contact Input 73	1
169	Contact Input 74	1
170	Contact Input 75	1
171	Contact Input 76	1
172	Contact Input 77	1
173	Contact Input 78	1
174	Contact Input 79	1
175	Contact Input 80	1
176	Contact Input 81	1
177	Contact Input 82	1
178	Contact Input 83	1
179	Contact Input 84	1
180	Contact Input 85	1
181	Contact Input 86	1
182	Contact Input 87	1
183	Contact Input 88	1
184	Contact Input 89	1
185	Contact Input 90	1
186	Contact Input 91	1
187	Contact Input 92	1
188	Contact Input 93	1
189	Contact Input 94	1
190	Contact Input 95	1
191	Contact Input 96	1
192	Contact Output 1	1
193	Contact Output 2	1
194	Contact Output 3	1
195	Contact Output 4	1
196	Contact Output 5	1
197	Contact Output 6	1
198	Contact Output 7	1
199	Contact Output 8	1
200	Contact Output 9	1
201	Contact Output 10	1
202	Contact Output 11	1
203	Contact Output 12	1
204	Contact Output 13	1
205	Contact Output 14	1
206	Contact Output 15	1
207	Contact Output 16	1
208	Contact Output 17	1
209	Contact Output 18	1
210	Contact Output 19	1
211	Contact Output 20	1
212	Contact Output 21	1
213	Contact Output 22	1
214	Contact Output 23	1
215	Contact Output 24	1
216	Contact Output 25	1

Table E-3: BINARY INPUTS (Sheet 6 of 10)

POINT INDEX	NAME/DESCRIPTION	CHANGE EVENT CLASS (1/2/3/NONE)
217	Contact Output 26	1
218	Contact Output 27	1
219	Contact Output 28	1
220	Contact Output 29	1
221	Contact Output 30	1
222	Contact Output 31	1
223	Contact Output 32	1
224	Contact Output 33	1
225	Contact Output 34	1
226	Contact Output 35	1
227	Contact Output 36	1
228	Contact Output 37	1
229	Contact Output 38	1
230	Contact Output 39	1
231	Contact Output 40	1
232	Contact Output 41	1
233	Contact Output 42	1
234	Contact Output 43	1
235	Contact Output 44	1
236	Contact Output 45	1
237	Contact Output 46	1
238	Contact Output 47	1
239	Contact Output 48	1
240	Contact Output 49	1
241	Contact Output 50	1
242	Contact Output 51	1
243	Contact Output 52	1
244	Contact Output 53	1
245	Contact Output 54	1
246	Contact Output 55	1
247	Contact Output 56	1
248	Contact Output 57	1
249	Contact Output 58	1
250	Contact Output 59	1
251	Contact Output 60	1
252	Contact Output 61	1
253	Contact Output 62	1
254	Contact Output 63	1
255	Contact Output 64	1
256	Remote Input 1	1
257	Remote Input 2	1
258	Remote Input 3	1
259	Remote Input 4	1
260	Remote Input 5	1
261	Remote Input 6	1
262	Remote Input 7	1
263	Remote Input 8	1
264	Remote Input 9	1
265	Remote Input 10	1
266	Remote Input 11	1
267	Remote Input 12	1

Table E-3: BINARY INPUTS (Sheet 7 of 10)

POINT INDEX	NAME/DESCRIPTION	CHANGE EVENT CLASS (1/2/3/NONE)
268	Remote Input 13	1
269	Remote Input 14	1
270	Remote Input 15	1
271	Remote Input 16	1
272	Remote Input 17	1
273	Remote Input 18	1
274	Remote Input 19	1
275	Remote Input 20	1
276	Remote Input 21	1
277	Remote Input 22	1
278	Remote Input 23	1
279	Remote Input 24	1
280	Remote Input 25	1
281	Remote Input 26	1
282	Remote Input 27	1
283	Remote Input 28	1
284	Remote Input 29	1
285	Remote Input 30	1
286	Remote Input 31	1
287	Remote Input 32	1
288	Remote Device 1	1
289	Remote Device 2	1
290	Remote Device 3	1
291	Remote Device 4	1
292	Remote Device 5	1
293	Remote Device 6	1
294	Remote Device 7	1
295	Remote Device 8	1
296	Remote Device 9	1
297	Remote Device 10	1
298	Remote Device 11	1
299	Remote Device 12	1
300	Remote Device 13	1
301	Remote Device 14	1
302	Remote Device 15	1
303	Remote Device 16	1
304	PHASE IOC1 Element OP	1
320	PHASE TOC1 Element OP	1
328	PH DIR1 Element OP	1
329	PH DIR2 Element OP	1
336	NEUTRAL IOC1 Element OP	1
352	NEUTRAL TOC1 Element OP	1
360	NTRL DIR OC1 Element OP	1
361	NTRL DIR OC2 Element OP	1
368	GROUND IOC1 Element OP	1
384	GROUND TOC1 Element OP	1
416	NEG SEQ TOC1 Element OP	1
417	NEG SEQ TOC2 Element OP	1
444	AUX UV1 Element OP	1
448	PHASE UV1 Element OP	1
449	PHASE UV2 Element OP	1

Table E-3: BINARY INPUTS (Sheet 8 of 10)

POINT INDEX	NAME/DESCRIPTION	CHANGE EVENT CLASS (1/2/3/NONE)
452	AUX OV1 Element OP	1
456	PHASE OV1 Element OP	1
460	NEUTRAL OV1 Element OP	1
494	POWER SWING Element OP	1
514	VOLTS PER HERTZ1 Elem. OP	1
515	VOLTS PER HERTZ2 Elem. OP	1
518	DIR POWER1 Element OP	1
519	DIR POWER2 Element OP	1
525	100% STATOR Element OP	1
528	SRC1 VT FUSE FAIL Elem OP	1
529	SRC2 VT FUSE FAIL Elem OP	1
530	SRC3 VT FUSE FAIL Elem OP	1
531	SRC4 VT FUSE FAIL Elem OP	1
532	SRC5 VT FUSE FAIL Elem OP	1
533	SRC6 VT FUSE FAIL Elem OP	1
569	STATOR DIFF Element OP	1
600	ACCDNT ENRG Element OP	1
604	LOSS EXCIT Element OP	1
616	SYNC 1 Element OP	1
617	SYNC 2 Element OP	1
634	3RD HARM NTRL UV Elem. OP	1
640	SETTING GROUP Element OP	1
641	RESET Element OP	1
648	OVERFREQ1 Element OP	1
649	OVERFREQ2 Element OP	1
650	OVERFREQ3 Element OP	1
651	OVERFREQ4 Element OP	1
655	OVERFREQ Element OP	1
656	UNDERFREQ 1 Element OP	1
657	UNDERFREQ 2 Element OP	1
658	UNDERFREQ 3 Element OP	1
659	UNDERFREQ 4 Element OP	1
660	UNDERFREQ 5 Element OP	1
661	UNDERFREQ 6 Element OP	1
704	FLEXELEMENT 1 Element OP	1
705	FLEXELEMENT 2 Element OP	1
706	FLEXELEMENT 3 Element OP	1
707	FLEXELEMENT 4 Element OP	1
708	FLEXELEMENT 5 Element OP	1
709	FLEXELEMENT 6 Element OP	1
710	FLEXELEMENT 7 Element OP	1
711	FLEXELEMENT 8 Element OP	1
712	FLEXELEMENT 9 Element OP	1
713	FLEXELEMENT 10 Element OP	1
714	FLEXELEMENT 11 Element OP	1
715	FLEXELEMENT 12 Element OP	1
716	FLEXELEMENT 13 Element OP	1
717	FLEXELEMENT 14 Element OP	1
718	FLEXELEMENT 15 Element OP	1
719	FLEXELEMENT 16 Element OP	1
816	DIG ELEM 1 Element OP	1

Table E-3: BINARY INPUTS (Sheet 9 of 10)

POINT INDEX	NAME/DESCRIPTION	CHANGE EVENT CLASS (1/2/3/NONE)
817	DIG ELEM 2 Element OP	1
818	DIG ELEM 3 Element OP	1
819	DIG ELEM 4 Element OP	1
820	DIG ELEM 5 Element OP	1
821	DIG ELEM 6 Element OP	1
822	DIG ELEM 7 Element OP	1
823	DIG ELEM 8 Element OP	1
824	DIG ELEM 9 Element OP	1
825	DIG ELEM 10 Element OP	1
826	DIG ELEM 11 Element OP	1
827	DIG ELEM 12 Element OP	1
828	DIG ELEM 13 Element OP	1
829	DIG ELEM 14 Element OP	1
830	DIG ELEM 15 Element OP	1
831	DIG ELEM 16 Element OP	1
848	COUNTER 1 Element OP	1
849	COUNTER 2 Element OP	1
850	COUNTER 3 Element OP	1
851	COUNTER 4 Element OP	1
852	COUNTER 5 Element OP	1
853	COUNTER 6 Element OP	1
854	COUNTER 7 Element OP	1
855	COUNTER 8 Element OP	1
864	LED State 1 (IN SERVICE)	1
865	LED State 2 (TROUBLE)	1
866	LED State 3 (TEST MODE)	1
867	LED State 4 (TRIP)	1
868	LED State 5 (ALARM)	1
869	LED State 6(PICKUP)	1
880	LED State 9 (VOLTAGE)	1
881	LED State 10 (CURRENT)	1
882	LED State 11 (FREQUENCY)	1
883	LED State 12 (OTHER)	1
884	LED State 13 (PHASE A)	1
885	LED State 14 (PHASE B)	1
886	LED State 15 (PHASE C)	1
887	LED State 16 (NTL/GROUND)	1
899	BATTERY FAIL	1
900	PRI ETHERNET FAIL	1
901	SEC ETHERNET FAIL	1
902	EPROM DATA ERROR	1
903	SRAM DATA ERROR	1
904	PROGRAM MEMORY	1
905	WATCHDOG ERROR	1
906	LOW ON MEMORY	1
907	REMOTE DEVICE OFF	1
910	Any Major Error	1
911	Any Minor Error	1
912	Any Self-Tests	1
913	IRIG-B FAILURE	1
914	DSP ERROR	1

Table E-3: BINARY INPUTS (Sheet 10 of 10)

POINT INDEX	NAME/DESCRIPTION	CHANGE EVENT CLASS (1/2/3/NONE)
915	Not Used	
916	NO DSP INTERRUPTS	1
917	UNIT NOT CALIBRATED	1
921	PROTOTYPE FIRMWARE	1
922	FLEXLOGIC ERR TOKEN	1
923	EQUIPMENT MISMATCH	1
925	UNIT NOT PROGRAMMED	1
926	SYSTEM EXCEPTION	1



## E.3.2 BINARY OUTPUT AND CONTROL RELAY OUTPUT

Supported Control Relay Output Block fields: Pulse On, Pulse Off, Latch On, Latch Off, Paired Trip, Paired Close.

**BINARY OUTPUT STATUS POINTS**

Object Number: **10**

Request Function Codes supported: **1 (read)**

Default Variation reported when variation 0 requested: **2 (Binary Output Status)**

**CONTROL RELAY OUTPUT BLOCKS**

Object Number: **12**

Request Function Codes supported: **3 (select), 4 (operate), 5 (direct operate), 6 (direct operate, noack)**

**Table E-4: BINARY/CONTROL OUTPUT POINT LIST**

POINT INDEX	NAME/DESCRIPTION
0	Virtual Input 1
1	Virtual Input 2
2	Virtual Input 3
3	Virtual Input 4
4	Virtual Input 5
5	Virtual Input 6
6	Virtual Input 7
7	Virtual Input 8
8	Virtual Input 9
9	Virtual Input 10
10	Virtual Input 11
11	Virtual Input 12
12	Virtual Input 13
13	Virtual Input 14
14	Virtual Input 15
15	Virtual Input 16
16	Virtual Input 17
17	Virtual Input 18
18	Virtual Input 19
19	Virtual Input 20
20	Virtual Input 21
21	Virtual Input 22
22	Virtual Input 23
23	Virtual Input 24
24	Virtual Input 25
25	Virtual Input 26
26	Virtual Input 27
27	Virtual Input 28
28	Virtual Input 29
29	Virtual Input 30
30	Virtual Input 31
31	Virtual Input 32

## E.3.3 COUNTERS

The following table lists both Binary Counters (Object 20) and Frozen Counters (Object 21). When a freeze function is performed on a Binary Counter point, the frozen value is available in the corresponding Frozen Counter point.

**BINARY COUNTERS**

Static (Steady-State) Object Number: **20**

Change Event Object Number: **22**

Request Function Codes supported: **1 (read), 7 (freeze), 8 (freeze noack), 9 (freeze and clear), 10 (freeze and clear, noack), 22 (assign class)**

Static Variation reported when variation 0 requested: **1 (32-Bit Binary Counter with Flag)**

Change Event Variation reported when variation 0 requested: **1 (32-Bit Counter Change Event without time)**

Change Event Buffer Size: **10**

Default Class for all points: **2**

**FROZEN COUNTERS**

Static (Steady-State) Object Number: **21**

Change Event Object Number: **23**

Request Function Codes supported: **1 (read)**

Static Variation reported when variation 0 requested: **1 (32-Bit Frozen Counter with Flag)**

Change Event Variation reported when variation 0 requested: **1 (32-Bit Frozen Counter Event without time)**

Change Event Buffer Size: **10**

Default Class for all points: **2**

Table E-5: BINARY and FROZEN COUNTERS

POINT INDEX	NAME/DESCRIPTION
0	Digital Counter 1
1	Digital Counter 2
2	Digital Counter 3
3	Digital Counter 4
4	Digital Counter 5
5	Digital Counter 6
6	Digital Counter 7

Table E-5: BINARY and FROZEN COUNTERS

POINT INDEX	NAME/DESCRIPTION
7	Digital Counter 8
8	Oscillography Trigger Count
9	Events Since Last Clear

Note that a counter freeze command has no meaning for counters 8 and 9.

## E.3.4 ANALOG INPUTS

The following table lists Analog Inputs (Object 30). It is important to note that 16-bit and 32-bit variations of Analog Inputs are transmitted through DNP as signed numbers. Even for analog input points that are not valid as negative values, the maximum positive representation is 32767. This is a DNP requirement.

The deadbands for all Analog Input points are in the same units as the Analog Input quantity. For example, an Analog Input quantity measured in volts has a corresponding deadband in units of volts. This is in conformance with DNP Technical Bulletin 9809-001 Analog Input Reporting Deadband. Relay settings are available to set default deadband values according to data type. Deadbands for individual Analog Input Points can be set using DNP Object 34.

When using the UR in DNP systems with limited memory, the ANALOG INPUT POINTS LIST below may be replaced with a user-definable list. This user-definable list uses the same settings as the Modbus User Map and can be configured with the MODBUS USER MAP settings. When used with DNP, each entry in the Modbus User Map represents the starting Modbus address of a data item available as a DNP Analog Input point. To enable use of the Modbus User Map for DNP Analog Input points, set the **USER MAP FOR DNP ANALOGS** setting to Enabled (this setting is in the **PRODUCT SETUP** ⇒ **COMMUNICATIONS** ⇒ **DNP PROTOCOL** menu). The new DNP Analog points list can be checked via the "DNP Analog Input Points List" webpage, accessible from the "Device Information menu" webpage.



After changing the **USER MAP FOR DNP ANALOGS** setting, the relay must be powered off and then back on for the setting to take effect.

Only Source 1 data points are shown in the following table. If the **NUMBER OF SOURCES IN ANALOG LIST** setting is increased, data points for subsequent sources will be added to the list immediately following the Source 1 data points.

Units for Analog Input points are as follows:

- |                   |     |              |           |
|-------------------|-----|--------------|-----------|
| • Current:        | A   | • Energy:    | Wh, varh  |
| • Voltage:        | V   | • Frequency: | Hz        |
| • Real Power:     | W   | • Angle:     | degrees   |
| • Reactive Power: | var | • Ohm Input: | Ohms      |
| • Apparent Power: | VA  | • RTD Input: | degrees C |

Static (Steady-State) Object Number: **30**

Change Event Object Number: **32**

Request Function Codes supported: **1 (read), 2 (write, deadbands only), 22 (assign class)**

Static Variation reported when variation 0 requested: **1 (32-Bit Analog Input)**

Change Event Variation reported when variation 0 requested: **1 (Analog Change Event w/o Time)**

Change Event Scan Rate: defaults to **500 ms**.

Change Event Buffer Size: **800**

Default Class for all Points: **1**

**Table E-6: ANALOG INPUT POINTS (Sheet 1 of 4)**

POINT	DESCRIPTION
0	SRC 1 Phase A Current RMS
1	SRC 1 Phase B Current RMS
2	SRC 1 Phase C Current RMS
3	SRC 1 Neutral Current RMS
4	SRC 1 Phase A Current Magnitude
5	SRC 1 Phase A Current Angle
6	SRC 1 Phase B Current Magnitude

**Table E-6: ANALOG INPUT POINTS (Sheet 2 of 4)**

POINT	DESCRIPTION
7	SRC 1 Phase B Current Angle
8	SRC 1 Phase C Current Magnitude
9	SRC 1 Phase C Current Angle
10	SRC 1 Neutral Current Magnitude
11	SRC 1 Neutral Current Angle
12	SRC 1 Ground Current RMS
13	SRC 1 Ground Current Magnitude

Table E-6: ANALOG INPUT POINTS (Sheet 3 of 4)

POINT	DESCRIPTION
14	SRC 1 Ground Current Angle
15	SRC 1 Zero Sequence Current Magnitude
16	SRC 1 Zero Sequence Current Angle
17	SRC 1 Positive Sequence Current Magnitude
18	SRC 1 Positive Sequence Current Angle
19	SRC 1 Negative Sequence Current Magnitude
20	SRC 1 Negative Sequence Current Angle
21	SRC 1 Differential Ground Current Magnitude
22	SRC 1 Differential Ground Current Angle
23	SRC 1 Phase AG Voltage RMS
24	SRC 1 Phase BG Voltage RMS
25	SRC 1 Phase CG Voltage RMS
26	SRC 1 Phase AG Voltage Magnitude
27	SRC 1 Phase AG Voltage Angle
28	SRC 1 Phase BG Voltage Magnitude
29	SRC 1 Phase BG Voltage Angle
30	SRC 1 Phase CG Voltage Magnitude
31	SRC 1 Phase CG Voltage Angle
32	SRC 1 Phase AB Voltage RMS
33	SRC 1 Phase BC Voltage RMS
34	SRC 1 Phase CA Voltage RMS
35	SRC 1 Phase AB Voltage Magnitude
36	SRC 1 Phase AB Voltage Angle
37	SRC 1 Phase BC Voltage Magnitude
38	SRC 1 Phase BC Voltage Angle
39	SRC 1 Phase CA Voltage Magnitude
40	SRC 1 Phase CA Voltage Angle
41	SRC 1 Auxiliary Voltage RMS
42	SRC 1 Auxiliary Voltage Magnitude
43	SRC 1 Auxiliary Voltage Angle
44	SRC 1 Zero Sequence Voltage Magnitude
45	SRC 1 Zero Sequence Voltage Angle
46	SRC 1 Positive Sequence Voltage Magnitude
47	SRC 1 Positive Sequence Voltage Angle
48	SRC 1 Negative Sequence Voltage Magnitude
49	SRC 1 Negative Sequence Voltage Angle
50	SRC 1 Three Phase Real Power
51	SRC 1 Phase A Real Power
52	SRC 1 Phase B Real Power
53	SRC 1 Phase C Real Power
54	SRC 1 Three Phase Reactive Power
55	SRC 1 Phase A Reactive Power
56	SRC 1 Phase B Reactive Power
57	SRC 1 Phase C Reactive Power
58	SRC 1 Three Phase Apparent Power
59	SRC 1 Phase A Apparent Power
60	SRC 1 Phase B Apparent Power
61	SRC 1 Phase C Apparent Power
62	SRC 1 Three Phase Power Factor

Table E-6: ANALOG INPUT POINTS (Sheet 4 of 4)

POINT	DESCRIPTION
63	SRC 1 Phase A Power Factor
64	SRC 1 Phase B Power Factor
65	SRC 1 Phase C Power Factor
66	SRC 1 Positive Watthour
67	SRC 1 Negative Watthour
68	SRC 1 Positive Varhour
69	SRC 1 Negative Varhour
70	SRC 1 Frequency
71	Stator Differential Iad
72	Stator Restraint Iar
73	Stator Differential Ibd
74	Stator Restraint Ibr
75	Stator Differential Icd
76	Stator Restraint Icr
77	Stator Ground Vn 3rd
78	Stator Ground Vn V0 3rd
79	Sens Dir Power 1 Actual
80	Sens Dir Power 2 Actual
81	Synchrocheck 1 Delta Voltage
82	Synchrocheck 1 Delta Frequency
83	Synchrocheck 1 Delta Phase
84	Synchrocheck 2 Delta Voltage
85	Synchrocheck 2 Delta Frequency
86	Synchrocheck 2 Delta Phase
87	Power Swing S1 S2 Angle
88	Tracking Frequency
89	FlexElement 1 Actual
90	FlexElement 2 Actual
91	FlexElement 3 Actual
92	FlexElement 4 Actual
93	FlexElement 5 Actual
94	FlexElement 6 Actual
95	FlexElement 7 Actual
96	FlexElement 8 Actual
97	FlexElement 9 Actual
98	FlexElement 10 Actual
99	FlexElement 11 Actual
100	FlexElement 12 Actual
101	FlexElement 13 Actual
102	FlexElement 14 Actual
103	FlexElement 15 Actual
104	FlexElement 16 Actual
105	Current Setting Group
106	VHZ 1 Actual
107	VHZ 2 Actual

## F.1.1 REVISION HISTORY

Table F-1: REVISION HISTORY

MANUAL P/N	G60 REVISION	RELEASE DATE	ECO
1601-0110-B1	2.8X	27 September 2001	URG-001
1601-0110-B2	2.9X	03 December 2001	URG-002
1601-0110-B3	2.9X	23 January 2001	URG-003

## F.1.2 CHANGES IN G60 MANUAL

Table F-2: MAJOR UPDATES FOR G60 MANUAL-B3

PAGE (B1)	CHANGE	DESCRIPTION
Title	Update	Manual part number from B2 to B3
5-2	Add	Added MONITORING ELEMENTS item to settings main menu
5-112	Add	Added MONITORING ELEMENTS: VT FUSE FAILURE section

Table F-3: MAJOR UPDATES FOR G60 MANUAL-B2

PAGE (B1)	CHANGE	DESCRIPTION
Title	Update	Manual part number from B1 to B2
2-2	Update	Updated SINGLE LINE DIAGRAM from 830710A5 to 830710A6
2-2	Update	Updated OTHER DEVICE FUNCTIONS table to include Generator Unbalance and IEC 60870-5-104 Communications protocol
2-6	Add	Added specifications for GENERATOR UNBALANCE element
2-5	Update	Updated specifications for AUTORECLOSURE
5-30	Update	Updated FLEXLOGIC OPERANDS table
5-52	Update	Updated STATOR DIFFERENTIAL section to include state machine information
5-76	Remove	Removed NEGATIVE SEQUENCE TOC sub-section
5-76	Add	Added GENERATOR UNBALANCE section
5-83	Update	Updated AUXILIARY OV1 sub-section
8-1	Update	Updated COMMISSIONING chapter to reflect new 2.9X settings
B-11	Update	MODBUS MEMORY MAP updated for version 2.9X firmware
D-1	Add	Added IEC 60870-5-104 INTEROPERABILITY DOCUMENT

## F.2.1 LIST OF FIGURES

Figure 1–1: REAR NAME-PLATE (EXAMPLE).....	1-1
Figure 1–2: UR CONCEPT BLOCK DIAGRAM .....	1-3
Figure 1–3: UR SCAN OPERATION.....	1-4
Figure 1–4: RELAY COMMUNICATIONS OPTIONS .....	1-8
Figure 2–1: SINGLE LINE DIAGRAM .....	2-2
Figure 3–1: G60 VERTICAL MOUNTING AND DIMENSIONS.....	3-1
Figure 3–2: G60 VERTICAL SIDE MOUNTING INSTALLATION .....	3-2
Figure 3–3: G60 VERTICAL SIDE MOUNTING REAR DIMENSIONS.....	3-3
Figure 3–4: G60 HORIZONTAL MOUNTING AND DIMENSIONS .....	3-3
Figure 3–5: UR MODULE WITHDRAWAL/INSERTION .....	3-4
Figure 3–6: REAR TERMINAL VIEW.....	3-5
Figure 3–7: EXAMPLE OF MODULES IN F & H SLOTS.....	3-5
Figure 3–8: TYPICAL WIRING DIAGRAM.....	3-6
Figure 3–9: CONTROL POWER CONNECTION.....	3-8
Figure 3–10: ZERO-SEQUENCE CORE BALANCE CT INSTALLATION .....	3-9
Figure 3–11: CT/VT MODULE WIRING .....	3-9
Figure 3–12: CT MODULE WIRING .....	3-9
Figure 3–13: FORM-A CONTACT FUNCTIONS .....	3-10
Figure 3–14: DIGITAL I/O MODULE WIRING (SHEET 1 OF 2) .....	3-13
Figure 3–15: DIGITAL I/O MODULE WIRING (SHEET 2 OF 2) .....	3-14
Figure 3–16: DRY AND WET CONTACT INPUT CONNECTIONS .....	3-15
Figure 3–17: TRANSDUCER I/O MODULE WIRING .....	3-16
Figure 3–18: RS232 FACEPLATE PORT CONNECTION.....	3-17
Figure 3–19: CPU MODULE COMMUNICATIONS WIRING .....	3-17
Figure 3–20: RS485 SERIAL CONNECTION.....	3-18
Figure 3–21: IRIG-B CONNECTION.....	3-19
Figure 4–1: URPC SOFTWARE MAIN WINDOW.....	4-3
Figure 4–2: UR HORIZONTAL FACEPLATE PANELS .....	4-4
Figure 4–3: UR VERTICAL FACEPLATE PANELS .....	4-4
Figure 4–4: LED PANEL 1 .....	4-5
Figure 4–5: LED PANELS 2 AND 3 (INDEX TEMPLATE).....	4-6
Figure 4–6: LED PANEL CUSTOMIZATION TEMPLATES (EXAMPLE).....	4-8
Figure 4–7: KEYPAD .....	4-8
Figure 5–1: BREAKER-AND-A-HALF SCHEME.....	5-5
Figure 5–2: EXAMPLE USE OF SOURCES.....	5-26
Figure 5–3: UR ARCHITECTURE OVERVIEW .....	5-28
Figure 5–4: EXAMPLE LOGIC SCHEME .....	5-35
Figure 5–5: LOGIC EXAMPLE WITH VIRTUAL OUTPUTS .....	5-36
Figure 5–6: LOGIC FOR VIRTUAL OUTPUT 3 .....	5-36
Figure 5–7: LOGIC FOR VIRTUAL OUTPUT 4 .....	5-37
Figure 5–8: FLEXLOGIC™ WORKSHEET .....	5-37
Figure 5–9: FLEXLOGIC™ EQUATION & LOGIC FOR VIRTUAL OUTPUT 3 .....	5-38
Figure 5–10: FLEXLOGIC™ EQUATION & LOGIC FOR VIRTUAL OUTPUT 4 .....	5-39
Figure 5–11: FLEXELEMENT™ SCHEME LOGIC.....	5-42
Figure 5–12: FLEXELEMENT™ DIRECTION, PICKUP, AND HYSTERESIS.....	5-43
Figure 5–13: FLEXELEMENT™ INPUT MODE SETTING .....	5-43
Figure 5–14: POWER SWING DETECT ELEMENT OPERATING CHARACTERISTICS.....	5-48
Figure 5–15: POWER SWING DETECT LOGIC (1 of 2) .....	5-48
Figure 5–16: POWER SWING DETECT LOGIC (2 of 2) .....	5-49
Figure 5–17: STATOR DIFFERENTIAL CHARACTERISTIC .....	5-52
Figure 5–18: STATOR DIFFERENTIAL LOGIC.....	5-53
Figure 5–19: SATURATION DETECTOR STATE MACHINE .....	5-54
Figure 5–20: STATOR DIFFERENTIAL FINAL OUTPUT LOGIC.....	5-55
Figure 5–21: VOLTAGE RESTRAINT CHARACTERISTIC FOR PHASE TOC.....	5-62
Figure 5–22: PHASE TOC1 SCHEME LOGIC.....	5-62
Figure 5–23: PHASE IOC1 SCHEME LOGIC.....	5-63
Figure 5–24: PHASE A DIRECTIONAL POLARIZATION .....	5-64
Figure 5–25: PHASE DIRECTIONAL SCHEME LOGIC .....	5-66
Figure 5–26: NEUTRAL TOC1 SCHEME LOGIC .....	5-67
Figure 5–27: NEUTRAL IOC1 SCHEME LOGIC .....	5-68
Figure 5–28: NEUTRAL DIRECTIONAL VOLTAGE-POLARIZED CHARACTERISTICS .....	5-71
Figure 5–29: NEUTRAL DIRECTIONAL OC1 SCHEME LOGIC .....	5-73

Figure 5-30: GROUND TOC1 SCHEME LOGIC .....	5-74
Figure 5-31: GROUND IOC1 SCHEME LOGIC .....	5-75
Figure 5-32: GENERATOR UNBALANCE INVERSE TIME CURVES .....	5-77
Figure 5-33: GENERATOR UNBALANCE SCHEME LOGIC .....	5-77
Figure 5-34: INVERSE TIME UNDERVOLTAGE CURVES .....	5-78
Figure 5-35: PHASE UV1 SCHEME LOGIC .....	5-79
Figure 5-36: PHASE OV1 SCHEME LOGIC .....	5-80
Figure 5-37: NEUTRAL OVERVOLTAGE SCHEME LOGIC .....	5-81
Figure 5-38: NEG SEQ OV SCHEME LOGIC .....	5-82
Figure 5-39: AUXILIARY UNDERVOLTAGE SCHEME LOGIC .....	5-83
Figure 5-40: AUXILIARY OVERVOLTAGE SCHEME LOGIC .....	5-84
Figure 5-41: VOLTS PER HERTZ LOGIC .....	5-86
Figure 5-42: LOSS OF EXCITATION OPERATING CHARACTERISTICS .....	5-88
Figure 5-43: LOSS OF EXCITATION SCHEME LOGIC .....	5-89
Figure 5-44: ACCIDENTAL ENERGIZATION SCHEME LOGIC .....	5-91
Figure 5-45: DIRECTIONAL POWER CHARACTERISTIC .....	5-93
Figure 5-46: DIRECTIONAL POWER ELEMENT SAMPLE APPLICATIONS .....	5-93
Figure 5-47: DIRECTIONAL POWER SCHEME LOGIC .....	5-94
Figure 5-48: 100% STATOR GROUND SCHEME LOGIC .....	5-97
Figure 5-49: THIRD HARMONIC NEUTRAL UNDERVOLTAGE SCHEME LOGIC .....	5-99
Figure 5-50: EXAMPLE FLEXLOGIC™ CONTROL OF A SETTINGS GROUP .....	5-100
Figure 5-51: UNDERFREQUENCY SCHEME LOGIC .....	5-101
Figure 5-52: OVERFREQUENCY SCHEME LOGIC .....	5-102
Figure 5-53: SYNCHROCHECK SCHEME LOGIC .....	5-106
Figure 5-54: DIGITAL ELEMENT SCHEME LOGIC .....	5-107
Figure 5-55: TRIP CIRCUIT EXAMPLE 1 .....	5-108
Figure 5-56: TRIP CIRCUIT EXAMPLE 2 .....	5-109
Figure 5-57: DIGITAL COUNTER SCHEME LOGIC .....	5-111
Figure 5-58: INPUT CONTACT DEBOUNCING MECHANISM AND TIME-STAMPING SAMPLE TIMING .....	5-113
Figure 5-59: VIRTUAL INPUTS SCHEME LOGIC .....	5-114
Figure 6-1: FLOW DIRECTION OF SIGNED VALUES FOR WATTS AND VARS .....	6-6
Figure 6-2: UR PHASE ANGLE MEASUREMENT CONVENTION .....	6-7
Figure 6-3: ILLUSTRATION OF THE UR CONVENTION FOR SYMMETRICAL COMPONENTS .....	6-8

## F.2.2 LIST OF TABLES

Table: 2-1 ANSI DEVICE NUMBERS AND FUNCTIONS .....	2-1
Table: 2-2 OTHER DEVICE FUNCTIONS .....	2-2
Table: 2-3 ORDER CODES .....	2-3
Table: 2-4 ORDER CODES FOR REPLACEMENT MODULES .....	2-4
Table: 3-1 DIELECTRIC STRENGTH OF UR MODULE HARDWARE .....	3-7
Table: 3-2 CONTROL POWER VOLTAGE RANGE .....	3-7
Table: 3-3 DIGITAL I/O MODULE ASSIGNMENTS .....	3-11
Table: 3-4 CPU COMMUNICATION PORT OPTIONS .....	3-17
Table: 5-1 OSCILLOGRAPHY CYCLES/RECORD EXAMPLE .....	5-17
Table: 5-5 RECOMMENDED SETTINGS FOR LED PANEL 2 LABELS .....	5-19
Table: 5-9 FLEXCURVE™ TABLE .....	5-27
Table: 5-10 UR FLEXLOGIC™ OPERAND TYPES .....	5-29
Table: 5-11 G60 FLEXLOGIC™ OPERANDS .....	5-30
Table: 5-12 FLEXLOGIC™ GATE CHARACTERISTICS .....	5-34
Table: 5-13 FLEXLOGIC™ OPERATORS .....	5-34
Table: 5-14 FLEXELEMENT™ BASE UNITS .....	5-44
Table: 5-15 OVERCURRENT CURVE TYPES .....	5-56
Table: 5-16 IEEE INVERSE TIME CURVE CONSTANTS .....	5-57
Table: 5-17 IEEE CURVE TRIP TIMES (IN SECONDS) .....	5-57
Table: 5-18 IEC (BS) INVERSE TIME CURVE CONSTANTS .....	5-58
Table: 5-19 IEC CURVE TRIP TIMES (IN SECONDS) .....	5-58
Table: 5-20 GE TYPE IAC INVERSE TIME CURVE CONSTANTS .....	5-59
Table: 5-21 IAC CURVE TRIP TIMES .....	5-59
Table: 5-22 I <sup>2</sup> t CURVE TRIP TIMES .....	5-60
Table: 5-23 QUANTITIES FOR "CALCULATED 3I0" CONFIGURATION .....	5-70
Table: 5-24 QUANTITIES FOR "MEASURED IG" CONFIGURATION .....	5-70
Table: 5-25 VALUES OF RESISTOR 'R' .....	5-109
Table: 5-26 UCA DNA2 ASSIGNMENTS .....	5-118

Table: 6-1 CALCULATING VOLTAGE SYMMETRICAL COMPONENTS EXAMPLE .....	6-8
Table: 6-2 FLEXELEMENT™ BASE UNITS .....	6-13
Table: 7-1 TARGET MESSAGE PRIORITY STATUS.....	7-3
Table: 7-2 MAJOR SELF-TEST ERROR MESSAGES .....	7-4
Table: 7-3 MINOR SELF-TEST ERROR MESSAGES.....	7-4
Table: 8-1 PRODUCT SETUP .....	8-1
Table: 8-2 SYSTEM SETUP .....	8-8
Table: 8-3 FLEXCURVE™ TABLE.....	8-9
Table: 8-4 FLEXCURVE™ TABLE.....	8-10
Table: 8-5 FLEXLOGIC™ .....	8-11
Table: 8-6 GROUPED ELEMENTS.....	8-21
Table: 8-7 CONTROL ELEMENTS .....	8-25
Table: 8-8 CONTACT INPUTS.....	8-30
Table: 8-9 VIRTUAL INPUTS.....	8-31
Table: 8-10 UCA SBO TIMER.....	8-31
Table: 8-11 CONTACT OUTPUTS.....	8-32
Table: 8-12 VIRTUAL OUTPUTS .....	8-33
Table: 8-13 REMOTE DEVICES .....	8-34
Table: 8-14 REMOTE INPUTS.....	8-35
Table: 8-15 REMOTE OUTPUTS.....	8-36
Table: 8-16 DCMA INPUTS .....	8-37
Table: 8-17 RTD INPUTS.....	8-38
Table: 8-18 FORCE CONTACT INPUTS .....	8-39
Table: 8-19 FORCE CONTACT OUTPUTS .....	8-39
Table: A-1 FLEXANALOG PARAMETERS .....	A-1
Table: B-1 MODBUS PACKET FORMAT .....	B-1
Table: B-2 CRC-16 ALGORITHM .....	B-3
Table: B-3 MASTER AND SLAVE DEVICE PACKET TRANSMISSION EXAMPLE .....	B-4
Table: B-4 MASTER AND SLAVE DEVICE PACKET TRANSMISSION EXAMPLE .....	B-5
Table: B-5 SUMMARY OF OPERATION CODES (FUNCTION CODE 05H) .....	B-5
Table: B-6 MASTER AND SLAVE DEVICE PACKET TRANSMISSION EXAMPLE .....	B-5
Table: B-7 MASTER AND SLAVE DEVICE PACKET TRANSMISSION EXAMPLE .....	B-6
Table: B-8 MASTER AND SLAVE DEVICE PACKET TRANSMISSION EXAMPLE .....	B-6
Table: B-9 MODBUS MEMORY MAP .....	B-9
Table: C-1 DEVICE IDENTITY – DI .....	C-3
Table: C-2 GENERIC CONTROL – GCTL .....	C-3
Table: C-3 GENERIC INDICATOR – GIND .....	C-4
Table: C-4 GLOBAL DATA – GLOBE .....	C-4
Table: C-5 MEASUREMENT UNIT (POLYPHASE) – MMXU .....	C-4
Table: C-6 PROTECTIVE ELEMENTS .....	C-5
Table: C-7 CT RATIO INFORMATION – ctRATO .....	C-5
Table: C-8 VT RATIO INFORMATION – vtRATO .....	C-5
Table: C-9 RECLOSING RELAY – RREC .....	C-6
Table: D-1 IEC 60870-5-104 POINTS.....	D-10
Table: E-1 DNP V3.00 DEVICE PROFILE .....	E-1
Table: E-2 IMPLEMENTATION TABLE .....	E-4
Table: E-3 BINARY INPUTS .....	E-8
Table: E-4 BINARY/CONTROL OUTPUT POINT LIST .....	E-13
Table: E-5 BINARY and FROZEN COUNTERS .....	E-14
Table: E-6 ANALOG INPUT POINTS.....	E-15
Table: F-1 REVISION HISTORY .....	F-1
Table: F-2 MAJOR UPDATES FOR G60 MANUAL-B2 .....	F-1



## F.3.1 STANDARD ABBREVIATIONS

A.....	ampere	GOOSE.....	general object oriented substation event
AC.....	alternating current	HARM.....	harmonic / harmonics
A/D.....	analog to digital	HGF.....	high-impedance ground fault (CT)
AE.....	accidental energization	HIZ.....	high-impedance & arcing ground
AE.....	application entity	HMI.....	human-machine interface
AMP.....	ampere	HYB.....	hybrid
ANSI.....	American National Standards Institute	I.....	instantaneous
AR.....	automatic reclosure	I <sub>0</sub> .....	zero sequence current
AUTO.....	automatic	I <sub>1</sub> .....	positive sequence current
AUX.....	auxiliary	I <sub>2</sub> .....	negative sequence current
AVG.....	average	IA.....	phase A current
BER.....	bit error rate	IAB.....	phase A minus B current
BF.....	breaker fail	IB.....	phase B current
BFI.....	breaker failure initiate	IBC.....	phase B minus C current
BKR.....	breaker	IC.....	phase C current
BLK.....	block	ICA.....	phase C minus A current
BLKG.....	blocking	ID.....	identification
BPNT.....	breakpoint of a characteristic	IEEE.....	Institute of Electrical & Electronic Engineers
CAP.....	capacitor	IG.....	ground (not residual) current
CC.....	coupling capacitor	Igd.....	differential ground current
CCVT.....	coupling capacitor voltage transformer	IN.....	CT residual current (3Io) or input
CFG.....	configure / configurable	INC SEQ.....	incomplete sequence
.CFG.....	file name extension for oscillography files	INIT.....	initiate
CHK.....	check	INST.....	instantaneous
CHNL.....	channel	INV.....	inverse
CLS.....	close	I/O.....	input/output
CLSD.....	closed	IOC.....	instantaneous overcurrent
CMND.....	command	IOV.....	instantaneous overvoltage
CMPRSN.....	comparison	IRIG.....	inter-range instrumentation group
CO.....	contact output	IUV.....	instantaneous undervoltage
COM.....	communication	K0.....	zero sequence current compensation
COMM.....	communications	kA.....	kiloAmpere
COMP.....	compensated	kV.....	kiloVolt
CONN.....	connection	LED.....	light emitting diode
CO-ORD.....	coordination	LEO.....	line end open
CPU.....	central processing unit	LOOP.....	loopback
CRT, CRNT.....	current	LPU.....	line pickup
CT.....	current transformer	LRA.....	locked-rotor current
CVT.....	capacitive voltage transformer	LTC.....	load tap-changer
D/A.....	digital to analog	M.....	machine
DC (dc).....	direct current	mA.....	milliAmpere
DD.....	disturbance detector	MAN.....	manual / manually
DFLT.....	default	MMI.....	man machine interface
DGNST.....	diagnostics	MMS.....	Manufacturing Message Specification
DI.....	digital input	MSG.....	message
DIFF.....	differential	MTA.....	maximum torque angle
DIR.....	directional	MTR.....	motor
DISCREP.....	discrepancy	MVA.....	MegaVolt-Ampere (total 3-phase)
DIST.....	distance	MVA_A.....	MegaVolt-Ampere (phase A)
DMD.....	demand	MVA_B.....	MegaVolt-Ampere (phase B)
DPO.....	dropout	MVA_C.....	MegaVolt-Ampere (phase C)
DSP.....	digital signal processor	MVAR.....	MegaVar (total 3-phase)
DTT.....	direct transfer trip	MVAR_A.....	MegaVar (phase A)
DUTT.....	direct under-reaching transfer trip	MVAR_B.....	MegaVar (phase B)
EPRI.....	Electric Power Research Institute	MVAR_C.....	MegaVar (phase C)
.EVT.....	file name extension for event recorder files	MVARH.....	MegaVar-Hour
EXT.....	extension	MW.....	MegaWatt (total 3-phase)
F.....	field	MW_A.....	MegaWatt (phase A)
FAIL.....	failure	MW_B.....	MegaWatt (phase B)
FD.....	fault detector	MW_C.....	MegaWatt (phase C)
FDH.....	fault detector high-set	MWH.....	MegaWatt-Hour
FDL.....	fault detector low-set	N.....	neutral
FLA.....	full load current	N/A, n/a.....	not applicable
FO.....	fiber optic	NEG.....	negative
FREQ.....	frequency	NMPLT.....	nameplate
FSK.....	frequency-shift keying	NOM.....	nominal
FWD.....	forward	NTR.....	neutral
G.....	generator	O.....	over
GE.....	General Electric	OC, O/C.....	overcurrent
GND.....	ground	O/P, Op.....	output
GNTR.....	generator	OP.....	operate

OPER .....	operate	SUPV .....	supervise / supervision
OPERATG .....	operating	SV .....	supervision
O/S .....	operating system	SYNCHCHK...	synchrocheck
OSB .....	out-of-step blocking		
OUT .....	output	T .....	time, transformer
OV .....	overvoltage	TC .....	thermal capacity
OVERFREQ .....	overfrequency	TD MULT.....	time dial multiplier
OVLD .....	overload	TEMP .....	temperature
		THD .....	total harmonic distortion
P .....	phase	TOC .....	time overcurrent
PC .....	phase comparison, personal computer	TOV .....	time overvoltage
PCNT .....	percent	TRANS.....	transient
PF .....	power factor (total 3-phase)	TRANSF .....	transfer
PF_A .....	power factor (phase A)	TSEL .....	transport selector
PF_B .....	power factor (phase B)	TUC .....	time undercurrent
PF_C .....	power factor (phase C)	TUV .....	time undervoltage
PHS .....	phase	TX (Tx).....	transmit, transmitter
PKP .....	pickup		
PLC .....	power line carrier	U .....	under
POS.....	positive	UC .....	undercurrent
POTT.....	permissive over-reaching transfer trip	UCA .....	Utility Communications Architecture
PRESS .....	pressure	UNBAL .....	unbalance
PROT .....	protection	UR .....	universal relay
PSEL .....	presentation selector	.URS .....	file name extension for settings files
pu .....	per unit	UV .....	undervoltage
PUIB .....	pickup current block		
PUIT .....	pickup current trip	V/Hz .....	Volts per Hertz
PUTT .....	permissive under-reaching transfer trip	V_0 .....	zero sequence voltage
PWM .....	pulse width modulated	V_1 .....	positive sequence voltage
PWR .....	power	V_2 .....	negative sequence voltage
		VA .....	phase A voltage
R .....	rate, reverse	VAB .....	phase A to B voltage
REM .....	remote	VAG .....	phase A to ground voltage
REV .....	reverse	VARH .....	var-hour voltage
RI .....	reclose initiate	VB .....	phase B voltage
RIP .....	reclose in progress	VBA .....	phase B to A voltage
ROD .....	remote open detector	VBG .....	phase B to ground voltage
RST .....	reset	VC .....	phase C voltage
RSTR .....	restrained	VCA .....	phase C to A voltage
RTD .....	resistance temperature detector	VCG .....	phase C to ground voltage
RTU .....	remote terminal unit	VF .....	variable frequency
RX (Rx) .....	receive, receiver	VIBR .....	vibration
		VT .....	voltage transformer
s .....	second	VTFF .....	voltage transformer fuse failure
S .....	sensitive	VTLOS.....	voltage transformer loss of signal
SAT .....	CT saturation		
SBO .....	select before operate	WDG .....	winding
SEL .....	select / selector / selection	WH .....	Watt-hour
SENS .....	sensitive	w/ opt .....	with option
SEQ .....	sequence	WRT .....	with respect to
SIR .....	source impedance ratio		
SRC .....	source	X .....	reactance
SSB .....	single side band	XDUCER.....	transducer
SSEL .....	session selector	XFMR.....	transformer
STATS .....	statistics		
SUPN .....	supervision	Z .....	impedance

## F.4.1 GE POWER MANAGEMENT WARRANTY

## GE POWER MANAGEMENT RELAY WARRANTY

General Electric Power Management Inc. (GE Power Management) warrants each relay it manufactures to be free from defects in material and workmanship under normal use and service for a period of 24 months from date of shipment from factory.

In the event of a failure covered by warranty, GE Power Management will undertake to repair or replace the relay providing the warrantor determined that it is defective and it is returned with all transportation charges prepaid to an authorized service centre or the factory. Repairs or replacement under warranty will be made without charge.

Warranty shall not apply to any relay which has been subject to misuse, negligence, accident, incorrect installation or use not in accordance with instructions nor any unit that has been altered outside a GE Power Management authorized factory outlet.

GE Power Management is not liable for special, indirect or consequential damages or for loss of profit or for expenses sustained as a result of a relay malfunction, incorrect application or adjustment.

For complete text of Warranty (including limitations and disclaimers), refer to GE Power Management Standard Conditions of Sale.



## Numerics

100% STATOR GROUND .....	8-24
see also entry for STATOR GROUND	
logic .....	5-97
settings .....	5-96
specifications .....	2-6
10BASE-F	
communications options .....	3-17
description .....	3-19
redundant option .....	3-17
settings .....	5-9
specifications .....	2-10
3RD HARMONIC NEUTRAL UNDERVOLTAGE	
see entry for THIRD HARMONIC NEUTRAL UNDERVOLTAGE	

## A

ABBREVIATIONS .....	F-5
AC CURRENT INPUTS .....	2-9, 3-8, 5-23
AC VOLTAGE INPUTS .....	2-9, 3-9
ACCIDENTAL ENERGIZATION	
commissioning .....	8-23
Modbus registers .....	B-24
specifications .....	2-7
ACTIVATING THE RELAY .....	1-10, 4-12
ACTIVE SETTING GROUP .....	5-45
ACTUAL VALUES	
metering .....	6-6
product information .....	6-16
status .....	6-3
ALARM LEDs .....	5-19
ALTITUDE .....	2-10
ANSI DEVICE NUMBERS .....	2-1
APPARENT POWER .....	2-9, 6-11
APPLICATION EXAMPLES	
breaker trip circuit integrity .....	5-109
contact inputs .....	5-114
sensitive directional power .....	5-93
APPROVALS .....	2-11
ARCHITECTURE .....	5-28
AUXILIARY OVERVOLTAGE	
commissioning .....	8-23
logic .....	5-84
Modbus registers .....	B-40
settings .....	5-84
specifications .....	2-6
AUXILIARY UNDERVOLTAGE	
commissioning .....	8-23
logic .....	5-83
Modbus registers .....	B-40
settings .....	5-83
specifications .....	2-6
AUXILIARY VOLTAGE CHANNEL .....	3-9
AUXILIARY VOLTAGE METERING .....	6-10

## B

BANKS .....	5-6, 5-23, 5-24
BATTERY FAIL .....	7-4
BATTERY TAB .....	1-10
BINARY INPUT POINTS .....	E-8

BINARY OUTPUT POINTS .....	E-13
BLOCK DIAGRAM .....	1-3
BLOCK SETTING .....	5-4
BREAKER-AND-A-HALF SCHEME .....	5-5
BRIGHTNESS .....	5-8

## C

CE APPROVALS .....	2-11
CHANGES TO MANUAL .....	F-1
CHANNELS	
banks .....	5-23, 5-24
CIRCUIT MONITORING APPLICATIONS .....	5-108
CLEANING .....	2-11
CLEAR RECORDS .....	7-2
CLOCK	
commissioning .....	8-1
Modbus registers .....	B-17
setting date and time .....	7-2
settings .....	5-15
COMMANDS MENU .....	7-1
COMMUNICATIONS	
10BASE-F .....	3-17, 3-19, 5-9
commissioning .....	8-1
connecting to the UR .....	1-6, 1-7
CRC-16 error checking .....	B-3
DNP .....	5-10
dnp .....	5-15, E-1
half duplex .....	B-1
HTTP .....	5-13
IEC 60870-5-104 protocol .....	5-14
Modbus .....	5-10, 5-15, B-1, B-4
Modbus registers .....	B-16
network .....	5-9
overview .....	1-8
RS232 .....	3-17
RS485 .....	3-17, 3-18, 5-8
settings .....	5-8, 5-9, 5-10, 5-12, 5-14, 5-15
specifications .....	2-10
TFTP .....	5-13
UCA/MMS .....	5-12, 5-115, 5-116, 5-117, 5-118, 5-119, C-1
web server .....	5-13
COMTRADE .....	B-7, B-8
CONDUCTED RFI .....	2-11
CONTACT INFORMATION .....	1-1
CONTACT INPUTS	
actual values .....	6-3
commissioning .....	8-30
dry connections .....	3-15
force contact inputs .....	8-39
Modbus registers .....	B-10, B-13, B-30, B-32
module assignments .....	3-11
settings .....	5-113
specifications .....	2-9
thresholds .....	5-113
wet connections .....	3-15
wiring .....	3-13
CONTACT OUTPUTS	
actual values .....	6-4
commissioning .....	8-32
force contact outputs .....	8-39
Modbus registers .....	B-10, B-13, B-34
module assignments .....	3-11
settings .....	5-116
wiring .....	3-13

CONTROL ELEMENTS .....	5-100
CONTROL POWER	
connection diagram .....	3-7
description .....	3-8
specifications .....	2-10
COUNTERS	
actual values .....	6-5
commissioning .....	8-28
settings .....	5-110
CRC-16 ALGORITHM .....	B-3
CRITICAL FAILURE RELAY .....	2-10
CSA APPROVAL .....	2-11
CT BANKS .....	8-8
Modbus registers .....	B-18
settings .....	5-23
CT INPUTS .....	3-9, 5-6, 5-23
CT WIRING .....	3-9
CURRENT BANK .....	5-23
CURRENT ELEMENTS .....	5-55
CURRENT METERING	
actual values .....	6-9
Modbus registers .....	B-11
specifications .....	2-9
CURVES	
definite time .....	5-60, 5-78
FlexCurves™ .....	5-27, 5-60
I <sup>2</sup> T .....	5-60
IAC .....	5-59
IEC .....	5-58
IEEE .....	5-57
inverse time undervoltage .....	5-78
types .....	5-56

## D

DATA FORMATS, MODBUS .....	B-41
DATA LOGGER	
clearing .....	7-2
commissioning .....	8-2
Modbus .....	B-7, B-8
Modbus registers .....	B-11, B-17
settings .....	5-18
specifications .....	2-8
DATE .....	7-2
DCMA INPUTS .....	6-14
commissioning .....	8-37
Modbus registers .....	B-14, B-26
settings .....	5-121
specifications .....	2-9
DEFINITE TIME CURVE .....	5-60, 5-78
DESIGN .....	1-3
DEVICE ID .....	5-118
DEVICE PROFILE DOCUMENT .....	E-1
DIELECTRIC STRENGTH .....	2-11, 3-7
DIFFERENTIAL	
stator .....	2-5, 5-52, 6-9, 8-21
DIGITAL COUNTERS	
actual values .....	6-5
commissioning .....	8-28
logic .....	5-111
Modbus registers .....	B-10, B-30
settings .....	5-110
DIGITAL ELEMENTS	
application example .....	5-108
commissioning .....	8-26
logic .....	5-107

Modbus registers .....	B-30
settings .....	5-107
DIGITAL INPUTS	
see entry for CONTACT INPUTS	
DIGITAL OUTPUTS	
see entry for CONTACT OUTPUTS	
DIMENSIONS .....	3-1
DIRECTIONAL OVERCURRENT	
see PHASE, GROUND, and NEUTRAL DIRECTIONAL entries	
DIRECTIONAL POLARIZATION .....	5-65
DIRECTIONAL POWER	
see entry for SENSITIVE DIRECTIONAL POWER	
DISPLAY .....	1-8, 4-8, 5-8
DISPLAY PROPERTIES	
commissioning .....	8-1
DISTURBANCE DETECTOR	
Modbus registers .....	B-22
DNA-1 BIT PAIR .....	5-119
DNP COMMUNICATIONS	
binary counters .....	E-14
binary input points .....	E-8
binary output points .....	E-13
commissioning .....	8-1
control relay output blocks .....	E-13
device profile document .....	E-1
frozen counters .....	E-14
implementation table .....	E-4
Modbus registers .....	B-16
settings .....	5-10
user map .....	5-12
DUPLEX, HALF .....	B-1

## E

ELECTROSTATIC DISCHARGE .....	2-11
ELEMENTS .....	5-3
ENERGY METERING	
actual values .....	6-11
Modbus registers .....	B-13
specifications .....	2-9
ENERGY METERING, CLEARING .....	7-2
EQUATIONS	
definite time curve .....	5-60, 5-78
FlexCurve™ .....	5-60
I <sup>2</sup> t curves .....	5-60
IAC curves .....	5-59
IEC curves .....	5-58
IEEE curves .....	5-57
ETHERNET	
actual values .....	6-5
configuration .....	1-6
Modbus registers .....	B-11
settings .....	5-9
specifications .....	2-10
EVENT CAUSE INDICATORS .....	4-5
EVENT RECORDER	
actual values .....	6-15
clearing .....	7-2
Modbus .....	B-8
Modbus registers .....	B-14
specifications .....	2-8
with URPC .....	4-2
EVENTS SETTING .....	5-4
EXCEPTION RESPONSES .....	B-6
EXCITATION, LOSS OF	
see entry for LOSS OF EXCITATION	

## F

F485 .....	1-8
FACEPLATE .....	3-1
FACEPLATE PANELS .....	4-4, 4-7
FAST FORM-C RELAY .....	2-10
FAST TRANSIENT TESTING .....	2-11
FAULT REPORT .....	
clearing .....	7-2
FAX NUMBERS .....	1-1
FEATURES .....	2-1
FIRMWARE REVISION .....	6-16
FIRMWARE UPGRADES .....	4-2
FLASH MESSAGES .....	5-8
FLEX STATE PARAMETERS .....	
actual values .....	6-5
commissioning .....	8-4
Modbus registers .....	B-10, B-13, B-28
settings .....	5-20
specifications .....	2-8
FLEXANALOG PARAMETER LIST .....	A-1
FLEXANALOG PARAMETERS .....	A-1
FLEXCURVES™ .....	
commissioning .....	8-9, 8-10
equation .....	5-60
Modbus registers .....	B-19
settings .....	5-27
specifications .....	2-8
table .....	5-27
FLEXELEMENTS™ .....	
actual values .....	6-13
commissioning .....	8-17
direction .....	5-43
hysteresis .....	5-43
Modbus registers .....	B-28, B-29
pickup .....	5-43
scheme logic .....	5-42
settings .....	5-41, 5-42, 5-44
specifications .....	2-8
FLEXLOGIC™ .....	
commissioning .....	8-11
editing with URPC .....	4-1
equation editor .....	5-40, 8-11
evaluation .....	5-35
example .....	5-28, 5-35
example equation .....	5-100
gate characteristics .....	5-34
Modbus registers .....	B-19
operands .....	5-29, 5-30
operators .....	5-34
rules .....	5-35
specifications .....	2-8
timers .....	5-40, 8-16
worksheet .....	5-37
FLEXLOGIC™ EQUATION EDITOR .....	5-40
FLEXLOGIC™ TIMERS .....	5-40
FORCE CONTACT INPUTS .....	5-123, 8-39
FORCE CONTACT OUTPUTS .....	5-123, 8-39
FORCE TRIGGER .....	6-15
FORM-A RELAY .....	
high impedance circuits .....	3-11
outputs .....	3-10, 3-11, 3-15
specifications .....	2-10
FORM-C RELAY .....	
outputs .....	3-10, 3-15
specifications .....	2-10
FREQUENCY .....	

actual values .....	6-12
settings .....	5-25
FREQUENCY METERING .....	
Modbus registers .....	B-13, B-28
specifications .....	2-9
values .....	6-11
FREQUENCY TRACKING .....	5-25
FREQUENCY, NOMINAL .....	5-24
FUNCTION SETTING .....	5-3
FUSE .....	2-10

## G

GE TYPE IAC CURVES .....	5-59
GENERATOR UNBALANCE .....	
Modbus registers .....	B-25
specifications .....	2-6
GOMSFE .....	C-1
GOOSE .....	5-13, 5-117, 5-118, 5-119, 5-120, 6-5
GROUND CURRENT METERING .....	6-10
GROUND INSTANTANEOUS OVERCURRENT .....	
see entry for GROUND IOC	
GROUND IOC .....	
commissioning .....	8-22
logic .....	5-75
Modbus registers .....	B-22
settings .....	5-75
specifications .....	2-5
GROUND TIME OVERCURRENT .....	
see entry for GROUND TOC	
GROUND TOC .....	
commissioning .....	8-21
logic .....	5-74
Modbus registers .....	B-21
settings .....	5-74
specifications .....	2-5
GROUPED ELEMENTS .....	5-45

## H

HALF-DUPLEX .....	B-1
HARMONIC CONTENT .....	6-9
HTTP PROTOCOL .....	5-13, 8-1
HUMIDITY .....	2-10

## I

I2T CURVES .....	5-60
IAC CURVES .....	5-59
IEC 60870-5-104 PROTOCOL .....	
commissioning .....	8-1
interoperability document .....	D-1
Modbus registers .....	B-16
settings .....	5-14
IEC CURVES .....	5-58
IED .....	1-2
IEEE CURVES .....	5-57
IMPORTANT CONCEPTS .....	1-4
IN SERVICE INDICATOR .....	1-10, 7-3
INPUTS .....	
AC current .....	2-9, 5-23
AC voltage .....	2-9, 5-24
contact inputs .....	2-9, 3-13, 5-113, 5-123
DCMA inputs .....	2-9

dcmA inputs .....	3-16, 5-121
IRIG-B .....	2-9, 3-19
remote inputs .....	5-117, 5-118
RTD inputs .....	2-9, 3-16, 5-122
virtual .....	5-115
INSPECTION CHECKLIST .....	1-1
INSTALLATION .....	
commissioning .....	8-7
communications .....	3-17
contact inputs/outputs .....	3-11, 3-13, 3-14
CT inputs .....	3-9
Modbus registers .....	B-18
RS485 .....	3-18
settings .....	5-22
VT inputs .....	3-8
INSTANTANEOUS OVERCURRENT .....	
see PHASE, GROUND, and NEUTRAL IOC entries	
INSULATION RESISTANCE .....	2-11
INTELLIGENT ELECTRONIC DEVICE .....	1-2
INTRODUCTION .....	1-2
INVERSE TIME UNDERVOLTAGE .....	5-78
IOC .....	2-5
see PHASE, GROUND, and NEUTRAL IOC entries	
IP ADDRESS .....	5-9
IRIG-B .....	
connection .....	3-19
settings .....	5-15
specifications .....	2-9
ISO-9000 REGISTRATION .....	2-11

## K

KEYPAD .....	1-9, 4-8
--------------	----------

## L

LAMPTTEST .....	7-2
LED INDICATORS .....	4-5, 4-6, 4-7, 5-19
LOGIC GATES .....	5-34
LOSS OF EXCITATION .....	
characteristics .....	5-88
commissioning .....	8-23
logic .....	5-89
Modbus registers .....	B-24
settings .....	5-88, 5-89
specifications .....	2-7
LOST PASSWORD .....	5-7

## M

MAINTENANCE COMMANDS .....	7-2
MANUFACTURING DATE .....	6-16
MEMORY MAP DATA FORMATS .....	B-41
MENU HEIRARCHY .....	1-9, 4-9
MENU NAVIGATION .....	1-9, 4-9, 4-10
METERING .....	
conventions .....	6-6, 6-7
current .....	2-9
frequency .....	2-9
power .....	2-9
voltage .....	2-9
METERING CONVENTIONS .....	6-7
MIC .....	C-3
MMS .....	

see entry for UCA/MMS	
MODBUS .....	
data logger .....	B-7, B-8
event recorder .....	B-8
exception responses .....	B-6
execute operation .....	B-5
flex state parameters .....	5-20
function code 03/04h .....	B-4
function code 05h .....	B-5
function code 06h .....	B-5
function code 10h .....	B-6
introduction .....	B-1
memory map data formats .....	B-41
obtaining files .....	B-7
oscillography .....	B-7
passwords .....	B-8
read/write settings/actual values .....	B-4
settings .....	5-10, 5-15
store multiple settings .....	B-6
store single setting .....	B-5
supported function codes .....	B-4
user map .....	5-15
MODEL INFORMATION .....	6-16
MODIFICATION FILE NUMBER .....	6-16
MODULES .....	
communications .....	3-17
contact inputs/outputs .....	3-11, 3-13, 3-14
CT .....	3-9
CT/VT .....	3-8, 5-6
insertion .....	3-4
order codes .....	2-4
ordering .....	2-4
power supply .....	3-7
transducer I/O .....	3-16
VT .....	3-9
withdrawal .....	3-4
MOUNTING .....	3-1

## N

NAMEPLATE .....	1-1
NEGATIVE SEQUENCE OVERVOLTAGE .....	
commissioning .....	8-23
logic .....	5-82
Modbus registers .....	B-23
settings .....	5-82
specifications .....	2-6
NEGATIVE SEQUENCE TOC .....	
Modbus registers .....	B-22
NEUTRAL DIRECTIONAL OVERCURRENT .....	
commissioning .....	8-22
logic .....	5-73
Modbus registers .....	B-26
polarization .....	5-71
settings .....	5-69
specifications .....	2-5
NEUTRAL INSTANTANEOUS OVERCURRENT .....	
see entry for NEUTRAL IOC	
NEUTRAL IOC .....	B-21
commissioning .....	8-21
logic .....	5-68
settings .....	5-68
specifications .....	2-5
NEUTRAL OVERVOLTAGE .....	
commissioning .....	8-23
logic .....	5-81



Modbus registers .....	B-40
settings .....	5-81
specifications .....	2-6
<b>NEUTRAL TIME OVERCURRENT</b>	
see entry for NEUTRAL TOC	
<b>NEUTRAL TOC</b>	
commissioning .....	8-21
logic .....	5-67
Modbus registers .....	B-21
settings .....	5-67
specifications .....	2-5

## O

ONE SHOTS .....	5-34
OPERATING TEMPERATURE .....	2-10
OPERATING TIMES .....	2-5
ORDER CODES .....	6-16, 7-2
ORDER CODES, UPDATING .....	7-2
ORDERING .....	2-3, 2-4
OSCILLATORY TRANSIENT TESTING .....	2-11
<b>OSCILLOGRAPHY</b>	
actual values .....	6-15
clearing .....	7-2
commissioning .....	8-1
Modbus .....	B-7
Modbus registers .....	B-13, B-14, B-17
settings .....	5-16
specifications .....	2-8
with URPC .....	4-2
OST .....	2-5, 5-47
OUT-OF-STEP TRIPPING .....	2-5, 5-47
<b>OUTPUTS</b>	
contact outputs .....	3-11, 3-13, 5-116
control power .....	2-10
critical failure relay .....	2-10
Fast Form-C relay .....	2-10
Form-A relay .....	2-10, 3-10, 3-11, 3-15
Form-C relay .....	2-10, 3-10, 3-15
remote outputs .....	5-119, 5-120
virtual outputs .....	5-117
OVERCURRENT CURVE TYPES .....	5-56
<b>OVERCURRENT CURVES</b>	
definite time .....	5-60
FlexCurves™ .....	5-60
I2T .....	5-60
IAC .....	5-59
IEC .....	5-58
IEEE .....	5-57
<b>OVERFREQUENCY</b>	
commissioning .....	8-25
logic .....	5-102
Modbus registers .....	B-23
settings .....	5-102
specifications .....	2-7
<b>OVERVOLTAGE</b>	
auxiliary .....	2-6, 5-84
negative sequence .....	5-82
negative-sequence .....	2-6
neutral .....	2-6, 5-81
phase .....	2-6, 5-80

## P

PANEL CUTOUT .....	3-1
--------------------	-----

PASSWORD SECURITY .....	5-7, 8-1
<b>PASSWORDS</b>	
changing .....	4-12
lost password .....	4-13, 5-7
Modbus .....	B-8
Modbus registers .....	B-15
overview .....	1-10
security .....	5-7
settings .....	5-7
<b>PC SOFTWARE</b>	
see entry for URPC	
PERMISSIVE FUNCTIONS .....	5-78
PER-UNIT QUANTITY .....	5-3
PHASE ANGLE METERING .....	6-7
PHASE CURRENT METERING .....	6-9
<b>PHASE DIRECTIONAL OVERCURRENT</b>	
commissioning .....	8-22
logic .....	5-66
phase A polarization .....	5-64
settings .....	5-64, 5-65
specifications .....	2-5
<b>PHASE INSTANTANEOUS OVERCURRENT</b>	
see entry for PHASE IOC	
<b>PHASE IOC</b>	
commissioning .....	8-21
logic .....	5-63
Modbus registers .....	B-20
specifications .....	2-5
<b>PHASE OVERVOLTAGE</b>	
commissioning .....	8-22
logic .....	5-80
Modbus registers .....	B-25
settings .....	5-80
specifications .....	2-6
<b>PHASE ROTATION</b> .....	
<b>PHASE TIME OVERCURRENT</b>	
see entry for PHASE TOC	
<b>PHASE TOC</b>	
commissioning .....	8-21
logic .....	5-62
Modbus registers .....	B-20
settings .....	5-61
specifications .....	2-5
<b>PHASE UNDERVOLTAGE</b>	
commissioning .....	8-22
logic .....	5-79
Modbus registers .....	B-25
settings .....	5-79
specifications .....	2-6
<b>PHONE NUMBERS</b> .....	
PICS .....	C-2
<b>POWER METERING</b>	
Modbus registers .....	B-12
specifications .....	2-9
values .....	6-11
<b>POWER SUPPLY</b>	
description .....	3-7
low range .....	2-10
specifications .....	2-10
<b>POWER SWING BLOCKING</b> .....	
<b>POWER SWING DETECT</b>	
commissioning .....	8-21
logic .....	5-48, 5-49
Modbus registers .....	B-23
settings .....	5-46, 5-50
specifications .....	2-5
<b>POWER SYSTEM</b>	
commissioning .....	8-8

Modbus registers .....	B-19
PRODUCT INFORMATION .....	6-16
PRODUCT SETUP .....	5-7, 8-1
PRODUCTION TESTS .....	2-11
PROTECTION ELEMENTS .....	5-3
PU QUANTITY .....	5-3

## R

REACTIVE POWER .....	2-9, 6-11
REAL POWER .....	2-9, 6-11
REAL TIME CLOCK .....	5-15
REAR TERMINAL ASSIGNMENTS .....	3-5
REDUNDANT 10BASE-F .....	3-17
RELAY ACTIVATION .....	4-12
RELAY ARCHITECTURE .....	5-28
RELAY MAINTENANCE .....	7-2
RELAY NAME .....	5-22
RELAY NOT PROGRAMMED .....	1-10
REMOTE DEVICES .....	
actual values .....	6-4
commissioning .....	8-34
device ID .....	5-118
Modbus registers .....	B-10, B-13, B-36
settings .....	5-117
statistics .....	6-5
REMOTE INPUTS .....	
actual values .....	6-3
commissioning .....	8-35
Modbus registers .....	B-10, B-13, B-36
settings .....	5-118
REMOTE OUTPUTS .....	
commissioning .....	8-36
DNA-1 bit pair .....	5-119
Modbus registers .....	B-37
UserSt-1 bit pair .....	5-120
REPLACEMENT MODULES .....	2-4
RESETTING .....	5-120, 8-36
REVISION HISTORY .....	F-1
RFI SUSCEPTIBILITY .....	2-11
RFI, CONDUCTED .....	2-11
RMS CURRENT .....	2-9
RMS VOLTAGE .....	2-9
RS232 .....	
configuration .....	1-6
specifications .....	2-10
wiring .....	3-17
RS485 .....	
communications .....	3-17
description .....	3-18
specifications .....	2-10
RTD INPUTS .....	
actual values .....	6-14
commissioning .....	8-38
Modbus registers .....	B-14, B-27
settings .....	5-122
specifications .....	2-9

## S

SALES OFFICE .....	1-1
SCAN OPERATION .....	1-4
SELF-TESTS .....	

description .....	7-3
error messages .....	7-4
SENSITIVE DIRECTIONAL POWER .....	
actual values .....	6-13
logic .....	5-94
Modbus registers .....	B-11, B-24
settings .....	5-92, 5-94
specifications .....	2-7
SENSTIVE DIRECTIONAL POWER .....	
characteristic .....	5-93
commissioning .....	8-23
SERIAL NUMBER .....	6-16
SERIAL PORTS .....	5-8, B-16
SETTING GROUPS .....	5-45, 5-100, 8-25
Modbus registers .....	B-29
SETTINGS, CHANGING .....	4-10
SIGNAL SOURCES .....	
commissioning .....	8-8
description .....	5-4
metering .....	6-9
Modbus registers .....	B-18
SIGNAL TYPES .....	1-3
SINGLE LINE DIAGRAM .....	2-1, 2-2
SITE LIST, CREATING .....	4-1
SOFTWARE .....	
see entry for URPC	
SOFTWARE ARCHITECTURE .....	1-4
SOFTWARE, PC .....	
see entry for URPC	
SOURCE TRANSFER SCHEMES .....	5-78
SOURCES .....	
description .....	5-4
example use of .....	5-26
metering .....	6-9
Modbus registers .....	B-11, B-12
SPECIFICATIONS .....	2-5
ST TYPE CONNECTORS .....	3-19
STANDARD ABBREVIATIONS .....	F-5
STATOR DIFFERENTIAL .....	
actual values .....	6-9
characteristic .....	5-52
commissioning .....	8-21
description .....	5-52
logic .....	5-53
Modbus registers .....	B-11, B-23
settings .....	5-52, 5-90
specifications .....	2-5
STATOR GROUND .....	
see also entry for 100% STATOR GROUND	
actual values .....	6-14
commissioning .....	8-24
Modbus registers .....	B-11, B-25
settings .....	5-95
STATUS INDICATORS .....	4-5
SURGE IMMUNITY .....	2-11
SYMMETRICAL COMPONENTS METERING .....	6-7
SYNCHROCHECK .....	
actual values .....	6-12
commissioning .....	8-26
logic .....	5-106
Modbus registers .....	B-13
settings .....	5-103, 5-104
specifications .....	2-7
SYSTEM FREQUENCY .....	5-24
SYSTEM SETUP .....	5-23, 8-8

## T

TARGET MESSAGES .....	7-3
TARGET SETTING .....	5-4
TARGETS MENU .....	7-3
TCP PORT NUMBER .....	5-13
TEMPERATURE, OPERATING .....	2-10
TERMINALS .....	3-5
TEST MODE .....	5-123
TESTING .....	
commissioning .....	8-39
force contact inputs .....	5-123
force contact outputs .....	5-123
lamp test .....	7-2
self-test error messages .....	7-3
test mode .....	5-123
TFTP PROTOCOL .....	5-13, 8-1
THIRD HARMONIC NEUTRAL UNDERVOLTAGE .....	
commissioning .....	8-24
logic .....	5-99
Modbus registers .....	B-24
settings .....	5-98
specifications .....	2-6
TIME .....	7-2
TIME OVERCURRENT .....	
see PHASE, NEUTRAL, and GROUND TOC entries	
TIMERS .....	5-40
TOC .....	
ground .....	5-74
neutral .....	5-67
phase .....	5-61
specifications .....	2-5
TRACKING FREQUENCY .....	6-12
TRANSDUCER I/O .....	
actual values .....	6-14
commissioning .....	8-37, 8-38
Modbus registers .....	B-14, B-26, B-27
settings .....	5-121, 5-122
specifications .....	2-9
wiring .....	3-16
TRIP LEDs .....	5-19
TROUBLE INDICATOR .....	1-10, 7-3
TYPE TESTS .....	2-11

## U

UCA SBO TIMER .....	
for virtual inputs .....	5-115, 5-116, 8-31
UCA/MMS .....	
commissioning .....	8-1
device ID .....	5-118
DNA2 assignments .....	5-119
MIC .....	C-3
overview .....	C-1
PICS .....	C-2
remote device settings .....	5-117
remote inputs .....	5-118
reporting .....	C-6
SBO timeout .....	5-115, 5-116
settings .....	5-12
UserSt-1 bit pair .....	5-120
UL APPROVAL .....	2-11
UNDERFREQUENCY .....	
commissioning .....	8-25
logic .....	5-101

Modbus registers .....	B-28
settings .....	5-101
specifications .....	2-7
UNDERVOLTAGE .....	
auxiliary .....	2-6
phase .....	2-6, 5-79
third harmonic neutral .....	2-6, 5-98
UNDERVOLTAGE CHARACTERISTICS .....	5-78
UNIT NOT PROGRAMMED .....	5-22
UNPACKING THE RELAY .....	1-1
UPDATING ORDER CODE .....	7-2
URPC .....	
creating a site list .....	4-1
event recorder .....	4-2
firmware upgrades .....	4-2
installation .....	1-5
introduction .....	4-1
oscillography .....	4-2
overview .....	4-1
requirements .....	1-5
USER MAP .....	B-10, B-19
USER-DEFINABLE DISPLAYS .....	
commissioning .....	8-6
example .....	5-21
settings .....	5-21
specifications .....	2-8
USER-PROGRAMMABLE LEDs .....	
commissioning .....	8-3
custom labeling .....	4-7
defaults .....	4-6
description .....	4-6
Modbus registers .....	B-17
settings .....	5-19
specifications .....	2-8
USERST-1 BIT PAIR .....	5-120

## V

VAR-HOURS .....	2-9, 6-11
VIBRATION TESTING .....	2-11
VIRTUAL INPUTS .....	
actual values .....	6-3
commands .....	7-1
commissioning .....	8-31
logic .....	5-115
Modbus registers .....	B-9, B-32
settings .....	5-115
VIRTUAL OUTPUTS .....	
actual values .....	6-4
commissioning .....	8-33
Modbus registers .....	B-33
settings .....	5-117
VOLTAGE BANKS .....	5-24, 8-8
VOLTAGE DEVIATIONS .....	2-11
VOLTAGE ELEMENTS .....	5-78
VOLTAGE METERING .....	
Modbus registers .....	B-12
specifications .....	2-9
values .....	6-10
VOLTAGE RESTRAINT CHARACTERISTIC .....	5-61
VOLTS PER HERTZ .....	
actual values .....	6-14
commissioning .....	8-23
curves .....	5-87
logic .....	5-86
Modbus registers .....	B-29

## INDEX

settings .....	5-85
specifications .....	2-6
VT BANKS	
Modbus registers .....	B-18
VT FUSE FAILURE	
commissioning .....	8-29
logic .....	5-112
Modbus registers .....	B-29
settings .....	5-112
VT INPUTS .....	3-9, 5-6, 5-24
VT WIRING .....	3-9

---

## W

WARRANTY .....	F-7
WATT-HOURS .....	2-9, 6-11
WEB SERVER PROTOCOL .....	5-13, 8-1
WEBSITE .....	1-1

---

## Z

ZERO SEQUENCE CORE BALANCE .....	3-9
----------------------------------	-----